



Washoe County School District

Project Title:

**Roof Replacement of Sections A, A1, B, and B1
at Roy Gomm Elementary School**

Bid #:

25-44-B-01-DA

Date:

January 8, 2025

Prepared By:

**Purchasing Department
14101 Old Virginia Road, Room 0
Reno, NV 89521
Phone: (775) 850-8025
Fax: (775) 857-3175**

E-Mail: solicitations@washoeschools.net

SECTION 00090 - NOTICE TO CONTRACTORS

Sealed bids for the **Roof Replacement of Sections A, A1, B, and B1 at Roy Gomm Elementary School** will be received by the Washoe County School District's (WCSD) Purchasing Department located at the Brown Center 14101 Old Virginia Road, Room #0, Reno, NV 89521, **until 2:00 p.m., (Local Time) on February 6, 2025**. The bids will be opened publicly via a TEAMS Meeting at **2:30 pm (local time)**.

[Join the meeting now](#)

Meeting ID: 233 268 282 808

Passcode: MY2bH7cv

Scope of Work: Roof Sections A, A1 and B: tear off existing roof system down to the metal deck. Repair deck as specified. Install gypsum board followed by a self-adhering vapor retarder. Install one layer of three-inch (3") polyisocyanurate insulation loose laid, one layer of 2 1/2" composite polyisocyanurate insulation mechanically attached, and an adhered reinforced Poly Vinyl Chloride (PVC) single-ply membrane system and associated finishes per specifications.

Approximate roof area of Section A: 11,480 Sq. Ft. Approximate roof area of Section A1: 240 Sq. Ft. Approximate roof area of Section B: 12,956 Sq. Ft.

Roof Section B1: Tear off existing roof system down to the metal deck. Repair as specified. Install tapered polyisocyanurate insulation loose laid. Install 1/2" high density polyisocyanurate insulation, mechanically attached and an adhered reinforced pvc single-ply membrane system and associated finishes per specifications. Approximate roof area of Section B1: 216 Sq. Ft.

Contractors desiring to bid on this work shall be contractors presently licensed by the Nevada State Contractors Board and shall maintain a valid Contractor's License for the duration of the construction project. In addition, any and all Subcontractors that will be utilized by the Contractor shall also be licensed by the Nevada State Contractors Board and shall maintain a valid license for the duration of the construction project. All licensing requirements as specified in Nevada Revised Statutes (NRS) [Chapter 624](#) shall also be strictly adhered to. Contractors shall also carry and provide evidence of required insurance liability coverage as specified in the Liability Insurance Specifications, as identified in Section 00800 – SUPPLEMENTARY GENERAL CONDITIONS.

NOTE: The Facilitating Buyer for this solicitation is named below. Interested parties may NOT contact anyone else regarding this solicitation. Any interested Bidder contacting any other individual including, but not limited to, WCSD staff, officials, evaluation committee members, or Board of Trustees may have their Bid submission rejected from evaluation and award consideration.

Plans and specifications are available to view and download at WCSD's Purchasing Department website at <http://solicitations.washoeschools.net/>.

There will be a NON-MANDATORY Pre-Bid Meeting held at 12:30 p.m. on January 22, 2025 at Roy Gomm Elementary School (Meet In Front Of The Office) 4000 Mayberry Drive, Reno, NV 89509. Due to access and coordination involved in this project we highly recommend that contractors walk the project site that we are making available.

The physical work is to be commenced upon issuance as phased in the Special Notifications. Work shall be completed on or before August 1, 2025.

Bid #: 25-44-B-01-DA
PWP #: WA-2025-145

Facilitating Buyer: Dawn Allshouse
Email: solicitations@washoeschools.net
To be published in the Reno Gazette Journal on January 8, 2025.

Washoe County School District
Purchasing Department
14101 Old Virginia Road, Room #0
Reno, NV 89521

Phone: 775-850-8025
Fax: 775-857-3175

Email: solicitations@washoeschools.net

C O N T E N T S

Roof Replacement of Sections A, A1, B, and B1 at Roy Gomm Elementary School

DIVISION 0			PAGES
Section 00100	Instruction to Bidders		7 – 9
	Special Notifications		10 – 12
Section 00400	Sample Bid Bond	PUR-F525	13 – 14
Section 00500	Sample Contract	PUR-F532	15 – 16
Section 00600	Sample Labor and Materials Bond	PUR-F526	17 – 18
Section 00610	Sample Performance Bond	PUR-F527	19 – 20
Section 00700	General Conditions		21
Section 00800	Supplementary General Conditions		22 – 45
Section 00810	Wage Rates and Apprentice Utilization		46
Section 00820	Special Conditions		47 – 66
Section 00830	Technical Specifications		67 – 68
2024 – 2025 Balanced School Calendar		Total Pages	1
2025 – 2026 Balanced School Calendar		Total Pages	1
HAZARDOUS MATERIALS SPECIFICATIONS			
Material, Water & Lead Disturbance Permit(s)		Total Pages	17
FACS Bulk Materials Analysis		Total Pages	26
FACS Gomm Elementary School Sections A & B Roof Replacement Project		Total Pages	14
Asbestos Abatement Technical Specifications – Effective 1/25/23		Total Pages	71
FORMS REQUIRED AT BID OPENING WITH BID SUBMISSION			
Bid Form	PUR-F523	Total Pages	5
Preferential Bidder Status Affidavit	PUR-F524	Total Pages	2
Public Disclosure Form	PUR-F210	Total Pages	1
Bid Bond	PUR-F525	Total Pages	2

FORMS REQUIRED FROM AWARD CONTRACTOR			
Labor and Materials Bond	PUR-F526	Total Pages	2
Performance Bond	PUR-F527	Total Pages	3
DIVISION 1			
Section 01001	Construction Procedures for Existing School Sites	Total Pages	2
Section 01010	Summary of Work	Total Pages	2
Section 01015	Schedule of Drawings	Total Pages	1
Section 01020	Personnel Safety Check Application	Total Pages	2
Section 01027	Application for Payment	Total Pages	7
Section 01035	Modification Procedures	Total Pages	7
Section 01040	Coordination	Total Pages	6
Section 01041	Project Management Software	Total Pages	5
Section 01045	Cutting and Patching	Total Pages	5
Section 01110	Prevailing Wage Specifications	Total Pages	20
2025 Prevailing Wage Rates (Washoe County, NV)		Total Pages	66
Section 01200	Project Meeting	Total Pages	6
Section 01300	Submittals	Total Pages	10
Section 01310A	Progress Schedules	Total Pages	8
Section 01400	Quality Control	Total Pages	4
Section 01420	References	Total Pages	6
Section 01600	Materials and Equipment	Total Pages	6
Section 01631	Substitutions	Total Pages	6
Section 01700	Contract Closeout	Total Pages	7
Section 01710	Final Cleaning	Total Pages	4
TECHNICAL SPECIFICATIONS – BENCHMARK, INC.			
Section 00 01 01	Cover	Total Pages	1
Section 00 01 02	Ownership of Documents	Total Pages	1

Section 00 01 10	Table of Contents	Total Pages	1
Section 00 01 16	Project Directory	Total Pages	1
Section 01 22 00	Unit Prices	Total Pages	2
	Preconstruction Damage Report	Total Pages	1
Section 01 33 24	Schedule of Pre-Job Submittals	Total Pages	2
Section 01 35 13	Special Project Procedures	Total Pages	5
Section 01 35 24	Construction Project Safety	Total Pages	9
Section 01 78 00	Schedule of Closeout Submittals	Total Pages	1
Section 01 78 36	Warranties	Total Pages	3
Section 02 41 20	Roof Demolition and Cleanup	Total Pages	3
Section 05 01 30.61	Steel Decking Repair/Replacement	Total Pages	3
Section 06 10 53	Miscellaneous Rough Carpentry	Total Pages	5
Section 07 22 16	Roof Board Insulation	Total Pages	7
Section 07 26 04	Self-Adhering Vapor Retarder	Total Pages	7
Section 07 54 19.02	Adhered PVC Thermoplastic Membrane Roofing	Total Pages	10
Section 07 62 00.02	Sheet Metal Flashing and Trim	Total Pages	12
Section 07 72 13	Manufactured Curbs	Total Pages	2
Section 07 72 65	Support Systems	Total Pages	4

SECTION 00100 - INSTRUCTION TO BIDDERS

Bids must be submitted in accordance with the following instructions to be considered for review and award.

Bids shall be submitted on the provided Bid Form (PUR-F523) only, and all of the blank spaces shall be completed; numbers shall be stated both in writing and in figures, the signature shall be in longhand; and the completed form shall be without interlineation, alteration or erasure. **Any bid submission will be disqualified and rejected if the bid submission is not signed.**

Washoe County School District only accepts signatures done manually (also known as a wet signature) or electronic digital signatures that are certified. Non-certified electronic digital signatures will NOT be accepted. A typed signature, even in cursive font, DOES NOT meet the requirements of an official digital signature. A digital signature must be accompanied by a certified digital stamp issued through programs like Adobe Acrobat, Docu-Sign or other similar programs that produce a digital stamp certifying the electronic digital signature. Any signatures on required forms that do not meet these requirements will not be accepted and the Contractor's submission will be deemed "Non-Responsive" and will be rejected. If you have any questions about this requirement, please submit your question by the question deadline, so that it can be answered prior to the bid submission deadline.

In the event of a discrepancy on the Bid Form, NRS 104.3114 Contradictory terms of instrument states that, "If an instrument contains contradictory terms, typewritten terms prevail over printed terms, handwritten terms prevail over both, and words prevail over numbers." No additional pages containing inclusions, exclusions or clarifications will be accepted as part of the bid. Any clarifications, additions or exclusions made by the Washoe County School District (WCSD – OWNER) will be considered incorporated into the specifications.

The Contractor is responsible for ensuring he/she has received and reviewed the entire bid package, including all specifications, plans and any/all issued Addendums.

Bids shall be addressed to the WCSD and delivered to the office of the Purchasing Department, located at the Brown Center, 14101 Old Virginia Road, Room #0, Reno, Nevada 89521, **until 2:00 p.m., (Local Time) on February 6, 2025**. Bids shall be delivered sealed in an opaque envelope. The outside of the envelope shall be clearly marked to indicate the bid for the proposed work and directed to the Purchasing Department. The bids will be opened publicly via a TEAMS Meeting at 2:30 pm.

Each individual bid shall be accompanied by a surety company issued Bid Bond or by a Certified or Cashier's Check made payable to the *Washoe County School District*, in the amount of not less than five percent (5%) of the bid, said amount to be forfeited to WCSD, should the Contractor to whom the Contract is awarded fail to enter into the Contract in accordance with the Contractor's bid and any other contract documents and furnish the required bonds within ten (10) days after the delivery of notice of such award. Bid Bonds, upon request, or deposits of the unsuccessful bidders will be returned upon signing of Contract, or within forty-five (45) days from bid date, whichever is earlier.

Contractors desiring to bid on this work shall be Contractors presently licensed by the Nevada State Contractors Board and shall maintain a valid Contractor's license for the duration of the construction project. In addition, any and all Subcontractors that will be utilized by the Contractor shall also be presently licensed by the Nevada State Contractors Board and shall maintain a valid license for the duration of the construction project. All licensing requirements as specified in NRS [Chapter 624](#) shall also be strictly adhered to.

WCSD requires that all Contractors who work on construction projects have in place a Drug and Alcohol Policy and this shall be acknowledged by signature on the Bid Form (PUR-F523).

The physical work is to be commenced as phased in the Special Notifications. Work shall be completed on or before August 1, 2025.

Contractor must agree that Owner may retain from the monies due the Contractor One Thousand Dollars (\$1,000) per day (Liquidated Damages) as a direct result of the Contractor's delay or for not completing the project in the required time allowance plus approved time extensions.

The right is reserved by WCSD to reject any and all bids or accept the bid, which is deemed by WCSD to be in the best interest of the school district. WCSD also reserves the right to waive any irregularities and/or informalities in the submitted bids.

Should a Contractor find discrepancies in, or omissions from, the drawings or documents, or should he/she be in doubt as to the meanings of said documents, he/she should immediately notify the Owner in writing via Email to solicitations@washoeschools.net, whereas the Owner will send written instruction via Addendum to all Contractors. The Owner, Architect/Engineer, Project Manager, Assistant Project Manager, or any other WCSD staff member will not be held responsible for any oral instructions provided during the bid submission process.

Before submitting a bid, Contractors shall carefully examine the scope of work outlined in the bid package and the proposed drawings, specifications, and forms and shall be thoroughly familiar with all existing conditions and expectations of a successful project completion.

No increase in cost or extension in performance time will be considered for failure to know the conditions to be encountered as to the character, quality, and quantity of the work to be performed, and materials to be furnished, and as to the requirements of the specifications.

No increase in cost or extension in performance time will be considered for material escalation. Section 01027 – Applications for Payment, Part 1, Subpart 1.3, Schedule of Values; B,5 of the contract documents provides a provision for the storage of materials, off-site if necessary, to help in managing the project costs and to hedge against potential future material price increases.

A 5% list showing all Subcontractors to be used on the project shall be submitted with the bid followed by a 1% list within 2 hours from the completion of the bid opening, as required

by Nevada Revised Statutes. WCSD also requires a Comprehensive Contractor/Subcontractor list showing all remaining subcontractors to be utilized on the project. All subcontractors shall be licensed as required by Nevada Revised Statutes.

Any Addendums issued during the bid solicitation process shall be acknowledged on the Bid Form (PUR-F523) and in the execution of a contract, Addendums will become a part thereof.

All questions shall be submitted in writing directly to WCSD's Solicitations website at <http://solicitations.washoeschools.net/> or via e-mail to solicitations@washoeschools.net by **4:30 p.m. (Local Time) on January 29, 2025**. During this active solicitation there shall be no personal contact with any WCSD employees or other parties associated with this project directly. All inquiries shall be done in writing as stated above.

Addendums will be distributed by WCSD accordingly and can also be accessed via the WCSD Public Works website at: <http://solicitations.washoeschools.net/>

Modifications to bids may only be considered if submitted bids by delivery as previously noted have already been received and said modifications are completed prior to the due date and time for the bid submission.

Bids may be withdrawn in a written request received from a Contractor prior to the time fixed for opening of bids.

In cases where the award of the project has not been made, bids submitted and opened may not be withdrawn for a period of forty-five (45) calendar days from the due date and time of the bid.

A person who bids on this work may file a notice of protest regarding the awarding of the contract with the WCSD's Purchasing Department's Director of Procurement and Contracts within five (5) business days after the date the recommendation to award a contract is issued. The notice of protest must be submitted in accordance with NRS [Chapter 338.142](#). Detailed specifications can be found in Section 00820 – Special Conditions, subsection 14.0 – Appeal by Unsuccessful Bidder.

A person filing a notice of protest in accordance with NRS [Chapter 338.142](#) will be required to post a bond or other security in the amount of twenty-five (25%) percent of the value of the total bid or two hundred fifty thousand (\$250,000) dollars, whichever is less. If the protest cannot be resolved by the WCSD's Director of Procurement and Contracts, it will be presented to the WCSD Board of Trustees at a regular meeting.

Contractors to be considered as a Preferential Bidder must submit the Certificate of Eligibility for Preferential Status issued by State of Nevada Contractors Board with their bid submission and the Preferential Bidder Status Affidavit must be provided within two (2) hours after the bid opening, although WCSD prefers the affidavit to also be submitted with the bid at the time of opening.

SPECIAL NOTIFICATIONS

Signature Requirements

Any bid submission will be disqualified and rejected if the bid submission is not signed.

Washoe County School District only accepts signatures done manually (also known as a wet signature) or electronic digital signatures that are certified. Non-certified electronic digital signatures will NOT be accepted. A typed signature, even in cursive font, DOES NOT meet the requirements of an official digital signature. A digital signature must be accompanied by a certified digital stamp issued through programs like Adobe Acrobat, Docu-Sign or other similar programs that produce a digital stamp certifying the electronic digital signature. Any signatures on required forms that do not meet these requirements will not be accepted and the Contractor's submission will be deemed "Non-Responsive" and will be rejected. If you have any questions about this requirement, please submit your question by the question deadline, so that it can be answered prior to the bid submission deadline.

Preferential Bidders

Contractors to be considered as a Preferential Bidder must submit the Certificate of Eligibility for Preferential Status issued by State of Nevada Contractors Board with their bid submission and the Preferential Bidder Status Affidavit must be provided within two (2) hours after the bid opening, although WCSD prefers the affidavit to also be submitted with the bid at the time of opening. Preferential Bidder Status shall be considered if the amount of the apparent low bid is \$250,000 or greater per NRS [Chapter 338.1389](#).

Specifications/Addendums

Contractor is responsible to ensure that he/she has received and reviewed the entire bid package, including specifications, plans and any/all issued Addendums. Contractors shall acknowledge by signing any issued Addendum(s) and returning the signed Addendums with his/her bid submission.

Technical Specifications

Any conflicts between the Architect and WCSD specification, it will be the responsibility of the Contractor to seek clarification for any conflicts or be responsible for all the requirements. Clarifications and questions must be submitted in writing via email to: solicitations@washoeschools.net

Washoe County School District Structured Cabling Standard – WCSD-SCS-015

The Washoe County School District Structured Cabling Standard – WCSD-SCS-015 dated March 13, 2023 is located on our website. The link to view it is

<https://www.washoeschools.net/cms/lib/NV01912265/Centricity/Domain/70/ITPC%20Images/WCSD-SCS-015%203-10-23.pdf>

Project Completion

The construction contract time allowed for this project is based on a reasonable expectation of how long it will take to do a project of this scope. WCSD recognizes that Contractors often try to finish projects in significantly less time than the construction contract time and, in such cases, develop schedules which are based on everything going smoothly with no delays. While WCSD allows Contractors to submit such accelerated

construction schedules, WCSD reserves the right to deny the Contractor's submission. Acceptance of a submittal with a shortened schedule is not an official agreement between WCSD and the Contractor that the project can be done in less time than the construction contract time specified.

Roof Penetrations

All roof-mounted equipment or penetrations associated with this project are to be flashed by a licensed roofing Contractor. The roofing Contractor shall have experience with the existing roofing membrane. New flashing materials shall be installed to comply with the membrane manufacturer's specifications or details published by the National Roofing Contractors Association Waterproofing Manual. In acceptance of the work, the Owner will make no allowance for lack of skill on the part of the Contractor. The Contractor shall coordinate all aspects of roof work including any penetrations to maintain the building in a totally watertight condition, no exceptions.

Hours

There is a potential that Summer School, Extended School Year (ESY), Intercession School, After School Care, Parent nights, etc. may be held at the project sites. The Contractor will be required to flex schedule and/or work areas to accommodate school needs during this time frame. In addition, the Contractor may have to alter their normal schedule in order to perform any lead and asbestos attachments and penetrations.

Pre-Bid Meeting Attendance

All Pre-Bid Meetings, whether mandatory or not, will require that all attendees sign in on the sign-in sheet provided. It is the Contractor's responsibility to ensure that he/she documents his/her attendance by signing the Pre-Bid Sign-In Sheet. Failure to do so could result in the Contractor's bid not being accepted by the WCSD, especially in the event of a Mandatory Pre-Bid Meeting.

In addition, if a Pre-Bid Meeting is held on-site, especially a school site, it is the Contractor's responsibility to sign in/register presence on grounds with the site's Front Office. A signature on a school's office sign-in sheet will not take the place of signature on the Pre-Bid Sign-In Sheet, which will only be present at the actual meeting and distributed by the staff of the Purchasing Department and Capital Projects Department.

Questions

All questions shall be submitted in writing directly to WCSD's Solicitations website at <http://solicitations.washoeschools.net/> or via e-mail to solicitations@washoeschools.net by 4:30 p.m. (Local Time) January 29, 2025.

Force Accounts

When applicable, the force account amount listed on the Bid Form (PUR-F523) shall be used for changes in the work at the Owner's discretion. Any changes shall be approved by change order and the force account balance shall be reduced to reflect said change. Any remaining force account balance at the completion of the project shall be returned to the Owner by a deductive change order.

Working Hours

7:00 a.m. until 7:00 p.m. Monday through Friday and from 9:00 a.m. through 5:00 p.m. the project site will be available to the Contractor.

Onsite Start

The onsite start shall be on June 12, 2025.

WCSD's Project Management Software (Procore)

The Awarded Contractor will be required to utilize WCSD's Project Management Software (Procore) for workflow of project documents. This will include, but not limited to submissions of RFIs, submittals, schedule and schedule updates, change documents, payment requests, and close out documents. The Awarded Contractor will be required to work with WCSD Project Manager and WCSD Consultants to manage process to meet project schedule needs. See Section 01041 – Project Management Software for details.

SECTION 00400 – SAMPLE BID BOND (PUR-F525)

KNOW ALL PERSONS BY THESE PRESENTS, that we, the undersigned _____, as Principal, and _____ as Surety, are hereby held and firmly bound unto the Board of Trustees, Washoe County School District, as Owner, in the sum of _____ Dollars (\$_____) for payment of which, well and truly to be made, we hereby jointly and severally bind ourselves, our heirs, executors, administrators, successors, and assigns.

Signed this _____ day of _____, 20____.

The condition of the above obligation is such that whereas the Principal has submitted to the Board of Trustees, Washoe County School District, a certain bid, attached hereto and hereby made a part hereof, to enter into a Contract in writing for:

_____.
NOW, THEREFORE, if said bid shall be rejected, or in the alternative, if said bid shall be accepted and the Principal shall execute and deliver a Contract in the form of Contract attached hereto (properly completed in accordance with said bid) and shall furnish a Bond for its Faithful Performance of said Contract, and a Bond for the payment of all persons performing labor or furnishing materials in connection therewith, and shall in all other respects perform the contract created by the acceptance of said bid, then this obligation shall be void.

Otherwise, the same shall remain in force and effect, and the sum herein specified paid over to the Owner; it being expressly understood and agreed that the liability of the Surety for any and all claims hereunder shall, in no event, exceed the amount of this obligation as herein stated.

The Surety, for value received, hereby stipulates and agrees that the obligations of said Surety and its bond shall be in no way impaired or affected by an extension of the time within which the Owner may accept such bid; said Surety does hereby waive notice of any such extension.

IN WITNESS WHEREOF, the Principal and the Surety have hereunto set their hands and seals, and such of them as are corporations have caused their corporate seals to be hereto affixed and these presents to be signed by their officers, the day and year first set forth above.

(Seal)

Principal

By: _____

Surety

By: _____

Address:

(Seal)

Phone: _____

SECTION 00500 – SAMPLE CONTRACT (PUR-F532)

THIS CONTRACT, made by and between _____ hereinafter called the Contractor, and **WASHOE COUNTY SCHOOL DISTRICT**, hereinafter called the Owner,

WITNESSETH, that the Contractor and the Owner, for the consideration hereinafter named, agree as follows:

Article 1 – Scope of Work. The Contractor shall furnish all of the materials and perform all of the work in conformance with the Contract Documents entitled _____ (Bid # _____).

Article 2 – Time of Completion. The work to be performed under this Contract shall be commenced on the date set forth in the Notice to Proceed and shall be completed on or before _____ or in _____ calendar days. The Contractor agrees that Owner may retain from the monies due the Contractor the actual value of the damages to the Owner as a direct result of the Contractor's delay or for not completing the project in the required time allowance plus approved time extensions.

Article 3 – The Contract Sum. The Owner shall pay the Contractor for the performance of the Contract, subject to additions and deductions provided therein, in current funds the following stipulated sum:
_____ (\$ _____).

Article 4 – Progress Payments. The Owner shall make payments and pay interest to the Contractor in accordance with Nevada Revised Statutes, Chapter 338. No monies payable under this Contract shall be assigned by Power of Attorney, or otherwise, except upon written consent of Owner.

Article 5 – Acceptance and Final Payment. Upon written notice to the Owner that the work is one hundred percent (100%) complete, the Owner shall inspect the project. When the project is one hundred percent (100%) acceptable and complete to the Owner, the Contractor shall submit evidence satisfactory to the Owner that all payrolls, material bills, interest on retention, and other indebtedness connected with the work have been paid. Once all requirements have been satisfied, the Owner shall issue a fully executed Certificate of Completion which shall constitute the Owner's acceptance of the work in accordance with NRS [Chapter 338](#).

Article 6 – The Contract Documents. The entire bidding documents, including but not limited to the: Notice to Contractors, Instructions to Bidders, Contractor's Bid, General Conditions, Supplementary Conditions, Special Conditions, Technical Specifications, Addenda, and the Drawings (if any), and this document form the Contract, and they are as fully a part of the Contract as if hereto attached.

Article 7 – Lead and Asbestos Certification. The Contractor hereby certifies that no lead/asbestos containing building material will be used for the construction of the project. If a lead/asbestos containing building material is subsequently found to have been included in the construction of the project, the Contractor shall be responsible for and indemnify the Owner against all costs for the proper removal of the lead/asbestos containing building material and the replacement of said material with a non-lead/asbestos containing material substitute. The removal method shall be specifically approved by the Owner and any and all authorities having jurisdiction over such removal.

IN WITNESS WHEREOF, the parties hereto have executed this Contract the day and year written below.

Bid # _____ - _____

WASHOE COUNTY SCHOOL DISTRICT

CONTRACTOR

Signature

Signature

Name

Name

Title

Title

Date

Date

SECTION 00600 – SAMPLE LABOR AND MATERIALS BOND (PUR-F526)

KNOW ALL PERSONS BY THESE PRESENTS: That WHEREAS, the Board of Trustees of Washoe County School District in the State of Nevada has awarded to _____, hereinafter designated as “Principal”, a contract dated _____, for _____

_____ a copy of which contract is attached hereto and by reference made a part hereof, and hereinafter referred to as the “Contract.”

And WHEREAS, said Principal is required under the terms of said Contract and by law under the provisions of [NRS Chapter 339](#) to furnish a Bond for the Labor and Materials used in said Contract;

NOW, THEREFORE, we, the Principal, and _____, as Surety, are held and firmly bound unto the Board of Trustees of Washoe County School District in the State of Nevada in the sum of _____ Dollars (\$_____), lawful money of the United States, being not less than one hundred percent (100%) of the estimated Contract cost of the work, for the payment of which sum will and truly to be made, we bind ourselves, our heirs, executors, administrators, and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that if the above-bounden Principal, or its heirs, executors, administrators, successors or assigns shall fail to pay for any materials, provisions, supplies implements or machinery used in, upon, for, or about the performance of the work contracted to be done, or for any work or labor thereon of any kind, or for amounts due under the Unemployment Compensation Law with respect to such work or labor, as required by the Provisions of [NRS Chapter 339](#), the Surety hereon will pay for the same within thirty (30) calendar days an amount not exceeding the sum specified in this bond, and the above obligation shall then be null and void. Otherwise, it shall remain in full force and virtue.

THE SURETY, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Contract, or to the work to be performed thereunder, or to the specifications accompanying the same, shall in any way affect its obligations on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Contract or to the work, or to the specifications.

And the said Surety, for value received, further stipulates and agrees that should the Board of Trustees of Washoe County School District, or other obligees, incur attorney's fees or other expenses for the enforcement of the Contract or this bond, the same shall

be paid by the Surety to the contracting body, subcontractors, workmen laborers, mechanics and furnishers of material as their interests may appear.

IN WITNESS WHEREOF, the above-bounded parties have executed this instrument under their seals this _____ day of _____, 20____, the name and corporate seal of each corporate party being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

(Seal)

Principal

By: _____

(Seal)

Surety

By: _____

Address: _____

Phone: _____

SECTION 00610 – SAMPLE PERFORMANCE BOND (PUR-F527)

KNOW ALL PERSONS BY THESE PRESENTS: That WHEREAS, the Board of Trustees of Washoe County School District in the State of Nevada has awarded to _____, hereinafter designated as "Principal": a contract dated _____, for

_____ a copy of which contract is attached hereto and by reference made a part hereof, and hereinafter referred to as the "Contract".

And WHEREAS, said Principal is required under the terms of said Contract and by law under the provisions of [NRS Chapter 339](#) to furnish a Bond for the faithful Performance of said Contract;

NOW, THEREFORE, we, the Principal, and _____, as Surety, are held and firmly bound unto the Board of Trustees of Washoe County School District in the State of Nevada in the sum of _____ Dollars (\$_____), lawful money of the United States, being no less than one hundred per cent (100%) of the estimated Contract Cost of the work, for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators, and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that if the above bounden Principal, or its heirs, executors, administrators, successors, or assigns, shall in all things stand to and abide by and well and truly keep the faithfully perform the covenants, conditions, and agreements in the Contract and any alterations made as therein provided, on his or its part to be kept and performed at the respects according to their true intent and meaning; and shall indemnify and save harmless the Board of Trustees of Washoe County School District in the State of Nevada, its officers and agents, as therein stipulated; then this obligation shall become null and void. Otherwise, it shall be and remain in full force and virtue.

As a condition precedent to the satisfactory completion of the Contract, the above obligation shall hold good for a period of one (1) year after completion and acceptance of the work done, during which time if the above-bounden Principal, his or its heirs, executors, administrators, successors, or assigns shall fail to make full, complete, and satisfactory repair and replacements or totally protect the Board of Trustees of Washoe County School District in the State of Nevada from loss or damage made evident during said period of one (1) year from the date of acceptance of said work, and resulting from or caused by defective materials or faulty workmanship in the prosecution of the

work done, the above obligation in the said sum of _____ Dollars (\$_____) shall remain in full force and virtue; otherwise, the above obligation shall be void.

THE SURETY, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Contract, or to the work to be performed thereunder, or to the specifications accompanying the same, shall in anyway affect its obligations on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Contract, or to the work, or to the specifications.

And the said Surety, for value received, further stipulates and agrees that should the Board of Trustees, Washoe County School District, incur attorney's fees or other expenses for the enforcement of the Contract or his/her bond, the same shall be paid by the Surety to the Board of Trustees, Washoe County School District.

IN WITNESS WHEREOF, the above-bounden parties have executed this instrument under their seals this _____ day of _____, 20____, the name and corporate seal of each corporate party being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

Principal

(Seal)

By: _____

Surety

By: _____

Address:

(Seal)

Phone: _____

SECTION 00700 – GENERAL CONDITIONS

The General Conditions of the Contract for Construction, AIA Document A201, 2017 Edition, Articles 1 through 15, are hereby incorporated by reference as the “General Conditions of this Project.” Copies of General Conditions may be examined or obtained through formal request to the WCSD’s Purchasing Department located at the Brown Center, 14101 Old Virginia Road, Room 0, Reno, Nevada, 89521 or by phone at (775) 850-8025.

The information contained in the Supplementary General Conditions (Section 00800), Special Conditions (Section 00820), Instructions to Bidders (Section 00100), and the Bid Form (PUR-F523) shall become a part of the Contract and shall apply to all Contractors and Subcontractors. The information contained in Supplementary General Conditions (Section 00800) may amend, modify, supersede, void or supplement the Articles of the “General Conditions of the Project.” Where any part of an Article of the “General Conditions of the Project” is amended, modified, superseded or voided by a provision of the Supplementary General Conditions (Section 00800) or other Contract documents, all other provisions of such Article shall remain in effect, and the provisions of the Supplementary General Conditions (Section 00800) or other Contract documents shall be considered as added.

SECTION 00800 – SUPPLEMENTARY GENERAL CONDITIONS

The General Conditions of the Contract for Construction, AIA Document A201, 2017 Edition, Articles 1 through 15, are hereby incorporated by reference as the “General Conditions of this Project.” Copies of General Conditions may be examined or obtained through formal request to the WCSD’s Purchasing Department located at The Brown Center, 14101 Old Virginia Road, Room 0, Reno, Nevada, 89521 or by phone at (775) 850-8025.

The information contained in the Supplementary General Conditions (Section 00800), Special Conditions (Section 00820), Instructions to Bidders (Section 00100), and the Bid Form (PUR-F523) shall become a part of the Contract and shall apply to all Contractors and Subcontractors.

In any instance where no Architect is involved in the project, any and all references contained in this or any other documents to "Architect" shall be deemed to refer to the consulting Engineer, if any, the special project consultant, if any, or, in the event no such individuals are involved, to the Owner.

The following supplements modify, delete and/or add to the “General Conditions of the Project.” Where any Article, Paragraph or Subparagraph in the “General Conditions of the Project” is supplemented by one of the following Paragraphs, the provisions of such Article, Paragraph, or Subparagraph shall remain in effect and the supplemental provisions shall be considered as added. Where any Article, Paragraph, or Subparagraph in the “General Conditions of the Project” is amended, voided or superseded by any of the following paragraphs, the remaining provisions of such Article, Paragraph or Subparagraph not amended, voided, or superseded shall remain in effect.

1. LIABILITY INSURANCE SPECIFICATIONS

A. INTRODUCTION

The Owner has established specific indemnification and insurance requirements for its construction contracts to help assure that reasonable insurance coverage is purchased and maintained. Insurance, indemnification and hold harmless clauses are intended to assure that a Contractor accepts and is able to pay for the loss or liability related to its activities.

Contractor’s attention is directed to the insurance requirements below. It is recommended that Contractors confer with their respective insurance carriers or brokers to determine **in advance of Bid submission** the availability of insurance certificates and endorsements as described and provided herein.

B. INDEMNIFICATION AGREEMENT

The Contractor agrees to hold harmless, indemnify and defend the Owner, its officers, agents, employees and volunteers from any loss or liability, financial or otherwise resulting from any claim, demand, suit, action, or cause of action based on bodily injury, including death, or property damage, including damage to the

Contractor's property or injury to the Contractor's employees, caused by any action, either direct or passive, the omission, failure to act or negligence on the part of the Contractor, employees, agents, representatives or Subcontractors arising out of the performance of work under this Contract by the Contractor, or by others under the direction or supervision of the Contractor.

In determining the nature of the claim against the Owner, the incident underlying the claim shall determine the nature of the claim, notwithstanding the form of the allegations against the Owner.

In the event of a lawsuit against the Owner, its officers, agents, employees and volunteers, the Contractor shall reimburse the Owner for costs of the Owner's attorneys' fees and costs, as well as personnel in defending such actions. Reimbursement for the time spent by such personnel shall be at the rate charged for such services by private counsel. The Owner shall not be held liable for any accident, loss or damage to the work prior to its completion and acceptance.

C. GENERAL REQUIREMENTS

The Contractor shall purchase Workers Compensation Insurance, General Liability and Automobile Liability as described below. The cost of such insurance shall be included in the Contractor's bid price.

D. WORKERS COMPENSATION INSURANCE

It is understood and agreed that there shall be no Workers Compensation Insurance coverage provided for the Contractor or any Subcontractor by the Owner. Contractor agrees, as a precondition to the performance of any work under this Contract and a precondition to any obligation of the Owner to make any payment under this Contract, to provide Owner with certificates issued by an insurer that shows compliance with NRS [Chapters 616A, 616B, 616C and 616D](#), inclusive, and [Chapter 617](#).

It is further understood and agreed by and between the Owner and the Contractor that the Contractor shall procure, pay for, and maintain the above-mentioned Workers Compensation Insurance coverage at the Contractor's sole cost and expense.

Should Contractor be self-funded for Workers Compensation Insurance, Contractor shall notify Owner in writing prior to the acceptance of this Contract. Owner reserves the right to approve said retentions and may request additional documentation, financial or otherwise, for review prior to the acceptance of this Contract as provisioned under NRS [Chapter 616B.627](#).

E. MINIMUM SCOPE OF LIABILITY INSURANCE

Coverage shall be at least as broad as:

1. Insurance Services Office (ISO) Commercial General Liability Coverage "Occurrence" form CG 0001 12 04 or substitute form

providing coverage as broad as CG 0001 12 04. The Commercial General Liability Coverage shall include, but is not limited to, Liability Coverage arising from Operations, Premises, Blanket Contractual Liability, Broad Form Property Damage Liability, Products and Completed Operations, Personal Injury and Advertising Liability, and Stop Gap or Employers Liability. In addition, explosion, collapse, and underground coverage must be included unless Owner waives this requirement in writing prior to execution of Contract.

2. Business Auto Coverage form number ISO CA 0001, CA 00 055, CA00 12, CA 00 20 or an equivalent form covering Automobile Liability Symbol 1 "Any Auto."

F. MINIMUM LIMITS OF INSURANCE

The Contractor shall maintain limits no less than:

1. General Liability: **\$1,000,000** minimum or the amount customarily carried by the Contractor, whichever is greater, combined single limit per occurrence (with \$2,000,000 Aggregate Limit) for bodily injury, personal injury, and property damage. General Liability coverage shall specifically apply to the acts and/or omissions of Contractor and his/her Subcontractors. The above General Liability coverage shall be maintained in full force and effect for five (5) years from the date of completion of the project. The required limits may be met through a combination of primary and excess liability coverage. Any excess liability coverage shall provide coverage at least as broad as the primary coverage and be subject to all of the requirements herein.
2. Automobile Liability: \$1,000,000 minimum or the amount customarily carried by the Contractor, whichever is greater, combined single limit per accident for bodily injury and property damage. No Aggregate Limits may apply. Non-owned and hired automobile liability must be included.
3. Workers Compensation Insurance: \$1,000,000 minimum in limits (Employers Liability) and obtain Statutory Limits of Workers Compensation Insurance for employees engaged on or at the site of the project in accordance with NRS [Chapters 616A, 616B, 616C](#) and [616D](#), inclusive, and [Chapter 617](#). If an excess policy is utilized, the policy will provide excess coverage for Employers' Liability.
4. Asbestos Environmental Risk Liability Insurance: \$5,000,000 minimum, per occurrence (with \$5,000,000 Aggregate Limit). Refer to Section 00820 – Technical Specifications for important information).

G. ASBESTOS COVERAGE

In the event that asbestos abatement is required on this project, Asbestos Liability Insurance is required. To that end, the Contractor will be required to provide written proof by way of an insurance certificate of a minimum of Five Million Dollars (\$5,000,000) occurrence-based Asbestos Environmental Risk Liability Insurance from a domestic Insurance company that has an A, A+ or A++ rating in Best's Insurance Guide, OAE. The Asbestos Abatement Contractor shall name the WCSD additionally insured on a primary and non-contributory basis for the contract term as well as any asbestos consultants the District may hire for job design and/or supervision and shall provide an insurance certificate specifically naming them as additionally insured, primary and stating that the policy cannot be cancelled in less than 30 days for any reason including non-payment.

H. PROPERTY COVERAGES

Not Required For This Project.

I. DEDUCTIBLES AND SELF-INSURED RETENTIONS

Any deductibles or self-insured retention must be declared to and approved by the Owner. The Owner reserves the right to request additional documentation, financial or otherwise, prior to giving its approval of the deductibles and self-insured retention's and prior to executing the Contract. Any changes to the deductibles or self-insured retentions made during the term of this Contract or during the term of any policy, must be approved by the Owner prior to the change taking effect. It is also understood that the Contractor is responsible for and shall assume payment of all deductibles and/or self-insured retentions.

J. OTHER INSURANCE PROVISIONS

The policies are to contain, or be endorsed to contain, the following provisions:

1. General Liability and Automobile Liability Coverages

- a. The Owner, its agents, officers, employees and volunteers are to be included as Additional Insureds for damages and defense arising from: activities performed by or on behalf of the Contractor, including the insured's general supervision of the Contractor; products and completed operations of the Contractor; premises owned, occupied or used by the Contractor; or automobiles owned, leased, hired or borrowed by the Contractor. The coverage shall contain no special limitations on the scope of protection afforded to the Owner, its officers, employees or volunteers.
- b. The Contractor's insurance coverage shall be primary insurance with respect to the Owner, its officers, employees and volunteers. Any insurance or self-insurance maintained by the Owner, its officers, employees or volunteers shall be in excess

of the Contractor's insurance and shall not contribute to the Contractor's insurance coverage in any way.

- c. The Contractor's insurance shall apply separately to each insured against whom claim is made or suit is brought, except with respect to the limits of the insurer's liability.
- d. The insurance companies issuing the policy or policies shall have no recourse against the Owner payment of any premiums, costs or assessments under any form of policy.
- e. Failure of the Contractor to take out and/or maintain any required insurance shall not relieve the Contractor from any liabilities under this Contract, nor shall the insurance requirements be construed to conflict with or otherwise limit the obligations of the Contractor concerning indemnification.

2. All Coverages

- a. Each insurance policy required by this clause shall be endorsed to state that coverage shall not be suspended, voided, canceled or non-renewed by either the Contractor or by the insurer, reduced in coverage or in limits except after thirty (30) days prior written notice has been given to the Owner, which must be approved, if acceptable, by the Owner in writing.

Furthermore, Contractor shall provide the Owner thirty (30) days prior notice, in writing when the Contractor elects to change carriers, not to renew the policy, or reduce coverage, which must be approved, if acceptable, by the Owner also in writing.

- b. The Contractor's insurers shall have no right of recovery or subrogation against the Owner or the design professionals which provide work on the project.
- c. Any failure to comply with reporting provisions of the policies shall not affect coverage provided to the Owner, its officers, employees or volunteers.
- d. The insurance companies issuing the policy or policies shall have no recourse against the Owner for payment of any premiums, costs or assessments under any form of policy.

K. ACCEPTABILITY OF INSURERS

Insurance is to be placed with insurers with an A.M. Best's rating of no less than A:X. The Owner may accept coverage with carriers that have lower A.M. Best's ratings upon review of financial information concerning Contractor and insurance carrier. The Owner reserves the right to require that the Contractor's insurer(s) be a

licensed and admitted insurer(s) in the State of Nevada, or on the Insurance Commissioner's approved, but not admitted, list.

L. VERIFICATION OF COVERAGE

Prior to the commencement of any work on the project, the Contractor shall furnish the Owner with certificates of insurance and with original endorsements affecting coverage required. The certificates and endorsements for each insurance policy are to be signed by a person authorized by that insurer to bind coverage on its behalf. All certificates and endorsements are to be received and approved by the Owner before work commences. The Owner reserves the right to require complete, certified copies of all required insurance policies, at any time should it be deemed in the best interest of the Owner.

M. SUBCONTRACTORS

The Contractor shall include all Subcontractors as insureds under its policies or shall furnish separate certificates and endorsements for each Subcontractor. All coverages for Subcontractors shall be subject to all of the requirements stated herein, except that if any Subcontractors maintain limits of insurance less than required in this Contract, Contractor's insurance shall include coverage for acts or omissions of Subcontractor up to the full limits required in this Contract.

N. MISCELLANEOUS CONDITIONS

1. The Contractor shall be responsible for and remedy all damage or loss to any property, including property of the Owner, caused in whole or in part by the Contractor, any Subcontractor, or any employed, directed or supervised by the Contractor.
2. Nothing herein contained shall be construed as limiting in any way the extent to which the Contractor may be held responsible for payment of damages to persons or property resulting from its operations or the operations of any Subcontractor under it.
3. In addition to any other remedies the Owner may have should the Contractor fail to provide or maintain any insurance policies or policy endorsements to the extent and within the time required, the Owner may, at its sole option:
 - a. Purchase such insurance to cover any risk for which the Owner may be liable through the operations of the Contractor under this Contract and deduct or retain the amount of the premiums for such insurance from any sums due to the Contractor under the Contract; or
 - b. Order the Contractor to cease work under this Contract and/or withhold any payments, which became due the Contractor until the Contractor demonstrates compliance with the requirements hereof; or

c. Terminate the Contract.

2. **GUARANTEE BOND**

Not Required For This Project.

3. **INTEREST**

Article 13.5 is hereby supplemented as follows:

Not Required For This Project.

4. **CLEANING UP**

Article 3.15 is hereby supplemented as follows:

The Contractor, at all times, shall keep the premises free from accumulation of waste materials or rubbish caused by operations. At the completion of the work, Contractor shall remove all waste materials and rubbish from and about the project as well as all tools, construction equipment, machinery and surplus materials, and shall clean all glass surfaces and leave the work "broom clean" or its equivalent, except as otherwise specified.

5. **LIQUIDATED DAMAGES**

Add Article 8.2.4 as follows:

It is hereby understood and mutually agreed that the date of beginning, rate of progress, and the time for completion of the work to be done hereunder are essential conditions of this Contract and that the work embraced in this Contract shall be commenced on the date set forth in the Notice to Proceed issued by the Owner.

The Contractor agrees that all work shall be performed regularly, diligently, and uninterruptedly at a rate of progress that will ensure substantial completion within the time specified. It is expressly understood and agreed, by and between the Contractor and the Owner, that the time for completion of the work described herein is an acceptable time for the completion of the work. If the Contractor should neglect, fail, or refuse to complete the work within the specified Contract time, that has been extended by the Owner, then the Contractor does hereby agree, as a part of the consideration for receiving the award of this Contract, to pay to the Owner, not as a penalty, but as Liquidated Damages, the amount of money specified in the Contract (Section 00100 – Instruction to Bidders and Bid Form (PUR-F523) per day. If the Owner incurs costs in excess of the Liquidated Damages as a result of the Contractor's inability to complete the work by the specified date the additional cost will be deducted from the Contract amount.

If the Contractor fails to complete or correct the work listed on the comprehensive list of deficiencies ("**Punch-List**") within the specified time for performance, the Contractor does hereby agree to pay the Owner **\$500** as Liquidated Damages for each calendar day that the completion or correction of the work extends beyond the 45 days

for performance allowed from the date the Contractor receives the Punch List of deficiencies from the Architect and/or his/her consultants and/or the Owner.

6. CHANGE ORDERS

Article 7.2 is hereby modified as follows:

- A. The Owner, without invalidating the contract, may order changes in the work consisting of additions, deletions, or other revisions, the contract sum and contract time being adjusted accordingly. All such changes in the work shall be authorized by Change Order issued by the Owner.
- B. The cost or credit to the Owner resulting from a change in the work shall be determined by the Architect in one or more of the following ways:
 - 1. By unit prices stated in the Contract documents or subsequently agreed upon.
 - 2. By mutual acceptance of a lump sum proposal, properly itemized by contractor/subcontractor, to include the following:
 - a. Labor, including fringe benefits, payroll taxes, and workers' compensation insurance;
 - b. Materials entering permanently into the work;
 - c. Equipment costs for equipment utilized to perform the Change Order work; and/or
 - d. Change Order Mark-Up per Schedule.
 - 3. By the actual cost of properly itemized by contractor/subcontractor, to include the following:
 - a. Labor, including fringe benefits, payroll taxes, and workers' compensation insurance;
 - b. Materials entering permanently into the work;
 - c. Equipment costs for equipment utilized to perform the Change Order work; and/or
 - d. Change Order Mark-Up per Schedule.
- C. The costs under Paragraph 6(B) 1-3 above may be increased by General/Prime Contractor, Subcontractor (all tiers) to include a fixed fee for Subcontractor profit and overhead, Prime Contractor profit and overhead on Subcontractor work, and profit and overhead on work done by the General/Prime Contractor's own forces. The total of such fixed fee shall not exceed the amount determined from the Change Order Mark-Up Schedule below for a single Change Order item, or for

any group of related items, and shall be full compensation for the cost of supervision (to include Project Manager, Project Coordinator, Superintendent, Administrative Staff, etc.), overhead, profit, insurance, general conditions not listed and any BIM updating, Procore updating, or other general expense associated with completing the change in the scope of work. The allowable mark-up fee for contractor bonding shall be in addition to the fee below for the Prime Contractor only and shall not exceed 1% of the change if applicable.

CHANGE ORDER MARK-UP SCHEDULE

1. Additive Changes (for the entity performing the work):	
<u>Total Cost of Change</u> +\$0.01 to +\$50,000 +\$50,000.00 and above	<u>Allowable Fee</u> 15% of the Total Cost 10% of the Total Cost
2. Additive Changes (Contractor Markup) Subcontractors work:	
<u>Total Cost of Change</u> +\$0.01 to +\$50,000 +\$50,000.00 and above	<u>Allowable Fee</u> 10% of the Total Subcontractor Fee 5% of the Total Subcontractor Fee
3. Deductive Changes:	
<u>Total Credit Cost of Change</u> +\$0.01 to +\$50,000 +\$50,000.00 and above	<u>Credit Fee to be Applied</u> 10% of the Total Subcontractor Cost. (Deductive) 5% of the Total Subcontractor Fee (Deductive)
<i>Example of Deductive Change: Assume <\$5,000.00> to be credited. The Contractor must include a 10% credit for profit and overhead, i.e. \$5,000.00 X 0.10 = <\$5,500.00> total credit to the Contract.</i>	

D. No fees shall be paid for time extensions.

E. All proposals shall be submitted to the Architect in sufficient detail to complete an analysis of all costs. The Contractor shall submit invoices for materials and equipment utilized in Change Order work. Labor rates shall not exceed the applicable Wage Rates (including Prevailing Wage Rates) as published by the State of Nevada Office of the Labor Commissioner. Fringe benefits shall not exceed the cost of fringe benefits normally paid to such personnel or established by the industry in the Northern Nevada area, whichever is lower. Labor rates or additional rates not identified as part of Prevailing Wage Rates shall be identified and approved by WCSD prior to start of construction.

7. SUBCONTRACTORS

Article 5.2.1 is hereby modified as follows:

A. Per NRS [Chapter 338](#):

1. Except as otherwise provided in Subsection 2, each bid submitted to any officer, department, board or commission for the construction of any public work or improvement must include:
 - a. The name of each Subcontractor who will provide labor or a portion of the work or improvement to the Contractor for which he/she will be paid; and
 - b. A description of the portion of the work or improvement which each Subcontractor named in the bid will complete.
2. The Contractor shall list in the Bid Form (PUR-F523) pursuant to Subsection 1 the name of a Subcontractor for each portion of the project that will be completed by him/her.
3. A Contractor whose bid is accepted, shall not substitute any person for a Subcontractor who is named on the Bid Form (PUR-523), unless:
 - a. The Owner objects to the Subcontractor, requests in writing a change in the Subcontractor and pays any increase in costs resulting from the change; or
 - b. The substitution is approved by the Owner and:
 1. The Subcontractor, after having a reasonable opportunity, fails or refuses to execute a written contract with the Contractor, which was offered to the Subcontractor with the same terms and conditions that all other Subcontractors on the project were offered; or
 2. The named Subcontractor files for bankruptcy or becomes insolvent; or
 3. The named Subcontractor fails or refuses to perform subcontract within a reasonable time.

8. MANDATORY DRUG TESTING PROGRAM

- A. In order to be eligible to perform work on WCSD construction projects all Contractors who will work on such projects must have a current and valid Drug and Alcohol Policy that is applicable to all workers who will be employed on those projects regardless of tier. This requirement is a reasonable precaution to ensure a safe and drug-free environment on school construction projects that may involve workers being in relatively in close contact with students.
- B. The Policy must meet the minimum requirements as outlined in Exhibit 1. Each Contractor shall demonstrate compliance with this provision by signature on the Bid Form that the Policy is in place, that it will be actively enforced, and that all workers who will be employed on WCSD projects will have undergone the pre-

placement drug testing required by WCSD. The WCSD and/or the Prime Contractor is empowered to review Contractor records of enforcement of its Drug and Alcohol Policy at any time during the construction period up to and including completion of the project in order to determine whether the policy is in fact being enforced. The Contractor shall forthwith deliver to the WCSD any and all records requested to determine compliance with this Drug and Alcohol Policy requirement. Failure to maintain or rigorously enforce the policy or to timely respond to WCSD demands for production of records relating to the Drug and Alcohol Policy may result in termination of the project agreement at no cost to the WCSD.

- C. Refer to Washoe County School District Mandatory Drug and Testing Program Requirements – EXHIBIT 1.

EXHIBIT 1

WASHOE COUNTY SCHOOL DISTRICT

MANDATORY DRUG AND ALCOHOL TESTING PROGRAM REQUIREMENTS

In order to be eligible to perform work on WCSD construction projects, all Contractors who work on such projects must have a current and valid Drug and Alcohol Policy that meets the following minimum requirements:

1. A statement identifying prohibited conduct regarding employee drug and alcohol use. At a minimum, the policy should address the following areas of prohibited conduct:

- a. Alcohol

Possession of open containers use or being under the influence of alcohol by any employee during normal business hours including lunch breaks, while performing Contractor business, while operating Contractor vehicles or equipment or while on company premises is prohibited. Failure to pass an alcohol test will be grounds for disciplinary action up to and including termination.

- b. Illegal Drugs

The unlawful manufacture, distribution, dispensation, possession or use of a controlled substance is prohibited. Failure to pass a drug test will be grounds for disciplinary action up to and including termination.

- c. Legal Drugs

Except as provided below, use or being under the influence of any mood-altering legal drug by any employee while on company premises or while performing company business is prohibited to the extent such use or influence may affect the safety of the employee, co-workers or the public, the employee's job performance or the safe or efficient operation of the Contractor.

An employee under the influence of a mood-altering legal drug has an obligation to inquire and determine whether the mood-altering legal drug he/she is taking

may or will affect his/her ability to safely and efficiently perform his/her job duties. If the employee is using a mood-altering legal drug at the direction of a physician, dentist or other licensed practitioner, the employee is required to inform a designated company official. In compliance with the Americans with Disabilities Act (ADA), this policy does not require the employee, physician, dentist or other licensed practitioner to identify the name of the prescription drug or the medical condition for who it is prescribed. For the safety of all employees, the Contractor may place persons using such drugs in a less hazardous job assignment or place them on temporary medical leave until released as fit for duty by the prescribing physician, dentist or other licensed practitioner. An employee taking over-the-counter medications contrary to instructions provided by the manufacturer may be subject to disciplinary action up to and including termination.

d. Drug Paraphernalia

Employee possession of drug paraphernalia on the project site is strictly prohibited.

2. A statement requiring, at a minimum, the following types of drug and/or alcohol testing:

a. Pre-Placement Testing

Prior to the start of employment generally, or employment on any WCSD project, the Contractor must assure that any employee assigned to work on a WCSD project has previously completed a pre-placement drug test before the effective date of the project assignment. In the case of a newly hired employee, he/she must pass a pre-placement drug test prior to being allowed to work on a WCSD project.

b. Reasonable Suspicion Testing

Contractor will require a medical examination, breath test, blood test, and/or urinalysis when there is reasonable suspicion to believe that the employee is using drugs and/or alcohol at work or where circumstances or workplace conditions justify it.

c. Post- Accident Testing

Each employee will be tested for prohibited drugs and alcohol use as soon as possible after a reportable accident. Reportable accident is defined as any incident that results in an employee requiring medical treatment that results in the filing of a Workers Compensation claim, or property damage in excess of five hundred dollars (\$500.00). An employee shall not be relieved of duty pending the receipt of test results except where there is reasonable evidence that alcohol or illegal drug use was a contributing factor as determined by the treating physician.

d. Return To Duty Testing and Follow-Up Testing

At the Contractor's discretion, employees in violation of the drug and alcohol policy will be subject to a return to duty policy as a condition of continued employment. In essence, this policy states that the Contractor may rehire or retain the employee in return for the employee's promise to remain alcohol and drug free on WCSD project sites, complete an evaluation by a licensed alcohol and drug counselor and follow all professional recommendations, provide a negative drug and/or alcohol test to return to duty and submit to follow-up testing on a random basis to confirm on-going policy compliance. This document will be kept in a confidential file belonging to the Contractor's agency.

3. A statement describing the procedures the Contractor will use to test for the presence of alcohol and controlled substances, protect the integrity of the testing processes, safeguard the validity of the test results and ensure that those results are attributed to the correct employee. To meet this requirement, the Contractor is encouraged to follow the Federal Substance Abuse and Mental Health Services Administration (SAMHSA) Drug and Alcohol Testing Guidelines (49 CFR Part 40). At a minimum, the employer must test for the following drugs of abuse:
 - Marijuana
 - Cocaine
 - Opiates
 - Amphetamines/Methamphetamines
 - Phencyclidine (PCP)
 - a. For the purpose of this policy, a positive drug test means that the employee has ingested a drug(s), which causes the employee's drug threshold level to be above the Federal Substance Abuse and Mental Health Services Administration (SAMHSA) Drug and Alcohol Testing Guidelines (49 CFR Part 40). For the purpose of this policy an employee whose breath/blood alcohol level is .04 or greater is considered to be in violation of the policy. It is recommended that blood alcohol testing only be used when an employee is medically unable to provide a breath alcohol sample.
4. A statement indicating the consequences for employees found to be in violation of the drug and alcohol policy. The Contractor's policy must outline the procedures the Contractor will follow to assure that the employee is fit to return to duty following a policy violation. At a minimum, an employee in violation of the Contractor's drug and alcohol policy must complete an evaluation by a licensed alcohol and drug counselor and follow all professional recommendations, provide a negative drug and/or alcohol test to return to duty and submit to follow-up testing on a random basis to confirm on-going policy compliance.
5. A statement indicating that actions taken under this policy will be confidential within the affected Contractor and employee. At a minimum, the Contractor must inform the employee that test results may be disclosed to another member of management on a need-to-know basis and to the employee upon request. Disclosures, without employee consent may also occur when: (A) the information is compelled by law or judicial or administrative process; (B) the information has been placed at issue in a formal dispute between the employer and the employee or job applicant; (C) the information is used in

administering an employee benefit plan or other insurance program; (D) the information is needed by first-aid, safety, or medical personnel for the diagnosis or treatment of an employee who is unable/unwilling to authorize disclosure; (E) for review by the State Worker's Compensation Board or the State Unemployment Security Division in determining a pending claim; or (F) the information is compelled by federal officials investigating compliance with the Americans with Disabilities Act (ADA).

6. A statement indicating that all employees shall participate in a company-sponsored drug/alcohol awareness program. The program shall provide employees with information regarding: (A) the company's drug/alcohol free workplace policy; (B) available counseling, referral agencies and rehabilitation; and (C) the penalties imposed upon employees for violations of this policy.

Each Contractor shall ensure that all supervisors designated to supervise employees on a WCSD project complete a training course on reasonable suspicion testing. This training shall include information on the physical, behavioral, speech and performance indicators of probable employee alcohol or drug abuse and how to effectively intervene per Contractor policy.

7. A statement indicating that Subcontractors, Sub-tiered Contractors, vendors, and their employees shall be required to cooperate with the Contractor's policy to achieve a drug/alcohol free workplace.

END OF EXHIBIT 1

9. ARTICLE 1.1 GENERAL PROVISIONS

Add the following at the end of Subparagraph 1.1.1:

In the event of any conflict among the Contract documents, the documents shall be construed according to the following priorities:

Highest Priority:	Modifications
Second Priority:	Agreement
Third Priority:	Addenda—later date to take precedence
Fourth Priority:	Supplementary General Conditions
Fifth Priority:	General Conditions
Sixth Priority:	Specifications with respect to quality and general performance of the Work
Seventh Priority:	Drawings with respect to quantity of materials and general location of the Work. Detail drawings shall take precedence over small scale drawings.

Add the following at the end of Subparagraph 1.2.1:

All Work mentioned or indicated in the Contract documents shall be performed by the Contractor as part of this Contract unless it is specifically indicated in the Contract documents that such Work is to be done by others. Should the Drawings or the Specifications disagree in themselves or with each other, the Contractor shall provide the better quality or greater quantity of work unless otherwise directed by written addendum to the Contractor.

Add the following to Subparagraph 1.2.2:

The Contractor and all Subcontractors shall refer to all of the Drawings, including those showing primarily the Work of the mechanical, electrical and other specialized trades, and to all of the Sections of the Specifications, and shall perform all Work reasonably inferable therefrom as being necessary to produce the indicated results.

Add new Subparagraphs 1.2.4 through 1.2.11 as follows:

- 1.2.4 All indications or notations which apply to one of a number of similar situations, materials or processes shall be deemed to apply to all such situations, materials or processes wherever they appear in the Work, except where a contrary result is clearly indicated by the Contract documents.
- 1.2.5 Where codes, standards, requirements and publications of public and private bodies are referred to in the Specifications, references shall be understood to be to the latest adopted version used to issue permits, except where otherwise indicated.
- 1.2.6 Where no explicit quality or standards for materials or workmanship are established for Work, such Work is to be of good quality for the intended use and consistent with the quality of the surrounding Work and of the construction of the Project generally.
- 1.2.7 All manufactured articles, materials, and equipment shall be applied, installed, connected, erected, used, cleaned, and conditioned in accordance with the manufacturer's written or printed directions and instructions unless otherwise indicated in the Contract documents.
- 1.2.8 The Mechanical, Electrical and Fire Protection Drawings are diagrammatic only, and are not intended to precisely show the alignment, physical locations or configurations of such Work. Such Work shall be installed without additional cost to the Owner to clear all obstructions, permit proper clearances for the Work of other trades, and present an orderly appearance where exposed. Prior to beginning such Work, the Contractor shall prepare coordination drawings showing the exact alignment, physical location and configuration of the Mechanical, Electrical and Fire Protection installations and demonstrating to the Contractor's satisfaction that the installations will comply with the preceding sentence.
- 1.2.9 Exact locations of fixtures and outlets shall be obtained from the Architect as provided in Subparagraph 3.2.2 before the Work is roughed in; Work

installed without such information from the Architect shall be relocated at the Contractor's expense.

1.2.10 Test boring or soil test information included with the Contract documents or otherwise made available to the Contractor was obtained by the Owner for use by the Architect in the design of the Project or Work. The Owner does not hold out such information to the Contractor as an accurate or approximate indication of subsurface conditions, and no claim for extra cost or extension of time resulting from reliance by the Contractor on such information shall be allowed except as provided in Subparagraph 15.1.8.

1.2.11 Where the Work is to fit with existing conditions or work to be performed by others, the Contractor shall fully and completely join the Work with such conditions or work, unless otherwise specified.

11. ARTICLE 3.1 CONTRACTOR

Add the following to the end of 3.2.1:

If the Contractor proceeds with the Work without such notice to the Architect, having discovered such errors, inconsistencies or omissions, or if by reasonable study of the Contract documents the Contractor could have discovered such, the Contractor shall bear all costs arising therefrom.

Add the following to the end of 3.2.2:

The Contractor shall give the Architect timely notice of any additional Drawings, Specifications, or instructions required to define the Work in greater detail or to permit the proper progress of the Work. The Contractor shall not proceed with any Work not clearly and consistently defined in detail in the Contract documents but shall request additional Drawings or instructions from the Architect. If the Contractor proceeds with such Work without obtaining further Drawings, Specifications or instructions, then the Contractor shall correct Work incorrectly done at the Contractor's own expense.

Add the following sentence to the end of Subparagraph 3.4.1:

The word "provide" shall mean furnish and install complete, including connections, unless otherwise specified.

Change the first sentence of Subparagraph 3.5.1 and delete the last (2) two sentences to read as follows:

The Contractor warrants that the materials and equipment furnished under the Contract will be new and of recent manufacture unless otherwise specified, and that all Work will be of good quality, free from faults and defects, and in conformance with the Contract documents.

Add new Subparagraphs 3.5.3 through 3.5.9 as follows:

- 3.5.3 The Contractor shall be responsible for determining that all materials furnished for the Work meet all requirements of the Contract documents. The Architect may require the Contractor to produce reasonable evidence that a material meets such requirements, such as certified reports of past tests by qualified testing laboratories, reports of studies by qualified experts, or other evidence which, in the opinion of the Architect, would lead to a reasonable certainty that any material used, or proposed to be used, in the Work meets the requirements of the Contract documents. All such data shall be furnished at the Contractor's expense. This provision shall not require the Contractor to pay for periodic testing of different batches of the same material, unless such testing is specifically required by the Contract documents to be performed at the Contractor's expense.
- 3.5.4 If the Contractor proposes to use a material which, while suitable for the intended use, deviates in any way from the detailed requirements of the Contract documents, the Contractor shall inform the Architect in writing of the nature of such deviations at the time the material is submitted for approval and shall request written approval of the deviation from the requirements of the Contract documents.
- 3.5.5 In requesting approval of deviations or substitutions, the Contractor shall provide, upon request, evidence leading to a reasonable certainty that the proposed substitution or deviation will provide a quality of result at least equal to that otherwise attainable. If, in the opinion of the Architect, the evidence presented by the Contractor does not provide a sufficient basis for such reasonable certainty, the Architect may reject such substitution or deviation without further investigation.
- 3.5.6 The Contract documents are intended to produce a building of consistent character and quality of design. All components of the building including visible items of mechanical and electrical equipment have been selected to have a coordinated design in relation to the overall appearance of the building. The Architect shall judge the design and appearance of proposed substitutes based on their suitability in relation to the overall design of the Project, as well as for their intrinsic merits. The Architect will not approve as equal to materials specified proposed substitutes which, in the Architect's opinion, would be out of character, obtrusive, or otherwise inconsistent with the character of quality of design of the Project. In order to permit coordinated design of color and finishes the Contractor shall, if required by the Architect, furnish the substituted material in any color, finish, texture, or pattern which would have been available from the manufacturer originally specified, at no additional cost to the Owner.
- 3.5.7 Any additional cost, or any loss or damage arising from the substitution of any material or any method for those originally specified shall be borne by the Contractor, notwithstanding approval or acceptance of such substitution by the Owner or the Architect, unless such substitution was made at the written request or direction of the Owner or the Architect.

- 3.5.8 The warranty provided in this Paragraph 3.5 shall be in addition to and not in limitation of any other warranty required by the Contract documents or otherwise prescribed by law.
- 3.5.9 The Contractor shall procure and deliver to the Architect, no later than the date claimed by the Contractor as the date of Substantial Completion, all special warranties required by the Contract documents. Delivery by the Contractor shall constitute the Contractor's guarantee to the Owner that the warranty will be performed in accordance with its terms and conditions.

Change the title of Paragraph 3.9 to read "Superintendence."

Change the first sentence of Subparagraph 3.9.1 to read as follows:

The Contractor shall employ a competent superintendent, reasonably acceptable to the Owner, and necessary assistants who shall be in attendance at the Project site full time during the progress of the Work until the date of Substantial Completion, and for such additional time thereafter as the Architect may determine to be necessary for the expeditious completion of the Work.

Add to end of Subparagraph 3.9.3 as follows:

The Contractor shall remove the superintendent if requested to do so in writing by the Owner and shall promptly replace him with a competent person reasonably acceptable to the Owner.

Add new Subparagraphs 3.9.4 through 3.9.7 as follows:

- 3.9.4 The Contractor shall retain a competent Registered Professional Engineer or Registered Land Surveyor, acceptable to the Architect, who shall establish the exterior lines and required elevations of all buildings and structures to be erected on the site and shall establish sufficient lines and grades for the construction of associated Work such as, but not limited to, roads, utilities, and site grading. The Engineer or Land Surveyor shall certify as to the actual location of the constructed facilities in relation to property lines, building lines, easements, and other restrictive boundaries.
- 3.9.5 The Contractor shall establish the building grades, lines, levels, columns, walls and partition lines required by the various Subcontractors in laying out their Work.
- 3.9.6 The Contractor shall coordinate and supervise the Work performed by Subcontractors to the end that the Work is carried out without conflict between trades and so that no trade, at any time, causes delay to the general progress of the Work. The Contractor and all Subcontractors shall at all times afford each trade, any separate contractor, or the Owner, every reasonable opportunity for the installation of work and the storage of materials.

3.9.7 The Contractor shall arrange for and attend job meetings with the Architect and such other persons as the Architect may from time-to-time wish to have present. The Contractor shall be represented by a principal, project manager, general superintendent or other authorized main office representative, as well as by the Contractor's own superintendent. An authorized representative of any Subcontractor or Sub-Subcontractor shall attend such meetings if the representative's presence is requested by the Architect. Such representatives shall be empowered to make binding commitments on all matters to be discussed at such meetings, including costs, payments, change orders, time schedules, and workforce. Any notices required under the Contract may be served on such representatives.

Change Subparagraph 3.10.1 to read as follows:

3.10.1 The Contractor shall prepare and submit to the Architect a progress schedule as described in Subparagraphs 8.2.4 through 8.2.10.

Change Subparagraph 3.12.6 to read as follows:

3.12.6 By approving and submitting Shop Drawings, Product Data, Samples, and similar submittals the Contractor thereby represents that the Contractor has determined and verified all dimensions, quantities, field dimensions, relations to existing work, coordination with work to be installed later, coordination with information on previously accepted Shop Drawings, Product Data, Samples, or similar submittals and verification of compliance with all the requirements of the Contract documents. The accuracy of all such information is the responsibility of the Contractor. In reviewing Shop Drawings, Product Data, Samples, and similar submittals the Architect shall be entitled to rely upon the Contractor's representation that such information is correct and accurate.

Add the following at the end of Subparagraph 3.12.9:

Unless such written notice has been given, the Architect's approval of a resubmitted Shop Drawing, Product Data, Sample, or similar submittal shall not constitute approval of any changes not requested on the prior submittal.

Change Subparagraph 3.13 to read as follows:

The right of possession of the premises and the improvements made thereon by the Contractor shall remain at all times with the Owner. The Contractor's right to entry and use thereof arises solely from the permission granted by the Owner under the Contract documents. The Contractor shall confine the Contractor's apparatus, the storage of materials, and the operations of the Contractor's workmen to limits indicated by law, ordinances, the Contract documents and permits and/or directions of the Architect and shall not unreasonably encumber the premises with the Contractor's materials. The Owner shall not be liable to the Contractor, their Subcontractors, their employees or anyone else with respect to the conditions of the premises, except only for a condition caused directly and

solely by the negligence of the Owner.

Add the following at the end of Subparagraph 3.15.1:

Immediately prior to the Architect's inspection for Substantial Completion, the Contractor shall completely clean the premises. Concrete and ceramic surfaces shall be cleaned and washed. Resilient coverings shall be cleaned. Woodwork shall be dusted and cleaned. Sash, fixtures, and equipment shall be thoroughly cleaned. Stains, spots, dust, marks and smears shall be removed from all surfaces. Hardware and all metal surfaces shall be cleaned and polished. Glass and plastic surfaces shall be thoroughly cleaned by professional window cleaners. All damaged, broken or scratched glass or plastic shall be replaced by the Contractor at the Contractor's expense.

12. ARTICLE 4.1 ADMINISTRATION OF THE CONTRACT

In Subparagraph 4.2.7, add to the end of the first sentence:

"...and only to the extent which the Architect believes desirable to protect the Owner's interest."

13. ARTICLE 8.1 TIME

Added new Subparagraphs 8.1.5 through 8.1.11 as follows:

- 8.1.5 Within two (2) weeks after award of the Contract, the Contractor shall submit to the Architect a Progress Schedule showing for each class of work included in the Schedule of Values, the percentage completion to be obtained and the total dollar value of work to be completed as of the first of each month until Substantial Completion. All calculations shall be based on the Work in place, and not include the value of materials delivered, but not in place.
- 8.1.6 The Progress Schedule shall be based on an orderly progression of the Work, allowing adequate time for each operation (including adequate time for submission and review of submittals), and leading to a reasonable certainty of Substantial Completion by the date established in the Agreement. The Progress Schedule will be reviewed by the Architect for compliance with the requirements of this Article and will be accepted by the Architect or returned to the Contractor for revision and resubmittal. Unless specifically required by law, no payment under this Contract shall be due until the Progress Schedule has been approved by the Architect.
- 8.1.7 If in any Application for Payment the total value of the completed Work in place, as certified by the Architect, is less than 90% of the total value of the Work in place estimated in the Progress Schedule, the Owner may, at the Owner's option, require the Contractor to accelerate the progress of the Work without cost to the Owner by increasing the work force or hours of work, or by other reasonable means approved by the Architect.

- 8.1.8 If each of three (3) successive applications, as certified by the Architect, indicate that the actual Work completed is less than 90% of the values estimated in the Progress Schedule to be completed by the respective dates, the Owner may at the Owner's option, treat the Contractor's delinquency as a default justifying the action permitted under Paragraph 14.2.
- 8.1.9 If the Architect has determined that the Contractor should be permitted to extend the time for completion as provided in Paragraph 8.3, the calendar dates in the Progress Schedule shall be adjusted accordingly to retain the same relationship to the adjusted date of Substantial Completion, and the dollar value of Work to be completed as of the first of each month shall be prorated.
- 8.1.10 If the Contractor fails to submit any Application for Payment in any month, the Architect shall, for the purpose of this evaluation of progress, certify separately to the actual value of the Work in place completed as of the first of the month to the best of the Architect's knowledge.
- 8.1.11 Nothing herein shall limit the Owner's right to liquidated or other damages for delays by the Contractor or to any other remedy which the Owner may possess under other provisions of the Contract Documents or by law.

Change Subparagraph 8.3.3 and add new Subparagraph 8.3.4 as follows:

- 8.3.3 No claim for delay shall be allowed on account of failure of the Architect to furnish Drawings, Specifications, or instructions or to return Shop Drawings or Samples until fifteen (15) days after receipt by the Architect by registered or certified mail of written demand for such instructions, Drawings, or Samples, and not then unless such claim be reasonable.
- 8.3.4 The Contractor hereby agrees that the Contractor shall have no claim for damages of any kind against the Owner or the Architect on account of any delay in the commencement of the Work and/or any delay or suspension of any portion of the Work, whether such delay is caused by the Owner, the Architect, or otherwise. The Contractor acknowledges that the Contractor's sole remedy for any such delay and/or suspension will be an extension of time as provided in this Article.

14. ARTICLE 9.1 PAYMENTS AND COMPLETION

Add at the end of the second sentence of Subparagraph 9.2:

“and shall be revised if later found by the Architect to be inaccurate.”

Add new Subparagraph 9.3.4 as follows:

- 9.3.4 Each Application for Payment or periodic estimate requesting payment shall at the Owner's option be accompanied by: (1) a waiver of liens from each Subcontractor; or (2) a certificate from each Subcontractor stating that the

Subcontractor has been paid all amounts due the Subcontractor on the basis of the previous periodic payment to the Contractor or else stating the amount not so paid and the reason for the discrepancy. In the event of any such discrepancy, the Contractor shall furnish the Contractor's own written explanation to the Owner through the Architect. Such waiver or certificate shall be in a form acceptable to the Owner.

In Subparagraph 9.5.1, add the new item to the list of .1 through .7 as follows:

- .8 failure of mechanical trade or electrical trade Subcontractors to comply with mandatory requirements for maintaining record drawings. The Contractor shall check record drawings each month. Written confirmation that the record drawings are current will be required by the Architect before approval of the Contractor's monthly payment requisition.

Replace the second sentence of Subparagraph 9.10.2 with the following:

If the Contractor fails to furnish such releases or waivers, as the Owner reasonably requires, to satisfy the Owner that there are not outstanding liens, the Owner may require the Contractor, as a condition of final payment and at the Contractor's expense, to furnish a bond satisfactory to the Owner to indemnify the Owner against any such liens.

15. ARTICLE 10.1 PROTECTIONS OF PERSONS AND PROPERTY

At the end of the Subparagraph 10.1, add the following:

"... including compliance with 29 CFR 1910.132, 1910.133, and 1910.134, and for providing a safe workplace and complying with all codes, bylaws, rules and regulations applicable to the construction site."

In Subparagraph 10.2.1.2 delete the word "and" at the end of the Subparagraph.

In Subparagraph 10.2.1.3 add the word "and" to the end of the Subparagraph.

In Subparagraph 10.2.1, add the new item to the list of .1 through .3 as follows:

- .4 any other property of the Owner, whether or not forming part of the Work, located at the site or adjacent thereto in areas to which the Contractor has access.

Add new Subparagraphs 10.2.9 through 10.2.12 as follows:

- 10.2.9 The Contractor shall provide and maintain in good operating condition suitable and adequate fire protection equipment and services and shall comply with all reasonable recommendations regarding fire protection made by the representatives of the fire insurance company carrying insurance on the Work or by the local Fire Chief or Fire Marshal. The area within the site limits shall be kept orderly and clean, and all combustible rubbish shall be promptly removed from the site.

10.2.10 The Contractor shall, at all times, protect excavations, trenches, buildings and materials, from rainwater, ground water, backup or leakage of sewers, drains and other piping, and from water of any other origin and shall remove promptly any accumulation of water. The Contractor shall provide and operate all pumps, piping, and other equipment necessary to this end.

10.2.11 The Contractor shall remove snow and ice which might result in damage or delay.

10.2.12 During the progress of the Work and at all times prior to the date of Substantial Completion of occupancy of the Work by the Owner, whichever is earlier, the Contractor shall provide temporary heat, ventilation, and enclosure, adequate to permit the Work to proceed in a timely fashion, and to prevent damage to completed Work or Work in progress, or to materials stored on the premises. The permanent heating and ventilation systems may be used for these purposes when available unless otherwise provided in the Contract Documents.

16. ARTICLE 11.3 PROPERTY INSURANCE

Subparagraphs 11.2.2 through 11.5.2 shall be deleted in their entirety.

17. ARTICLE 12.1 UNCOVERING AND CORRECTION OF WORK

Add at the end of Subparagraph 12.2.1:

“...and any cost, loss, or damages to the Owner resulting from such failure or defect.”

18. ARTICLE 13.1 MISCELLANEOUS PROVISIONS

Change Subparagraph 13.4.4 to read as follows:

13.5.4 The Contractor shall obtain and deliver promptly to the Architect any occupancy permit and any certificates of final inspection of any part of the Contractor's work and operating permits for any mechanical apparatus, such as elevators, escalators, boilers, air compressors, etc., which may be required by law to permit full use and occupancy of the premises by the Owner. Receipt of such permits or certificates by the Architect shall be a condition precedent to Substantial Completion of the Work.

19. ARTICLE 14.1 TERMINATION OF THE CONTRACT

Delete “or” from end of Subparagraph 14.1.1.2

Delete Subparagraphs 14.1.1.4 in its entirety.

20. ARTICLE 15 CLAIMS AND DISPUTES

Add the following sentence to the end of Subparagraph 15.1.3.1:

Any change or addition to a previously made Claim shall be made by timely written notice in accordance with this Subparagraph 15.1.3.1.

Delete the second sentence of Subparagraph 15.1.6.1 and substitute the following:

The Contractor shall have the burden of demonstrating the effect of the claimed delay on the Contract Time and shall furnish the Architect with such documentation relating thereto as the Architect may reasonably require.

Add the following Subparagraph:

15.1.6.3 Any extension of time for weather delays shall be considered by the Architect and Owner only when a request for such extension is made in writing by the Contractor and provided further that any such request shall be presented to the Architect or Owner within ten (10) days from the commencement of the period of delay.

It is expressly understood and agreed that the Contract Time includes adequate time to allow for usual weather/smoke delays considering the climatic conditions in the area of the Project. No adjustments to the Contract Time will be allowed on account of usual weather or subsequent building/site conditions. The Contractor shall include adequate float or other allowance in the Contractors construction schedule to accommodate weather conditions that may be associated with weather dependent work. Any extension of time for weather will be per specifications 01310(A/B).

Time extension requests for delays caused by additional adverse weather conditions will be evaluated individually. Inclement weather days in which no work is conducted at the project site will be considered by the Owner for full day time extensions. Inclement weather days in which any trade or worker perform work on the project will be considered by the Owner for a maximum of one-half ($\frac{1}{2}$) daytime extension.

SECTION 00810 – WAGE RATES AND APPRENTICE UTILIZATION

The Contractor shall comply strictly with the requirements of **NRS Chapter 338** and shall pay, if required by statute, prevailing wage rates for the appropriate labor positions as outlined in "Washoe County - Prevailing Wage Rates for Public Works, State of Nevada" for projects that are \$100,000 or greater. Prevailing wage shall be paid for all work through punch list and issuance of Notice of Completion.

Wage rates as published by the Labor Commissioner of the State of Nevada are available as follows:

Office of Labor Commissioner
1818 College Parkway, Suite 102
Carson City, NV 89706

- Phone: (775) 684-1890
- Email: mail1@Labor.nv.gov
- Website: <https://labor.nv.gov/>

The Contractor shall comply strictly with the requirements of **NRS Chapter 338 and the Apprentice Utilization Act** as reformed by Senate Bill 82 (SB82) in the 2023 Legislative Session effective January 1, 2024. Please refer to the Labor Commissioner's website specifically for a copy of [Senate Bill 82](#), [Presentation Senate Bill 82 dated 12-12-23](#), [Senate Bill 82 OLC Summary dated 12-12-23](#) and any other posted information.

(https://labor.nv.gov/Apprenticeship_Utilization_Act/Apprenticeship_Utilization_Act/)

A contractor or subcontractor engaged in Public Works construction who employs workers on one or more public works during a calendar year pursuant to NRS 338.040 shall use apprentices for a portion of the total hours of labor worked for each apprenticed craft or type of work to be performed on those public works.

This project is subject to the Apprentice Utilization Act and is categorized as **VERTICAL** work.

It is the Contractor's responsibility to comply, document and report directly to the Labor Commissioner annually if they have performed a certain number of hours or more on Public Works. Failure to comply, document and report could result in financial penalties and disqualification per NRS.

SECTION 00820 - SPECIAL CONDITIONS

1. TIME OF COMPLETION

The physical work is to commence upon issuance as phased in the Special Notifications and shall be completed on or before August 1, 2025.

2. EXAMINATION OF SITE

Contractor is requested to visit the project site, compare the Drawings and Specifications with any work in place, and be informed of all conditions, including the work, if any, being performed. Failure to visit the project site will in no way relieve the Contractor from necessity of furnishing any materials or performing any work in accordance with Drawings and Specifications that may be required to complete the work without additional cost to the Owner.

The Contractor shall call the project site and make arrangements for a time to visit. To review the existing premises, contact the Principal and/or Site Facilities Coordinator at the site(s). **Whenever at the site, be sure to check in at the Front Office.**

3. STORAGE

If available as determined by the Capital Projects Department, the Contractor may make arrangements with the Capital Projects Department for an area which the Contractor may use for storage of tools, equipment, and supplies while the project is in progress. Contractor to provide own storage unit for self and any Subcontractors.

4. UTILITIES

If available as determined by the Capital Projects Departments, the Contractor may make arrangements with the Capital Projects Department for the use of all water, electricity, lighting, and other utilities necessary for construction purposes. However, the Contractor shall furnish at his/her own expense any lines or equipment, or extensions necessary to bring utilities to construction areas including any design, permitting, fees, hookup, etc. to execute the use of the utility.

5. TOILETS

If available as determined by the Capital Projects Department, the Contractor may make arrangements with the Capital Projects Department for toilets as necessary for use of workers. Toilets must be kept in sanitary condition and are the responsibility of the Contractor. Additional toilets may be required to be provided by the Contractor if weekend or after hour work is anticipated.

6. BUILDING CODES

All work in this project shall strictly comply with ordinances and laws, state and local, governing such construction in this locality.

Should the Drawings and/or Specifications in any way conflict with these ordinances and laws, the Contractor shall immediately notify the Owner.

7. WAGES

- a. Wage Rates – The Contractor shall comply strictly with the requirements of NRS [Chapter 338](#) and shall pay, if required by statute, prevailing wage rates for the appropriate labor positions as outlined in "Washoe County - Prevailing Wage Rates for Public Works, State of Nevada" for projects that are \$100,000 or greater.
- b. Nondiscrimination - In connection with the performance of the work under this Contract, the Contractor agrees not to discriminate against any employee or applicant for employment because of race, creed, color, national origin, or sex. Such agreement shall include, but not be limited to, the following: employment, upgrading, demotion or transfer, recruitment, or recruitment advertising, layoff or termination, rates of pay or other forms of compensation, and selection for training, including apprenticeship. The Contractor further agrees to insert this provision in all subcontracts hereunder, except subcontract for standard commercial supplies or raw materials. Any violation of these provisions by a Contractor or Subcontractor shall constitute a material breach of Contract.
- c. Health and Safety in Employment - All applicable provisions of NRS [Chapter 618](#) shall be incorporated in the construction practices for all employees directly engaged in the completion of this project.

Safety: In accordance with generally accepted construction practices, the Contractor will be solely and completely responsible for condition of the job site, including safety of all persons and property during performance of the work. This requirement will apply continuously and not be limited to normal working hours.

The duty of the Engineer/Architect to conduct construction review of the Contractor's performance is not intended to include review of the adequacy of the Contractor's safety measures.

- d. Hours - No overtime or weekend work on the project will be performed without the written approval of the Owner or Owner's representative except in cases of emergency where life or property is in imminent danger. The Contractor may submit a request for overtime, weekend or holiday work to the Capital Projects Department for review and approval or denial, a minimum of one (1) week prior to such work. It shall be the Contractor's responsibility to pay, as a Deductive Change Order, any overtime costs associated with such work for WCSD personnel to open/close site, provide quality assurance and quality control for such work.

WCSD has the right to reject any overtime, holiday or weekend work.

No person shall be employed for more than eight (8) hours in any one day or

more than forty (40) hours in any one week without proper overtime compensation being paid.

During occupied periods, the Contractor can only work with the WCSD's permission. During these occupied periods, the Contractor will be responsible for the complete clean-up and weatherproofing of any work each day in order that the space can be utilized for its educational purpose the next day.

The cost of these "off" hours shall be included in the bid.

From 7:00 a.m. until 7:00 p.m. Monday through Friday and from 9:00 a.m. through 5:00 p.m. the site will be available to the Contractor.

- e. Employment – Contractors shall comply with NRS [Chapter 338.125](#) and [Chapter 338.130](#) inclusively. The Contractor expressly agrees to comply with the provisions of [Chapter 338.130](#) and further agrees that if those provisions are not complied, or any failure or refusal to comply with the provisions of [Chapter 338.130](#), shall render this Contract VOID.
- f. Statutes - All applicable provisions of NRS [Chapter 338](#) shall apply to this project and Contract and all Contractor and Subcontractors shall comply therewith.
- g. Workers' Compensation - Workers' Compensation premiums shall be paid as required by law for the duration of the Contract practices delineated under "Occupational Safety and Health" (NRS [Chapter 618](#)) and will be adhered to in all phases of construction.

8. PERMITS AND INSPECTIONS

- a. Since the project site is within Washoe County, City of Reno or City of Sparks, the Contractor shall secure a building permit and arrange for all inspections through the appropriate jurisdiction. WCSD is not exempt from the requirements of these authorities.
- b. Any fees charged by Washoe County, City of Reno, or City of Sparks, for permanent improvements plan checking, permits and water, sewer, electrical hook-up will be paid by WCSD.
- c. The Contractor shall give all notices as required and comply with all laws, ordinances, rules, and regulations bearing on the conduct of the work as drawn and specified. If the Contractor observes that the Specifications and/or Drawings are at variance therewith, the Contractor shall notify the Owner promptly in writing, of any necessary changes in the work. If the Contractor performs any work knowing it to be contrary to such laws, ordinances, rules, and regulations, and without such notice to the Owner, the Contractor shall bear all costs arising therefrom.

- d. The Contractor shall notify the Owner when ready for final inspection.
- e. Final payment shall not be made until the original closed out permit for the work has been turned over to the Owner.

9. EMPLOYEE REGULATIONS

The Contractor shall, at all times, enforce strict discipline and good order among employees and shall not employ on the work any unfit person or anyone not skilled in the work assigned to him.

The Contractor shall ensure that each and every kind of work shall be performed by workmen, laborers, or mechanics especially skilled in the class of work (trade) required and that workmanship shall be of the best trade practice, regardless of the quality of materials.

The Contractor shall provide, at all times, sufficient and competent labor to carry on the work properly and ensure completion of each part in accordance with schedule and within the time agreed to.

An employee of the Contractor or Subcontractor, who is deemed incompetent, disorderly, or otherwise objectionable by the Owner, shall be removed promptly by the Contractor, and not reemployed on the work.

10. MANUFACTURER'S SPECIFICATIONS AND RECOMMENDATIONS

Wherever, in these specifications, a particular brand or make of item is specified, the Contractor shall comply strictly with the specifications and recommendations of that manufacturer as to the installation and/or application of that particular item.

11. REFERENCE TO SPECIFICATIONS AND TRADE NAMES

In these Specifications, wherever American Society for Testing Materials or other specifications or standards are mentioned it shall be understood that the materials or methods mentioned therewith shall conform to all requirements of the issue in effect on date of submission of bids. In these specifications whenever the trade name of a product or the name of a product or the name of a manufacturer appears it shall be understood to specify the product so identified or its "Approved Equal." The words "Or Equal" or "Approved Equal" shall mean equal in the opinion of and approved by the Owner or its representative. Refer to requirements outlined in Section 01631 - SUBSTITUTIONS.

12. NOTIFICATION TO CONTRACTOR OF WORK TO BE PERFORMED

After award of the bid, the project shall be initiated by the successful execution of a Contract and a "Notice to Proceed" has been issued by the WCSD's Purchasing Department.

13. GUARANTEE

The Contractor shall guarantee all work and equipment provided under this Contract to be free from defects of workmanship and material for a period of **one (1) year** or as specified, from the date of final acceptance of the work, which constitutes the issuance of a Notice of Substantial Completion and shall, at Contractor's own expense, repair and replace all defective work and materials.

14. APPEAL BY UNSUCCESSFUL BIDDER

Any unsuccessful Bidder (Appellant) may appeal the results in the solicitation's RECOMMENDATION OF AWARD TABULATION if they believe applicable provisions of the law were violated.

Appellant must submit a notice of protest to the Director of Procurement and Contracts no later than five (5) business days beginning the day after the date of the ROA TABULATION.

The notice of protest must include a written statement setting forth with specificity the reasons the person filing the notice believes the applicable provisions of the law were violated.

Appellant shall submit with the notice of protest a bond (i.e., Protest Bond or Appeal Bond) with a good and solvent surety company, authorized to do business in the State of Nevada or submit other security in a form approved by WCSD, who will hold the bond or other security until a determination is made on the appeal.

The bond shall be in the amount of twenty-five percent (25%) of the total dollar value of the Appellant's bid submission, up to a maximum amount of two hundred fifty thousand dollars (\$250,000).

If Appellant is not satisfied with WCSD's Director of Procurement and Contracts' response, Appellant may then appeal to an appeals committee designated by WCSD.

If Appellant is not satisfied with the appeals committee's response, Appellant may then appeal to WCSD's Board of Trustees, who will render the final decision.

WCSD will postpone any award action until after WCSD's Board of Trustees renders a final decision.

Appellant will not seek any type of judicial intervention until WCSD has rendered its final decision on the protest.

If an appeal is granted, the full amount of the posted bond will be returned to Appellant.

If the appeal is denied/not upheld, a claim may be made against the bond by WCSD for expenses suffered by WCSD as a result of the unsuccessful appeal.

WCSD is not liable for any costs, expenses, attorney's fees, loss of income, or other damages sustained by Appellant in an appeal process.

15. QUALITY ASSURANCE

It shall be the Contractor's responsibility to use adequate numbers of skilled workers who are thoroughly trained and experienced in the necessary crafts and who are completely familiar with the specified requirements and the methods needed for proper performance of the work.

16. OTHER PROJECTS

The Contractor is hereby informed that other projects may be happening at the school/ site at the same time as this project. The Contractor will make every effort to coordinate work with that of other Contractors.

17. EXISTING BUILDING AND CONDITIONS

During construction, it shall be the responsibility of the Contractor to take all reasonable precautions to preserve and protect surrounding buildings and property from damage of all kinds arising from the execution of this Contract. He/she shall repair and/or be responsible for any such damage at no additional cost to the Owner.

It is the Contractor's responsibility to identify and document any building or site damage that exists prior to the start of construction. If undocumented damage is discovered by the Owner that could have been caused as a result of the Contractor's presence it will be the Contractor's responsibility to repair the damage to the Owner's satisfaction without cost to the Owner. If the Contractor does not repair the damage to the Owner's satisfaction, then the Owner has the right after forty-eight (48) hours of written notification to repair the damage and process an Owner's Deductive Change Order for all expenses associated with the repair.

The Contractor shall provide temporary protective fencing or covering over any open trenching or excavation arising from the execution of this Contract, to keep out unauthorized persons, at no additional cost to the Owner.

The Contractor shall notify the Capital Projects Department's representative forty-eight (48) hours prior to any electrical shutdowns at the project site. Failure to do so could cause freezing and other damage due to shut down of the energy management system. The Contractor shall bear all costs for damage resulting from any failure to notify designated parties.

The Contractor shall meet with the representative of the Capital Projects Department to establish limits of work and general ground rules. As school may be in session, all safety precautions will be rigidly enforced.

Contractor shall hire a qualified, properly Licensed Contractor to test all natural gas lines within area of work for leaks prior to the start of the project and at project completion. Note all gas leaks at the start of the project and report it to the Capital

Projects Department's representative IMMEDIATELY. Contractor shall not proceed with work in area of any leaks until directed by the Capital Projects Department's representative. Gas line leaks at project completion shall be the responsibility of the Contractor and be repaired by a qualified, Licensed Contractor at no cost to the Owner. Contractor shall assume that all exposed conduit that exists within the work area is fully functional and operational for all wiring that is within the conduit at the start of the project. If at any time during construction, operations utilizing this wiring fail or are disrupted, the Contractor shall be responsible for repairs to make the operations fully functional by a qualified, Licensed Contractor at no cost to the Owner.

18. MATERIAL DISTURBANCE PERMIT

The Building Material Disturbance Permit (MDP) is a Washoe County School District (WCSD) document that identifies asbestos and lead site specific information, and it is issued by the Environmental, Safety & Assessment (ES&A) Department. A site-specific Material Disturbance Permit is required for each project. Each project and facility require a separate Material Disturbance Permit because each facility has specific information and direction regarding asbestos and lead, as each facility is different in that regard. The Material Disturbance Permit is to be requested by the Project Manager, or appointed District representative, in accordance with current Material Disturbance Permit requirements. No work can be done by a Contractor in WCSD without an MDP.

19. WATER SYSTEM DISTURBANCE

Improper closing of valves and other improperly conducted disruptions to District facilities can result in cross connections and back siphoning of chemicals and other contaminants into the water supply. Since these disturbances are very important, the District has added a water system disturbance section to the Material Disturbance Permit (MDP). Work, as a part of this contract, may involve the disturbance of a facilities water distribution system and, as such, the contractor is required to comply with the Water System Disturbance Permit Appendix section of the Material, Water & Lead Disturbance Permit for any work impacting a facility water system.

The contractor shall carefully comply with all requirements of the Material, Water & Lead Disturbance Permit, and shall be aware of this process prior to bid preparation and any construction. The permit requirements are hereby made a part of this specification and contract to the same extent as if bound herein and shall apply to all contractors and subcontractors.

The contractor shall be responsible for all costs incurred by the Washoe County School District, including the consultant, sampling and testing, clean-up, replacement of effected equipment, materials, etc., and any legal action that may result from an unauthorized disturbance of a water system caused by the contractor or his subcontractors, resulting in a cross connection or backflow incident.

If Contractors have any questions regarding the requirements of the Water System Disturbance Permit, please call the ES&A Department for the Regulated Systems Compliance & Safety Officers at (775) 325-8491.

20. ASBESTOS

The Washoe County School District has approx. 60% of our facilities that contain asbestos-containing materials. Contractors performing disturbances to asbestos-containing materials must be properly licensed and trained per the EPA AHERA regulation, as well as other Federal, State, and Local regulations.

Since so many of the facilities contain asbestos, minor construction activities many times will involve disturbance of materials which contain asbestos. These projects may involve "small scale-short duration" asbestos disturbances also termed "Attachments & Penetrations" to non-friable materials. As a part of this contract, the successful contractor will be required to include Attachments & Penetrations into the scope of their work.

a. Asbestos and the Material Disturbance Permit

The Contractor shall carefully comply with all the items of the Building Material Disturbance Permit (MDP) and shall review the permit and become familiar with its contents prior to bid preparation and any construction.

Once a Material Disturbance Permit Request is received for a specific project, building materials that have been identified as being disturbed during construction, and/or demolition, will have been tested for the presence of asbestos. These materials will be identified as asbestos-containing or non-asbestos-containing on the building Material Disturbance Permit(s) by the District's AHERA Management Planner. The Material Disturbance Permit must be referred to before any work commences. No outside asbestos sampling of building materials, by the Contractor or a Contractor hired asbestos consultant, is allowed.

All asbestos-containing material must be handled by contractors and/or individuals trained and certified in the removal of asbestos-containing building materials. No asbestos-containing materials shall be disturbed prior to authorization from the owner. If any material is encountered that is not listed on the Material Disturbance Permit, it shall immediately be brought to the attention of the Project Manager before any work continues that might disturb this material. If any building material listed in the disturbance permit as containing asbestos is improperly disturbed, in the opinion of the District, by the Contractor or his sub-contractor/s, the District will immediately hire a third-party asbestos consultant to investigate possible asbestos contamination, and an asbestos Contractor to perform any recommended clean-up.

The Contractor shall be responsible for all costs incurred by the District including the consultant, sampling and testing, clean-up, replacement of affected equipment, materials, etc., and any legal action that may result

from an asbestos fiber release incident caused by the Contractor or his sub-contractors.

b. Asbestos Abatement (The removal of an asbestos material)

Attachments and Penetrations does not include the removal (other than drilling holes) of asbestos containing materials. Any removal of asbestos-containing materials is not an “Attachment and Penetration” activity, but rather an abatement, and any abatement of asbestos materials must be designed by an EPA AHERA certified Asbestos Project Designer. Any abatement project’s design will be the responsibility of the District to design and provide abatement specifications. Asbestos abatement (Removal) must be conducted by an asbestos abatement contractor, which will be supervised by the District and/or a District hired asbestos abatement consultant. The abatement costs will be included into the scope of this project.

c. Asbestos – Attachments & Penetrations

Attachments & Penetrations, for the purpose of this document, is the drilling of holes, installing/removing screws, installing anchors, nails, and staples in non-friable asbestos-containing materials, in which the disturbance may release asbestos fibers. Attachments & Penetrations are minor disturbances that are normal activities such as installing conduits, mounting boxes or brackets, and removing equipment anchors from asbestos containing materials. The Material Disturbance Permit will identify which materials at a specific site can be disturbed, and the minimum requirements to perform an asbestos disturbance.

d. “Small Scale-Short Duration” – WCSD Attachment & Penetration Procedures

The WCSD Attachment & Penetration Procedures that the Contractor must utilize, when identified as being required in the MDP, are available from the Project Manager. The contractor shall submit their WCSD Attachment & Penetration Procedures to the Project Manager. The Project Manager will submit the documents to the ES&A Department for approval.

The contractor can add additional requirements, but nothing required in the MDP and WCSD Attachment & Penetration Procedures may be omitted. The Contractor must submit their Attachment & Penetration Procedure to their Project Manager to get ES&A approval of these documents **prior to any disturbance.** The ES&A Department will notify the contractor upon approval of these documents.

Once the approval of the WCSD Attachment & Penetration Procedure and training certificates is received, the contractor may schedule the disturbance, but must notify the ES&A Department immediately prior to disturbing the asbestos-containing materials. The Contractor shall provide this notice by calling the ES&A Attachment & Penetration hotline at 325-8490, follow the directions, and leave a message. ES&A Department

personnel, Project Managers, Assistant Project Managers/PCI's, and other district personnel may conduct site visits to ensure compliance with the contractor's submitted and approved procedures.

e. Asbestos Training Certificates – Abatement

Abatement of asbestos-containing materials, as allowed and identified in the Material Disturbance Permit, will be done by an Asbestos Abatement Contractor, with workers that have a minimum of 32-hour AHERA asbestos training (Asbestos Worker), and supervised by an abatement supervisor with 40-hour AHERA asbestos training (Contractor/Supervisor). Workers and supervisors must also get an annual refresher certificate if the original training is greater than one year old. Contractor training certificates will be submitted to the Project Manager at least two weeks prior to the start of the project. The ES&A Department will review the submitted training documentation, verify certificates as required, and approve the abatement workers and supervisors, so they can work on the assigned WCSD project. No one that has not been approved by the ES&A Department is authorized to perform any asbestos disturbances within the WCSD.

New workers added after the start of the project will be approved by the ES&A Department within one 8-hour work period of the standard Monday thru Friday work schedule. Certification submittal will be serviced by the ES&A Department on a first come, first served basis. Delays to review the documentation will be anticipated and taken into account on any abatement schedule developed, and asbestos workers and supervisors will not be allowed to work in any way on that project until their documentation has been reviewed and approved.

f. Asbestos Training Certificates – Attachment & Penetration

Contractors performing "Attachment & Penetration" work on non-friable asbestos-containing materials, as allowed, and identified in the Material Disturbance Permit, will be required to have a minimum of 16 hours of AHERA asbestos training (Operations & Maintenance, or O&M), as well as an annual refresher certificate if the original training is greater than one year old. Contractor training certificates will be submitted to the Project Manager at least two weeks prior to the start of the project. The ES&A Department will review the submitted training documentation, verify certificates as required, and approve the Attachment & Penetration technicians, so they can work on the assigned WCSD project. No one that has not been approved by the ES&A Department is authorized to perform any asbestos disturbances within the WCSD.

New workers added after the start of the project will be approved by the ES&A Department within one 8-hour work period of the standard Monday thru Friday work schedule. Certification submittal will be serviced by the ES&A Department on a first come, first served basis. Delays to review the documentation will be anticipated and taken into account on any Attachment & Penetration schedule developed, and Attachment & Penetration technicians will not be allowed to work in any way on that project until their

documentation has been reviewed and approved.

g. Asbestos Air Sampling, Respiratory Protection, and Protective Suits

Asbestos personal air sampling is required during any asbestos disturbance. Asbestos air sampling results will be supplied to the ES&A Department, and the Project Manager, within 48 hours of the completion of a disturbance. Laboratory results will be emailed directly to the ES&A Department from the laboratory providing analysis. Handwritten results will not be allowed. Regardless of air sampling results, Contractors will not be allowed to submit a Negative Exposure Assessment so that they can discontinue the use of respirators and personal protective suits. The District reserves the right to require this requirement, to reduce the long-term exposure liability from Contractors and their workers, which have disturbed this owner's asbestos materials.

If training certificates are issued for a class, those training certificates need to be submitted. Wallet cards will not be accepted as a training certificate unless no training certificate is provided by the training provider. In order for a wallet card to be accepted, the contractor will supply a letter from the training provider stating that no training certificate was provided, and only wallet cards were supplied to attendees. Wallet cards are less desirable due to their small size and mitigate the ability to clearly read and verify all the information on the card. Contractors are encouraged to request a full size 8 1/2" x 11" training certificate from their training providers.

21. LEAD PAINTS, COATINGS, CERAMIC TILE, AND LEAD-CONTAINING MATERIALS IN WCSD FACILITIES

a. Lead-containing paints, coatings, ceramic tile, and lead materials are present in WCSD facilities.

Bidders/Contractors that disturb lead-containing or potentially lead-containing paints, coatings, ceramic tile, and lead-containing materials, by law, are required to know all applicable regulations, and comply with all state and federal regulations that apply to the disturbances to lead-containing paints, coatings, ceramic tile, and lead-containing materials they are conducting. The regulations that are recommended by the District for a contractor to be properly trained and knowledgeable related to lead disturbances, includes, but is not limited to, the following:

OSHA Regulation CFR 1926.62 – Lead & Appendix A, B, C, & D – Lead Construction Standard.

OSHA Regulation CFR 1910. 1025 - Lead & Appendix A, B, C, & D – General Industry Standard.

EPA, 40 CFR Part 745 – Lead; Renovation, Repair, and Painting Regulation.

b. Lead and the Material Disturbance Permit

The Contractor shall carefully comply with all items of the Building Material Disturbance Permit (MDP) and shall review the permit and become familiar with its contents prior to bid preparation and any construction.

Once a Material Disturbance Permit request is received for a specific project, building materials that have been identified as being disturbed during construction, and/or demolition, will have been tested for the presence of lead. These materials will be identified as lead-containing or not lead-containing on the building Material Disturbance Permit(s) by the District's ES&A Staff. The Material Disturbance Permit must be referred to before any work commences. **No outside lead sampling of building materials, by the Contractor or a Contractor hired lead consultant, is allowed.**

All lead-containing materials must be handled by contractors and/or individuals trained and certified to perform lead disturbances. No lead-containing materials shall be disturbed prior to authorization from the owner. If any building material listed in the disturbance permit as lead-containing are improperly disturbed, in the opinion of the District, by the Contractor or his sub-contractor, the District will immediately hire a third-party lead consultant to investigate possible lead contamination, and a lead removal Contractor to perform any recommended clean-up.

The Contractor shall be responsible for all costs incurred by the District, including the consultant, sampling and testing, clean-up, replacement of the affected equipment, materials, etc., and any legal action that may result from a lead contamination incident caused by the Contractor or his sub-contractors.

Bidders/Contractors accept and acknowledge, by signing the Material Disturbance Permit, the existence of lead related regulations, and accept all liability related to the disturbance of lead-containing materials, citations resulting from, or any other costs the District may incur by the action of all parties of the bidders' company or companies hired by the successful bidder to complete this project.

c. Construction Age of Buildings in the District

At the conception of adding lead information to MDP's, it was thought that lead-containing paints, coatings, and ceramic tile were much more likely to be present on more surfaces in the District's older facilities. However, recent sampling has shown lead containing paints, coatings and ceramic tiles DO routinely exist, even in our newest facilities. Due to that finding, the age of buildings is not as important as was originally thought. We are still providing construction date information in MDP's because lead-based paint >5000 ppm is much less likely in facilities built after 1978.

d. Pre – 1978 WCSD Buildings

Paint and coating sampling have shown that paints and coatings contain some levels of lead in the Districts' Pre-1978 facilities. Therefore, all persons performing **any** disturbance to coatings or paints in our Pre-1978 constructed facilities must utilize lead safe work practices. In addition, any person performing **any** disturbance to paints, coatings, ceramic tile, and lead-containing materials must have taken an OSHA lead action level training class from a WCSD ES&A Department approved training provider. If identified as lead-containing, the Contractor will be required to perform all disturbances as per the MDP, WCSD provided lead specification, and all local, state, and federal regulations.

e. Post – 1978 WCSD Buildings

While it was originally thought that paints and coatings on materials other than metal surfaces and ceramic tile typically did not contain lead in WCSD post – 1978 constructed facilities, sampling has shown that is not the case. The MDP will provide specific historical sampling that has been conducted in the District facilities. If past sampling has shown the presence of lead-containing paints and coatings in the facility, the Contractor will be required to treat all painted and coated surfaces as lead-containing. If identified as lead-containing, the Contractor will be required to perform all disturbances as per the MDP, WCSD provided lead specification, and all local, state, and federal regulations.

The MDP will state all buildings identified above were constructed after 1978. While it was originally thought that paints, coatings and ceramic wall tile are less likely to contain lead in newer WCSD facilities, recent sampling has shown lead-containing paints, coatings, and ceramic tiles DO routinely exist, even in our newest facilities. Due to that finding, Contractors must treat all paints, coatings, and ceramic tile as lead-containing unless WCSD project sampling has proven otherwise, and it will be deemed negative within the MDP and the project scope. **The Bidder/Contractor must comply with all lead-containing or assumed lead-containing paint and coating disturbance instructions and requirements listed in the MDP, District provided lead specifications, and all local, state, and federal regulations, unless the material has been proven, to the satisfaction of the District, that said materials do not contain lead.**

f. Lead Removal (The removal of a lead-containing material)

Attachments and Penetrations does not include any removal, demo, welding, sanding, abrading, sandblasting, cutting, grinding, heating, and torch cutting of lead-containing materials, and is not an "Attachment and Penetration" disturbance. These activities must be designed by an EPA Certified Lead Consultant. The project's design for the above-listed activities will be the responsibility of the District to design and provide the specs as a part of this bid package. Lead activities listed above must be conducted by a lead removal contractor, which will be supervised by the

District and/or District hired EPA Certified Lead Consultant. The lead activities costs will be included into the scope of each project.

g. Lead Attachments & Penetrations

Attachments & penetrations, for the purpose of this document, is the drilling of holes, installing/removing screws, installing anchors, nails, and staples, in which the disturbance may release lead dust. Attachments and Penetrations are minor disturbances that are normal activities such as installing conduits, mounting boxes or brackets, and removing equipment anchors from lead-containing materials. The Material Disturbance Permit will identify which materials at a specific site can be disturbed, and the minimum requirements to perform a lead disturbance.

h. Lead Safe Work Practices – WCSD Attachment & Penetration Procedures

The WCSD Attachment & Penetration Procedures that the Contractor must utilize, when identified as being required in the MDP, are available from the Project Manager. The contractor shall submit their WCSD Attachment & Penetration Procedures to the Project Manager. The Project Manager will submit the documents to the ES&A Department for approval.

The contractor can add additional requirements, but nothing required in the MDP and WCSD Attachment & Penetration Procedures may be omitted. The Contractor must submit their Attachment & Penetration Procedure to their Project Manager to get ES&A approval of these documents **prior to any disturbance**. The ES&A Department will notify the contractor upon approval of these documents.

Once the approval of the WCSD Attachment & Penetration Procedure and training certificates is received, the contractor may schedule the disturbance, but must notify the ES&A Department immediately prior to disturbing the lead-containing materials. The Contractor shall provide this notice by calling the ES&A Attachment & Penetration hotline at 325-8490, follow the directions, and leave a message. ES&A Department personnel, Project Managers, Assistant Project Managers/PCI's, and other district personnel may conduct site visits to ensure compliance with the contractor's submitted and approved procedures.

i. Lead Training Certificates – Removal and Attachments & Penetrations

The health and safety of all occupants of the WCSD facilities is the number one priority of the District. To that end, technicians performing disturbances to lead-containing materials must have adequate training. Contractors performing lead disturbances, as allowed and identified in the Material Disturbance Permit, will be required to have a minimum of "OSHA Lead Action Level" training, as well as an annual OSHA Lead Action Level training certificate if the original training is greater than one year old, before being approved to perform lead disturbances. OSHA Lead Action Level training will be conducted in accordance with OSHA 1926.62(l)(2)(i) thru

(viii) and all required topics identified in this standard will be completed to include:

- 1926.62(l)(2)(i) The content of this standard and its appendices;
- 1926.62(l)(2)(ii) The specific nature of the operations which could result in exposure to lead above the action level;
- 1926.62(l)(2)(iii) The purpose, proper selection, fitting, use, and limitations of respirators;
- 1926.62(l)(2)(iv) The purpose and a description of the medical surveillance program, and the medical removal protection program including information concerning the adverse health effects associated with excessive exposure to lead (with particular attention to the adverse reproductive effects on both males and females and hazards to the fetus and additional precautions for employees who are pregnant);
- 1926.62(l)(2)(v) The engineering controls and work practices associated with the employee's job assignment including training of employees to follow relevant good work practices described in Appendix B of this section;
- 1926.62(l)(2)(vi) The contents of any compliance plan in effect;
- 1926.62(l)(2)(vii) Instructions to employees that chelating agents should not routinely be used to remove lead from their bodies and should not be used at all except under the direction of a licensed physician; and
- 1926.62(l)(2)(viii) The employee's right of access to records under 29 CFR 1910.20.

Certificates of Training showing that technicians have successfully completed an OSHA Lead Action Level course and are required to be properly submitted and approved by the District's ES&A Department prior to any Contractor's technician performing any disturbances to lead-containing or assumed lead-containing paints or coatings, or any other lead-containing materials. The training certificate must have "OSHA Lead Action Level Training" clearly identified on the training certificate and should have a sentence that states that the training topics covered in the class meet or exceed the training topics of OSHA 1926.62(l)(2)(i) thru (viii).

If training certificates are issued for a class, those training certificates need to be submitted. Wallet cards will not be accepted as training certificates unless no training certificate is provided by the training provider. In order for a wallet card to be accepted, the contractor will supply a letter from the training provider stating that no training certificate was provided, and only wallet cards were supplied to attendees. Wallet cards are less desirable due to their small size and mitigate the ability to clearly read and verify all the information on the card. Contractors are encouraged to request a full size 8 1/2" x 11" training certificate from their training providers.

It is important that Contractor's planning on doing the lead work within the District become familiar with the lead training requirements, and spend the

time confirming that the lead classes being taken are truly an OSHA Lead Action Level course, and not a lead awareness course as identified above. Many training providers have differing training class titles on their lead classes, but only training certificates that are noted as above will be accepted to fulfill the listed District's training requirements. Contractors requiring training are responsible in providing the training providers a clear understanding of what training is required.

Full Lead worker initial and annual training certificates that comply with adjacent state requirements for lead worker certification, will be accepted in lieu of the OSHA Lead Action Level training certificate, as long as they are titled "Lead Worker" and then accompanied with a letter from the training provider certifying that the topics identified in OSHA 1926.62(l)(2)(i) thru (viii) were covered in that class. Contractors are responsible with ensuring and verifying training certificates meet the above-listed requirements. Training certificates that do not have "OSHA Lead Action Level or Lead Worker" will not be accepted or submitted.

Contractor training certificates will be submitted to the Project Manager at least two weeks prior to the start of the project. The ES&A Department will review the submitted training documentation and must pre-approve workers so they can work on the assigned WCSD project. No one that has not been approved by the ES&A Department is authorized to perform any lead disturbances.

New workers added after the start of the project will be approved by the ES&A Department within one 8-hour work period of the standard Monday thru Friday work schedule. Certification submittal will be serviced by the ES&A Department on a first come, first served basis. Delays to review the documentation will be anticipated and taken into account on any Removal or Attachment & Penetration schedule developed, and Removal and/or Attachment & Penetration technicians will not be allowed to work in any way on that project until their documentation has been reviewed and approved.

j. Renovation, Repair & Painting Regulations (RR&P) - 40 CFR Part 745.81

Effective April 22, 2010, contractors will be required to be trained and registered with the EPA to conduct regulation applicable renovations, repairs and painting (RR&P) in all **elementary schools or child occupied District facilities constructed prior to 1978 when lead-based paints and coatings are being disturbed**. Contractors are reminded that there are some childcare facilities in middle and high school locations, and the RR&P would apply at those locations as outlined in the RR&P regulation requirements. <http://www.epa.gov/lead/pubs/steps.pdf>

In general, all firms that disturb 6 square feet of **lead-based** painted surface per room on the interior, or 20 square feet on the exterior, within a 30 day period in **this** facility, must comply with the EPA's Renovation, Repair and Painting (RR&P) regulation **and** must be registered with the federal EPA. Per the Regulation, the area of disturbance is calculated by adding up the entire

surface areas being removed/disturbed, which then determines the amount of painted surface area disturbed. Work that involves window replacement or demolition of a painted surface, the EPA RR&P regulation applies regardless of size if lead-based paint is present.

The District requires all workers in RR&P projects involving lead disturbances to have, at a minimum, OSHA lead action level training. This regulation also requires that the contractor must assign an EPA RR&P certified renovator that is responsible for ensuring and documenting all work is conducted in compliance with the EPA RR&P regulation. There are extensive record keeping and notification requirements that the Contractor must perform. All workers with the minimum OSHA lead action level training, but are not EPA RR&P certified renovator trained, must be trained and supervised by the EPA RR&P certified renovator.

On a RR&P project, Contractors must have a minimum of one EPA RR&P certified renovator on-site that has successfully attended and passed a 8-hour EPA accredited renovator training course before working in any elementary schools or child occupied District facilities constructed prior to 1978. The renovator's training certification must remain current. Recertification requirements through the attendance of refresher courses are a requirement of this regulation. The renovator must be on-site throughout the project. The certified renovator is responsible for ensuring that lead safe work practices are utilized per this EPA RR&P regulation, as well as per all District lead requirements and policies that may be more stringent than the EPA and OSHA regulations.

The EPA RR&P regulation requires that personnel disturbing lead containing materials utilize lead safe work practices as identified in the EPA guidance document titled “**steps to lead safe renovation, repair and painting**”, **pages 12 through 23**. This document is available electronically at <http://www.epa.gov/lead/pubs/steps.pdf>. The contractor shall submit lead safe work practice procedures, and all RR&P and OSHA lead action level training certificates to the Project Manager at least two weeks prior to the start of the project. The ES&A Department will review the submitted training documentation and must pre-approve workers so they can work on the assigned WCSD project. No one that has not been approved by the ES&A Department is authorized to perform any lead disturbances.

New workers added after the start of the project will be approved by the ES&A Department within one 8-hour work period of the standard Monday thru Friday work schedule. Certification submittal will be serviced by the ES&A Department on a first come, first served basis. Delays to review the documentation will be anticipated and taken into account on any RR&P project schedule developed, and EPA RR&P certified renovators and workers will not be allowed to work in any way on that project until their documentation has been reviewed and approved.

This is a general overview of the regulation and the contractor must refer to the regulation for additional requirements and information. Fines are expensive and are levied toward the Contractor not the owner, so compliance with this regulation is very important, and it is important that Bidders/Contractors are well versed in this regulation.

k. Lead Air Sampling, Respiratory Protection and Protective Suits

Lead personal air sampling is required during any lead disturbance. Lead air sampling results will be supplied to the ES&A Department, and the Project Manager, within 48 hours of the completion of a disturbance. Laboratory results will be emailed directly to the ES&A Department from the laboratory providing analysis. Handwritten results will not be allowed. Regardless of air sampling results, Contractors will not be allowed to submit a Negative Exposure Assessment so that they can discontinue the use of respirators and personal protective suits. The District reserves the right to require this requirement, to reduce the long-term exposure liability from Contractors and their workers, which have disturbed this owner's lead materials.

22. INDOOR ENVIRONMENTAL QUALITY

Preventative job site practices will reduce the potential for residual problems with indoor air quality in completed buildings and reduce undue health risks for all workers. The following are the minimum standards required by the WCSD for on-site construction in the district.

a. Existing HVAC System:

When feasible, the HVAC system for the project area will be shut down for the duration of the project. If occupied spaces will be adversely affected by the shut-down of the system, construction area return registers should be sealed with polyethylene sheeting and secured as an alternative. Registers must be sealed prior to the start of work.

b. Separating Occupied Spaces From Non-Occupied:

Keep work areas separate from occupied spaces with polyethylene sheeting (or similar) if there are no other natural barriers in place OR in spaces where air exchange will occur around the barriers.

c. Ventilation:

During the installation of carpet, paints, furnishings and any other VOC emitting products, provide "spot" ventilation during application/installation and for at least 24 hours after the work is completed. In most cases, opening windows and doors will not be enough to effectively exhaust contaminants. It is recommended that an exhaust fan be used to pull polluted air out of the building. This can be accomplished by placing a fan in a window or door and temporarily sealing any opening around the fan with plastic. Additionally, a door or window at the opposite end of the room should be opened to allow fresh, outdoor air to flow across the work area and sweep polluted air out through the exhaust fan. As long as odors are present, the temporary exhaust

ventilation must continue to operate. This may include nights and weekends, as necessary. Ventilation should continue for a minimum of 24 hours after the completion of the project or until there are no more noticeable odors.

d. Construction Dust:

Minimize the amount of dust in the air and on surfaces. Examples include the use of vacuum assisted drywall sanding equipment and the use of vacuums instead of brooms to clean construction dust from floors.

e. After Hours Scheduling:

Schedule high dust generating operations or extreme noise generating activities for after normal working hours. (i.e. saw cutting, jack hammering) and install temporary barriers to confine dust, as necessary.

f. Gasoline/Diesel Powered Equipment:

Electric powered equipment must be used in lieu of diesel or gasoline powered equipment. Gas and diesel equipment may not be used inside a WCSD building or near an outdoor fresh air building intake.

g. Material Safety Data Sheets (MSDS):

MSDS must be made be maintained onsite and made available upon request as required by federal law.

h. Construction Completion:

Prior to the occupancy of the building but after the installation of new furniture, carpet, etc., the building should be flushed with 100% outside air for one to three days.

i. Air Filters:

Replace all filtration media immediately at the conclusion of the job.

j. Monitoring Air Quality:

Indoor air quality monitoring will be conducted randomly throughout the project. Results and any recommendations will be communicated through the building inspector to construction management.

k. Pre-Construction Work Area Inspection:

Any overhead work including roof, the Contractor shall conduct a pre room condition walk through with WCSD Project Manager to determine the level of cleanliness that will be expected at completion of project. Contractor shall be responsible for cleaning all exposed surfaces within the facility beneath the work area. At the completion of the project, the Contractor shall clean all exposed surfaces within the facility beneath the aforementioned work area including but not limited to all shelving, duct, lighting, flooring, furniture, etc.

23. LOCK OUT TAG OUT (LOTO) PROCEDURE

Contractor will be responsible for the isolation and termination of all building systems that may be impacted by the scope of work within this bid. Contractor will coordinate all shut-down processes with the construction manager prior to any shutdowns up to and including Lock Out Tag Out procedures 24 hours prior to any shutdowns. WCSD will make the final determination of which systems and location shall be isolated. All Lock Out Tag Out will be performed at main service panel.

SECTION 00830 - TECHNICAL SPECIFICATIONS

I. SUMMARY OF THE WORK:

The work shall include the furnishing of all labor, tools, equipment, material, transportation and the performance of all operations required for the **Roof Replacement of Sections A, A1, B, and B1 at Roy Gomm Elementary School** at the site(s) and associated work as specified herein and shall include the cleanup and removal from the site(s) of all debris resulting from the operations performed. It shall also be the Contractor's responsibility to take all necessary safety precautions and to furnish barricades and/or other safety measures as required.

All work shall be performed in strict accordance with the requirements of these specifications and any and all appropriate state, county and local ordinances.

II. LOCATION OF THE WORK:

The location(s) of the work and contact person(s) are:

Roy Gomm Elementary School
4000 Mayberry Drive
Reno, NV 89509
Phone #: 775-333-5000
Principal: Barbara Barker
Site Facilities Coordinator: Santos Castellanos

The Contractor is urged to examine the site(s) and compare the existing conditions with that of the work outlined. No extra payment will be considered for work additional to that shown or noted if such work would have been apparent in an inspection of the premises.

To review the existing premises, contact the Principal and/or Site Facilities Coordinator at the site(s). **Whenever at the site, be sure to check in at the front office.**

At the above-named site(s), school classes and other construction projects may or may not be taking place during the construction phase. It will require coordination between the school site(s), other vendors, and the WCSD's Capital Projects Department.

III. QUESTIONS & CLARIFICATIONS:

For questions and clarifications regarding the Technical Specifications, Drawings, General Conditions, Special Conditions, Bidding and Contract Information contact the Purchasing Department at solicitations@washoeschools.net. **All questions shall be submitted in writing directly to WCSD's Solicitations website at <http://solicitations.washoeschools.net/> or via e-mail to solicitations@washoeschools.net by 4:30 p.m. (Local Time) on January 29, 2025.**

IV. MANUFACTURERS:

Manufacturers, types, model numbers and execution as detailed on the drawings.

V. ASBESTOS ASSESSMENT:

The Material, Water & Lead Disturbance Permit(s) are included in the Special Conditions section of the Specifications.



2024-2025 Balanced Calendar

July 2024							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 0
	1	2	3	4	5	6	
7	8	9	10	11	12	13	
14	15	16	17	18	19	20	
21	22	23	24	25	26	27	
28	29	30	31				

January 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 19
			1	2	3	4	January 1 - 3 - Winter Break
5	6	7	8	9	10	11	
12	13	14	15	16	17	18	
19	20	21	22	23	24	25	January 20 - Martin Luther King, Jr. Day
26	27	28	29	30	31		

August 2024							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 15
				1	2	3	August 6 - 8 - Teacher Professional Dev. Days
4	5	6	7	8	9	10	August 9 - Teacher Work Day
11	12	13	14	15	16	17	August 12 - First Day of School for Students
18	19	20	21	22	23	24	August 12 - 16 - Kindergarten Testing Week
25	26	27	28	29	30	31	August 19 - First Day of Kindergarten

February 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 19
						1	
2	3	4	5	6	7	8	
9	10	11	12	13	14	15	February 17 - President's Day
16	17	18	19	20	21	22	
23	24	25	26	27	28		February 25 - College and Career Readiness Assessment for high schools only.

September 2024							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 18
1	2	3	4	5	6	7	September 2 - Labor Day
8	9	10	11	12	13	14	September 9 & 11 - Emergency Closure
15	16	17	18	19	20	21	
22	23	24	25	26	27	28	
29	30						

March 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 11
						1	
2	3	4	5	6	7	8	
9	10	11	12	13	14	15	March 14 - End of Grading Period
16	17	18	19	20	21	22	March 17 - 28 - Spring Break
23	24	25	26	27	28	29	
30	31						

October 2024							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 17
		1	2	3	4	5	
6	7	8	9	10	11	12	October 7 - 11 - Fall Break
13	14*	15	16	17	18	19	October 14 - Teacher Professional Dev. Day
20	21	22	23	24	25	26	October 18 - End of Grading Period
27	28	29	30	31			October 18, 21 - 24 - Conference Week
							October 25 - Nevada Day Observance

April 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 22
		1	2	3	4	5	
6	7	8	9	10	11	12	
13	14	15	16	17	18	19	
20	21	22	23	24	25	26	
27	28	29	30				

November 2024							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 17
					1	2	
3	4	5*	6	7	8	9	November 5 - Election Day (See * below)
10	11	12	13	14	15	16	November 11 - Veterans Day
17	18	19	20	21	22	23	
24	25	26	27	28	29	30	November 27 - 29 - Thanksgiving Break

May 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 21
				1	2	3	
4	5	6	7	8	9	10	
11	12	13	14	15	16	17	
18	19	20	21	22	23	24	
25	26	27	28	29	30	31	May 26 - Memorial Day

December 2024							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 14
1	2	3	4	5	6	7	
8	9	10	11	12	13	14	December 19 - End of Grading Period
15	16	17	18	19	20	21	December 20 - Teacher Work Day
22	23	24	25	26	27	28	December 23 - January 3 - Winter Break
29	30	31					

June 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 7
1	2	3	4	5	6	7	June 6 - End of Grading Period
8	9*	10*	11	12	13	14	June 6 - Last Day of School
15	16	17	18	19	20	21	June 9 & 10 - Teacher Professional Dev. Days
22	23	24	25	26	27	28	June 11 - Contingency Day
29	30						June 19 - Juneteenth

*October 14, 2024, November 5, 2024, June 9, 2025 and June 10, 2025 are non-student days used for professional development but counted as days in session per NAC 387.140 (2a).	Number of Days Per Quarter	42	39	48	51	180
	Number of Days Per Semester	81		99		180
	Contingency Days: June 11					

Teacher Work Days: August 6 - 9, December 20
Teacher Professional Dev Day: October 14, 2024, November 5, 2024, June 9 - 10, 2025



2025-2026 BALANCED CALENDAR

July 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 0
		1	2	3	4	5	
6	7	8	9	10	11	12	
13	14	15	16	17	18	19	
20	21	22	23	24	25	26	
27	28	29	30	31			

January 2026							No School on Shaded Days
J	M	T	W	TH	F	S	# of School Days = 19
				1	2	3	January 1 - 2 - Winter Break
4	5*	6	7	8	9	10	January 5 - Teacher Professional Dev. Day
11	12	13	14	15	16	17	
18	19	20	21	22	23	24	January 19 - Martin Luther King, Jr. Day
25	26	27	28	29	30	31	

August 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 15
					1	2	
3	4	5	6	7	8	9	August 5 - 7 Teacher Professional Dev. Days
10	11	12	13	14	15	16	August 8 - Teacher Work Day
17	18	19	20	21	22	23	August 11 - First Day of School for Students
24	25	26	27	28	29	30	August 11 - 15 - Kindergarten Testing Week
							August 18 - First Day for Kindergarten Students

February 2026							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 19
1	2	3	4	5	6	7	
8	9	10	11	12	13	14	
15	16	17	18	19	20	21	February 16 - President's Day
22	23	24	25	26	27	28	

September 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 21
	1	2	3	4	5	6	September 1 - Labor Day
7	8	9	10	11	12	13	
14	15	16	17	18	19	20	
21	22	23	24	25	26	27	
28	29	30					

March 2026							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 15
1	2	3	4	5	6	7	March 3 - College and Career Readiness Assessment for high schools only. Awaiting confirmation from NDE.
8	9	10	11	12	13	14	March 13 - End of Grading Period
15	16	17	18	19	20	21	
22	23	24	25	26	27	28	March 23 - April 3- Spring Break
29	30	31					

October 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 17
			1	2	3	4	October 6 - 10 - Fall Break
5	6	7	8	9	10	11	October 13 - Teacher Professional Dev. Day
12	13*	14	15	16	17	18	October 17 - End of Grading Period
19	20	21	22	23	24	25	October 24, 27 - 30 - Conference Week
26	27	28	29	30	31		October 31 - Nevada Day

April 2026							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 19
			1	2	3	4	March 23 - April 3- Spring Break
5	6	7	8	9	10	11	
12	13	14	15	16	17	18	
19	20	21	22	23	24	25	
26	27	28	29	30			

November 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 16
						1	
2	3	4	5	6	7	8	
9	10	11	12	13	14	15	November 11 - Veterans Day
16	17	18	19	20	21	22	
23	24	25	26	27	28	29	November 26 - 28 - Thanksgiving Break

May 2026							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 20
					1	2	
3	4	5	6	7	8	9	
10	11	12	13	14	15	16	
17	18	19	20	21	22	23	
24	25	26	27	28	29	30	May 25 - Memorial Day

December 2025							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 14
	1	2	3	4	5	6	
7	8	9	10	11	12	13	
14	15	16	17	18	19	20	December 18 - End of Grading Period
21	22	23	24	25	26	27	December 19 - Teacher Work Day
28	29	30	31				December 22 - January 2 - Winter Break

June 2026							No School on Shaded Days
S	M	T	W	TH	F	S	# of School Days = 5
	1	2	3	4	5	6	June 5 - End of Grading Period
7	8	9	10	11	12	13	June 5 - Last Day of School
14	15	16	17	18	19	20	June 9 - Primary Election Day
21	22	23	24	25	26	27	June 8, 9, 10 - Contingency Days
28	29	30					June 19 - Juneteenth

* October 13, 2025 & January 5, 2026 is a non-student day used for professional development but counted as a day in session per NAC 387.120 (4)	Number of Days per Quarter		44	39	48	49	180
	Number of Days per Semester		83	97	180		
	Contingency Days: June 8, 9, 10						

Teacher Work Days: August 5 - 8, December 19
Teacher Professional Dev Days: October 13, 2025 & January 5, 2026

WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT

FACILITY AND MATERIAL LOCATION: Roy Gomm Elementary School

MDP #

DESCRIPTION OF WORK TO BE PERFORMED:

IT IS THE RESPONSIBILITY OF THE CONTRACTOR/WORKER TO IDENTIFY MATERIAL TYPE PRIOR TO DISTURBANCE. ONLY MATERIALS LISTED ON THIS PERMIT MAY BE DISTURBED. ANY NEW MATERIAL DISCOVERED OR ANY MATERIAL WHOSE EXACT NATURE OR CHARACTER IS UNCERTAIN REQUIRES A NEW PERMIT PRIOR TO DISTURBANCE. ANY CITATIONS OR ASBESTOS/LEAD CONTAMINATION RESULTING FROM THE IMPROPER OR UNAUTHORIZED DISTURBANCE OF ASBESTOS OR LEAD MATERIALS IS SOLELY THE RESPONSIBILITY OF THE CONTRACTOR. A COPY OF THIS PERMIT MUST BE SIGNED BY THE CONTRACTOR AND SUBMITTED TO THE DISTRICT PRIOR TO STARTING THE PROJECT.

REFER TO THE MAP ON THE LAST PAGE OF THIS PERMIT FOR ADDITIONAL INFORMATION ON BLDG/ROOF AREA ALPHABETICAL IDENTIFICATION LETTERS BEING REFERRED TO IN THIS PERMIT. DO NOT USE ANY OTHER SOURCE TO DETERMINE WHAT AREAS ARE IDENTIFIED IN THIS PERMIT. THE BUILDING/ROOF IDENTIFICATION LETTERS USED IN THIS PERMIT MAY NOT NECESSARILY MATCH WHAT IS FOUND OR REFERENCED IN THE FIELD OR IN OTHER CONTRACT DOCUMENTS.

ITEM #1	MATERIAL DESCRIPTION: GYPSUM BOARD BUILDING SYSTEM
AHERA MATERIAL NUMBER: M-01	CONTAINS ASBESTOS ?: YES
<p>MATERIAL DISTURBANCE INSTRUCTIONS: THE GYPSUM BOARD BUILDING SYSTEM MATERIALS AT THIS SCHOOL HAVE BEEN SURVEYED AND SHOWS THE FOLLOWING:</p> <p><u>ASBESTOS GYPSUM BOARD BUILDING SYSTEM AREAS – (SEE ATTACHED DRAWING LAST PAGE)</u> BUILDING(S) “D” HAS ASBESTOS CONTAINING GYPSUM BOARD BUILDING SYSTEM MATERIALS PRESENT; WHEN DISTURBING THESE MATERIALS IN THESE AREA CONTRACTOR MUST COMPLY WITH ALL ASBESTOS REQUIREMENTS LISTED BELOW. CONTRACTOR IS RESPONSIBLE FOR ATTACHMENT AND PENETRATION (DRILLING OF HOLES). 16 HOUR AHERA ASBESTOS TRAINED PERSONNEL MUST BE UTILIZED, AIR MONITORING MUST BE CONDUCTED THROUGHOUT ANY DISTURBANCE AND A HEPA VACUUM MUST BE ON SITE AND USED TO CLEAN ALL DEBRIS. AIR SAMPLES RESULTS MUST BE SUBMITTED TO THE DISTRICT. NO REMOVAL OF THIS MATERIAL OTHER THEN ATTACHMENT OR PENETRATION IS ALLOWED EXCEPT WHEN CONDUCTED BY A WCSD ES&A SUPERVISED ASBESTOS ABATEMENT CONTRACTOR.</p> <p><u>NON-ASBESTOS GYPSUM BOARD BUILDING SYSTEM AREAS – (SEE ATTACHED DRAWING LAST PAGE)</u> BUILDING “A”, “B”, & “C” HAS NON-ASBESTOS CONTAINING GYPSUM BOARD BUILDING SYSTEM PRESENT, OK TO DISTURB.</p> <p><u>ASBESTOS REQUIREMENTS</u> IF THE CONTRACTOR MUST DISTURB THE ASBESTOS CONTAINING AREAS IDENTIFIED ABOVE, THE CONTRACTOR IS RESPONSIBLE AND AUTHORIZED TO CONDUCT ATTACHMENT, PENETRATION (DRILLING OF HOLES) & REMOVAL OF SCREWS OR ANCHORS ONLY. THE CONTRACTOR IS REQUIRED TO SUBMIT A DISTURBANCE PROCEDURE TO THE ES&A DEPARTMENT AND RECEIVE APPROVAL PRIOR TO CONDUCTING ANY DISTURBANCE TO THIS MATERIAL.. THE PROCEDURE WILL INCLUDE ALL WCSD DISTRICT MINIMUM ASBESTOS MATERIAL DISTURBANCE REQUIREMENTS. NOTIFY THE WCSD ES&A DEPARTMENT AT 325-8590 OF ANY ASBESTOS DISTURBANCE PRIOR TO DISTURBANCE.</p> <p>IF ASBESTOS ABATEMENT IS IDENTIFIED AS A PART OF THIS PROJECT, THE ABATEMENT MUST BE SCHEDULED AT LEAST TWO WEEKS IN ADVANCE WITH THE PROJECT MANAGER AND THE ES&A DEPARTMENT. MOST ABATEMENT PROJECTS CANNOT BE COMPLETED WHEN SCHOOL IS IN SESSION. DELAYS DUE TO ABATEMENT ISSUES OR SCHEDULES MAY BE ENCOUNTERED.</p>	

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

ITEM #2	MATERIAL DESCRIPTION: BLOCK/MORTAR
AHERA MATERIAL NUMBER: M-02B	CONTAINS ASBESTOS ?: NO
<p>MATERIAL DISTURBANCE INSTRUCTIONS: THE BLOCK/MORTAR HAS BEEN SAMPLED IN ACCORDANCE WITH AHERA AND ASTM PROTOCOLS AND DOES NOT CONTAIN ASBESTOS. OK TO DISTURB. COMPLETE SURVEY RESULTS AVAILABLE UPON REQUEST.</p>	

ITEM #3	MATERIAL DESCRIPTION: CONCRETE
AHERA MATERIAL NUMBER: M-02C	CONTAINS ASBESTOS ?: UNKNOWN
<p>MATERIAL DISTURBANCE INSTRUCTIONS: CONCRETE MAY CONTAIN ASBESTOS. CONTRACTOR MUST TREAT THIS MATERIAL AS ASBESTOS CONTAINING AND IN ACCORDANCE WITH ALL APPLICABLE REGULATIONS AND DISTRICT ASBESTOS MATERIAL DISTURBANCE REQUIREMENTS UNLESS THIS MATERIAL HAS BEEN PROPERLY SAMPLED BY THE DISTRICT TO DETERMINE IT DOES NOT CONTAIN ASBESTOS. IN ADDITION, ALL CONCRETE CONTAINS SILICA SO IF THE CONTRACTOR MUST DRILL, CUT, ABRADE, OR GRIND THIS MATERIAL, THE CONTRACTOR MUST ALSO COMPLY WITH THE FEDERAL SILICA REGULATION AND REQUIREMENTS.</p>	

ITEM #4	MATERIAL DESCRIPTION: METAL BUILDING MATERIALS
AHERA MATERIAL NUMBER: M-03	CONTAINS ASBESTOS ?: NO
<p>MATERIAL DISTURBANCE INSTRUCTIONS: OK TO DISTURB.</p>	

ITEM #5	MATERIAL DESCRIPTION: TRANSITE PIPE
AHERA MATERIAL NUMBER: M-04P	CONTAINS ASBESTOS ?: YES
<p>MATERIAL DISTURBANCE INSTRUCTIONS: CONTRACTOR IS RESPONSIBLE FOR THE DISTURBANCE AND REMOVAL OF DAMAGED TRANSITE PIPE AS REQUIRED TO PERFORM REPAIR/INSTALLATION PROPERLY. CONTRACTOR WILL ONLY UTILIZE WORKERS WITH A MINIMUM OF 16 HOURS OF ASBESTOS TRAINING. AND ABSOLUTELY NO CUTTING OF THE PIPE IS AUTHORIZED. ONLY SNAP CUTTING CAN BE CONDUCTED AND THE CONTRACTOR MUST COMPLY WITH ALL LOCAL, STATE AND FEDERAL REGULATIONS. THE PIPE MUST BE DISPOSED OF PROPERLY TO INCLUDE IMMEDIATE WRAPPING WITH TWO LAYERS OF 6 MIL POLY ON THE SITE UPON REMOVAL. ANY DISTURBANCE MUST BE NOTIFIED TO ES&A AT 325-8590 IMMEDIATELY PRIOR TO DISTURBANCE.</p>	

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

ITEM #6	MATERIAL DESCRIPTION: WOOD BUILDING PRODUCTS
AHERA MATERIAL NUMBER: M-06	CONTAINS ASBESTOS ?: NO
<u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> OK TO DISTURB.	

ITEM #7	MATERIAL DESCRIPTION: WOOD/METAL DOOR
AHERA MATERIAL NUMBER: M-08	CONTAINS ASBESTOS ?: NO
<u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> OK TO DISTURB.	

ITEM #8	MATERIAL DESCRIPTION: CEILING TILE
AHERA MATERIAL NUMBER: M-10	CONTAINS ASBESTOS ?: NO
<u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> OK TO DISTURB.	

ITEM #9	MATERIAL DESCRIPTION: FLOOR TILE AND MASTIC
AHERA MATERIAL NUMBER: M-12 & M-12A	CONTAINS ASBESTOS ?: NO
<u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> OK TO DISTURB.	

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

ITEM #10	MATERIAL DESCRIPTION: BASE COVE AND MASTIC
AHERA MATERIAL NUMBER: M-13	CONTAINS ASBESTOS ?: NO
<p><u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> THIS MATERIAL DOES NOT CONTAIN ASBESTOS BUT THE PAINTS AND COATING ON THE WALLS DOES CONTAIN LEAD. IF THIS BASE COVE MUST BE REMOVED, AS A PART OF A FLOORING PROJECT, THE CONTRACTOR MUST COMPLY WITH DISTRICT SUPPLIED BASE COVE LEAD REMOVAL SPECIFICATIONS PROVIDED BY THE DISTRICT'S HIRED LEAD CONSULTANT. IN ADDITION, THE DISTRICT HIRED LEAD CONSULTANT WILL BE REQUIRED TO WATCH THE BASE COVE REMOVAL. THE CONTRACTOR MUST SCHEDULE ALL DISTURBANCES WITH THE DISTRICT'S LEAD CONSULTANT AND NO DISTURBANCE CAN BE CONDUCTED WHEN THEY ARE NOT THERE.</p>	

ITEM #11	MATERIAL DESCRIPTION: SHEET VINYL AND MASTIC
AHERA MATERIAL NUMBER: M-14	CONTAINS ASBESTOS ?: NO
<p><u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> OK TO DISTURB.</p>	

ITEM #12	MATERIAL DESCRIPTION: CARPET AND MASTIC
AHERA MATERIAL NUMBER: M-15	CONTAINS ASBESTOS ?: NO
<p><u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> VERIFY THAT NO FLOOR TILE IS PRESENT UNDER CARPET. OK TO DISTURB IF NO TILE IS PRESENT. IF TILE IS PRESENT REFER AND COMPLY WITH ALL MATERIAL INSTRUCTION IDENTIFIED FOR MATERIAL #M-12, FLOOR TILE AND MASTIC. NO REMOVAL OF CARPET GLUED TO FLOOR TILES IS AUTHORIZED.</p>	

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

ITEM #13	MATERIAL DESCRIPTION: FIBERGLASS BUILDING INSULATION
AHERA MATERIAL NUMBER: M-17	CONTAINS ASBESTOS ?: NO
<u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> OK TO DISTURB.	

ITEM #14	MATERIAL DESCRIPTION: ASBESTOS FIRE DAMPER-INSIDE HEAT DUCTS
AHERA MATERIAL NUMBER: M-23	CONTAINS ASBESTOS ?: YES
<u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> DO NOT DISTURB. THIS MATERIAL IS LOCATED IN THE HEAT DUCTS.	

ITEM #15	MATERIAL DESCRIPTION: ASBESTOS PIPE INSULATION
AHERA MATERIAL NUMBER: T-40	CONTAINS ASBESTOS ?: YES
<u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> DURING THE PLANNING STAGES, NO EXPOSED ASBESTOS PIPE INSULATION WAS FOUND THAT REQUIRED ABATEMENT AS A PART OF THIS PROJECT. IT IS POSSIBLE THAT THROUGH THE PROCESS OF COMPLETING THIS PROJECT, ASBESTOS CONTAINING PIPE INSULATION MAY BE FOUND IN WALLS OR INACCESSIBLE SPACES OR OTHER AREAS THAT MUST BE ABATED. IF THAT IS THE CASE, THE ABATEMENT OF THIS MATERIAL MUST BE TREATED AS A CHANGE ORDER AND THE ABATEMENT AND COST FOR ABATEMENT MUST BE NEGOTIATED WITH THE PROJECT MANAGER. ANY ABATEMENT MUST BE SUPERVISED BY THE DISTRICT AND DONE IN ACCORDANCE WITH ALL DISTRICT ABATEMENT REQUIREMENTS	

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

ITEM #16	MATERIAL DESCRIPTION: FIBERGLASS PIPE INSULATION
AHERA MATERIAL NUMBER: T-41	CONTAINS ASBESTOS ?: NO
<p><u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> OK TO DISTURB HOWEVER IF HARD ELBOWS ARE ENCOUNTERED THESE CANNOT BE DISTURBED. HARD ELBOWS CONTAIN ASBESTOS.</p>	

ITEM #17	MATERIAL DESCRIPTION: PLUMBING/MECHANICAL GASKETS
AHERA MATERIAL NUMBER: N/A	CONTAINS ASBESTOS ?: YES
<p><u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> PLUMBING AND MECHANICAL GASKETS HAVE BEEN FOUND TO CONTAIN ASBESTOS IN THE DISTRICT. THE CONTRACTOR MUST ASSUME ANY GASKET THAT NEEDS TO BE REMOVED OR DISTURBED CONTAINS ASBESTOS AND THE CONTRACTOR IS RESPONSIBLE TO HIRE AN ASBESTOS CONTRACTOR THAT WILL BE SUPERVISED BY THE DISTRICT TO PROPERLY REMOVE (AS PER DISTRICT ASBESTOS ABATEMENT SPECIFICATIONS AND/OR DISTRICT HIRED ASBESTOS CONSULTANT SPECIFICATIONS) OR CUT OUT THOSE GASKETS AND DISPOSE OF AS ASBESTOS CONTAINING MATERIALS. THE CONTRACTOR IS RESPONSIBLE FOR VISITING THE SITE AND DETERMINING IF ANY GASKETS NEED REMOVAL OR WILL BE DISTURBED PRIOR TO BIDDING AND THIS COST IS TO BE ADDED TO THE PRICE PROVIDED TO THE DISTRICT BY THE CONTRACTOR TO COMPLETE THE ABOVE DESIGNATED PROJECT. ABATEMENT MUST BE COMPLETED WHEN SCHOOL IS UNOCCUPIED. DELAYS DUE TO ABATEMENT ISSUES OR SCHEDULES MAY BE ENCOUNTERED. NOTIFY THE WCSD ES&A DEPARTMENT AND ANY DISTRICT HIRED ASBESTOS CONSULTANT TO SCHEDULE ANY REQUIRED ABATEMENT AT LEAST TWO WEEKS IN ADVANCE PRIOR TO REMOVAL.</p>	

ITEM #	MATERIAL DESCRIPTION: TACKABLE SURFACES - TACK BOARD
AHERA MATERIAL NUMBER: N/A	CONTAINS ASBESTOS ?: NO
<p><u>MATERIAL DISTURBANCE INSTRUCTIONS:</u> THE TACKABLE SURFACES - TACK BOARD HAS BEEN SAMPLED IN ACCORDANCE WITH AHERA AND ASTM PROTOCOLS AND DOES NOT CONTAIN ASBESTOS. OK TO DISTURB. COMPLETE SURVEY RESULTS AVAILABLE UPON REQUEST.</p>	

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

ITEM #18	MATERIAL DESCRIPTION: ROOFING MATERIALS
AHERA MATERIAL NUMBER: N/A	CONTAINS ASBESTOS ?: YES/NO
<p>MATERIAL DISTURBANCE INSTRUCTIONS: ROOFING MATERIALS MATERIALS IDENTIFIED ON THIS PROJECTS DRAWINGS HAVE BEEN SAMPLED AND THEY DO CONTAIN ASBESTOS. ASBESTOS ABATEMENT OF THIS MATERIAL IS REQUIRED AND THE SUCCESSFUL BIDDER IS REQUIRED TO HIRE AN ASBESTOS ABATEMENT CONTRACTOR THAT WILL BE SUPERVISED BY A DISTRICT HIRED ASBESTOS CONSULTANT. REFER TO THE PROJECT DRAWINGS WHICH WILL IDENTIFY THE LOCATIONS WHICH WILL REQUIRE ABATEMENT AND COMPLY WITH PROJECT ABATEMENT SPECIFICATIONS. <u>THE PROJECT DRAWINGS ARE NOT PROVIDED TO IDENTIFY ALL OF THE LOCATIONS OF THIS MATERIAL, RATHER JUST IDENTIFY AREAS THAT HAVE BEEN SLATED FOR ABATEMENT ON THIS PROJECT.</u> THE ASBESTOS ABATEMENT MUST BE SCHEDULED AT LEAST TWO WEEKS IN ADVANCE WITH THE PROJECT MANAGER AND THE <u>ES&A DEPARTMENT</u>. THIS ABATEMENT PROJECTS CANNOT BE COMPLETED WHEN SCHOOL IS IN SESSION. DELAYS DUE TO ABATEMENT ISSUES OR SCHOOL SCHEDULES MAY BE ENCOUNTERED.</p> <p>ATTACHMENT AND PENETRATION ABOVE AND BEYOND THE FULL ABATEMENT MAY BE REQUIRED. IF REQUIRED, THE CONTRACTOR IS REQUIRED TO PERFORM ALL ATTACHMENT AND/OR PENETRATION IN ACCORDANCE WITH THE ASBESTOS DISTURBANCE INSTRUCTION LISTED BELOW.</p> <p><u>ASBESTOS REQUIREMENTS</u></p> <p>IF THE CONTRACTOR MUST DISTURB THIS MATERIAL THE CONTRACTOR IS RESPONSIBLE AND AUTHORIZED TO CONDUCT ATTACHMENT, PENETRATION (DRILLING OF HOLES) & REMOVAL OF SCREWS OR ANCHORS ONLY. 16 HOUR AHERA ASBESTOS TRAINED PERSONNEL MUST BE UTILIZED AND PERSONAL AIR MONITORING MUST BE CONDUCTED THROUGHOUT ANY DISTURBANCES. A HEPA VACUUM MUST BE ON SITE AND USED TO CLEAN ALL DEBRIS. BEFORE PERFORMING A DISTURBANCE, THE CONTRACTOR MUST SUBMIT AN ASBESTOS DISTURBANCE PROCEDURE TO THE ES&A DEPARTMENT. THE ASBESTOS DISTURBANCE PROCEDURE MUST RECEIVE APPROVAL BY THE ES&A DEPARTMENT PRIOR TO THE CONTRACTOR BEING ABLE TO CONDUCT ANY ASBESTOS DISTURBANCES. TO BE APPROVED, THE CONTRACTOR'S SUBMITTED PROCEDURE MUST INCLUDE ALL OF THE WCSD, ES&A DEPARTMENT, AND MINIMUM ASBESTOS MATERIAL DISTURBANCE REQUIREMENTS. WHEN CONDUCTING DISTURBANCES, THE CONTRACTORS TECHNICIAN MUST</p>	

NOTE: THE ASBESTOS MATERIAL DISTURBANCE INSTRUCTIONS LISTED ABOVE ARE BASED ON THE AHERA REGULATION. THERE MAY EXIST OTHER REGULATIONS THAT MAY BE MORE STRINGENT THEN THESE RECOMMENDATIONS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE COMPLIANCE WITH ALL REGULATIONS THAT ARE APPLICABLE TO THE DISTURBANCE OF ASBESTOS/LEAD CONTAINING MATERIALS. ASBESTOS IS A MICROSCOPIC FIBER AND THE CLEANING OF ASBESTOS DEBRIS MUST BE CONDUCTED TO A MICROSCOPIC LEVEL. IN THE EVENT THAT ANY VISIBLE DEBRIS IS DISCOVERED FROM A DISTURBANCE OR AIR SAMPLING RESULTS ARE NOT PROVIDED TO THE DISTRICT, THE DISTRICT WILL IMMEDIATELY HIRE A THIRD PARTY LEAD/ASBESTOS CONSULTANT TO INVESTIGATE POSSIBLE LEAD/ASBESTOS CONTAMINATION AND AN LEAD/ASBESTOS ABATEMENT CONTRACTOR TO PERFORM ANY RECOMMENDED CLEAN-UP. THE CONTRACTOR WILL BE REQUIRED TO REIMBURSE THE DISTRICT FOR ALL COSTS INCURRED. IF AIR MONITORING IS REQUIRED, AIR MONITORING MUST BE CONDUCTED THROUGHOUT THE PROJECT. AIR MONITORING RESULTS FAXED DIRECTLY FROM THE LAB TO THE ES&A DEPARTMENT @ 851-5695, WITHIN 48 HOURS OF THE DISTURBANCE

DATE ISSUED: December 3, 2024

WASHOE COUNTY SCHOOL DISTRICT MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT CONTINUATION PAGE – SCHOOL #130

Material Water & Lead Disturbance Permit, Water System Disturbance Permit Appendix Page #1

Contractors, their sub-contractors or workers are responsible in completing all work without impacting the water quality of District facilities and the domestic water supplies which feed district facilities. This Water System Disturbance Permit identifies the minimum requirements that Contractors, their sub-contractors and all workers will utilize to perform disturbance to the Districts water systems.

The following general requirements shall apply to any person who will be disturbing a District water system. In addition, they must contact the Environmental, Safety and Assessment Department (ES&A Dept) prior to any disturbance at 325-8494. This phone number has an answering machine and can be accessed 24 hours a day. These disturbances will be logged in and documented by the ES&A department.

All requirements for isolation are designed to protect the facility's potable water source from existing as well as potential cross-connections and to prevent any backflow occurrences in the form of backpressure or backsiphonage. The Water Disturbance Procedures listed are not site or incident specific and great care must be taken by technicians during all valving and isolation activities within a facility to prevent a potential backflow occurrence. There may be additional requirements that must be utilized to prevent any cross-connection or backflow occurrence, and each entity performing the disturbance is responsible for ensuring none occur and utilizing any additional steps as necessary to ensure none result from the completion of this project.

Any costs to correct any cross-connections and/or any backflow occurrences that result from the performance of this project are solely the responsibility of the Contractor, their sub-contractor and workers and the signing of this ES&A Department Disturbance Permit on acknowledges and agrees to this requirement.

FACILITY ISOLATION MINIMUM REQUIREMENTS

MECHANICAL ROOMS:

When turning off or disrupting the water service to a mechanical room all applicable requirements below must be conducted per this permit

1. Remove all hoses from custodial faucets and bibs in location to be effected.
2. Shut down all boiler and chiller circulating pumps. Heating, Cooling and Domestic.
3. Shut down boiler, chiller and cooling tower if present.
4. Isolate boiler, cooling tower, chiller and relieve pressure from boiler.
5. Shut down hot water return pump, isolate any hot water heaters and turn off heating source.
6. Isolate domestic service to mechanical room.
7. Re-establish service to mechanical room in reverse order.

BASIC WING:

When turning off or disrupting the water service to a facility wing all applicable requirements below must be conducted per this permit

1. Remove all hoses from custodial, art and science faucets along with bibs in location to be effected.
2. Isolate all water utilizing chemical dispensers in location to be effected.
3. Shut down and isolate any water using equipment if applicable. Hot water heaters, domestic make ups for heat exchangers, photo labs, etc.
4. Isolate domestic cold water main to wing.
5. Re-establish service to wing in reverse order. Flush system at the end of each lateral to remove any and all foreign material and air.

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

Material Water & Lead Disturbance Permit, Water System Disturbance Permit Appendix Page #2

FACILITY:

When turning off or disrupting the water service to a facility all applicable requirements below must be conducted per this permit. Turning off or disturbing the waters services to a facility should only be done as a last resort. If it is possible to isolate the area of disturbance without disrupting facilities entire water service that is the way the project is to be accomplished. This will also keep the contractor, his sub-contractors or workers from having to perform all the listed requirements.

1. Remove all hoses from custodial, art and science faucets along with bibs in entire facility.
2. Isolate mechanical room. See above requirements.
3. Isolate each individual wing where possible. See above requirements.
4. Isolate all irrigation laterals connected to the domestic potable water supply.
5. Isolate domestic cold water main at all locations present to allow as little drain back as possible.
6. Re-establish service to facility in reverse order. Flush system at the end of each lateral to remove any foreign material and air.

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

PAINTS AND COATINGS – Material Disturbance Permit Appendix - Lead in Paints and Coatings in WCSD Facilities

Lead containing paints and coating are present in WCSD facilities. Bidders/Contractors that disturb lead containing or potentially lead containing paints or coatings, by law, are required to know all applicable regulations applicable and comply with all state and federal regulations that apply to the disturbances to lead paints and coating they are conducting. The regulations that requires by a contractor to be properly trained and knowledgeable, related to lead disturbance includes, but is not limited to the following:

- OSHA Regulation CFR 1926.62 – Lead & Appendix A, B, C, & D – Lead Construction Standard.
- OSHA Regulation CFR 1910. 1025 - Lead & Appendix A, B, C, & D – General Industry Standard.
- EPA, 40 CFR Part 745 – Lead; Renovation, Repair, and Painting Regulation.

Bidders/Contractors accept and acknowledge by signing this Material Disturbance Permit, the existence of lead related regulations, and accept all liability related to the disturbance of lead containing materials, citation resulting from, or any other costs the District may incur by the action of all parties of the bidders company or companies hired by the successful bidder to complete this project.

CONSTRUCTION AGE OF BUILDINGS AT THIS FACILITY

Lead sampling has shown that lead containing paints, coatings and ceramic tiles **DO** routinely exist, even in our newest facilities even constructed after 1978. Since age does not determine the presence of lead, Contractors need the date a facility was constructed to determine if the RR&P rule applies. To that end, we are providing construction date information for RR&P applicability. There are 2 lead category's tables addressed in this lead portion of the permit: The category 1 table addresses buildings built **before** 1978 and Category 2 table addresses buildings built **after** 1978

LEAD CATEGORY #1	PAINTS, COATINGS & CERAMIC TILE IN BUILDINGS CONSTRUCTED BEFORE 1978
CONTAINS LEAD?: YES/NO – for NO see Appendix 1	Buildings: “A”, “B”, & “D”
<p><u>Lead Containing or Assumed Lead Containing Paints and Coatings Disturbance Instructions</u> If project lead specific paints and coating sampling has been requested by the District Project Manager, and completed by the ES&A department for this project, the results of that lead sampling are attached at the end of this permit. It is titled: Project Specific Lead Sampling Results – Appendix #1. The Contractor <u>must</u> treat all paints and coating as lead containing in the buildings except any exclusions on Appendix #1 and comply with all lead requirements. Contractor must plan and bid accordingly.</p> <p><u>OSHA Requirements</u> All persons performing <u>any</u> disturbance to coatings or paints to paints and coating in and on the buildings listed above must have taken an OSHA lead action level training class from a WCSD, ES&A department approved training provider, and utilize lead safe work practices. In addition, all work must be completed, as a minimum, utilizing the lead safe work practices identified in the EPA guidance document titled “steps to lead safe renovation, repair and painting”, pages 12 thru 23. This document is available electronically at the following link: HTTP://WWW.EPA.GOV/LEAD/PUBS/STEPS.PDF.</p> <p><u>EPA Renovation, Repair and Painting Regulation Requirements</u> In general, all firms that disturb 6 square feet of painted surface in a room or 20 square feet on the exterior within a 30 day period in <u>this</u> facility must comply with the EPA’s Renovation, Remodel and Repair (RR&P) regulation and must be registered with the federal EPA. Per the Regulation, the area of disturbance is calculated, by adding up the entire surface areas being removed/disturbed, which then determines the amount of painted surface area disturbed. Work that involves window replacement or demolition of a painted surface, the RR&P regulation applies regardless of size. This regulation also requires that the contractor must assign a RR&P trained supervisor that is responsible for ensuring and documenting all work is conducted in compliance with the RR&P regulation and there are extensive record keeping and notification requirements that the Contractor must perform. In addition, This is a general overview of the regulation and the contractor must refer to regulation for additional requirements and information. Fines are expensive and the compliance with this regulation rests solely on the Contractor so it is very important that Bidders/Contractors are well versed in this regulation.</p> <p>– CONTINUED SEE NEXT PAGE #10</p>	

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

LEAD CATEGORY #1	PAINTS, COATINGS & CERAMIC TILE IN BUILDINGS CONSTRUCTED BEFORE 1978
CONTAINS LEAD?: YES/NO – for NO see Appendix 1	Buildings: “A”, “B”, & “D”
<p>– CONTINUED FROM PAGE #9</p> <p><u>WCSD Requirements</u></p> <p>In addition to regulatory requirements, the WCSD has requirements that must be met by the Contractor/Bidder. The contractor is responsible for submitting to the ES&A department lead disturbance procedures that outline the lead safe work practices to be utilized and that procedure must comply with the Districts minimum lead disturbance requirements. The current minimum lead disturbance requirements, which will apply to this project, follow these tables.</p> <p>OSHA action level training and RR&P training certification and RR&P firm certification must be submitted to the project manager and they are to submit a copy to the ES&A department. The ES&A department must review, verify, and approve all required documentation prior to the contractor being able to perform any disturbance, so time for review must be taken into account when developing schedules. Once the ES&A department has approved the procedures and training and firm certification, the contractor may proceed but they must notify the ES&A department at 325-8490 of any paint/coating disturbance immediately disturbance prior to the disturbance. ES&A department personnel, project managers and assistant project managers and other district personnel will spot check in the field, to ensure compliance with the contractors submitted and approved procedures. Refer to section listed below regarding lead sampling that may be available.</p>	

LEAD CATEGORY #2	PAINTS, COATINGS & CERAMIC TILE IN BUILDINGS CONSTRUCTED AFTER 1978
CONTAINS LEAD?: YES/NO – for NO see Appendix 1	Buildings: “C”
<p><u>Lead Containing or Assumed Lead Containing Paints and Coatings Disturbance Instructions</u></p> <p>If project lead specific paints and coating sampling has been requested by the District Project Manager, and completed by the ES&A department for this project, the results of that lead sampling are attached at the end of this permit. It is titled: Project Specific Lead Sampling Results – Appendix #1. The Contractor must treat all paints and coating as lead containing in the buildings except any exclusions on Appendix #1 and comply with all lead requirements. Contractor must plan and bid accordingly.</p> <p><u>RR&P Regulation</u> - The building(s) listed above in Lead Category #2 were/was constructed after 1978, so the EPA RR&P regulation does not apply to these buildings.</p> <p><u>Material Disturbance instructions:</u> The buildings listed above was/were constructed after 1978 and lead sampling has verified that the paints and coating at this facility, other than exclusions listed above, do indeed contain lead. The Contractor must comply with all Lead Containing or Assumed Lead Containing Paints and Coatings Disturbance Instructions requirements listed in Lead Category 1 (if present) above or as listed below. No additional sampling is to be done by the district or the Contractor. Contractor must plan and bid accordingly.</p>	

WASHOE COUNTY SCHOOL DISTRICT MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT CONTINUATION PAGE – SCHOOL #130

A NOTE ABOUT SAMPLING AND SAMPLING REQUEST PROCEDURES

Only approximately 20% of the paints and coatings in the District have been found to contain lead. The majority of white and off-white paints on sheetrock and block walls does not contain lead in facilities constructed after approx. 1990. Brighter or more colorful paints/coatings on any surface, or all paints and coatings on metals, are much more likely to be found to contain lead in all facilities. In addition, ceramic tile in any age facility is very likely to contain lead. It is highly recommended that sampling be done to confirm lead content unless time does not allow a delay for processing samples through the WCSD ES&A department. If paints and coatings are not sampled, all paints and coatings must be assumed to be lead containing, above 5000 parts per million (lead based), and treated in accordance with all lead regulations, lead specifications, and requirements identified in this permit.

The process to request lead sampling is for anyone requiring sampling to submit through their project's Project Manager. The designated WCSD Project Manager will submit the required sampling forms, and sampling will be coordinated by the ES&A department. A minimum of 10 days will be allowed before sampling results are provided to the Project Manager for them to be distributed to all interested parties. All lead sampling must be processed through the ES&A department, and sampled by ES&A approved and trained lead professionals.

If project lead specific paints and coatings sampling has been requested by the District Project Manager, and completed by the ES&A department, the results of that lead sampling will be attached at the end of this permit. It will be titled: Project Specific Lead Sampling Results – Appendix #1. If there is no Project Specific Lead Sampling Results – Appendix #1 attached that means no project specific lead sampling has been requested and the Contractor must utilize only the information provided in the lead instructions of this permit.

Any paints or coatings that are not specifically addressed on this permit, or on the project drawings, has to be assumed to be lead containing, and above 5000 parts per million (lead based) – no exceptions. Any disturbance to those paints and coatings not specifically addressed on this permit or on the project drawings must be done by properly trained (Minimum of OSHA action level training) personnel, and those disturbances must be performed in accordance with all lead requirements listed in this permit, as well as any applicable regulations and local requirements. Many times scope modifications are required after the bid, and new areas of the facility may need to be disturbed. These areas would not have been addressed on this permit, since they were unknown at the time of issuance. Additional sampling could be conducted by requesting lead sampling through their project's Project Manager, but there will be a delay getting sampling requests and a new MDP would be required. The District reserves the right to direct the Contractor to assume new paints and coatings, due to scope changes, are lead containing and the contractor would then be required to treat all paints and coatings as lead containing in compliance with all requirements of this permit.

REPLACEMENT PAINTS, COATINGS, CERAMIC TILE, AND OTHER LEAD CONTAINING MATERIALS

Unless otherwise specifically allowed by this projects specifications, the Contractor shall not reinstall any lead containing paints/coatings in any detectable levels during the process of completing this project. "lead containing" is defined as any paint or coating that has ANY detectable lead level when paint chip sampling is conducted and chip is analyzed by the ICP method. The District may perform sampling of replacement materials and if analysis finds any detectable levels of lead, the Contractor will be liable for all costs to properly remove that material and re-apply paints and coatings with no detectable levels of lead. Contractors are encouraged to pre-sample paints they may be using to determine the actual amount in paint/coatings used.

WASHOE COUNTY SCHOOL DISTRICT MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT CONTINUATION PAGE – SCHOOL #130

MINIMUM REQUIREMENTS TO PERFORM ATTACHMENTS AND PENETRATIONS IN WCSD FACILITIES

Below are the minimum requirements to perform any Attachment and Penetration activity to a known or assumed asbestos and/or lead containing material in Washoe County School District (WCSd) facilities. This document is not provided to address demolition, stabilization, abatement, or removal activities. If any work to known or assumed asbestos or lead materials need to be done on this project, and it is anything other than the installation of screws, the removal of screws, or the drilling of holes, the successful bidder must comply with, in addition to these minimum requirements, all applicable District asbestos and lead specifications and requirements. Regarding these procedures, the District has done its best to provide a complete and regulatory compliant attachment and penetration procedure, but by signing this MDP, the Contractor acknowledges that it is the successful bidder's sole responsibility for compliance with this MDP, as well as any other applicable regulatory requirements.

ASBESTOS/LEAD PROCEDURE SUBMISSION PROCESS

Prior to starting this project, each contractor working on this project is required to submit to the WCSd ES&A department an asbestos/lead procedure that includes all District requirements listed below. To simplify the procedure submittal process, an electronic PDF fillable template of these requirements will be provided to the successful bidder of this project. This document is available by contacting the assigned WCSd Capital Projects Project Manager for this project. Contractors must utilize the most current above-mentioned electronic template and fill out all required information, add company letterhead, sign, and date the document. The completed procedures will be e-mailed to the Project Manager by all contractors working on this project that will performing any applicable disturbances. Once submitted, the WCSd Project Manager will pass the document onto the ES&A department for approval. Successful bidders are required to add time to their project schedule for this procedure submittal and approval process.

The Contractor has the option to submit a site-specific or blanket district-wide applicable procedure. A district-wide blanket procedure applies to a scheduled project, as well as all future sites where a contractor will be performing disturbances. The site specific procedure will apply to just one site or project. District-wide procedures are valid for one year from the date the procedure is signed by the ES&A department. Site specific procedures will be valid for the term of the project. Each Contractor must receive a signed and approved procedure prior to performing any disturbances to all asbestos/lead paint or assumed asbestos/lead paint materials. The procedure is a combined procedure and it addresses both asbestos and lead disturbances. A minimum of one work day will be required by the ES&A department for the review and approval process.

In addition to the Material Disturbance Permit (MDP), the Contractors must also have a copy of the approved procedures on site at all times. The purpose of this procedure is to document the agreement between the Contractor and the District that all lead and asbestos disturbances performed by staff of the Contractor will be done per all noted District requirements, District Specifications, and project specifications. Again, Contractors must ensure that their procedure has been approved, and the approved signed procedure is on site prior to any disturbance.

MINIMUM REQUIREMENTS

1. Receive approved Lead/Asbestos procedures as identified above.
2. Technicians performing disturbances will be required to have a minimum of AHERA 16 Hour O&M training and OSHA action level training per 29 CFR 1926.62 (i) (2) lead training. In addition, as applicable, contractors must comply with the EPA RR&P training and certifications requirements listed in the RR&P section of this appendix. Copies of training certifications, including a refresher within the last 12 months, will be provided to the ES&A Department **prior** to the start of any project. Only personnel with the proper minimum training will be authorized to perform any disturbance to asbestos/lead paint or assumed asbestos/lead paint containing materials, or be in the adjacent area of a disturbance.
3. Notify the ES&A Department at **325-8490** and leave a message with the time, name of the technician doing the work, date and exact locations in the school where they will be performing any disturbance. This call should take place immediately prior to disturbance, this phone number (**325-8490**) will go to voice mail, and the contractors are to provide notifications with above identified information, 24 hours a day. The Contractor is also required to notify their assigned WCSd Construction Department Project Managers and Assistant Project Managers of scheduled disturbances so they can also verify compliance with the contractors approved disturbance procedures.

WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130

4. Contractors must refer to this Material Disturbance Permit to determine what materials contain asbestos or lead and utilize the applicable lead/asbestos procedures. Some materials cannot be disturbed, and each specific material disturbance permit will identify what can be disturbed and provided material disturbance instructions. The minimum disturbance permits in this section of the material permit are in addition to any requirements listed in the material disturbance instructions. Any instance where 100% of the minimum asbestos/lead requirements are not followed, the District will immediately hire an environmental remediation contractor as well as an environmental consultant to properly clean up the contamination and perform air sampling. The contractor will be responsible for reimbursing the District for all costs due to any improper or unauthorized disturbances.
5. Contractors or technicians who are new to performing asbestos/lead paint or assumed asbestos/lead paint disturbances for the District must contact the Capital Projects PM/PCI Department and schedule a disturbance. A Capital Projects PM/PCI employee will be scheduled to review the technician's compliance with the disturbance procedures in the field. Once a technician has demonstrated on a minimum of two (2) occasions to the Capital Projects Department that he has an understanding of the District disturbance requirements and has proper equipment, the ES&A Department will then authorize that technician to perform disturbances without prior approval of the Capital Projects Department. Notifications prior to starting all disturbances as listed above will still be required and technicians should expect unannounced random compliance inspections, from the ES&A Department. A list of approved technicians is available upon request from the ES&A department.
6. Post the appropriate "Danger Lead - Keep Out" or "Danger Asbestos Keep Out" signs on the entry side of all doors leading into classrooms, hallways, bathrooms, offices or mechanical rooms where drilling is to occur. Doors will be closed. It is the contractor /technician's responsibility to take adequate means to keep the public or school staff out of the disturbance area.
7. Large rooms, such as multipurpose rooms, will have yellow caution tape placed across all entries to the room in addition to signage but access to these areas must be restricted to ensure no unprotected person can enter the areas where disturbances are taking place. If unprotected personnel can see the activity, this is not a large enough area of demarcation.
8. A 6 ml plastic drop will be placed under the disturbance in a manner that extends 6' out in all directions from the disturbance area. This poly drop can be reused if properly wet-wiped or HEPA-vacuumed off after use.
9. Worker will don the respiratory protection and a protective suit, (protective suits are optional for lead disturbance, "attachments and penetration" disturbances if the Contractor will not exceed the lead action level) and initiate personal air monitoring procedures per item #10 below. Respiratory protection is required throughout all asbestos/lead paint or assumed asbestos/lead paint disturbances in WCSD regardless of air sampling results.
10. If a Contractor is performing a **lead** attachments and penetrations (see the definition in #20 below), air sampling will be conducted at the start of the project. If air sampling results show the technicians performing the work is below the OSHA Lead Action Level, air sampling can be suspended unless the work being performed is changed. Air sampling will be performed for each type of lead attachment and penetration activity to develop a representative sample for each lead activity. Air sampling will be performed during **all** asbestos disturbances, no exceptions.
11. Drill the hole or holes as required using an HEPA VAC and a shrouded or dust collecting apparatus (i.e. Bit Buddy. A HEPA VAC is to remain running during this whole process to ensure all debris is cleared from hole. All clean-up must be conducted the HEPA Vacuum. If a contractor fails to properly control the asbestos/lead containing dust, the District will then hire an environmental remediation contractor as well as an environmental consultant to properly clean up the contamination. The contractor will be responsible for reimbursing the District for all costs due to improper disturbances that result in debris exiting the area of disturbance.
12. All HEPA vacuums used will have been DOP challenge tested prior to first use and annually thereafter. If this project involves 30 or more disturbances over the span of this project, the HEPA vacuum will be DOP tested on-site prior to the start of the project.

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

13. If required, to be determined by the technician, an encapsulant material may be sprayed or brushed on to the area of the holes.
14. A device, backing, box or raceway, or any other equipment will then be mounted using anchors installed per #11 above, with the HEPA VAC running and properly directed at the area of the disturbance.
15. A HEPA VAC or wet methods will be used to clean up any debris on 6ml poly drop, around device box, technician's suit, and any surfaces below holes, such as tops of chalkboards and base boards.
16. The poly drop, if utilized, will be folded into itself in such a manner as to not spread any debris, the HEPA vacuum hose sealed, and personal air monitoring time logged appropriately. This poly drop can be reused if it is properly wet-wiped or HEPA-vacuumed off after use.
17. All signs and equipment are to be removed, and the technician is to move to the next location. The contaminated suit should be removed and a new suit utilized at the new disturbance location, unless the suit can be properly decontaminated.
18. Upon completion of a shift, air samples will be dated and sent in to a properly accredited lab to be analyzed. Results will be forwarded to WCSD. Lab results will be e-mailed directly from the lab to the ES&A Department within 48 hours of the disturbance. All lab results will reference the Material Disturbance Permit (MDP) # located on the top of the first page of this permit. Results without the MDP number prefix will be returned to the lab for clarification and the addition of the MDP tracking number
19. All debris, waste, poly drop, suits, etc. will be placed in 6 mil poly waste bags (double bagged) and disposed of properly.
20. The definition of "Attachment and Penetrations" in this document is only the drilling of holes through a HEPA shrouded device, the installation of screws through a HEPA shrouded device, or the removal of screws through a HEPA shrouded device. Any other activity that is not attachments and penetrations as listed in item #20 must be designed by an asbestos or lead project designer, done per a lead specification, and supervised by the District or District hired outside asbestos/lead consultant. Contractors cannot perform any work, other than "Attachments and Penetrations" without an onsite District or District hired asbestos or Lead Consultant being present.
21. All asbestos abatement or lead disturbances, other than "Attachment and Penetrations", must be completed in full compliance with applicable regulations, the District's Asbestos Abatement Specifications, and District hired asbestos or lead consultants supplement specifications. If in error, an asbestos abatement bid or quote is put forth without the District Asbestos Abatement Specifications, Contractors are required to request a copy of the most current asbestos abatement specifications from the bid or quote entity through the formal bid inquiry process

THE UNDERSIGNED AGREES TO COMPLY WITH THE CONDITIONS OF THIS MATERIAL, WATER & LEAD DISTURBANCE PERMIT, APPENDIXES, & ALL APPLICABLE REGULATIONS. UNDERSIGNED ACKNOWLEDGES LIABILITY FOR ANY COSTS THE DISTRICT MAY INCUR TO INVESTIGATE & CLEAN UP ANY DISCOVERY OF IMPROPER AND/OR UNAUTHORIZED DISTURBANCES DONE BY UNDERSIGNED'S EMPLOYEE(S) OR SUB-CONTRACTOR(S) TO MATERIALS LISTED AS LEAD/ASBESTOS-CONTAINING BY THE DISTRICT. IN ADDITION, THE UNDERSIGNED AGREES TO ALL REQUIREMENTS OF THE WATER & LEAD APPENDIX.

SIGNED BY (PRINT): _____ SIGNATURE: _____

COMPANY (PRINT): _____





DATE RECEIVED: _____

WASHOE COUNTY SCHOOL DISTRICT MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT CONTINUATION PAGE – SCHOOL #130

File: N:\WASHNO08\10\WASHNO0810026.dwg Time: Apr 20, 2009 - 1:33pm

#130

Section	Site (S, N)	Roof System	Roof Membrane	Year Installed	Manufacturer	Wfg. Warranty Expires	Wfg. Warranty Phase	Collector	Collector Warranty Expires	Collector Warranty Phase	Estimated Replacement
East & Center Buildings and Walkway	24,640	Modified Bitumen	SSS Modified	2001	Johns Manville	-	-	Center Roofing	-	-	11+ years
West Building	16,130	Built-up	Asphalt	1981	Unknown	-	-	Unknown	-	-	2012
South Building	7,320	Built-up	Asphalt	1972	Unknown	-	-	Unknown	-	-	2009

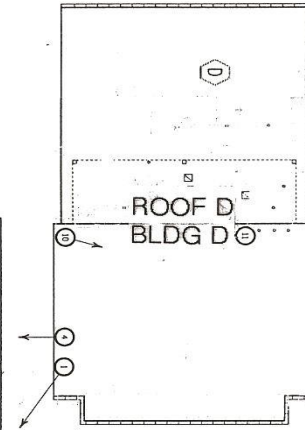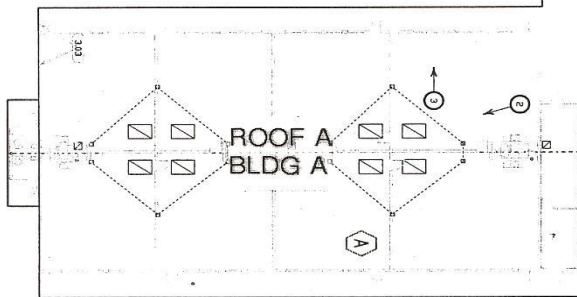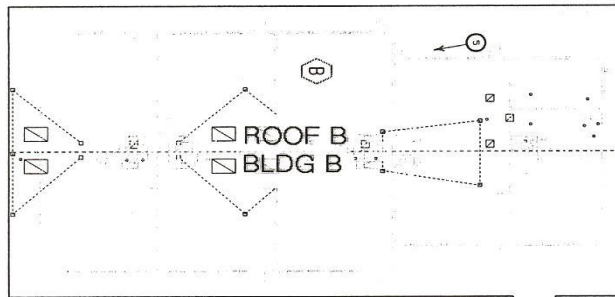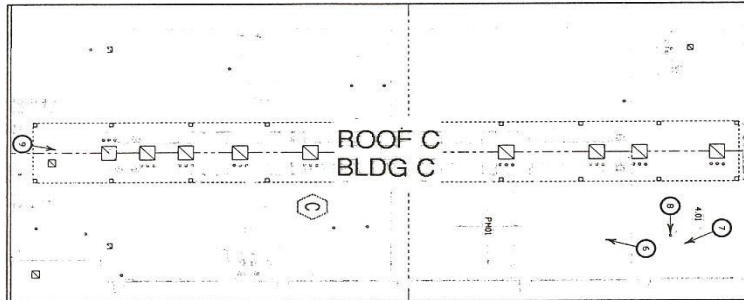

ACTION CODE LEGEND

1	PERMANENT REMOVAL
2	ASBESTOS REMOVAL
3	PERMANENT REMOVAL
4	PERMANENT REMOVAL
5	PERMANENT REMOVAL
6	PERMANENT REMOVAL
7	PERMANENT REMOVAL
8	PERMANENT REMOVAL
9	PERMANENT REMOVAL
10	PERMANENT REMOVAL
11	PERMANENT REMOVAL
12	PERMANENT REMOVAL
13	PERMANENT REMOVAL
14	PERMANENT REMOVAL
15	PERMANENT REMOVAL
16	PERMANENT REMOVAL
17	PERMANENT REMOVAL
18	PERMANENT REMOVAL
19	PERMANENT REMOVAL
20	PERMANENT REMOVAL
21	PERMANENT REMOVAL
22	PERMANENT REMOVAL
23	PERMANENT REMOVAL
24	PERMANENT REMOVAL
25	PERMANENT REMOVAL
26	PERMANENT REMOVAL
27	PERMANENT REMOVAL
28	PERMANENT REMOVAL
29	PERMANENT REMOVAL
30	PERMANENT REMOVAL
31	PERMANENT REMOVAL
32	PERMANENT REMOVAL
33	PERMANENT REMOVAL
34	PERMANENT REMOVAL
35	PERMANENT REMOVAL
36	PERMANENT REMOVAL
37	PERMANENT REMOVAL
38	PERMANENT REMOVAL
39	PERMANENT REMOVAL
40	PERMANENT REMOVAL
41	PERMANENT REMOVAL
42	PERMANENT REMOVAL
43	PERMANENT REMOVAL
44	PERMANENT REMOVAL
45	PERMANENT REMOVAL
46	PERMANENT REMOVAL
47	PERMANENT REMOVAL
48	PERMANENT REMOVAL
49	PERMANENT REMOVAL
50	PERMANENT REMOVAL
51	PERMANENT REMOVAL
52	PERMANENT REMOVAL
53	PERMANENT REMOVAL
54	PERMANENT REMOVAL
55	PERMANENT REMOVAL
56	PERMANENT REMOVAL
57	PERMANENT REMOVAL
58	PERMANENT REMOVAL
59	PERMANENT REMOVAL
60	PERMANENT REMOVAL
61	PERMANENT REMOVAL
62	PERMANENT REMOVAL
63	PERMANENT REMOVAL
64	PERMANENT REMOVAL
65	PERMANENT REMOVAL
66	PERMANENT REMOVAL
67	PERMANENT REMOVAL
68	PERMANENT REMOVAL
69	PERMANENT REMOVAL
70	PERMANENT REMOVAL
71	PERMANENT REMOVAL
72	PERMANENT REMOVAL
73	PERMANENT REMOVAL
74	PERMANENT REMOVAL
75	PERMANENT REMOVAL
76	PERMANENT REMOVAL
77	PERMANENT REMOVAL
78	PERMANENT REMOVAL
79	PERMANENT REMOVAL
80	PERMANENT REMOVAL
81	PERMANENT REMOVAL
82	PERMANENT REMOVAL
83	PERMANENT REMOVAL
84	PERMANENT REMOVAL
85	PERMANENT REMOVAL
86	PERMANENT REMOVAL
87	PERMANENT REMOVAL
88	PERMANENT REMOVAL
89	PERMANENT REMOVAL
90	PERMANENT REMOVAL
91	PERMANENT REMOVAL
92	PERMANENT REMOVAL
93	PERMANENT REMOVAL
94	PERMANENT REMOVAL
95	PERMANENT REMOVAL
96	PERMANENT REMOVAL
97	PERMANENT REMOVAL
98	PERMANENT REMOVAL
99	PERMANENT REMOVAL
100	PERMANENT REMOVAL

SYMBOL LEGEND

1	PERMANENT REMOVAL
2	PERMANENT REMOVAL
3	PERMANENT REMOVAL
4	PERMANENT REMOVAL
5	PERMANENT REMOVAL
6	PERMANENT REMOVAL
7	PERMANENT REMOVAL
8	PERMANENT REMOVAL
9	PERMANENT REMOVAL
10	PERMANENT REMOVAL
11	PERMANENT REMOVAL
12	PERMANENT REMOVAL
13	PERMANENT REMOVAL
14	PERMANENT REMOVAL
15	PERMANENT REMOVAL
16	PERMANENT REMOVAL
17	PERMANENT REMOVAL
18	PERMANENT REMOVAL
19	PERMANENT REMOVAL
20	PERMANENT REMOVAL
21	PERMANENT REMOVAL
22	PERMANENT REMOVAL
23	PERMANENT REMOVAL
24	PERMANENT REMOVAL
25	PERMANENT REMOVAL
26	PERMANENT REMOVAL
27	PERMANENT REMOVAL
28	PERMANENT REMOVAL
29	PERMANENT REMOVAL
30	PERMANENT REMOVAL
31	PERMANENT REMOVAL
32	PERMANENT REMOVAL
33	PERMANENT REMOVAL
34	PERMANENT REMOVAL
35	PERMANENT REMOVAL
36	PERMANENT REMOVAL
37	PERMANENT REMOVAL
38	PERMANENT REMOVAL
39	PERMANENT REMOVAL
40	PERMANENT REMOVAL
41	PERMANENT REMOVAL
42	PERMANENT REMOVAL
43	PERMANENT REMOVAL
44	PERMANENT REMOVAL
45	PERMANENT REMOVAL
46	PERMANENT REMOVAL
47	PERMANENT REMOVAL
48	PERMANENT REMOVAL
49	PERMANENT REMOVAL
50	PERMANENT REMOVAL
51	PERMANENT REMOVAL
52	PERMANENT REMOVAL
53	PERMANENT REMOVAL
54	PERMANENT REMOVAL
55	PERMANENT REMOVAL
56	PERMANENT REMOVAL
57	PERMANENT REMOVAL
58	PERMANENT REMOVAL
59	PERMANENT REMOVAL
60	PERMANENT REMOVAL
61	PERMANENT REMOVAL
62	PERMANENT REMOVAL
63	PERMANENT REMOVAL
64	PERMANENT REMOVAL
65	PERMANENT REMOVAL
66	PERMANENT REMOVAL
67	PERMANENT REMOVAL
68	PERMANENT REMOVAL
69	PERMANENT REMOVAL
70	PERMANENT REMOVAL
71	PERMANENT REMOVAL
72	PERMANENT REMOVAL
73	PERMANENT REMOVAL
74	PERMANENT REMOVAL
75	PERMANENT REMOVAL
76	PERMANENT REMOVAL
77	PERMANENT REMOVAL
78	PERMANENT REMOVAL
79	PERMANENT REMOVAL
80	PERMANENT REMOVAL
81	PERMANENT REMOVAL
82	PERMANENT REMOVAL
83	PERMANENT REMOVAL
84	PERMANENT REMOVAL
85	PERMANENT REMOVAL
86	PERMANENT REMOVAL
87	PERMANENT REMOVAL
88	PERMANENT REMOVAL
89	PERMANENT REMOVAL
90	PERMANENT REMOVAL
91	PERMANENT REMOVAL
92	PERMANENT REMOVAL
93	PERMANENT REMOVAL
94	PERMANENT REMOVAL
95	PERMANENT REMOVAL
96	PERMANENT REMOVAL
97	PERMANENT REMOVAL
98	PERMANENT REMOVAL
99	PERMANENT REMOVAL
100	PERMANENT REMOVAL



REV. NO.	DATE	BY
1	04/20/09	CLM
2	04/20/09	CLM
3	04/20/09	CLM
4	04/20/09	CLM
5	04/20/09	CLM
6	04/20/09	CLM
7	04/20/09	CLM
8	04/20/09	CLM
9	04/20/09	CLM
10	04/20/09	CLM
11	04/20/09	CLM
12	04/20/09	CLM
13	04/20/09	CLM
14	04/20/09	CLM
15	04/20/09	CLM
16	04/20/09	CLM
17	04/20/09	CLM
18	04/20/09	CLM
19	04/20/09	CLM
20	04/20/09	CLM
21	04/20/09	CLM
22	04/20/09	CLM
23	04/20/09	CLM
24	04/20/09	CLM
25	04/20/09	CLM
26	04/20/09	CLM
27	04/20/09	CLM
28	04/20/09	CLM
29	04/20/09	CLM
30	04/20/09	CLM
31	04/20/09	CLM
32	04/20/09	CLM
33	04/20/09	CLM
34	04/20/09	CLM
35	04/20/09	CLM
36	04/20/09	CLM
37	04/20/09	CLM
38	04/20/09	CLM
39	04/20/09	CLM
40	04/20/09	CLM
41	04/20/09	CLM
42	04/20/09	CLM
43	04/20/09	CLM
44	04/20/09	CLM
45	04/20/09	CLM
46	04/20/09	CLM
47	04/20/09	CLM
48	04/20/09	CLM
49	04/20/09	CLM
50	04/20/09	CLM
51	04/20/09	CLM
52	04/20/09	CLM
53	04/20/09	CLM
54	04/20/09	CLM
55	04/20/09	CLM
56	04/20/09	CLM
57	04/20/09	CLM
58	04/20/09	CLM
59	04/20/09	CLM
60	04/20/09	CLM
61	04/20/09	CLM
62	04/20/09	CLM
63	04/20/09	CLM
64	04/20/09	CLM
65	04/20/09	CLM
66	04/20/09	CLM
67	04/20/09	CLM
68	04/20/09	CLM
69	04/20/09	CLM
70	04/20/09	CLM
71	04/20/09	CLM
72	04/20/09	CLM
73	04/20/09	CLM
74	04/20/09	CLM
75	04/20/09	CLM
76	04/20/09	CLM
77	04/20/09	CLM
78	04/20/09	CLM
79	04/20/09	CLM
80	04/20/09	CLM
81	04/20/09	CLM
82	04/20/09	CLM
83	04/20/09	CLM
84	04/20/09	CLM
85	04/20/09	CLM
86	04/20/09	CLM
87	04/20/09	CLM
88	04/20/09	CLM
89	04/20/09	CLM
90	04/20/09	CLM
91	04/20/09	CLM
92	04/20/09	CLM
93	04/20/09	CLM
94	04/20/09	CLM
95	04/20/09	CLM
96	04/20/09	CLM
97	04/20/09	CLM
98	04/20/09	CLM
99	04/20/09	CLM
100	04/20/09	CLM

**WASHOE COUNTY SCHOOL DISTRICT
MATERIAL, WATER, AND LEAD DISTURBANCE PERMIT
CONTINUATION PAGE – SCHOOL #130**

Project Specific Lead Sampling Results – Appendix #1.

A limited project lead-specific paints and coatings survey has been conducted. The sampling has been requested by the District Project Manager, and completed by the ES&A department. The results of that lead sampling are below. The results listed below apply ONLY to the locations and paint and coating colors listed below. This information cannot be applied to other areas that are not specifically addressed below. If additional sampling is required in the Contractor's opinion, the Contractor must relay that information to the District Project Manager. The Project Manager will determine if additional sampling will be conducted. If additional sampling will be done, a new MDP will be required. Contractors or their representatives cannot perform any asbestos or lead sampling.

Any paints or coatings that are not specifically addressed on this permit, or on the project drawings, has to be assumed to be lead containing, and above 5000 parts per million (lead based) – no exceptions. Any disturbance to those paints and coatings not specifically addressed on this permit, or on the project drawings must be done by properly trained (Minimum of OSHA action level training) personnel, and those disturbances must be performed in accordance with all lead requirements listed in this permit, as well as any applicable regulations and local requirements. Many times scope modifications are required after the bid, and new areas of the facility may need to be disturbed. These areas would not have been addressed on this permit, since they were unknown at the time of issuance. Additional sampling could be conducted by requesting lead sampling through their project's Project Manager, but there will be a delay getting sampling requests and a new MDP would be required. The District reserves the right to direct the Contractor to assume new paints and coatings, due to scope changes, are lead containing and the contractor would then be required to treat all paints and coatings as lead containing in compliance with all requirements of this permit.

LEAD CONTAINING PAINTS AND COATING

<u>LOCATION</u>	<u>TYPE OF PAINTED SURFACE</u>	<u>COLOR</u>	<u>RESULTS</u>
<u>No sampling requested so all paints and coatings must be treated as lead containing</u>			

NON-LEAD CONTAINING PAINTS AND COATINGS

<u>LOCATION</u>	<u>TYPE OF PAINTED SURFACE</u>	<u>COLOR</u>	<u>RESULTS</u>
No Sampling Requested			

December 7, 2022

Mr. John Nolan, Director
Environmental, Safety, and Assessment
Washoe County School District
14101 Old Virginia Road
Reno, NV 89521

Dear Mr. Nolan:

This letter and the attached documents comprise the asbestos and lead survey information for roof areas at Washoe County School District's Gomm Elementary School, located at 4000 Mayberry Drive in Reno, Nevada. This survey was revised in preparation for an upcoming rooftop units replacement project on Sections A, B, and C. Sampling for asbestos and lead was performed previously by Hazard Management Services, Inc. (HMS) and the results have been incorporated as applicable into this report.

Sampling of roof materials and painted components during this survey was performed by Daniel Prado and Ryan Hettich of Forensic Analytical Consulting Services, Inc. (FACS) on November 14 and 17, 2022. This survey was completed in a manner which meets the requirements of the US EPA National Emissions Standard for Hazardous Air Pollutants and Nevada Division of Industrial Relations regulations.

The initial site inspection was performed by Chris Chipponeri of HMS on September 22, 2009.

During the summer of 2009, Roof Section D was abated by Advance Installations, Inc. HMS, Inc. personnel collected samples of the new roofing system installed.

During the summer of 2015, Roof Section C was abated by D & D Roofing & Sheet Metal, Inc.

Bulk asbestos samples collected during this inspection were given a unique number, identified on a chain-of-custody, packaged and sent via FedEx to SGS-Forensic Laboratories (SGS-FL) in Hayward, California. SGS-FL is accredited by the National Institute of Standards and Technology's National Voluntary Laboratory Accreditation Program for the analysis of bulk asbestos fibers by polarized light microscopy.

Bulk lead paint chip samples were collected from paints that may be impacted by roof replacement or repair projects. Each bulk sample was given a unique number, identified on a chain-of-custody, packaged and sent via FedEx to SGS-Forensic Laboratories (SGS-FL) in Carson, California for analysis. SGS-FL is accredited by the American Industrial Hygiene Association's Environmental Lead Laboratory Accreditation Program for the analysis of bulk lead paint chips by inductively coupled plasma.

Asbestos Results

For the current roofing materials at this site, the following materials sampled were found to contain asbestos by laboratory analysis:

- Silver Paint & Mastic (Section B)
- Penetration Mastic – Grey/Black (Sections A-C)

Asbestos-containing roof materials shall only be disturbed by personnel with proper asbestos training using asbestos work practices. The waste created shall be disposed of as a non-hazardous asbestos-containing

material, unless made friable. If made friable by removal methods, the material shall be disposed of as a regulated asbestos-containing material. Materials that contain asbestos cannot be recycled.

All other materials on Sections A-D have been sampled and do not contain asbestos by laboratory analysis.

Lead Results

For the current roofing materials at this site, the following paints/coatings were found to be lead-containing by laboratory analysis by inductively coupled plasma or flame atomic absorption spectroscopy:

- Green Paint on Metal Flashing (Sections A-D)
- Off-White Paint on Metal Enclosure (Sections A-C)
- Tan Paint on Metal Units (Sections A-C)
- Silver Paint on Metal Boiler Stack (Section B)

In addition, approximately twenty-seven (27) lead pipe flues were identified on Roof Sections A-C.

Paints that contain a detectable concentration of lead shall only be impacted by personnel with OSHA Lead Action Level training using lead-safe work practices. No paint chips shall be allowed to fall onto unprotected surfaces and if this occurs, the area shall be HEPA-vacuumed clean immediately. All lead containing waste must be characterized prior to disposal to determine proper waste disposal requirements. Materials that are lead-containing may also be recycled, but the lead-content of such materials shall be disclosed to the recycling facility prior to submittal of materials for recycling.

Current Washoe County Air Quality Management Division (WCAQMD) policies would require additional sampling of materials on multiple roof sections at this site prior to any disturbance.


Thank you for the opportunity to perform this inspection. If you have any questions, please contact me at (775) 993-7389 or via e-mail at dprado@forensicanalytical.com.

Sincerely,



Daniel Prado
Project Manager, Reno Office
Nev. Lic. No. IJPM-2057
US EPA LBP-R-1214705-1

Reviewed by:



Chris Chipponeri
Local Director, Central Valley Offices
Nev. Lic. No. IJPM-1410
US EPA LBP-R-128230-2

Bulk Material Analysis Request Form

Date: 11-18-2022 Contact Name: Daniel Prado
Collected by: Daniel Prado & Ryan Hettich Bill: RN12
Date Collected: 11-14-22 & 11-17-2022 Type of Analysis: PLM w/ Dispersion Staining
Laboratory: SGS Forensic Laboratories Turnaround Time: 5 Day

Job ID: PJ73123
Job Site: WCSD – Gomm Elementary School
Special:
Instructions:
Send Results: dprado@forensicanalytical.com

Sample ID	Results	Material Description and Location
PJ73123-01A		Rolled Comp Roofing – Grey/Black
		Section A – NE Corner
PJ73123-01B		Rolled Comp Roofing – Grey/Black
		Section A – S Side Center at Enclosure
PJ73123-01C		Rolled Comp Roofing – Grey/Black
		Section A – N Side Center on South Small Roof
PJ73123-01D		Rolled Comp Roofing – Grey/Black
		Section B – NE Corner
PJ73123-01E		Rolled Comp Roofing – Grey/Black
		Section B – Center at North Enclosure
PJ73123-01F		Rolled Comp Roofing – Grey/Black
		Section B – Center at South Enclosure
PJ73123-01G		Rolled Comp Roofing – Grey/Black
		Section B – SW Corner
PJ73123-02A		Rolled Comp Roofing – Grey
		Section C – N Side Center at HVAC Curb
PJ73123-02B		Rolled Comp Roofing – Grey
		Section C – S Side Center at HVAC Curb
PJ73123-02C		Rolled Comp Roofing – Grey
		Section C – NE Corner

Submitted By: _____

Date: 11/18/2022

Received By: _____


Date: _____




Bulk Material Analysis Request Form

Date: 11-18-2022
Collected by: Daniel Prado & Ryan Hettich
Date Collected: 11-14-22 & 11-17-2022
Laboratory: SGS Forensic Laboratories
Contact Name: Daniel Prado
Bill: RN12
Type of Analysis: PLM w/ Dispersion Staining
Turnaround Time: 5 Day
Job ID: PJ73123
Job Site: WCSD – Gomm Elementary School
Special Instructions:
Send Results: dprado@forensicanalytical.com

Sample ID	Results	Material Description and Location
PJ73123-02D		Rolled Comp Roofing – Grey
		Section C – E Side Center
PJ73123-02E		Rolled Comp Roofing – Grey
		Section C – W Side Center
PJ73123-03A		Rolled Comp Patch – Grey
		Section A – W Side Center
PJ73123-03B		Rolled Comp Patch – Grey
		Section A – N Side W End
PJ73123-03C		Rolled Comp Patch – Grey
		Section B – N Side Center
PJ73123-04A		Rubberized Roofing – Black
		Section A – NW at Overhang
PJ73123-04B		Rubberized Roofing – Black
		Section A – NW at Overhang
PJ73123-04C		Rubberized Roofing – Black
		Section B – NE at Overhang
PJ73123-05A		Penetration Mastic – Grey/Black
		Section A – Center at Curb
PJ73123-05B		Penetration Mastic – Grey/Black
		Section B – Center at North Enclosure

Submitted By:  Date: 11/18/2022

Received By:  Date: _____

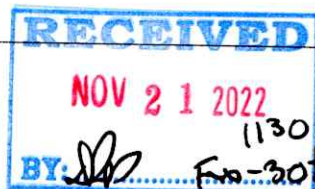

Bulk Material Analysis Request Form

Date: 11-18-2022
Collected by: Daniel Prado & Ryan Hettich
Date Collected: 11-14-22 & 11-17-2022
Laboratory: SGS Forensic Laboratories
Contact Name: Daniel Prado
Bill: RN12
Type of Analysis: PLM w/ Dispersion Staining
Turnaround Time: 5 Day
Job ID: PJ73123
Job Site: WCSD – Gomm Elementary School
Special:
Instructions:
Send Results: dprado@forensicanalytical.com

Sample ID	Results	Material Description and Location
PJ73123-05C		Penetration Mastic – Grey/Black
		Section C – Center of Roof
PJ73123-06A		Penetration Mastic – White
		Section A – Center at South Enclosure
PJ73123-06B		Penetration Mastic – White
		Section B – N Side W End
PJ73123-06C		Penetration Mastic – White
		Section C – S Side Center
PJ73123-07A		Foil Tape & Mastic
		Section A – Center at North Enclosure
PJ73123-07B		Foil Tape & Mastic
		Section B – Center at North Enclosure
PJ73123-07C		Foil Tape & Mastic
		Section C – S Side E End of Enclosure

Submitted By:  Date: 11/18/2022

Received By:  Date: _____





Bulk Asbestos Analysis

(EPA Method 40CFR, Part 763, Appendix E to Subpart E and EPA 600/R-93-116, Visual Area Estimation)

NVLAP Lab Code: 101459-0

Forensic Analytical Consulting Svcs
Daniel Prado
3777 Depot Road
Suite 413
Hayward, CA 94545

Client ID: FACS00
Report Number: B341148
Date Received: 11/21/22
Date Analyzed: 11/30/22
Date Printed: 11/30/22
First Reported: 11/30/22

Job ID/Site: PJ73123; Washoe County School District - Capital Projects & Planning Gomes
Elementary School 4000 Mayberry Reno NV

SGSFL Job ID: FACS00
Total Samples Submitted: 27
Total Samples Analyzed: 27

Date(s) Collected:

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
-----------	------------	------------------	---------------------	------------------	---------------------	------------------	---------------------

PJ73123-01A

12622136

Layer: Black Tar	ND
Layer: Black Felt	ND
Layer: Black Tar	ND
Layer: Black Felt	ND
Layer: Black Tar	ND
Layer: Black Felt	ND
Layer: Black Tar	ND
Layer: Black Felt	ND

Total Composite Values of Non-Asbestos Fibrous Components:

Cellulose (2 %) Fibrous Glass (45 %)

Comment: Bulk complex sample.

PJ73123-01B

12622137

Layer: Black Tar	ND
Layer: Black Felt	ND
Layer: Black Tar	ND
Layer: Black Felt	ND
Layer: Black Tar	ND
Layer: Black Felt	ND
Layer: Black Tar	ND
Layer: Black Felt	ND
Layer: Tan Fibrous Material	ND

Total Composite Values of Non-Asbestos Fibrous Components:

Cellulose (2 %) Fibrous Glass (45 %)

Comment: Bulk complex sample.

Client Name: Forensic Analytical Consulting Svcs

Report Number: B341148

Date Printed: 11/30/22

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
PJ73123-01C	12622138						
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Total Composite Values of Non-Asbestos Fibrous Components:							
Cellulose (2 %) Fibrous Glass (45 %)							
Comment: Bulk complex sample.							
PJ73123-01D	12622139						
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Tan Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components:							
Cellulose (2 %) Fibrous Glass (45 %)							
Comment: Bulk complex sample.							
PJ73123-01E	12622140						
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Tan Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components:							
Cellulose (2 %) Fibrous Glass (45 %)							
Comment: Bulk complex sample.							

Client Name: Forensic Analytical Consulting Svcs

Report Number: B341148

Date Printed: 11/30/22

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
PJ73123-01F	12622141						
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Tan Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components:							
Cellulose (2 %) Fibrous Glass (45 %)							
Comment: Bulk complex sample.							
PJ73123-01G	12622142						
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Total Composite Values of Non-Asbestos Fibrous Components:							
Cellulose (2 %) Fibrous Glass (45 %)							
Comment: Bulk complex sample.							
PJ73123-02A	12622143						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: White Foam			ND				
Total Composite Values of Non-Asbestos Fibrous Components:							
Cellulose (2 %) Fibrous Glass (30 %) Synthetic (10 %)							
Comment: Bulk complex sample.							

Client Name: Forensic Analytical Consulting Svcs

Report Number: B341148

Date Printed: 11/30/22

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
PJ73123-02B	12622144						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Mastic			ND				
Layer: White Foam			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (2 %) Fibrous Glass (30 %) Synthetic (10 %) Comment: Bulk complex sample.							
PJ73123-02C	12622145						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: White Semi-Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (2 %) Fibrous Glass (30 %) Synthetic (10 %) Comment: Bulk complex sample.							
PJ73123-02D	12622146						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: White Semi-Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (2 %) Fibrous Glass (30 %) Synthetic (10 %) Comment: Bulk complex sample.							

Client Name: Forensic Analytical Consulting Svcs

Report Number: B341148

Date Printed: 11/30/22

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
PJ73123-02E	12622147						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: White Semi-Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (2 %) Fibrous Glass (30 %) Synthetic (10 %) Comment: Bulk complex sample.							
PJ73123-03A	12622148						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (2 %) Fibrous Glass (45 %) Comment: Bulk complex sample.							
PJ73123-03B	12622149						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (2 %) Fibrous Glass (45 %) Comment: Bulk complex sample.							

Client Name: Forensic Analytical Consulting Svcs

Report Number: B341148

Date Printed: 11/30/22

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
PJ73123-03C	12622150						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (2 %) Fibrous Glass (45 %) Comment: Bulk complex sample.							
PJ73123-04A	12622151						
Layer: Black Non-Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-04B	12622152						
Layer: Black Non-Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-04C	12622153						
Layer: Black Non-Fibrous Material			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-05A	12622154						
Layer: Black Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (15 %) Synthetic (5 %)							
PJ73123-05B	12622155						
Layer: Black Mastic		Chrysotile	10 %				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-05C	12622156						
Layer: Black Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (15 %) Synthetic (5 %)							
PJ73123-06A	12622157						
Layer: White Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							

Client Name: Forensic Analytical Consulting Svcs

Report Number: B341148

Date Printed: 11/30/22

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
PJ73123-06B	12622158						
Layer: White Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-06C	12622159						
Layer: White Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-07A	12622160						
Layer: Silver Tape			ND				
Layer: Black Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-07B	12622161						
Layer: Silver Tape			ND				
Layer: Black Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							
PJ73123-07C	12622162						
Layer: Silver Tape			ND				
Layer: Black Mastic			ND				
Total Composite Values of Non-Asbestos Fibrous Components: Cellulose (Trace)							



Tad Thrower, Laboratory Supervisor, Hayward Laboratory

Note: Limit of Quantification ('LOQ') = 1%. 'Trace' denotes the presence of asbestos below the LOQ. 'ND' = 'None Detected'.

Analytical results and reports are generated by SGS Forensic Laboratories (SGSFL) at the request of and for the exclusive use of the person or entity (client) named on such report. Results, reports or copies of same will not be released by SGSFL to any third party without prior written request from client. This report applies only to the sample(s) tested. Supporting laboratory documentation is available upon request. This report must not be reproduced except in full, unless approved by SGSFL. The client is solely responsible for the use and interpretation of test results and reports requested from SGSFL. SGSFL is not able to assess the degree of hazard resulting from materials analyzed. SGS Forensic Laboratories reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified. All samples were received in acceptable condition unless otherwise noted.

BULK MATERIAL Analysis Request Form for Hazard Management Services, Inc.**PHONE: 209-551-2000****P.O. Box 576848 Modesto, CA 95357-5657****FAX: 209-575-5657****Job I.D. M09015A****CLIENT: Washoe County School District COLLECTED BY: Chris C****DATE COLLECTED: 9/22/09****DATE SUBMITTED: 9/23/09****LAB SUBMITTED TO: FALI****Special Instructions: Please e-mail to: cchipponeri@hazmange.com****ANALYSIS REQUESTED: PLM****TURNAROUND TIME: 48 hr****PROJECT: Gemma ES Roof Sampling**

	SAMPLE #	Material Description/Location	Results
1	HMS-M09015A-01A	Roof core with edge mastic-Bld C	
2	HMS-M09015A-02A	Penetration Mastic-Bld C	
3	HMS-M09015A-03A	Roofing material over pipes-Bld C	
4	HMS-M09015A-04A	Grey penetration sealant-Bld C	
5	HMS-M09015A-05A	Grey paint on metal boiler stack-Bld B	
6	HMS-M09015A-06A	Roof core at peak-Bld B	
7	HMS-M09015A-07A	Roof core at edge-Bld B	
8	HMS-M09015A-08A	Roofing on boiler stack-Bld B	
9	HMS-M09015A-09A	Sealant at HVAC Fence supports-Bld B	
10	HMS-M09015A-10A	Black sealant at HVAC fence supports-Bld B	
11	HMS-M09015A-11A	Roof core in field-Bld A	

Delivered by: CHDate: 9/29/09

Submitted Via:

Received by: JSDate: 9/30/09 10:20am F10Drop Off ☐ Fed Ex ☒ Courier ☐



Bulk Asbestos Analysis

(EPA Method 600/R-93-116, Visual Area Estimation)

Hazard Mgmt Svcs-Modesto/Plst Hill
Chris Chipponeri
PO Box 576848

Modesto, CA 95357-6848

Client ID: 1146
Report Number: B128754
Date Received: 09/30/09
Date Analyzed: 10/01/09
Date Printed: 10/02/09
First Reported: 10/02/09

Job ID/Site: M09015A - Washoe County School District, Gomm ES Roof Sampling

FALI Job ID: 1146

Date(s) Collected: 09/22/2009

Total Samples Submitted: 11

Total Samples Analyzed: 11

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
HMS-M09015A-01A	10907957						
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace)	Fibrous Glass (40 %)	Synthetic (7 %)					
Comment: Bulk complex sample.							
HMS-M09015A-02A	10907958						
Layer: Black Mastic		Chrysotile	3 %				
Layer: Silver Paint			ND				
Total Composite Values of Fibrous Components:		Asbestos (3%)					
Cellulose (Trace)							
HMS-M09015A-03A	10907959						
Layer: Silver Paint		Chrysotile	Trace				
Layer: Black Tar			ND				
Total Composite Values of Fibrous Components:		Asbestos (Trace)					
Cellulose (Trace)							
HMS-M09015A-04A	10907960						
Layer: Grey Non-Fibrous Material			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace)							
HMS-M09015A-05A	10907961						
Layer: Silver Paint			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace)							

Report Number: B128754

Date Printed: 10/02/09

Client Name: Hazard Mgmt Svcs-Modesto/Plst Hill

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
HMS-M09015A-06A	10907962						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Tan Fibrous Material			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (45 %) Fibrous Glass (25 %)							
Comment: Bulk complex sample.							
HMS-M09015A-07A	10907963						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace) Fibrous Glass (45 %)							
Comment: Bulk complex sample.							
HMS-M09015A-08A	10907964						
Layer: Black Semi-Fibrous Tar		Chrysotile	10 %				
Layer: Silver Paint		Chrysotile	2 %				
Total Composite Values of Fibrous Components:		Asbestos (10%)					
Cellulose (Trace) Fibrous Glass (15 %)							
HMS-M09015A-09A	10907965						
Layer: Off-White Non-Fibrous Material			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace)							
HMS-M09015A-10A	10907966						
Layer: Stones			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Black Tar			ND				
Layer: Black Felt			ND				
Layer: Grey Fibrous Material			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (30 %) Fibrous Glass (25 %)							
Comment: Bulk complex sample.							

Client Name: Hazard Mgmt Svcs-Modesto/Plst Hill

Report Number: B128754

Date Printed: 10/02/09

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
HMS-M09015A-11A	10907967						
Layer: Black Non-Fibrous Material			ND				
Layer: Foil			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace)							

Jim Flores

James Flores, Laboratory Supervisor, Hayward Laboratory

Note: Limit of Quantification ('LOQ') = 1%. 'Trace' denotes the presence of asbestos below the LOQ. 'ND' = 'None Detected'.

Analytical results and reports are generated by Forensic Analytical at the request of and for the exclusive use of the person or entity (client) named on such report. Results, reports or copies of same will not be released by Forensic Analytical to any third party without prior written request from client. This report applies only to the sample(s) tested. Supporting laboratory documentation is available upon request. This report must not be reproduced except in full, unless approved by Forensic Analytical. The client is solely responsible for the use and interpretation of test results and reports requested from Forensic Analytical. This report must not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. Government. Forensic Analytical is not able to assess the degree of hazard resulting from materials analyzed. Forensic Analytical reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified. All samples were received in acceptable condition unless otherwise noted.

BULK MATERIAL Analysis Request Form for Hazard Management Services, Inc.**PHONE: 209-551-2000****P.O. Box 576848 Modesto, CA 95357-5657****FAX: 209-575-5657****Job I.D. M09015A****CLIENT: Washoe County School District COLLECTED BY: Chris Chipponeri****DATE COLLECTED: 7-24-09****DATE SUBMITTED: 9-14-09****LAB SUBMITTED TO: FASI****Special Instructions: Please e-mail to: CCHIPPONERI@HAZMANAGE.COM****ANALYSIS REQUESTED: PCM BULK****TURNAROUND TIME: 48HR****Project: GOMMES**

	SAMPLE #	Material Description/Location	Results
1	HMS-M09015A-10PB	WHITE FOAM ROOFING NEW ROOFING MATERIAL	
2	HMS-M09015A-11PB	ASPHALT PAPER NEW ROOFING MATERIAL	
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

Delivered by: Am...Date: 9/14/09

Submitted Via:

Received by: BT FIKDate: 9/17/091030Drop Off ☐ Fed Ex ☐ Courier ☐



Bulk Asbestos Analysis

(EPA Method 600/R-93-116, Visual Area Estimation)

Hazard Mgmt Svcs-Modesto/Plst Hill
Chris Chipponeri
PO Box 576848

Modesto, CA 95357-6848

Client ID: 1146
Report Number: B128317
Date Received: 09/17/09
Date Analyzed: 09/21/09
Date Printed: 09/21/09
First Reported: 09/21/09

Job ID/Site: M09015A - Washoe County School District, Gomm E.S.

FALI Job ID: 1146

Date(s) Collected:

Total Samples Submitted: 2

Total Samples Analyzed: 2

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
HMS-M09015A-10 PB	10904447						
Layer: Off-White Foam			ND				
Layer: Grey Fibrous Material			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (10 %)							
HMS-M09015A-11 PB	10904448						
Layer: Black Semi-Fibrous Material			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace) Fibrous Glass (10 %)							

James Flores, Laboratory Supervisor, Hayward Laboratory

Note: Limit of Quantification ('LOQ') = 1%. 'Trace' denotes the presence of asbestos below the LOQ. 'ND' = 'None Detected'.

Analytical results and reports are generated by Forensic Analytical at the request of and for the exclusive use of the person or entity (client) named on such report. Results, reports or copies of same will not be released by Forensic Analytical to any third party without prior written request from client. This report applies only to the sample(s) tested. Supporting laboratory documentation is available upon request. This report must not be reproduced except in full, unless approved by Forensic Analytical. The client is solely responsible for the use and interpretation of test results and reports requested from Forensic Analytical. This report must not be used by the client to claim product endorsement by NVI/AP or any other agency of the U.S. Government. Forensic Analytical is not able to assess the degree of hazard resulting from materials analyzed. Forensic Analytical reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified. All samples were received in acceptable condition unless otherwise noted.

BULK MATERIAL Analysis Request Form for Hazard Management Services, Inc.

P.O. Box 576848 Modesto, CA 95357-5657

PHONE: 209-551-2000

FAX: 209-575-5657

Job I.D. M09015A

CLIENT: Washoe County School District COLLECTED BY: Chris Chipponeri

DATE COLLECTED: 7-24-09

DATE SUBMITTED: 9-08-09

LAB SUBMITTED TO: FAS


Special Instructions: Please e-mail to: CCHIPPONERI@HAZMANAGE.COM

ANALYSIS REQUESTED: PCM BULK

TURNAROUND TIME: ~~24HR~~ 24 1/2


Project: GOMM E.S.

	SAMPLE #	Material Description/Location	Results
1	HMS-M09015A-010B	BROWN FIBERBOARD ROOFING	
		NEW ROOFING MATERIAL	
2	HMS-M09015A-011B	WHITE FOAM WITH GREY PAPER ROOFING	
		NEW ROOFING MATERIAL	
3	HMS-M09015A-012B	ASPHALT PAPER ROOFING	
		NEW ROOFING MATERIAL	
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

Delivered by: 

Date: 9/29/09

Submitted Via:

Received by: 

Date: 9/9/09 10:20

Drop Off ☐ Fed Ex ☒ Courier



Bulk Asbestos Analysis

(EPA Method 600/R-93-116, Visual Area Estimation)

Hazard Mgmt Svcs-Modesto/Plst Hill
Chris Chipponeri
PO Box 576848

Modesto, CA 95357-6848

Client ID: 1146
Report Number: B128033
Date Received: 09/09/09
Date Analyzed: 09/09/09
Date Printed: 09/10/09
First Reported: 09/10/09

Job ID/Site: M09015A - Washoe County School District, Gomm E. S

FALI Job ID: 1146

Date(s) Collected: 07/24/2009

Total Samples Submitted: 3

Total Samples Analyzed: 3

Sample ID	Lab Number	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer	Asbestos Type	Percent in Layer
HMS-M09015A-010B	10902111						
Layer: Grey Fibrous Material			ND				
Layer: Paint			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (35 %) Fibrous Glass (45 %)							
HMS-M09015A-011B	10902112						
Layer: Off-White Foam			ND				
Layer: Brown Fibrous Material			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (10 %) Fibrous Glass (Trace)							
HMS-M09015A-012B	10902113						
Layer: Black Semi-Fibrous Tar			ND				
Total Composite Values of Fibrous Components:		Asbestos (ND)					
Cellulose (Trace) Synthetic (10 %)							

James Flores, Laboratory Supervisor, Hayward Laboratory



Note: Limit of Quantification ('LOQ') = 1%. 'Trace' denotes the presence of asbestos below the LOQ. 'ND' = 'None Detected'.

Analytical results and reports are generated by Forensic Analytical at the request of and for the exclusive use of the person or entity (client) named on such report. Results, reports or copies of same will not be released by Forensic Analytical to any third party without prior written request from client. This report applies only to the sample(s) tested. Supporting laboratory documentation is available upon request. This report must not be reproduced except in full, unless approved by Forensic Analytical. The client is solely responsible for the use and interpretation of test results and reports requested from Forensic Analytical. This report must not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. Government. Forensic Analytical is not able to assess the degree of hazard resulting from materials analyzed. Forensic Analytical reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified. All samples were received in acceptable condition unless otherwise noted.

Bulk Material Analysis Request Form

Date: 11-18-2022
 Collected by: Daniel Prado & Ryan Hettich
 Date Collected: 11-14-2022 & 11-17-2022
 Laboratory: SGS Forensic Laboratories
 Contact Name: Daniel Prado
 Bill: RN12
 Type of Analysis: ICP for Lead
 Turnaround Time: 5 Day
 Job ID: PJ73123
 Job Site: WCSD – Gomm Elementary School
 Special Instructions: _____
 Send Results: dprado@forensicanalytical.com

Sample ID	Results	Material Description and Location
PJ73123-01PbA		Green Paint on Metal Flashing
		Section A – South Side Center
PJ73123-01PbB		Green Paint on Metal Flashing
		Section B – East Side North End
PJ73123-01PbC		Green Paint on Metal Flashing
		Section C – South Side Center
PJ73123-02PbA		Off White Paint on Metal Enclosure
		Section A – North Center
PJ73123-02PbB		Off White Paint on Metal Enclosure
		Section B – North Side Center
PJ73123-02PbC		Off White Paint on Metal Enclosure
		Section C – Center
PJ73123-03PbA		Tan Paint on Metal Unit
		Section A – North Side Center
PJ73123-03PbB		Tan Paint on Metal Unit
		Section B – North Side Center
PJ73123-03PbC		Tan Paint on Metal Unit
		Section C – North Side Center

Submitted By:  Date: 11/18/2022
 Received By:  Date: 11/21/22 09:15 PM FE

Metals Analysis of Bulks - TTLC

(AIHA-LAP, LLC Accreditation, Lab ID #101629)

Forensic Analytical Consulting Svcs
Daniel Prado
3777 Depot Road
Suite 413
Hayward, CA 94545

Client ID: FACS00
Report Number: M246958
Date Received: 11/21/22
Date Analyzed: 11/30/22
Date Printed: 11/30/22
First Reported: 11/30/22

Job ID / Site: PJ73123; Washoe County School District - Capital Projects & Planning Gomes
Elementary School 4000 Mayberry Reno NV

SGSFL Job ID: FACS00


Date(s) Collected: 11/14/22, 11/17/22

Total Samples Submitted: 9

Total Samples Analyzed: 9

Sample Number	Lab Number	Analyte	Result	Result Units	Reporting Limit*	Method Reference
PJ73123-01PBA	LM238658	Pb	5	mg/kg	3	EPA 3050B/6010B
PJ73123-01PBB	LM238659	Pb	< 20	mg/kg	20	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						
PJ73123-01PBC	LM238660	Pb	< 20	mg/kg	20	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						
PJ73123-02PBA	LM238661	Pb	20	mg/kg	20	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						
PJ73123-02PBB	LM238662	Pb	< 8	mg/kg	8	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						
PJ73123-02PBC	LM238663	Pb	11	mg/kg	8	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						
PJ73123-03PBA	LM238664	Pb	50	mg/kg	20	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						
PJ73123-03PBB	LM238665	Pb	21	mg/kg	6	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						
PJ73123-03PBC	LM238666	Pb	290	mg/kg	6	EPA 3050B/6010B
Comment: Sample submission below recommended weight.						

* The Reporting Limit represents the lowest amount of analyte that the laboratory can confidently detect in the sample, and is not a regulatory level. The Units for the Reporting Limit are the same as the Units for the Final Results.

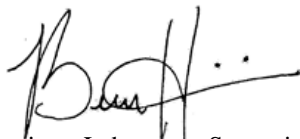

Beatriz Hinojosa, Laboratory Supervisor, Carson Laboratory

Analytical results and reports are generated by SGS Forensic Laboratories at the request of and for the exclusive use of the person or entity (client) named on such report. Results, reports or copies of same will not be released by SGS Forensic Laboratories to any third party without prior written request from client. This report applies only to the sample(s) tested. Supporting laboratory documentation is available upon request. This report must not be reproduced except in full, unless approved by SGS Forensic Laboratories. The client is solely responsible for the use and interpretation of test results and reports requested from SGS Forensic Laboratories. SGS Forensic Laboratories is not able to assess the degree of hazard resulting from materials analyzed. SGS Forensic Laboratories reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified. Any modifications that have been made to referenced test methods are documented in SGS Forensic Laboratories' Standard Operating Procedures Manual. Sample results have not been blank corrected. Quality control and sample receipt condition were acceptable unless otherwise noted.

Note* Sampling data used in this report was provided by the client as noted on the associated chain of custody form.

BULK MATERIAL Analysis Request Form for Hazard Management Services, Inc.**P.O. Box 576848 Modesto, CA 95357-5657****PHONE: 209-551-2000****FAX: 209-575-5657****Job I.D. M09015A****CLIENT: Washoe County School District COLLECTED BY: Chris C****DATE COLLECTED: 9/22/09****DATE SUBMITTED: 9/29/09****LAB SUBMITTED TO: FALI****Special Instructions: Please e-mail to: echipponeri@hazmange.com****ANALYSIS REQUESTED: Flame AA****TURNAROUND TIME: 48 hr****PROJECT: Gamma ES Roof Sampling**

	SAMPLE #	Location / Description	Remarks
1	HMS-M09015A-01Pb	Silver paint on metal boiler stack-Bld B	
2	HMS-M09015A-02Pb	Green paint on metal flashing-Bld B	
3			
4			
5			
6			
7			
8			
9			
10			
11			

Delivered by CLDate: 9/29/09

Submitted Via:

Received by: BPDate: 9/30/09 10:30 amDrop Off ☒ Fed Ex ☐ Courier



Metals Analysis of Paints

Hazard Mgmt Svcs-Modesto/Plst Hill
Chris C.
PO Box 576848

Modesto, CA 95357-6848

Client ID: 1146
Report Number: M106100
Date Received: 09/30/09
Date Analyzed: 10/01/09
Date Printed: 10/01/09
First Reported: 10/01/09

Job ID / Site: M09015A, Washoe County School District, Gomm ES Roof Sampling
Date(s) Collected: 09/29/09

FALI Job ID: 1146
Total Samples Submitted: 2
Total Samples Analyzed: 2

Sample Number	Lab Number	Analyte	Result	Result Units	Reporting Limit*	Method Reference
HMS-M09015A-01PB	30357497	Pb	34	wt%	2	EPA 3050B/7420
HMS-M09015A-02PB	30357498	Pb	< 0.2	wt%	0.2	EPA 3050B/7420

Comment: Insufficient sample size for repeatable analysis.


* The Reporting Limit represents the lowest amount of analyte that the laboratory can confidently detect in the sample, and is not a regulatory level. The Units for the Reporting Limit are the same as the Units for the Final Results.

Dave Sandusky, Laboratory Supervisor, Hayward Laboratory



Analytical results and reports are generated by Forensic Analytical at the request of and for the exclusive use of the person or entity (client) named on such report. Results, reports or copies of same will not be released by Forensic Analytical to any third party without prior written request from client. This report applies only to the sample(s) tested. Supporting laboratory documentation is available upon request. This report must not be reproduced except in full, unless approved by Forensic Analytical. The client is solely responsible for the use and interpretation of test results and reports requested from Forensic Analytical. Forensic Analytical is not able to assess the degree of hazard resulting from materials analyzed. Forensic Analytical reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified. Any modifications that have been made to referenced test methods are documented in Forensic Analytical's Standard Operating Procedures Manual. Sample results have not been blank corrected. Quality control and sample receipt condition were acceptable unless otherwise noted.

Roof Section	Size (Sq. Ft.)	Roof System	Roof Membrane	Year Installed	Manufacturer	Mfgr Warranty Expires	Mfgr Warranty Phone	Contractor	Contractor Warranty Expires	Contractor Warranty Phone	Estimated Replacement
A & B (East & Center Buildings and Walkway)	24,874	Modified Bitumen	SBS Modified	2001	Johns Manville	08/20/2011	(800) 922-5922	Cedar Roofing	-	-	6-10 years
C (West Building)	16,128	Modified Bitumen	SBS modified bitumen	1991	GAF Materials Corporation	07/31/2025	(800) 766-3411	D&D Roofing and Sheet Metal, Inc.	07/31/2017	(775) 685-5555	11+ years
D1 (North Building - Lower Roof)	3,904	Modified Bitumen	Modified bitumen	2009	GAF Materials Corporation	08/17/2009	(800) 766-3411	Kodiak Roofing	08/14/2009	(915) 253-1900	11+ years
D2 (North Building - Upper Roof)	3,661	Modified Bitumen	Modified bitumen	2009	GAF Materials Corporation	08/17/2009	(800) 766-3411	Kodiak Roofing	08/14/2009	(915) 253-1900	11+ years
E (Single Point Entry Corrugated Metal Panel Roof)	336	Architectural Metal Panel	Prefinished aluminum	2013	Unknown	-	-	-	-	-	11+ years

- Lead Containing Paints
- Non-Asbestos Materials
- Asbestos Containing Materials

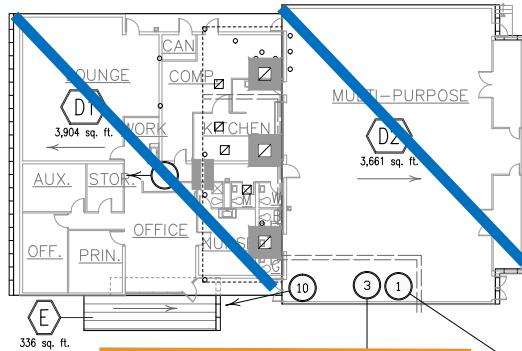

SYMBOL LEGEND

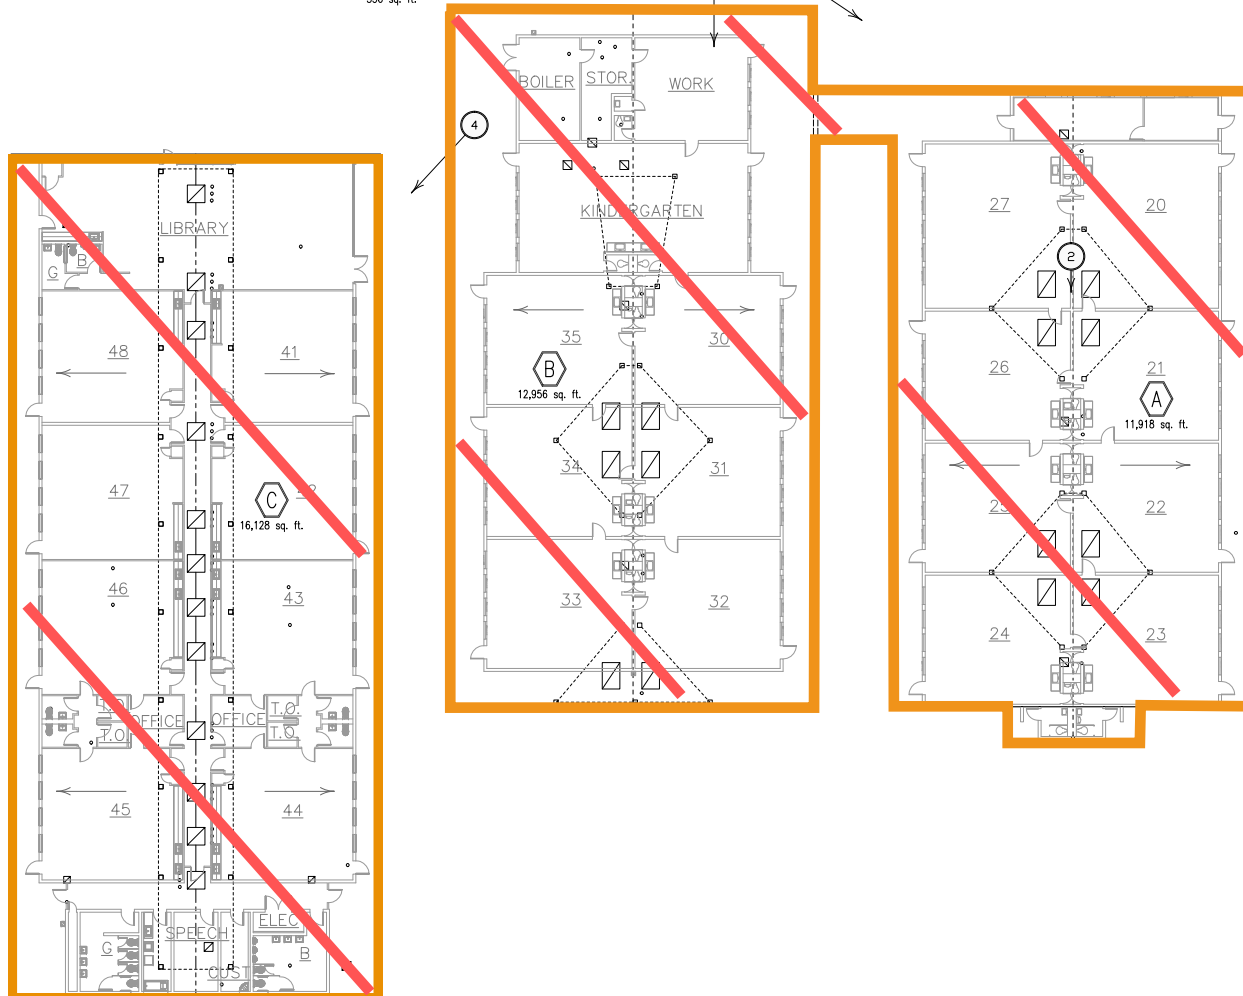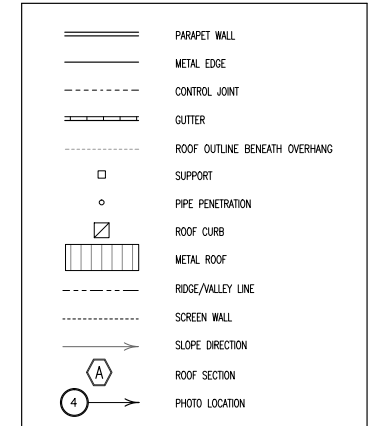

Roof Plan
20' 10' 0 20'
ORIGINAL SHEET SIZE: 18 x 24



2015 Construction Update Plan

WASHOE COUNTY SCHOOL DISTRICT
130-ROY GOMM ELEMENTARY SCHOOL
4000 MAYBERRY DRIVE
RENO, NEVADA





MANAGER: T. WILLMAN
DRAWN BY: M. WILSON
DATE: 12/12/15
JOB NO.: WASREN0219A
DRAWING NO.: WASREN0219A003

SHEET:
R-1

Roof Section	Size (Sq. Ft.)	Roof System	Roof Membrane	Year Installed	Manufacturer	Mfr Warranty Expires	Mfr Warranty Phone	Contractor	Contractor Warranty Expires	Contractor Warranty Phone	Estimated Replacement
A & B (East & Center Buildings and Walkway)	24,874	Modified Bitumen	SBS Modified	2001	Johns Manville	08/20/2011	(800) 922-5922	Cedar Roofing	-	-	6-10 years
C (West Building)	16,128	Modified Bitumen	SBS modified bitumen	1991	GAF Materials Corporation	07/31/2025	(800) 766-3411	D&D Roofing and Sheet Metal, Inc.	07/31/2017	(775) 685-5555	11+ years
D1 (North Building - Lower Roof)	3,904	Modified Bitumen	Modified bitumen	2009	GAF Materials Corporation	08/17/2009	(800) 766-3411	Kodiak Roofing	08/14/2009	(915) 253-1900	11+ years
D2 (North Building - Upper Roof)	3,661	Modified Bitumen	Modified bitumen	2009	GAF Materials Corporation	08/17/2009	(800) 766-3411	Kodiak Roofing	08/14/2009	(915) 253-1900	11+ years
E (Single Point Entry Corrugated Metal Panel Roof)	336	Architectural Metal Panel	Prefinished aluminum	2013	Unknown	-	-	-	-	-	11+ years

- Lead Containing Paints
- Non-Asbestos Materials
- Asbestos Containing Materials

SYMBOL LEGEND

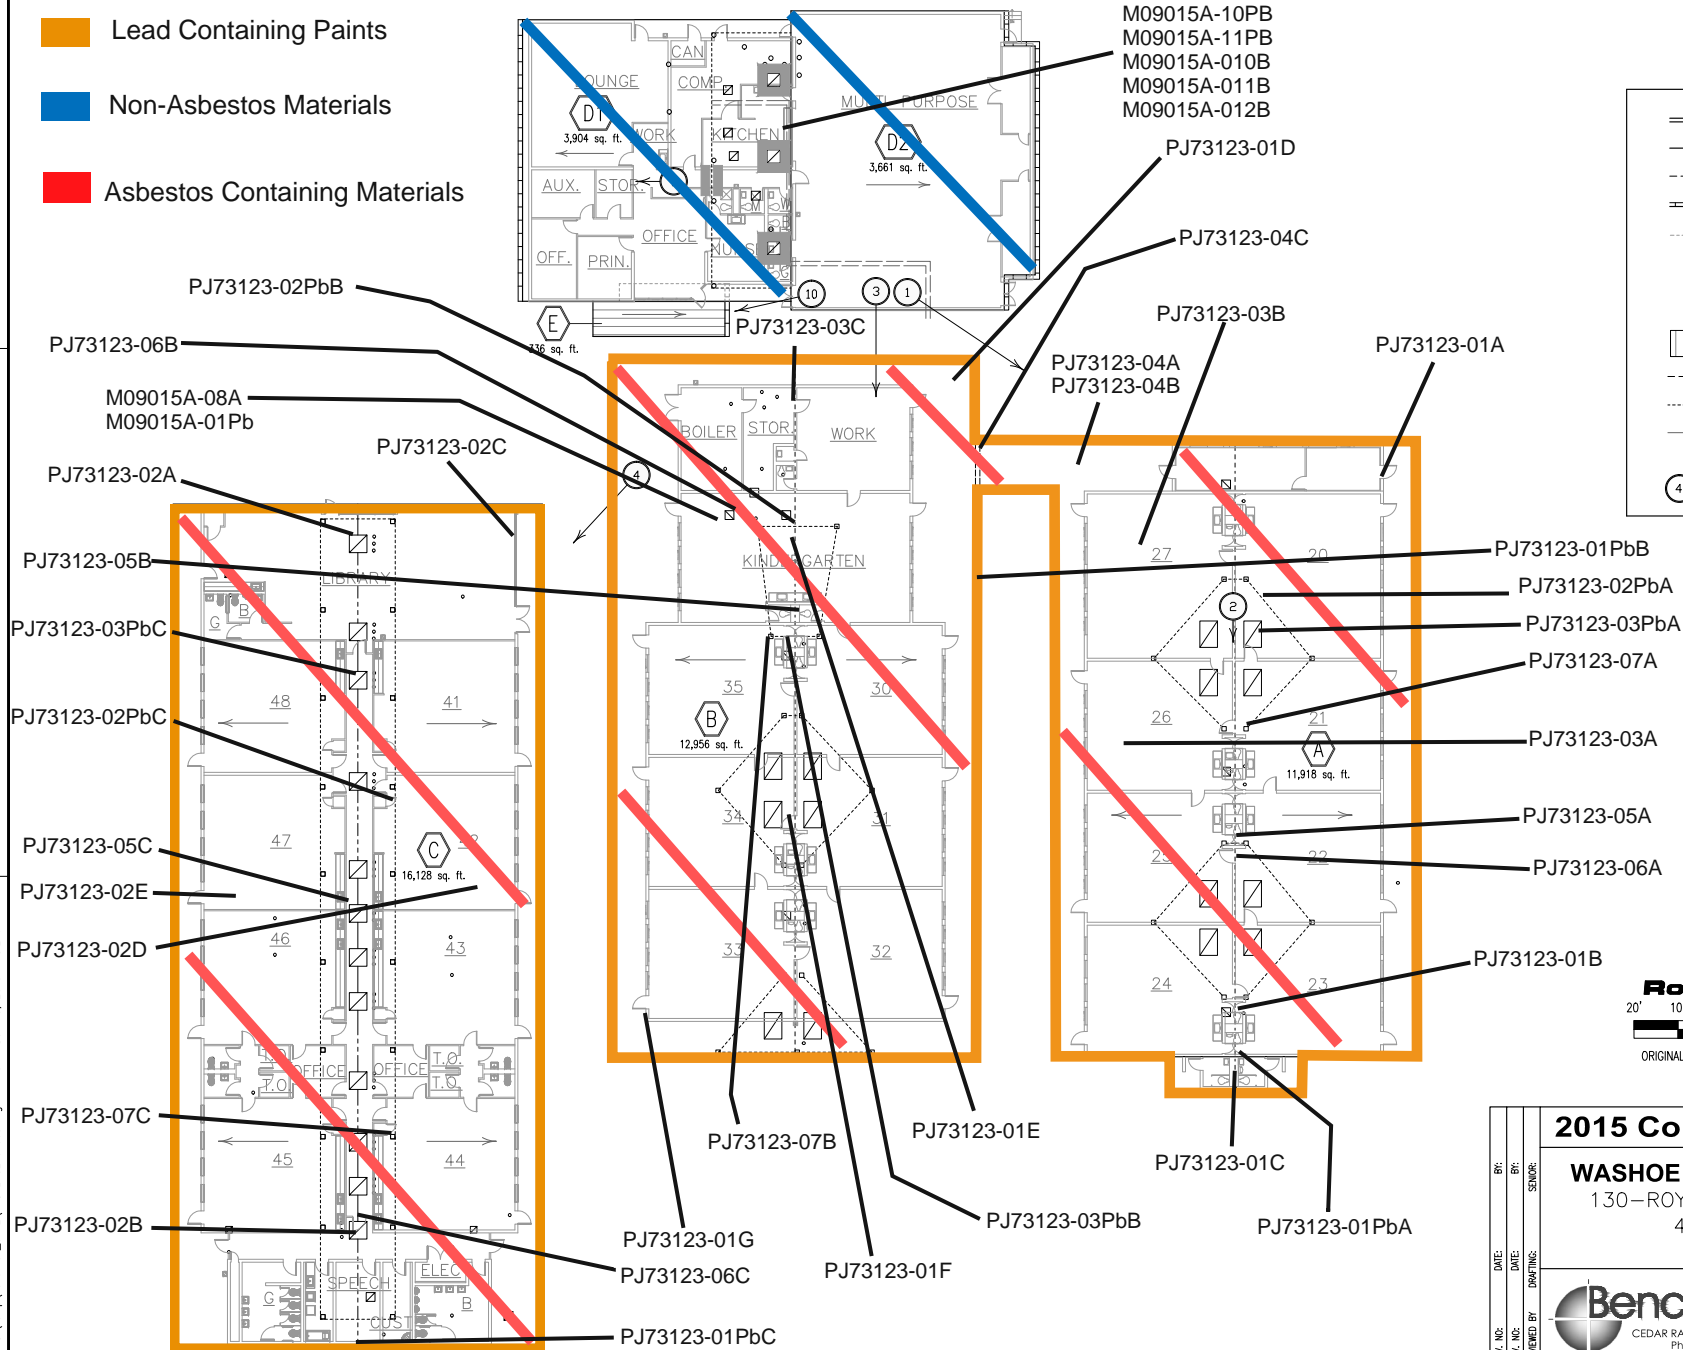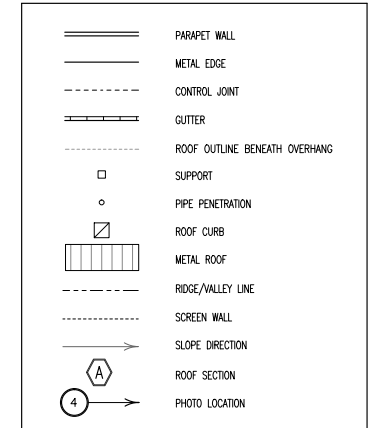

Roof Plan
20' 10' 0' 20'
ORIGINAL SHEET SIZE: 18 x 24

2015 Construction Update Plan

WASHOE COUNTY SCHOOL DISTRICT
130-ROY GOMM ELEMENTARY SCHOOL
4000 MAYBERRY DRIVE
RENO, NEVADA



MANAGER:	T. WILLMAN
DRAWN BY:	M. WILSON
DATE:	12/12/15
JOB NO.:	WASREN0219A
DRAWING NO.:	WASREN0219A003
SHEET:	R-1

REV. NO.:
DATE:
BY:
REVIEWED BY:
DATE:
BY:

Hazardous Materials Specifications

Gomm Elementary School Sections A & B Roof Replacement Project

4000 Mayberry Drive
Reno, NV 89519

Prepared for:

Washoe County School District Capital Projects

Created By:

Daniel Prado, FACS
IJPM-2057, US EPA LBP-R-I214705-2

Reviewed By:

Chris Chipponeri, FACS
IJPM-1410, US EP LBP-R-128230-3

Table of Contents

Site Address	1
Background	1
Scope of Work.....	1
Asbestos-Containing Materials	1
Lead.....	1
Project Requirements	2
Site Conditions	3
Water, HVAC, and Electricity	3
Lighting	3
Pre-Cleaning.....	4
Notifications.....	4
Equipment.....	4
Training	4
Personal Protection Equipment.....	5
Personal Air Monitoring.....	5
Security and Safety	6
Work Hours and Dates.....	6
Adverse Weather Conditions.....	6
Occupancy.....	7
Challenge Testing.....	7
Asbestos Abatement Containment & Handling Requirements – Roofing & Mastics	7
Lead – Exterior Component Removal Procedure and Requirements.....	8
Regulated Area Signage	10
Disposal Requirements	10
Asbestos.....	10
Lead.....	10
Clearance	10
New Material Sampling	11

Site Address

Gomm Elementary School
4000 Mayberry Drive
Reno, Nevada 89519

Background

Washoe County School District (WCSD) will be performing a roofing replacement project on roof sections A and B at their Gomm Elementary School site. This project will be limited to areas and materials of the site as indicated on project drawings and included in the project bid documents. A survey conducted by Forensic Analytical Consulting Services, Inc. (FACS) in 2022 found various asbestos-containing materials, lead-containing paints, and lead pipe flues. This will require the special handling of the identified materials as outlined within these specifications.

Scope of Work

For a general narrative, this project consists of the removal and replacement of the existing roof system from Sections A and B at the site. An asbestos and lead paint survey of the roof was previously conducted by Hazard Management Services, Inc. (HMS) in 2009 and supplemented by FACS in 2022.

Asbestos-Containing Materials

The following materials were found to contain asbestos in the proposed project area:

- Silver Paint & Mastic (Section B)
- Penetration Mastic – Grey/Black (Sections A & B)

Asbestos containing silver paint and mastics are located at roof curbs and penetration points on Section B and the penetration mastic is present at roof curbs and penetration points on Sections A and B.

These materials shall be abated by a contractor registered with the Nevada Division of Industrial Relations as an Asbestos Abatement Contractor and workers with AHERA Worker and/or Contractor-Supervisor training. This contractor shall also be currently licensed by the Nevada State Contractors Board and hold the A-23 classification for the Removal of Asbestos.

Lead

The following paints were found to be lead-containing in the proposed project area:

- Green Paint on Metal Flashing (Sections A & B)
- Off-White Paint on Metal Enclosure (Sections A & B)
- Silver Paint on Metal Boiler Stack (Section B)

Additionally, there were approximately twenty (20) lead pipe flues identified during the most recent survey of Sections A and B.

Any work disturbing paints containing lead or lead pipe flues must be performed using lead-safe work practices. Removal of lead-containing materials must be performed by personnel with OSHA Action Level training.

If the scope of work is expanded in any way, a new survey must be completed to identify any suspect asbestos-containing materials or suspect lead-containing paints that might be included in the new scope of work.

The general contractor and any sub-contractors working onsite will need to consult the WCSD Environmental Safety and Assessment (ES&A) Department's Material Disturbance Permit (MDP) to verify asbestos and lead content of materials prior to impacting any materials. In addition, FACS has provided survey reports for the areas inspected as reference, but this document does not take precedence over MDP or project drawings and other construction directives.

Testing of materials not previously sampled or testing to verify asbestos or lead content of materials, will only be performed by WCSD ES&A Staff or District's independent third-party consultant. Testing by another third-party consultant will not be accepted as proof of the asbestos-content of building materials or lead-content of paints or coatings.

This narrative is not a definitive scope of all work to be completed, including hazardous materials work, and is primarily intended to provide a general overview of the project. Project drawings and other construction documents developed shall be consulted to determine exact scope of work.

Project Requirements

Contractor performing hazardous material abatement shall be approved by the WCSD ES&A Department to perform asbestos abatement and lead removal activities within the District. **Approval of firms that have not previously performed activities impacting asbestos or lead materials for the District will require submission for approval of all necessary documentation outlined by WCSD for the project at least fifteen (15) business days prior to work commencing.**

All workers certifications (asbestos training, DIR licensing, lead training) shall be submitted to the WCSD ES&A Department for approval at least fifteen (15) working days prior to project commencement at minimum. Online training of employees is not sufficient to meet the requirements of District policy, and all training must be provided in-person with each individual receiving an individual training certificate for the specific discipline from the training provider. Contractor is responsible for reviewing WCSD ES&A worker roster for the company to ensure all workers to be used on the project have been approved prior to arrival onsite. Workers not identified on the approved WCSD ES&A worker list for the contractor will not be allowed to perform any activities onsite, even if documentation is provided onsite at time of the project commencement or work.

The hazardous materials remediation sub-contractor, acting under the general contractor, will be responsible for following all project drawings and contract requirements for materials/components to be removed. The abatement contractor's onsite supervisor shall always have a copy of the project specifications and the Material Disturbance Permit for the project onsite. The supervisor shall be familiar with the project requirements prior to arrival onsite at the project. Failure to follow requirements of these Specifications, or lack of knowledge of general regulatory requirements to be followed during the project, are grounds for replacement of the remediation contractor's onsite supervisor.

Only the abatement contractor will be allowed to occupy the project area once abatement or remediation activities are scheduled to start. This applies to all WCSD non-ES&A staff/personnel, general contractor, and other sub-contractors. The area shall only be occupied by the abatement contractor, WCSD ES&A staff, and District's independent third-party hazardous materials consultant.

The roofing contractor personnel cannot work within the same wing of the site or a directly adjacent wing as abatement contractor personnel unless these workers meet the requirements for training set forth in these specifications. If work falls within a regulated work area, they would also be required to wear all of the same PPE as outlined within this specification.

Contractor shall adhere to the requirements of these Specifications, WCSD ES&A Technical Specifications, Material Disturbance Permit, Lead Appendix (found in Material Disturbance Permit), and Federal, State, and Local regulations.

Site Conditions

Contractor is responsible for documenting any existing damage prior to the project start that they do not want to be held responsible for. Documentation shall include photographs or videos and shall be provided to WCSD Project Manager prior to starting work onsite.

Water, HVAC, and Electricity

Water and electricity are available onsite; however, long hoses and cords may be necessary. Contractor shall provide a GFCI at the primary plug-in of all electrical trains used for electrical equipment. Hose washers shall be provided at all connections to prevent leakage of water and potential damage to District facilities. Contractor is responsible for any damage caused by their usage to any District water or electrical systems.

Contractor shall coordinate with the WCSD Project Manager for the shut-down of any active HVAC systems within the project area prior to commencing abatement/removal activities. Contractor is responsible for the lock-out / tag-out of all electrical circuits and HVAC systems that may be impacted by the project. Contractor shall follow requirements of WCSD for the lock-out / tag-out of equipment. Contractor shall coordinate the shut-down of HVAC systems at least 72 hours prior to turning any units off as some units are controlled by an off-site location and additional steps may be required to turn off the units.

Lighting

In the event that work will take place in the evenings, the Contractor shall provide temporary lighting as required for workers to clearly see materials to be abated, traverse through the work area, and move waste to the waste receptacle. Sufficient lighting shall be provided to allow a clearance visual inspection to be performed at the conclusion of each work shift by the District's independent third-party consultant.

Lighting used shall meet requirements for safety as set forth by OSHA requirements. All lighting shall have a sturdy base and guards to protect bulbs from breakage in the event they are dropped or knocked over.

Pre-Cleaning

No pre-cleaning of asbestos or lead contamination at project areas is required to complete this project; however, small amounts of garbage and build-up of dust may be required to be cleaned to allow sufficient adherence of containment barriers.

Notifications

Contractor performing abatement of asbestos-containing materials shall file a courtesy notification to the Northern Nevada Public Health Air Quality Management District and Nevada OSHA at least 10 days prior to work commencing onsite. A copy of the notifications and proof of submittal to agencies shall be provided to the District's independent third-party consultant at least 48 hours prior to commencing abatement and removal activities, including setup of containment.

No notification is required for the removal or disturbance of lead-containing components, but the contractor performing lead work shall provide notice of work to the WCSD ES&A Department and District's independent third-party consultant at least 48 hours prior to commencing activities, including setup of containment.

Equipment

Contractor is responsible for providing all necessary equipment in sufficient quantities to complete the work in the schedule provided for the project. All equipment must arrive onsite clean and in proper functioning order. Any equipment that arrives onsite dirty or not in proper functioning order shall be removed from the project site for cleaning and/or repairs.

The requirement for clean equipment in proper working order extends to any rental equipment used on the project. If rental equipment is used, contractor shall provide notification in writing to the rental agency that equipment will be used within an asbestos or lead regulated work area. Proof of this notification being filed shall be provided to District's independent third-party consultant.

Operators of lifts or other similar powered equipment must be trained in the use of equipment to meet manufacturer and OSHA requirements. Proof of training shall be provided if requested to WCSD and District's third-party consultant.

Training

Workers disturbing asbestos-containing materials must have AHERA Worker training. One worker on the abatement work crew must be trained to the AHERA Contractor-Supervisor level. The crew lead Contractor-Supervisor may not leave the site when asbestos abatement activities are taking place.

Workers performing work impacting lead paints or coatings, regardless of level of lead present, must have OSHA Lead Action Level training. This training requirement extends to any personnel entering a lead regulated area, whether they are primarily a lead remediation contractor worker or not.

As noted previously, all workers certifications must be approved by the WCSD ES&A prior to arrival onsite to start work. Certifications shall clearly identify the name/level of the training and provide the complete name of the worker. Names on certifications must match from certification to certification.

Failure to meet these requirements may cause a delay in approval up to complete rejection of certifications until corrections can be made and new copies obtained by the contractor.

Copies of the worker certs will also be requested to be provided to the District's onsite third-party consultant as well. Web-based or virtual training is prohibited by District policy.

Personal Protection Equipment

All personnel entering a regulated asbestos or lead work area, regardless of level of work to be performed, shall wear disposable coveralls, tight-fitting half-face negative-pressure air purifying respirators fitted with HEPA (P-100) filters, safety glasses and gloves. The contractor may require additional personal protection equipment based on their job hazard assessment, but the listed requirements must be met at minimum.

Street clothes may be worn beneath disposable coveralls, but HEPA-vacuum cleaning of clothing may be required as part of decontamination procedures in the event suits become ripped or torn during work. Requirements of PPE extend to any contractors disturbing hazardous materials, even if they are not primarily a remediation contractor.

All employees shall have a valid medical clearance and fit test for the respirators to be worn. Copies of the medical clearance and fit test shall be provided to the District's onsite independent third-party consultant.

The contractor may opt to include additional PPE items based on their own job hazard assessment for the project, but they may not reduce level/type of PPE below what is required in this Specification.

Personal Air Monitoring

The contractor is responsible for the collection of personal air samples on 50% of workers entering a regulated work area during asbestos abatement and lead disturbance activities as applicable. If an odd number of workers are entering the regulated work area, the contractor shall round up for the number of workers to be monitored (i.e., five workers entering a work area would require collection of three samples). These samples shall be collected in accordance with OSHA sampling protocols and analyzed by a laboratory with the proper accreditation and approval from the WCSD ES&A Department.

The contractor shall have their laboratory submit or fax, within **48 hours** of the date the sample was collected, the final laboratory result documents (including legible chain-of-custody) for air monitoring to the WCSD ES&A Department. No hand-written results reports will be allowed. The laboratory reports will reference the air monitoring cassette's factory assigned number and the personal air monitoring results must be properly applied to an 8-hour time weighted average. Failure to submit results within the required 72-hour period (48-hour turnaround with 24-hour grace period) may result in the District temporarily stopping the applicable remediation project until results are received. Continued failure may also result in the termination of the contract.

Copies of the personal air sampling results, along with laboratory accreditation, shall be submitted to the WCSD ES&A and District's independent third-party consultant as noted above.

The District's independent third-party consultant reserves the right to halt work or increase respiratory protection if personal air samples are not submitted in a timely manner, or if area air sampling shows current respiratory protection does not sufficiently protect employees.

Security and Safety

The Contractor is responsible for security of all equipment and safety of all employees. Contractor shall provide any storage containers or security needed for tools and equipment if they are to be left onsite. Contractor shall coordinate with WCSD Site Facilities Coordinator or WCSD Project Manager for placement of any storage container brought onsite.

Contractor is responsible for all worker safety and following all applicable regulations, namely Nevada and Federal OSHA. Contractor or their designated supervised shall hold a safety meeting on the first day of the project that addresses all safety hazards workers may encounter. Safety meetings shall be held at least weekly thereafter, or in the event that job hazards change, or an accident occurs. The safety meeting topics shall be documented, and all attendees sign the document for recordkeeping. A copy of the safety meeting shall be provided to the District's independent third-party consultant.

Work Hours and Dates

A specific schedule of calendar dates for the project will be provided in other contract documents. However, it is anticipated that workdays and hours when school is not in session will be Monday through Friday, 07:00 am to 03:30 pm. When school is in session, work hours will be 03:30 pm to 11:00 pm. WCSD holidays are excluded dates of work and no work shall be scheduled for these dates. As noted above, a detailed schedule of project events, including shift hours, shall be provided for approval by WCSD.

The contractor may request alternate days or hours in writing to the WCSD Project Manager for approval, but it does not guarantee acceptance. The request must be filed at least 48 hours prior to the first alternate shift commencing.

Adverse Weather Conditions

The work shall be planned and scheduled when there are favorable weather conditions, such as, performing the abatement work when the forecast is for "clear skies" and no rain for three or more consecutive days. In addition, all roof areas abated must be "dried-in" per WCSD requirements prior to stoppage of work and demobilization each day by the roofing contractor.

Contractor may request a waiver of this requirement from WCSD but will be held responsible for all damage incurred by failure of barriers that allows water to enter building envelope. Damage includes mold that may grow later due to water intrusion from not having roof system installed.

Polyethylene critical barriers and drop sheets require sufficient attachment and/or anchoring to prevent windy conditions from rendering them ineffective.

Windy conditions that cause dust and/or debris to be blown beyond the removal work area or the poly drop sheets will require stoppage of removal work, correction of any containment deficiencies, and clean-up and disposal of all waste material generated before abatement or remediation work may continue.

Rain, snow, hail or other weather involving moisture which could cause interior of buildings to become wet will require remediation contractor to stop work as necessary to ensure building is weather-tight.

The District or District's independent third-party consultant has the authority to halt abatement or remediation work due to adverse weather conditions. Neither the District, nor the District's consultant, will be responsible for lost work shifts or hours due to Contractor failing to monitor weather and attempting to proceed when inclement weather is forecasted.

Occupancy

As noted previously, occupancy of the project area will be limited to the abatement contractor, WCSD ES&A staff, and District's independent third-party consultant once abatement or remediation activities are ready to commence. Once the area has been cleared, other parties may occupy.

Emergency services may also occupy areas in the event of an emergency during the project.

Challenge Testing

All HEPA-filtered equipment to be used on this project shall be challenge tested (DOP or equivalent) within 30 days prior to use. Copies of the challenge testing results shall be provided to the WCSD ES&A and/or District's independent third-party consultant.

All HEPA-filtered equipment will be required to be functioning properly with no visible emissions or broken parts. If these issues occur, the equipment will be removed from use immediately.

Asbestos Abatement Containment & Handling Requirements – Roofing & Mastics

It is anticipated that any asbestos-containing mastics will be abated prior to the primary (non-asbestos) roofing system/material being removed.

It is recommended that asbestos abatement activities be performed at the same time as lead removal work to limit time for containment setup / teardown, material used for containment barriers, and other cost considerations.

All poly used on this project shall be 6-mil in thickness and fire-retardant. **No exterior containment area may remain in place past the work shift that the asbestos abatement work is performed in.**

1. All openings leading into interior spaces shall be sealed with one layer of 6-mil poly as critical barriers. This includes doorways, windows, louvers, HVACs, etc. Critical barriers shall also be installed as needed at adjacent buildings within 50 feet of abatement. These barriers may remain in place past one shift if approved by WCSD. Critical barriers within a regulated area must be cleaned as part of the final detail cleaning process.
2. Poly sheeting shall be placed at ground surfaces if abatement is to take place within 10 feet of the roof edge. Poly shall extend out 10 feet from the building to capture any material that may fall off the roof area.
3. Ground poly shall be secured or weighed down to prevent billowing and movement of poly drop sheet or creation of a trip hazard.
4. The Contractor shall limit and control exterior access within 100 feet of exterior work areas. This will require the erection of barrier tape with Contractor-supplied pylons or fixed objects as available around the project area.

5. A HEPA-vacuum shall be present inside the regulated area prior to abatement activities commencing.
6. Regulated area shall be demarcated using asbestos danger tape and/or signage. This barrier shall extend out around the work area at least 50 feet unless modified onsite by the District's independent third-party consultant. Personal Protection Equipment must be worn within the area.
7. A wash station / decontamination area shall be attached to the containment area to allow workers to decontaminate themselves and equipment when exiting the work area. This wash station shall include wet-wipes, soap, and towels for use with a waste bag for disposal of PPE and decontamination waste materials.
8. Mastics shall be removed as intact as possible using non-mechanical means. This may be accomplished by cutting the roofing materials around the mastics to more efficiently facilitate the abatement process.
9. Materials shall be wetted using a Hudson sprayer or an airless sprayer applying amended water to the materials.
10. All surfaces (including poly) shall be wet-wiped and HEPA-vacuumed clean as part of the detail cleaning within the work area.
11. No "loose" water shall be present in the waste bag when it is removed from the containment area. Water shall be soaked up with either kitty litter, diatomaceous earth or similar as necessary to meet this requirement.
12. Excess air in bag shall be evacuated during sealing with use of the HEPA-vacuum to limit potential for popping within waste bin or transport of waste.
13. All waste shall be bagged prior to any work stoppages. This includes breaks, such as lunch, as well as end of day stoppages.
14. All waste shall be double-bagged in clear 6-mil poly waste bags and both bags shall be sealed in a "gooseneck" fashion.
15. All waste shall be packaged for disposal on the roof then lowered to the ground by hand or via a lift. No waste or waste bags may be dropped or thrown from the roof to the ground or to an open-top waste container.
16. Containment poly is included in description of asbestos waste and must be packaged as noted above.
17. Poly shall be cleaned of all debris as part of final detail cleaning. Folding poly up without cleaning and prior to receiving a visual clearance is prohibited.
18. After final cleaning, the Contractor's supervisor shall perform a visual inspection to determine if the work area is ready for a visual clearance inspection, and the supervisor shall notify District ES&A personnel or District's independent third-party consultant when the work area is ready.
19. A visual clearance inspection will be performed by the District's ES&A personnel or District's independent third-party consultant. The criteria for passing visual clearance shall be the complete abatement of all asbestos-containing materials down to the substrate and the absence of any dust or debris within the regulated work area. All waste and debris shall be properly packaged and removed from the regulated area prior to this final inspection.

Lead – Exterior Component Removal Procedure and Requirements

All poly used on this project shall be 6-mil in thickness and fire-retardant. **No exterior containment area may remain in place past the work shift that the lead work is performed in.**

1. The Contractor shall limit and control exterior access within 50 feet of exterior work areas. This will require the erection of barrier tape with Contractor-supplied pylons or fixed objects as available around the project area.
2. Required regulated area lead hazard signage shall be placed 20 feet away from the work area. Personal Protection Equipment must be worn within this regulated area.

3. Caution tape shall be used to demarcate a buffer area 20 feet past the regulated area signage to ensure authorized access control is maintained.
4. Critical barriers shall be applied to all openings (windows, doors, or otherwise) within 20 feet of the work area. These barriers may remain in place past one shift if approved by WCSD. Critical barriers within a regulated area must be cleaned as part of the final detail cleaning process.
5. One layer of 6-mil poly shall be placed on the ground and extend out 10 feet in each direction from the location of lead disturbance.
6. Poly shall be weighed down or secured to prevent movement or billowing and the creation of a trip hazard.
7. A wash station / decontamination area shall be attached to the containment area to allow workers to decontaminate themselves and equipment when exiting the work area. This wash station shall include wet-wipes, soap, and towels for use with a waste bag for disposal of PPE and decontamination waste materials.
8. Removal of painted components and lead pipe flues shall be conducted using hand tools whenever possible to limit potential lead release.
9. Any cutting of surfaces using mechanical equipment shall be performed using equipment with a shroud with HEPA-vacuum attachment to provide local exhaust at the point of the cut.
10. A build-up of waste or debris within the work area is prohibited. Contractor workers shall ensure that the area is kept free of waste bags or other debris as work progresses.
11. Waste shall be placed into clear 6-mil poly waste bags. All waste must be double-bagged with both waste bags sealed in a “gooseneck” fashion to create a double-layered leak-tight container. Wrapped waste shall have staggered seams to create a leak-tight container.
12. Lead waste shall be characterized prior to disposal and shall be labeled and disposed of in accordance with the waste determination.
13. No “loose” water shall be present in the waste bags prior to sealing closed. Water shall be soaked up with either kitty litter or diatomaceous earth as necessary to meet this requirement.
14. A HEPA-vacuum shall be used to evacuate air from waste bags when sealing. Workers using hands or knees to collapse air out of waste bags is prohibited.
15. All waste packaged for disposal on the roof shall be lowered to the ground by hand or via a lift. No waste or waste bags may be dropped or thrown from the roof to the ground or to an open-top waste container.
16. At the conclusion of lead disturbance, the poly drop sheet shall be wet-wiped and HEPA-vacuumed clean of all debris and dust.
17. After final cleaning, the Contractor’s supervisor shall perform a visual inspection to determine if the work area is ready for a visual clearance inspection, and the supervisor shall notify District ES&A personnel or District’s independent third-party consultant when the work area is ready.
18. A visual clearance inspection will be performed by the District’s ES&A personnel or District’s independent third-party consultant. The criteria for passing visual clearance shall be the absence of any dust or debris within the regulated work area. All waste and debris shall be properly packaged and removed from the regulated area prior to this final inspection.

Regulated Area Signage

Asbestos Danger and Lead Hazard signs shall be posted at all entrances to a containment area as appropriate for work being performed. Signage will be posted after a pre-start visual is passed and work may begin in the containment, but no work shall start until all signs are posted.

Signage shall meet the revised requirements for lead set forth in 29 CFR 1926.62(m) and for asbestos set forth in 29 CFR 1926.1101 (k)(7).

Disposal Requirements

Asbestos

All asbestos waste shall be double-bagged in 6-mil poly waste bags. Both bags shall be sealed in a “gooseneck” fashion. Waste shall be properly labeled for disposal as non-hazardous asbestos-containing material waste. If made friable by removal, the waste must be disposed of as a regulated asbestos-containing material.

The contractor will need to provide a fully enclosed, lockable waste bin for all waste created on this project. Waste bin will need to be labeled with asbestos signage once the waste is loaded into the bin. Waste bins shall be lined with one layer of 6-mil poly prior to waste being loaded. Asbestos waste and lead waste cannot be mixed.

Asbestos waste shall be hauled from the site by a properly licensed waste hauler and disposed of at a waste facility that will accept the waste.

Lead

Contractor is responsible for the waste characterization profiling of all lead waste to be disposed of. Copies of the laboratory results, including chain-of-custody, must be provided to WCSD ES&A or independent third-party consultant prior to disposal.

The contractor will need to provide a fully enclosed, lockable waste bin for all waste created on this project. Waste bin will need to be labeled with lead signage once the waste is loaded into the bin. Waste bins shall be lined with one layer of 6-mil poly prior to waste being loaded. Lead waste cannot be mixed with asbestos waste.

Clearance

At the conclusion of abatement or remediation within a regulated area, a final visual inspection will be performed by the District’s independent third-party consultant. The criteria for a successful final visual inspection are that a work area will need to be free of all dust and debris with all asbestos abatement or lead disturbance completed within the regulated area.

In the event that a potential lead hazard has been created by a contractor, such as improper disturbance of painted surfaces outside of a contained area, the District’s ES&A staff or independent third-party consultant will collect dust wipe or soil samples to verify conditions. If a lead hazard has been created, the contractor performing the improper disturbance will be responsible for all cleaning costs required for the lead abatement contractor to remediate the hazard, including costs for collection of clearance dust wipe or soil samples to document that the lead hazard has been remediated.

New Material Sampling

During the installation of the new roofing materials, the District's third-party consultant will need to sample the newly installed roofing, mastics, and any painted components as part of the WCSD requirements. The roofing contractor is responsible for providing a representative for any required patching of the roof due to the sampling of the materials. The District's third-party consultant will coordinate sampling with the roofing contractor and will make their best attempt to conduct the sampling during the installation process.

Created by: Daniel Prado, FACS, IJPM-2057, US EPA LBP-R-I214705-2

Reviewed by: Chris Chipponeri, FACS, IJPM-1410, US EP LBP-R-128230-3

Date: November 1, 2024

ASBESTOS ABATEMENT TECHNICAL SPECIFICATIONS – EFFECTIVE 1/25/23

PART 1 – GENERAL REQUIREMENTS

1.1 LOCATION

This asbestos abatement is to take place at: Gomm ES Roofing Project, Issued 11-24

1.2 DESCRIPTION

The work shall include the furnishing of all labor, tools, and equipment, material, transportation, ALL waste disposal fees and services to include waste characterization sampling costs and the performance of all operations required to properly provide the work. The Contractor will be supervised by District AHERA certified personnel or District Hired Asbestos Consultants and the abatement work will be coordinated through the Regulated Systems and Assessment department. The work shall also include obtaining required permits and notifying regulating agencies as required by all applicable state, local and federal laws and regulations for the work to be performed. Notification fees and disposal manifest fees are to be paid by the Contractor. Contractors are reminded that non-friable asbestos projects may not require regulatory notification, but non-friable materials that have been made friable in the opinion of the regulatory agency require notification. Mastics removed with buffers require notification. It is the responsibility of the Contractor to determine if regulatory notification is required and any monetary citations that result from failure to notify or improperly done notifications will be fully the responsibility of the Contractor. Should the District be named in addition to the contractor, due to a Contractor's failure or improper notification, the contractor shall be required to reimburse legal fees to defend the District, as well as the cost of any monetary citation that results. The work shall also include the cleanup and removal from the site of all debris resulting from the operations performed. Waste disposal of all materials removed from the site shall be performed in a manner consistent with these specifications and all applicable regulations and the Contractor is required to complete properly and pay for all waste characterization sampling costs. The Contractor shall be responsible for submitting the application for the waste disposal permit and the contractor will be responsible for the picking up and the payment of the fee for the permit. The Contractor will submit the waste application to the District prior to submittal to the Health Department for signature. It shall also be the Contractor's responsibility to take all necessary safety precautions and to furnish security barricades, and/or any safety measures as may be required to properly separate the abatement areas from the public. All taxes/fees associated with the disposal of asbestos containing wastes, regulated or not, shall be the responsibility of the abatement contractor.

As the District may decide to pay a third party consultant to supervise projects, the District would have to pay the consultant additional money or pay overtime to district employees for weekend and overtime work. The work schedule of this project will be set by the Construction Department Project Manager. If the contractor must work additional time or hours not identified in the initial schedule, due to the contractor's inability to man the job with enough workers, the District may require the contractor to reimburse the district for additional costs for consultants incurred by the District. **The Contractor will be required to staff this project with enough personnel to ensure completion within the required timeline.** The Contractor shall provide at all times sufficient and competent labor to carry on the work

properly and insure completion of each part in accordance with schedule and within the time agreed to. An employee of the Contractor or subcontractor, who is deemed incompetent, disorderly, or otherwise objectionable by the Owner, shall be removed promptly by the Contractor, and not re-employed on the work. Any employee of the Contractor that is observed that is not utilizing his personal protective equipment will be immediately removed from a project and not allowed on any other District projects. Should any disagreements result regarding the identification of the employee or his/her proper use of personal protective equipment, the determination of the District Regulated Systems Supervisor or District hired Consultant will be considered final and conclusive. The Contractors Asbestos Abatement Supervisors who allow employees to not utilize their personal protective equipment will be immediately removed from a project and not allowed on any other District projects. Contractors will be required to replace removed employees/Supervisors and no additional time will be allowed to complete the project.

When possible without the disturbance of asbestos-containing materials, it shall be the responsibility of the **OWNER** to remove and replace all loose and attached furniture, cabinets, bookcases, etc. before the project commences. The removal of these items, where removal impacts asbestos-containing materials, and re-hanging of doors that have to be removed because they impede removal will be the responsibility of the contractor.

The **OWNER** will be responsible for air sampling for the purpose of project clearance. The Contractor shall not include the cost associated with clearance sampling in his bid. The Contractor shall be responsible for all personal and area air monitoring required by regulation, the technical specifications or required by the Contractor's asbestos liability insurance carrier.

The **OWNER** shall be responsible for the cost associated with the initial air sample clearance requirements. If the initial sample analysis results do not pass for clearance, the Contractor will be responsible for the cost of all additional air sample analysis until clearance is achieved. In the case that a project requires the isolation of toilet facilities it shall be the responsibility of the Contractor to provide alternative facilities as needed, if no alternative facilities are available on-site. If the Contractor utilizes District toilet facilities, the Contractor will be required to maintain the cleanliness of the designated District toilet facilities.

The contractor will be required to assign enough personnel and equipment to complete all projects scheduled for completion during each site's normal work hours. Costs to provide access to facilities after normal work hours, due to a Contractors inability to meet the schedule during normal hours will be passed on to the Contractor and deducted from a project's final payment.

There may be supplemental asbestos abatement specifications created by an outside asbestos consultant and provided to the Contractor to provide additional information. The Contractor must refer to all specifications provided in the bid package, and comply with all specification requirements. If there are any conflicts regarding asbestos abatement specification requirements, Contractors are required to comply with the most stringent requirement. Conflicts/disagreements regarding specification requirements will be settled based upon direction from the WCD ES&A Department AHERA Project Designer certified staff.

1.3 EQUIPMENT

If requested the Contractor shall provide proof acceptable to the District that Contractors has disposal is enough equipment to support this project. Delays of up to 48 hours are to be anticipated for TEM Laboratory analysis result turnaround and abatement project schedule will reflect this delay. Additional equipment needs may result and the Contractor will be required to have enough equipment to proceed with work as schedule in spite of delays in awaiting final clearance sampling.

1.4 ASBESTOS LIABILITY INSURANCE REQUIREMENTS

The Contractor will be required to written proof by way of an insurance certificate of a minimum of Five Million Dollar (\$5,000,000.) Occurrence Based Asbestos Environmental Risk Liability Insurance from a domestic Insurance company that has an A, A+ or A++ rating in Best's Insurance Guide, OAE. The Asbestos Abatement Contractor shall name the WCSD additionally insured on a primary and non-contributory basis for the contract term as well as any asbestos consultants the District may hire for job design and/or supervision and shall provide an insurance certificate specifically naming them as additionally insured, primary and stating that the policy cannot be cancelled in less than 30 days for any reason including non-payment.

1.5 LOCK OUT/TAG OUT PROGRAM

The Contractor will be required to comply with the Districts Lock Out/Tag out procedures. Requirements are available to contacting the WCSD safety officer.

1.6 WORK HOURS

The work schedule of this project will be set by the Construction Department Project Manager. Contractor must determine the work hours by reviewing the other contract documents and specifications or address these issues with the Project Manager so all Contractors are clear of the required abatement schedule prior to bidding on this project. These asbestos abatement specifications are not meant to set work hours or schedules rather the procedures to be used to abate asbestos containing materials within the district. The WCSD, ES&A department will be the entity ensuring the abatement specification are being properly being addressed by Contractors but the day to day scheduling and project specifics, not related to abatement procedures, will be administered by the Construction Department of WCSD.

SECTION 02110

ASBESTOS ABATEMENT: GENERAL

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. These specifications cover the removal of specific types of asbestos containing material for the Washoe County School District. Refer to the project drawing for exact abatement information and locations. The work may include the abatement of asbestos containing material (ACM) on floors. New flooring materials will be installed over abatement areas so mastic removal techniques employed by the abatement contractor are to be done so that installed flooring products are able to be warranted by the flooring manufactures. If the abatement contractor is being hired by a flooring contractor the abatement contractor must consult the flooring installer and ensure their employed removal techniques do not void any warranties for new installed products. It is quite possible that chemical mastic removers may not be able to be utilized to achieve this requirement. No power tools may be used to remove asbestos containing materials unless approved by the District and the applicable regulatory authority. All carpeting in the areas shall be removed and disposed of as ACM, as directed by the District. Work will require use of a negative air pressure system and depending upon personal air sampling may require Type "C" supplied air respirators. Transmission Electron Microscopy (TEM) or Phase Contrast Microscopy (PCM) will be used by the District to establish final airborne asbestos levels prior to acceptance of the work by the District; final levels of airborne asbestos fibers at the completion of the work shall be in accordance with AHERA Regulations (40 CFR Part 763).
- B. Polished Concrete and Concrete Grinding: The district may be grinding and or polishing concrete in scheduled areas after a flooring asbestos abatement project has been completed. In cases that polished concrete will be a part of the scope, **or concrete grinding will be required after abatement**, Contractors will **not** be allowed to utilize solvent mastic removers or any other method that liquefies the matrix of the mastic which could contribute to the mastic entering into cracks, and pores of the concrete. The exception to this would be the use of a fully HEPA vacuum shrouded techniques, such as water jet or hydro blasting. The intent of this requirement is that all mastic will be removed and no liquefied mastics will remain at the conclusion of work. If grinding of the concrete is required, it will happen after the final asbestos air clearance has passed and the asbestos abatement is complete. The poly containment that has been built, during the asbestos abatement phase, might be very helpful and cost effective if it were left in place for the concrete grinding contractor to use. So once the final clearance and abatement contractor has removed all signage, asbestos contaminated materials and the negative pressure machines, the grinding contractor may want to make arrangements with the abatement contractor to leave the poly containment up. All arrangements regarding the logistics of this agreement are up to the contractors' responsibility to determine. Contractors performing concrete grinding will be required to comply with District specifications regarding silica exposure during the grinding phase.

C. INTENT

1. These specifications are intended to describe all material, labor, and equipment necessary for asbestos material removal.
2. The listing or mention of any method of installation, erection, fabrication, or workmanship shall not operate to make the Contractor an agent, but shall be for the sole purpose of setting a standard of quality for the finished work; an alternate method may be approved in writing by the District if it results in quality equal to that intended by these documents, without increasing the District's liability. Unless an alternate method is approved, all work shall be in strict accordance with all methods of installation, erection, fabrication, and ownership listed or mentioned herein. In addition, while the methods are provided, the Contractor will be required to ensure any method utilized complied with all applicable regulations.
3. It is the responsibility of the Contractor to verify the square footage of asbestos containing material that needs to be removed on this project. The Contractor shall remove all asbestos-containing material from the areas as directed.

1.02 DESCRIPTION OF WORK

- A. Furnish all labor, licenses, notifications, payment of notification and waste manifest fees, permits, materials, services, insurance, associated taxes, and equipment to complete and dispose of all asbestos containing materials and asbestos-contaminated material as directed by the District. Base cove materials inhibit the removal process and trap contaminated materials, therefore all removable base cove materials must be removed as a part of the abatement process of flooring materials.
- B. CORRELATION OF DRAWINGS AND SPECIFICATIONS
 1. In general, the specifications will describe the "quality" of the work. The specifications are cooperative and supplementary; however, each item of work is not necessarily mentioned in the specifications. All work necessary to complete the projects so described is to be included in this Contract.
 2. In case of disagreement within the specifications, the better quality of the work shall be estimated and the matter drawn to the District's attention for decision and/or adjustment. Any work done by the Contractor without consulting with the District, when the same requires a decision, shall be done at the Contractor's risk.
 3. Omissions or Errors. If any omissions or errors in technical specifications are noted, or instructions at variance with the obvious intent of the document, it is the responsibility of the Contractor to call them to the District's attention before performing the work.

C. INTERPRETATION OF "OR EQUAL"

1. The use of trade names, with a notation such as "or equal" in these specifications is to establish quality required; there is no attempt to limit competitive bidding, but, in like manner, the quality specified will be rigidly maintained.
2. The words "approved", "equal to", "as directed". etc., are interpreted and will be taken to mean "to the satisfaction of the District."

D. UTILITIES (each of the following apply to this project as stated, unless otherwise noted in the project documents.)

1. Water - Existing service is available for the Contractor's use.
2. Electrical Service
 - a. Existing service is available for the Contractor's use.
 - b. The Contractor shall be responsible for furnishing necessary light bulbs, temporary lighting, temporary power stations, GFI outlets and extension cords as may be essential to the execution of their respective branches of the work. In addition, for extensions of lines to sheds or to power tools and remote areas which cannot be reached with extension cords.
 - c. The Contractor shall be responsible for replacement cost of transformers, panels, circuit breakers and any other item of electrical equipment and installation thereof which is destroyed or broken as a result of or during the course of the Contractor's abatement activity.
3. Utility charges for electric power and water service will be paid by the Owner.

E. GUARANTEE

1. The Contractor shall, in case of work performed by his Subcontractors and where guarantees are required, secure warranties from said Subcontractors and deliver copies of same to the District upon completion of the work and prior to final retention payment.
2. All portions of the work shall also be maintained in perfect condition during this period. Such written guarantees as may be requested shall be submitted in duplicate at the completion of the work. These will be supplementary to and not in any way canceling specific guarantees which apply to various portions of the work.
3. If, in the Contractor's opinion, any work that is called for in the specifications in such a manner as to make it impossible for him to produce and guarantee a first-class piece of work, he shall refer the same to the District in a timely manner before proceeding.

1.03 DEFINITIONS

A. GENERAL TERMINOLOGY FOR ASBESTOS ABATEMENT

1. Owner - Washoe County School District, hereinafter referred to as the Owner, or the District, or the authorized representative of the Owner, or the District's consultant.
2. Authorized Visitor - Any visitor to the site whose visit has been authorized by the District.
3. Asbestos - The term asbestos includes chrysotile, amosite, crocidolite, tremolite, anthophyllite, and actinolite. Materials are considered to contain asbestos if any amount of asbestos is present.
4. ACM - Asbestos-containing material(s).
5. Visible Asbestos - Visible Asbestos Containing Material
6. Abatement - Procedure to control fiber release from asbestos-containing building materials. Includes encapsulation, enclosure and removal.
7. Removal - All herein specified procedures necessary to strip all ACM from the designated areas and to dispose of these materials at an acceptable site. **The preferred method of removal of flooring material mastic is by wet method utilizing a chemical mastic remover.**
8. Work Area - A room or location in which ACM is indicated to be removed by this Contract.
9. Containment Area - A work area or zone which is prepared with plastic sheeting, barriers, negative air, etc., for asbestos abatement work.
10. Enclosure - All herein specified procedures necessary to completely enclose all ACM behind airtight, impermeable, permanent barriers.
11. Encapsulation - All herein specified procedures necessary to treat ACM with an encapsulant to control the possible release of asbestos fibers into the ambient air.
12. Encapsulant (Sealant) - A liquid material which can be applied to ACM and which controls the possible release of asbestos fibers from the material either by creating a membrane over the surface (bridging encapsulant) or by penetrating into the material and binding its components together (penetrating encapsulant). Any encapsulant installed must be compatible with any new products that will be installed over the encapsulated such as flooring products.
13. Air Monitoring (Air Sampling) - The process of measuring the fiber content of a specific volume of air in a stated period of time.

14. Area Monitoring - Air monitoring of fiber concentrations within the asbestos control area and outside the asbestos control area which is representative of the ambient airborne concentration of fibers.
15. Personal Monitoring - Air monitoring of fiber concentrations within the breathing zone of an employee.
16. HEPA Filter - A High Efficiency Particulate Air (HEPA) filter capable of trapping and retaining 99.97% of particles greater than 0.3 micron in size.
17. Negative Air Pressure System - A local exhaust system capable of maintaining a minimum pressure differential of minus 0.03 inch of water gauge in work area relative to adjacent areas. Documentation of negative air pressure is mandatory.
18. Negative Air Machine (NAM, "HOG") - A self-contained local exhaust machine utilized in a negative air pressure system. This equipment must use HEPA filters when used in asbestos work areas to collect and retain asbestos fibers.
19. HEPA Filter Equipment - Vacuuming equipment, which uses HEPA filters capable of collecting and retaining asbestos fibers. Filters shall be of 99.97% efficiency for retaining fibers of 0.3 micron or larger in size.
20. Surfactant - A chemical wetting agent added to water to improve penetration.
21. Amended Water - water to which a surfactant has been added.
22. Removal Encapsulate - a penetrating encapsulate specifically designed for removal of asbestos-containing materials rather than for on site encapsulation.
23. Chemical Remover - A pre-mixed chemical-penetrating agent designed specifically for removal of asbestos-containing material.
24. Airlock - A system for permitting ingress or egress without permitting air movement between a contaminated area and an uncontaminated area, typically consisting of two curtained doorways.
25. Curtained Doorway - Device to allow ingress or egress from one room to another while permitting minimal air movement between the rooms
26. Decontamination Facilities - A series of connected rooms, with doorways between any two adjacent rooms, for the decontamination of workers or of materials and equipment. The facility minimally consists of a clean room, a shower room, and an equipment room.
27. Clean Room - An uncontaminated area or room, which is part of the worker decontamination facility, with provisions for storage of workers' street clothes and clean or unused protective equipment.

- 28. Shower Room - A room between the clean room and the equipment room in the worker decontamination facility, with hot and cold running water, soap, shampoo, and suitably arranged for complete showering during decontamination.
- 29. Equipment Room - A contaminated area or room that is part of the worker decontamination facility, with provisions for storage of contaminated clothing and equipment.
- 30. Wet Cleaning - The process of eliminating asbestos contamination from building surfaces and objects by using cloths, mops, or other cleaning tools which have been dampened with water, and by afterwards disposing of these cleaning tools as asbestos-contaminated waste.
- 31. Water Filtration System - A local water-filtering system capable of trapping and retaining 99.9% of asbestos fibers greater than 5 micron in size.
- 32. Fixed Object - A unit of equipment or furniture in the work area which is not removed from the work area. To include chalk boards, bulletin boards, TV stands etc.
- 33. Movable Object - A unit of equipment or furniture in the work area, which can be feasibly removed from the work area without disassembly.
- 34. MSDS - Material Safety Data Sheet - OSHA Form 20 or equivalent form containing health hazard information about chemical products.
- 35. NESHAPS - The National Emission Standards for Hazardous Air Pollutants (40 CFR Part 61).
- 36. NIOSH - National Institute for Occupational Safety and Health.
- 37. OSHA - Occupational Safety and Health Administration.
- 38. EPA - Environmental Protection Agency.
- 39. ASTM - American Society for Testing and Materials.
- 40. ULI - Underwriters Laboratories, Inc.
- 41. Chemical Mastic Remover - A non-flammable solvent manufactured especially for the removal of mastic materials. **The flash point of the mastic remover used on District projects must be no less than 140 degrees Fahrenheit.**

PART 2 - APPLICABLE STANDARDS AND GUIDELINES

2.01 REFERENCE DOCUMENTS AND RESOURCES

- A. All work covered by these regulations shall be performed in accordance with all applicable federal, state, and local regulations, standards, and codes governing asbestos abatement, transportation, and disposal. The current issue of each document shall govern. Where conflict among requirements or with these specifications, the more stringent requirements shall apply. Requirement shall include but not be limited to:
- B. Department of Transportation
 - Title 49 CFR 172 – Special Provisions, Hazardous Materials Communications, Emergency Response Information and Training requirements.
 - Title 49 CFR 173 – General Requirements for Shipments and Packaging.
- C. Environmental Protection Agency (EPA)
 - Title 40 CFR, Part 763, Asbestos Containing Materials in Schools (AHERA)
 - Title 40 CFR 61, Subparts A & M – National Emission Standard for Asbestos (Neshaps)
 - Title 40 CFR, Part 763 – Revised Model Accreditation Plan
- D. Federal Occupational Safety and Health Administration (OSHA)
 - Title 29 CFR 1910.20 – Access to Employee Exposure and Medical Records
 - Title 29 CFR 1910.38 – Emergency Procedures
 - Title 29 CFR 1910.134 – Respiratory Protection
 - Title 29 CFR 1926.20 – General Safety and Health Provisions
 - Title 29 CFR 1926.21 – Safety Training and Education
 - Title 29 CFR 1926.23 – First Aids
 - Title 29 CFR 1926.24 – Fire Protection
 - Title 29 CFR 1926.25 – Housekeeping
 - Title 29 CFR 1926.28 – Personal Protective Equipment
 - Title 29 CFR 1926.51(f) – Washing Facilities
 - Title 29 CFR 1926.55 – Gases, Vapors, Fumes, Dusts, and Mists
 - Title 29 CFR 1926.56 – Illumination
 - Title 29 CFR 1926.57 – Ventilation
 - Title 29 CFR 1926.59 – Hazard Communication Standard
 - Title 29 CFR 1926.103 – Respiratory Protection
 - Title 29 CFR 1926.300, 301, 302 – Hand and Power Tools
 - Title 29 CFR 1926.451 – Scaffolding
 - Title 29 CFR 1926.500, 502, 503 – Fall Protection
 - Title 29 CFR 1926.1101 – Asbestos Standard for the Construction Industry

- E. Nevada Division of Environmental Protection (NDEP)
- NAC 444.965 to 444.976 – Sanitation of Asbestos
- F. Nevada Occupational Safety and Health Enforcement Section (OSHES)
- NAC 618.850 to 618.907 – Abatement of Asbestos, General Provisions
 - NAC 618.910 to 618.948 – Abatement of Asbestos, Licensing and Accreditation to Perform Services
 - NAC 618.950 to 618.962 – Abatement of Asbestos, Performance of Activities for Abatement
 - NAC 618.970 to 618.986 – Abatement of Asbestos, Disciplinary Action
- G. Washoe County District Health Department, Environmental Health Services Division. (WCHD)
- 030107A to 030.107C – District Board of Health Regulations Governing Air Quality Management (regarding asbestos)
 - 030.184 to 030.185 - District Board of Health Regulations Governing Solid Waste Management
- H. STATE AND LOCAL REQUIREMENTS
1. The Contractor shall comply with the State of Nevada, Division of Occupational Safety and Health Regulations for construction and handling of asbestos. All Contractor personnel will have the applicable Nevada OSHES card on their person at all times during the completion of the project. Personnel will be required to present the license to District personnel upon request. Personnel without their Nevada OSHES card, or with unreadable or mutilated cards, or expired cards will not be allowed to work on the project until a readable, unexpired card is produced.
 2. The Contractor shall comply with the Federal Environmental Protection Regulations pertaining to handling and disposal of asbestos-containing materials as well as the State of Nevada and any local governmental agencies which have delegated responsibility for the administration and enforcement of NESHAPS and other federal regulations.
 3. The Contractor shall comply with all requirements of the EPA approved landfill which is selected as the disposal site.
- I. OTHER REQUIREMENTS
- ANSI - American National Standards Institute: ANSI Z9.2 Fundamentals Governing the Design and Operation of Local Exhaust Systems.
- J. The Contractor shall comply with said regulations, requirements, and standards (noted in B through I) and require and be directly responsible for compliance therewith on the part of his agents, employees, and subcontractors; and shall directly receive and be responsible for all citations, assessments, fines or penalties which may be incurred by reason of his agents, employees, or subcontractors failing to so comply.

PART 3 - REQUIRED DOCUMENTATION

3.01 SUBMITTALS AND NOTICES

A. PRIOR TO COMMENCEMENT OF WORK, ALL THE FOLLOWING MUST BE SUBMITTED TO THE WCSD, ES&A DEPARTMENT

1. Notification in writing of proposed asbestos work, with copy to the WCSD, ES&A Department, the EPA Regional Office, OSHA or OSHA Regional Office, local air pollution agency, and local authority with responsibility for enforcement of occupational health and safety regulations and enforcement of NESHAPS regulations and with jurisdiction in the State in which this project is located, not fewer than ten (10) working days before work commences on this project. Courtesy notifications will be submitted on **all** projects regardless of the regulatory requirement.
2. Submit proof satisfactory to the WCSD, ES&A Department that all required permits, site locations, and arrangements for transport and disposal of asbestos-containing materials, supplies and the like have been obtained.
3. Submit documentation to the WCSD, ES&A Department indicating that all employees have had medical examinations (See Section 02110, PART 3, 3.01, B, 6) and instruction on the hazards of asbestos exposure, use of protective clothing, on use of showers, on entry and exit from work areas, on work procedures and protective measures, and on all aspects of 29 CFR 1910.134 (See also Section 02130, PARTS 3 and 4).
4. Submit documentation to the WCSD, ES&A Department that fifty (50) percent of the work force (exclusive of job foremen, superintendents, etc.) have at least one year's experience in asbestos abatement work for any employee not already approved and verified.
5. Submit to the WCSD, ES&A Department documentation that all superintendents, and supervisors have been certified as supervisors for at least two (2) year's and possess two (2) years' experience supervising asbestos abatement projects in that capacity for any employee not already approved and verified.
6. Submit documentation that **all** of the work force members are licensed by the State of Nevada in the field of asbestos control. Personnel will be required to present the license to District personnel upon request. Personnel without their Nevada OSHES card, with unreadable or mutilated cards, or expired cards will not be allowed to work on the project until a readable unexpired card is produced.
7. Submit documentation that each negative air machine and HEPA vacuums have been "thermally DOP tested" by a "third party" testing agency within a 6 month period prior to the start of each project. The "third party" testing must be conducted by a testing agency with its own testing equipment and may have no relationship with the contractor. The District's decision regarding the issue of when a testing agency meets the "third party"

requirement will be regarded as final and conclusive. The Contractor will be required to submit DOP test result certification for each unit prior to its use. The DOP testing company will be required to strictly comply with the manufacture procedures and testing media. The District may require access to review the DOP testing conducted during the contract period. **Any negative air machine or vacuums that are to be exhausted outside of a negative pressure enclosure must be DOP tested on-site prior to the start of any project. In addition equipment inside a containment larger than 2000 square feet will require on-site DOP testing of all negative air machines and vacuums prior to the start of the project.** Contractor will be required to add this delay for DOP testing into the project schedule and supplement the workforce accordingly to maintain the required abatement schedule.

8. Submit documentation that each negative air recording device (manometer) has been calibrated within 12 months prior to the start of each project.
 9. Various manufacturers' information, including MSDS's, for approval, prior to its use on any project. In addition to submitting a copy to the ES&A department, Contractors will also be required to provide to the site's administration office and the Site Coordinator (head custodian) one complete copy of all MSDS's for all chemicals used on site.
 10. Proof of insurance coverage prior to the start of each project.
 11. Submit documentation from the Contractors asbestos liability insurance company, information on all area and personal area monitoring requirements. A complete copy of the insurance policy including any riders must be provided.
 12. Submit documentation to the District indicating that all employees have taken the required AHERA training for the type of work they will be performing. Legible copies of each employee's initial training class and copies of the most recent refresher must be submitted. All employees will be required to have in their possession when performing abatement work the original copies of the initial training and refresher training certificates. District inspectors will review certificates in the field. Personnel without their AHERA training certificates, with unreadable or mutilated certificates, or expired certificates will not be allowed to work on the project until a readable initial or unexpired refresher certificate is produced.
- B. The following procedure is to be implemented in an effort to reduce the time and cost to submit worker/employee training certs, Nevada State license, and physical documentation, items #3, #6 and #12 listed above. The required compliance will reduce the time the Contractor must put forth submitting training/physical documents as well as reduce the time it takes to review and approve the documents submitted. Contractors **will not** submit duplicate documentation to the ES&A department or representatives in the field that the ES&A department already has on file. Contractor can request a complete list of documents the ES&A department has on-file by calling the ES&A department at 851-5675 and one will be provided.

1. **At least two weeks prior to the start of the project**, contractor shall provide all worker/employee training certs and physical documentation for employees not already in the WCSD training database, to the ES&A Department at 7495 South Virginia Street, Reno, Nevada. To do this electronic copies will be provided through e-mail to the ES&A department Administrative Secretary. Contact the ES&A department Administrative Secretary. At 851-5675 if you do not their e-mail address. The ES&A Department will review the submitted training documentation and pre-approve workers and supervisors so they can work on the assigned WCSD project.
 2. New workers added to the project after the start of the project will be approved by the ES&A department within one 8 hour period of the standard Monday thru Friday normal work schedule. Certification submittal will be serviced by the ES&A Department on a first come, first served basis. Delays to review the documentation will be anticipated and taken into account on any project schedule developed.
 3. Workers or technicians will not report to the job site until they have been added to the ES&A database and properly documented on the contractors training report which is provided to ES&A or lead supervisory consulting staff in the field. ny way that requires certification on that project.
 4. Contractors should request and will be provided a copy of the most current WCSD Company Training Report for their company which will identify training and physical documentation on file with WCSD for each employee. This database should be kept current by perspective bidders by providing to the ES&A department any new documentation when it is received for their employee so no delays are encountered due to a contactor not keeping this companies documentation current. Do not wait till you get a bid to provide updated data for your employees otherwise delays can occur.
 5. ES&A staff in the field or environmental lead consulting staff will not be allowed to let anyone work or show up to the job site of they are not up to date on their documentation as identified on the WCSD Company Training Report.
- C. The Contractor shall submit to the WCSD, ES&A Department, upon request, any other information the District may require, including, but not limited to, the following:
1. Weekly work schedule.
 2. Type and brands of materials for worker protection.
 3. Method of application and materials to be used.
 4. Medical examination results of all employees (OSHA 1910.1001), including chest roentgenogram, pulmonary function and forced expiratory volume at one second (Contractor is responsible for obtaining the appropriate medical releases).
 5. Schedule for changing filters in negative air pressure system and water filtration system.
 6. Copies of all OSHA Form 101 or equivalent accident/injury/incident reports.

- D. The Contractor shall submit directly to the WCSD, ES&A Department, **not Capital Projects Construction personnel**, or the Districts Consultant, upon each jobs completion And prior to final invoice submittal, a complete original documents job package including the following, **this is in addition to any other contract required documentation or documentation requested by others like asbestos consultants:**
1. Asbestos Removal Certification Letter signed and dated by the Contractors representative with language certifying that all asbestos materials have been properly removed in accordance with all Federal, State and Local regulations.
 2. Asbestos insurance certificates
 3. Manometer documentation that records air pressure differential between work areas and external air).
 3. Copies of all daily manpower, work logs, and containment sign in logs indicating area(s) and type of work performed.
 4. An original copy of all certifications of disposal.
 5. Copies of permits.
 6. Copy of the submitted notifications or courtesy notifications
 7. Personal air sampling logs and an original air sampling results of each personal air sample taken on the project. The submitted log and sample results must include all the required data listed under air monitoring, Section 02120, part 2 of the technical specifications on page 23 and 24. The submittal of all personal sampling data identified above is in addition to the submittal of daily sample logs.
- E. It is the Districts intention that the Contractors are responsible for supplying to the WCSD ES&A Department all Contractor generated documents. WCSD District-hired asbestos abatement consultants will be required to supply the following documents as a minimum, to the WCSD ES&A Department, at the end of the project and prior to final billing. The cost for development and submittal of the following is to be included in the asbestos consulting cost estimates provided to WCSD. Any costs for asbestos consultants to gather and/or submit a duplications of Contractor items listed above is not to be added to the Consultant's cost estimate. The District will not pay for this service twice, as the document submission of Contractor documents will be included in a Contractor's bid.
1. Summary letter explaining what was done, with a certification statement that observed work was done in accordance with Contract Specifications.
 2. Drawing identifying what was done with post abatement notes, with information as required to identify all abatement work done.
 3. Consultant's Daily logs documenting what was done, notes and narratives of the daily progress of the Contractor, and the steps taken to enforce contract specifications. Important project milestones should be addressed, as well in these daily logs, and pictures are encouraged.

4. Clearance air sampling maps identifying the outline of the abatement containment, date that the samples were taken, times that pumps were turned on and off, and flow measurements for each set of clearance air samples.
 5. Copy of each clearance air sample laboratory chain of custody forms.
 6. A copy of each clearance air sample laboratory results.
 7. Area air sampling maps identifying the location samples were taken, date that the samples were taken, times that pumps were turned on and off, and flow measurements for each set of area air samples.
 8. Copy of each area air sample laboratory chain of custody forms.
 9. A copy of each area air sample laboratory results.
 10. Bulk sampling map(s) identifying the locations any bulk samples were taken (if applicable).
 11. Copy of any bulk sample laboratory chain of custody forms (if applicable).
 12. A copy of each bulk sample laboratory results (if applicable).
- F. The Contractor will submit daily by fax or e-mail to the WCSD, ES&A Department a copy of a daily air monitoring log with the numbers of all air monitoring cassette taken that day and the location taken or activity conducted by the personnel wearing the sample. A copy of each projects sample logs will not be acceptable. The daily sampling data listed above must be combined from all projects and listed on one daily air-monitoring log.
- G. The Contractor shall have his laboratory e-mail or fax within **48 hours** of the date the sample was taken final laboratory result documents for air monitoring to the WCSD, ES&A Department. No hand written result report will be allowed. The laboratory reports will reference the air monitoring cassette's factory assigned number and the personal air monitoring results must be properly applied to an 8 hour time weighted average. Failure to submit results within the required 72 hour period may result in the District temporarily stopping the applicable abatement projects until results are received. Continued failure may also result in the termination of this contract.
- H. The contractor may only invoice for a percentage of the project as agreed upon by the WCSD Project Manager & Contractor at the completion of work. but prior to submitting the final complete job package to the WCSD, ES&A Department at the Contrator discretion. The remaining agreed upon % may not be invoiced, and will not be authorized for payment until a complete job package has been submitted to the WCSD, ES&A Department and the completed package has been reviewed for correctness and accepted and all restoration of damage has been completed.

- I. The Contractor will submit **daily** by fax or e-mail to the WCSD, ES&A Department an activity log with the location that contractor conducted activities that day, with a complete listing of workers assigned to each project.
- J. Upon submittal, job packages will be reviewed for completeness by the WCSD, ES&A Department. In the event that a job package must be returned more than once, due to omissions or corrections, the contractor shall deduct a \$200.00 processing fee from the projects final invoice, one fee per each occurrence after the first that the WCSD ES&A Department, district consultant or WCSD project Manager must contact the contractor due to omissions or errors.

PART 4 - SPECIAL PROCEDURES

4.01 ACCEPTANCE CRITERIA

- A. Before any building or section of any building can be occupied by any personnel without respiratory protection, the level of airborne fibers must be less than or equal to the AHERA clearance level.
- B. After the final cleaning, projects will be cleared by laboratory analysis of 5 air monitoring cassettes taken by the Owner, or Owner representative, inside the containment using aggressive methods. The analysis of cassettes from projects under 160 square feet will be analyzed by Phase Contrast Microscopy (PCM), NIOSH 7400. Projects over 160 square feet will analyzed by Transmission Electron Microscopy (TEM). Acceptable clearance levels for PCM analysis is all samples must be less than or equal to .01 fibers/cc. The Acceptable clearance level for TEM analysis is the average of the 5 samples taken inside the containment must be equal to or less than 70 asbestos structures per square millimeter. Fiber levels outside of the containment **cannot** be deducted from samples inside the containment to meet clearance criteria. It is the Contractor's responsibility to filter make-up air if so deemed necessary. Failure to filter a containments make up air will not relieve the Contractor from reimbursing the District for additional clearance samples that exceed clearance levels and fibers from outside the containment are suspected.
- C. In the event that the initial clearance samples do not meet with the above protocol for air sampling clearance, the Contractor shall bear all costs required to perform additional sampling.
- D. The District or Districts hired asbestos consultant will only perform as many air clearances as time allows. All attempts will be made to accommodate all requested requests for air clearance but the Contractor will be required to anticipate this requirement. Any delays or equipment tie ups due to the Contractors requiring more clearance samples then time allows on any given District work day is solely the responsibility of the Contractors and no additional fees will be paid to the contractor by the District. The Contractor will be required to have enough equipment available to maintain the required schedule in spite of any delays due the contractor requiring more samples then time allows. Locations requiring clearance sampling must be scheduled with the District one (1) day in advance by mail or fax. The containment must be ready for clearance sampling by 12:00 PM or earlier the day the samples are scheduled to be taken or the samples will be taken the next day. Contractor will anticipate an up to a 48 hour delay in receiving from the District TEM laboratory results.

4.02 STOPPING THE WORK

- A. If, at any time, the WCSD, ES&A Department decides that work practices are violating pertinent provisions of the Contract, endangering workers, innocent bystanders, or endangering District facilities, they will immediately notify the Contractor in writing that operations shall cease until corrective action is taken and the Contractor shall take such corrective action before proceeding with the work.
- B. If, at any time, the negative air pressure system is not operating in compliance with Sections 02120, PART 3, 3.02 and 02140, PART 1, 1.01H, and/or units are non-operational, operations shall cease until corrective action is taken and the Contractor shall take such corrective action before proceeding with the work.
- C. Delays caused by inappropriate work practices as noted in 4.02A or 4.02B (Section 02110, PART 4) and/or excessive airborne fiber concentrations (defined as concentrations in excess of 0.2 fibers/cc, TWA) shall be at the Contractor's expense. No later claims for extra compensation which result from action taken under 4.02A, 4.02B or 4.02C (Section 02110, PART 4), or other delays caused by the Contractor failure to comply this Contract specifications will be recognized by the District.
- D. In case of disagreement between the District and the Contractor regarding the analysis of any air monitoring data, either personal or area, the results of the District will be regarded as final and conclusive.

4.03 SITE SECURITY

- A. The work area is to be restricted only to authorized, trained, and protected personnel. These may include the Contractor's employees, employees of subcontractors, District employees and representatives, State and local inspectors and any other designated individuals. The Contractor is responsible to ensure that the security of the building is not diminished and install all outside negative air machine exhaust ports in a secure manner. Failure to provide adequate security measures will leave the Contractor responsible to loss or damage of property if it is determined that access was gained through an inadequate security measure employed by the Contractor. A list of authorized personnel shall be established prior to job start and posted in the clean room of the worker decontamination facility and in the Contractor's office. The Contractor will not restrict access to District asbestos personnel to any asbestos containment at any time.
 - 1. Contractor shall be notified by the District of any other authorized visitors prior to their entry to the job site.
- B. Entry into the work area by unauthorized individuals shall be reported immediately to the District by the Contractor.

- C. A log sheet shall be maintained in the clean-room area of the worker decontamination system or Contractor's office. Anyone who enters the work area must record name, affiliation, time in, and time out for each entry (See Section 02140, PART 1, 1.04G).
- D. Should any keys that have been signed out to the Contractor become lost and cannot be found, the Contractor may be responsible for all cost associated with re-keying all locks at the site that the lost key opened.

4.04 EMERGENCY PLANNING

- A. Emergency planning and procedures shall be developed by the Contractor prior to abatement initiation and agreed to by the Contractor and District.
- B. Emergency procedures shall be in written form and prominently posted in the clean change area and equipment room of the worker decontamination area. All employees must read and sign these procedures to acknowledge receipt and understanding of work site layout, location of emergency exits and emergency procedures.
- C. Emergencies may arise during the progress of work which may require special effort or require extra shifts of personnel to continue the work beyond the normal working hours. Be prepared in case of such emergency to do all necessary work promptly, at no additional cost to the District.
- D. The Contractor shall file with District the names, addresses and telephone numbers of local personnel who can be contacted at any time in case of emergency. These persons must be fully authorized and equipped to correct unsafe conditions on short notice.
- E. The Contractor shall provide the District with means to contact the Contractor or his representative, available 24 hours a day, in the case of emergencies while asbestos projects are in progress. Acceptable means would be a home or office phone plus a cell phone or beeper for when the Contractor is out of the home or office. Vehicle phone will not be acceptable. If the Contractor assigns this responsibility to one of his employees, the employee must have authorization and the ability to perform any emergency response requested.

4.05 PRE-CONSTRUCTION MEETING

- A. The Contractor shall attend as specified a pre-construction job meeting at a time agreed upon by the Contractor and the District. Attending this meeting will be representatives of the District who will actually participate in the District's asbestos project monitoring program. The preconstruction meeting may be held via the telephone at the District's option. This meeting may be waived at the District's discretion.
- B. At this meeting or prior to starting work, the Contractor shall provide all submittals as required in Section 02110, PART 3. They shall be prepared to discuss the following information:

1. Preparation of work area.
2. Personal protective equipment including respiratory protection and protective clothing.
3. Employees who will participate in the project, including delineation of experience, training, and assigned responsibilities during the project.
4. Decontamination procedures for personnel, work area and equipment.
5. Abatement methods and procedures to be utilized.
6. Required air monitoring procedures.
7. Procedures for handling and disposing of waste materials.
8. Procedures for final decontamination and clean-up.
9. Detailed work and performance schedule.
10. Emergency procedures.

SECTION 02120

MATERIALS AND EQUIPMENT

PART 1 - GENERAL

- 1.01 It should not be inferred that all materials, tools and equipment listed in Part 2 are required or that all required materials, tools and equipment necessary are listed herein.

PART 2 - MATERIALS

- 2.01 Deliver all materials in the original packages, containers or bundles bearing the name of the manufacturer, the brand name, and labeling as required by 29 CFR 1910.1200.
- A. Store all materials subject to damage off the ground, away from wet or damp surfaces, and under cover sufficient to prevent damage or contamination.
 - B. Damaged or deteriorating materials shall not be used and shall be removed from the premises. Material that becomes contaminated with asbestos shall be disposed of in accordance with the applicable regulations.
- 2.02 Polyethylene sheeting of a **true** 4 mil and 6 mil thickness unless otherwise specified, clear in color and in sizes to minimize the frequency of joints. All Polyethylene sheeting will be **Fire retardant**.
- 2.03 Polyethylene bags, properly labeled, of a **true** 6 mil thickness, clear in color, for disposal of asbestos debris.
- 2.04 Tape - capable of sealing joints of adjacent sheets of plastic sheets and for attachment of plastic sheet to finished or unfinished surfaces of dissimilar materials and capable of adhering under dry and wet conditions, including use of amended water, chemical removers, or removal encapsulant.
- 2.05 Surfactant (wetting agent) - shall consist of 50% polyoxyethylene ester and 50% polyoxyethylene ether, or equivalent and shall be mixed with water to provide a concentration of 1.25 kg/cubic meter of water.
- 2.06 Chemical Remover - suitable to aid in removal of ACM such as EPA 55 or equivalent.
- 2.07 Removal Encapsulant - suitable to aid in removal of ACM such as Asbestite 1000, Serpiflex Shield #4, BWE 5000, or equivalent; the removal encapsulant shall act as its own solvent and be capable of binding and encapsulating individual asbestos fibers.
- 2.08 Impermeable containers (Drums) - suitable to receive and retain any asbestos-containing or contaminated materials until disposal at an approved site. (The containers shall be labeled in accordance with OSHA Regulations 29 CFR 1910.1001).

- 2.09 Warning labels and signs - as required by Regulation.
- 2.10 Encapsulant - Penetrating type, such as Asbestite 2000, American Coatings' Cable Coating 22p, SK 13-1C, BWE 3000, or equivalent. The encapsulant should have a coverage of 80 square feet per gallon and shall be compatible with new applications of flooring mastic. The encapsulant **must** be **clear** in color.
- 2.11 Encapsulant - Bridging type, such as American Coating FNE High Temperature Sealant, Ocean 666, or equivalent. Bridging encapsulant shall have a coverage of 25 square feet per gallon. Any encapsulant installed must be compatible with any new products that will be installed over the encapsulated such as flooring products.
- 2.12 Spray Poly - Spray applied water resistant film with minimum coverage of 16 mil thickness when wet, such as Isotek Spray Poly or equivalent.
- 2.13 Other Materials - provide all other materials as specified in drawings; also, other materials such as lumber, nails, and hardware, which may be required to construct and dismantle the decontamination area and the barriers that isolate the work area.
- 2.14 Chemical Mastic Remover - A non-flammable solvent manufactured especially for the removal of mastic materials such as Control Low Odor, Sentinel 747, or equivalent. The flash point shall be no less than 140 degrees Fahrenheit.

PART 3 - TOOLS AND EQUIPMENT

- 3.01 Provide suitable tools for asbestos removal. The minimum acceptable amount of equipment to support this contract is estimated at 4 recording manometers, 4 standard incline manometers, 4 shower and water filter units, and twenty four 1500 cfm negative air units. This is an estimate of the minimum equipment and additional equipment may be required to comply with Contract Specifications and Documents.
 - A. If the Contractor is unable to keep up with the requested work schedule due to the lack of required equipment or inoperable equipment, the District reserves the right to purchase or rent equipment which will then be supplied to the Contractor. The Contractor will then be responsible to reimburse the District for the cost associated with the rental or procurement. The District would only exercise this option in the event the Contractor fails to take reasonable steps on his own to repair his own equipment or rent or procure equipment necessary to keep up with the requested schedule.
 - B. Under no circumstance will contaminated tools or equipment, be placed inside of a District room outside of a containment. Contaminated tools and equipment will be sealed in impermeable plastic bags (minimum of six-mil thick) and **immediately** transported into the containment from the transporting vehicle directly into a containment that has already had its critical barriers completed and is under negative pressure. This includes equipment or tools that is placed in bags or sealed in plastic.

- 3.02 Negative Air Pressure System - a negative pressure must be established in the work area by means of a local exhaust system. The equipment shall exhaust through a **three** or more stage HEPA filtration system to the outside of the work area. The equipment shall be in operation for 24 hours per day until decontamination and final clean-up of the work area is completed. A recording device shall be used to provide documentation of the pressure differential of 0.03 inches of water gauge. The system shall have the following additional characteristics:
- A. Filtration equipment in compliance with ANSI Z9.2, Local Exhaust Ventilation.
 - B. Capable of maintaining a minimum pressure differential of minus 0.05 inch of water gauge in the work area relative to adjacent areas. The 0.05 inch of water gauge requirement must be maintained throughout the removal process including the waste load out and during the entrance and exit of the containment through the Decon. It is suggested that this is considered when calculating the negative air requirements of each containment.
 - C. Negative air pressure system units shall be employed in sufficient quantity to provide no less than **eight (8)** air changes per hour in the work area.
 - D. Negative pressure units **must** be exhausted to the outside of the building through a reinforced **Owner** approved opening. In the event a window or door to the outside is removed, the opening installed will be vandal proof and not reduce the security of the building. As a minimum, when a window or door is removed, the contractor must install a plug constructed of 1/2" plywood. The plug must be larger than the hole and secured inside the opening with two or more wood 2 x 4s installed crosswise and secured with 3/8" tamper proof bolts.
 - E. **Pre-fabricated** metal reinforced exhaust tube will be utilized to exhaust all negative air machines. The exhaust tubing utilized must be the same size throughout the exhaust run and the same size as the negative air machine exhaust port. Continuous runs of tubing without splices are required for runs less than twenty-five feet (25'). The Pre-fabricated exhaust tubes will be replaced at the first signs of wear. Contaminated, taped or damaged tubes will not be allowed to be used. The Districts decision regarding when an exhaust tube requires replacement will be regarded as final and conclusive.
 - F. At the discretion of the Owner and at no extra cost the contractor may be required to install an extension to the negative air exhaust tube where it exits a containment. The extension will be constructed of metal reinforced exhaust tubing. Typically the extension would extend from the plug to a point on the roof determined by the District inspector.

- G. The negative air machine exhaust tubing will be routed as per the direction of the District inspector. The routing of the negative air machine exhaust tubing through rooms not included in the containment will not be allowed unless there are no exterior windows or doors present inside the containment area. In the case of inoperable windows, Contractors will be required to hire a window company or perform the work themselves to remove and properly re-install inoperable windows as required so the negative air machine exhaust tubing is routed through windows. Only the WCSO ES&A department AHERA Project Designer certified staff are allowed to sign off on any instance, where a negative air machine tube is routed through a room that is not a part of the asbestos abatement containment area, instead of using a window or other exterior openings. No exceptions and Contractors must bid accordingly.
- 3.03 Water Filtration System - Water used for showering in the decontamination area and any other asbestos-contaminated water must be filtered prior to disposal as waste water. The system shall contain at a minimum a three-stage filtering system with the following additional characteristic:
- A. Capable of trapping and retaining 99.9% of asbestos fibers greater than 3 microns in size.
- B. All water systems equipment to include showers and filter systems will comply with all (including the District's) applicable backflow/cross connection prevention requirements. The District will enforce all backflow/cross connection prevention requirements
- 3.04 Airless Pump - Encapsulant, if spray-applied, shall be applied with an airless pump in order to minimize fiber dispersion during the decontamination process. The tip shall have an orifice of .019 to .026 or as required by the manufacturer of the encapsulant selected for use.
- 3.05 Type "C" Supplied Air System - A continuous flow or pressure-demand, supplied air respirator, NIOSH/MSHA certified or other suitable air filtration system, as required by OSHA regulations for performance of work of this nature, is suggested for all workers. Type "C" system shall have visual and audible alarms to warn of carbon monoxide levels in excess of 20 ppm. Such system shall meet all criteria prescribed by OSHA for supplied air respirators. It also must be fully certified for hose length combinations up to 300 feet. Either half-mask or full facepiece units fitted with HEPA filter back-up units are acceptable.
- 3.06 Temporary electrical cords and outlets shall be of an approved type and connected to a source of power outside of the work area as directed by the District (see Section 02140, 1.01). All temp power cords must be plugged into a ground fault interrupter equipped power source.

SECTION 02130

COMPLIANCE REQUIREMENTS

PART 1 - PERSONAL PROTECTION

1.01 RESPIRATORY PROTECTION

- A. Provide workers with clean and properly maintained respiratory equipment approved by NIOSH/MSHA as specified in Section 02120, PART 3, 3.05. The Contractor must present documentation of no less than five (5) similar projects with personal sampling results indicating that employee exposure levels were at "clean air levels" (0.01 f/cc) inside the respirator. Half-mask air-purifying respirators equipped with high-efficiency particulate air (HEPA) filters may be utilized with written permission of the Owner. Initially, temporary approval for the use of half-mask respirators will be granted after receipt of the proof requested above. Continued authorization will be considered based thereafter on personal monitoring samples taken on projects completed under this contract. If the Contractor consistently maintains personal monitors levels at or below "clean air levels" (0.01 f/cc inside the respirator) on a 8 hour time weighted average, continued use of half-mask respirators will be authorized. Should the personal monitoring or area monitoring levels show the contractor is unable to maintain levels at the "clean air levels" (0.01 f/cc), inside the respirator, the half-mask authorization will be rescinded. Area or personnel monitoring level above 1.0 fibers/cc TWA will require that personnel utilize type "C" respiratory protection. The Contractor will be responsible for providing sample results that have been applied over the 8 hour time weighted average. When utilized, the Contractor shall provide a sufficient quantity of filters during the work day. The clean respirator filters shall be stored at the job site in the change room and shall be totally protected from exposure to asbestos prior to their use.site in the change room and shall be totally protected from exposure to asbestos prior to their use.
1. Single-use or disposable respirators will not be permitted at the job site.
 2. Contractor shall also monitor and provide documentation indicating that the workers are properly protected against over exposure to any of the chemicals contained in the chemical mastic remover(s).
 3. Additional air filter protection will be required when chemical solvents are used.

1.02 PROTECTIVE CLOTHING

- A. Provide workers with sufficient sets of protective full-body clothing. Such clothing shall consist of full-body coveralls and headgear. Provide eye protection and hard hats as required by applicable safety regulations. Non-disposable type protective clothing and footwear shall be left

in the Contaminated Equipment Room until the end of the asbestos abatement work, at which time such items shall be disposed of as asbestos waste, or shall be thoroughly cleaned of all asbestos or asbestos-containing material. Disposable type protective clothing, headgear, and footwear may be used and shall be disposed of as asbestos waste. Bare feet will not be permitted.

1.03 WORKER PROTECTION PROCEDURES

- A. Each worker shall, upon entering the job site: Remove street clothes in the clean change room, put on a respirator and clean protective clothing before entering the equipment room or work area, except that workers intending to rewear contaminated protective clothing stored in the equipment room shall enter equipment room wearing respirators.
- B. Each worker shall, each time he leaves the work area: Remove gross contamination from clothing before leaving the work area; proceed to the equipment room and remove all clothing except respirators; still wearing the respirator, proceed to the showers; clean the outside of the respirator with soap and water while showering; remove the respirator; thoroughly shampoo and wash themselves, remove filters (where required) and place them in the container provided for the purpose; and wash and rinse the inside of the respirator.
- C. Following showering, each worker shall proceed directly to the clean change room and dress in clean clothes at the end of each day's work, or before eating, smoking or drinking. Before re-entering the work area from the clean change room, each worker and authorized visitor shall put on a clean respirator with filters (where required) and shall dress in clean protective clothing, except that workers intending to rewear contaminated protective clothing stored in the equipment room shall enter the equipment room wearing respirators.
- D. Contaminated work footwear shall be stored in the equipment room when not in use in the work area. Upon completion of asbestos abatement, dispose of footwear as contaminated waste or clean thoroughly inside and out using soap and water before removing from work area or from equipment and access area. Store contaminated protective clothing in the equipment room for reuse or place in receptacles for disposal with other asbestos contaminated materials.
- E. Workers shall not eat, drink, smoke or chew gum or tobacco, or utilize sanitary (toilet) facilities at the worksite except in established locations outside the work and containment areas, and enclosures.
- F. Workers shall be fully protected with respirators and protective clothing immediately prior to the first disturbances of asbestos-containing or contaminated materials and until final clean-up is completed. This includes removal of fixtures, ceilings, or anything else which may disturb the ACM.

PART 2 - AIR MONITORING

- 2.01 Throughout the removal and subsequent cleaning operations AMBIENT (AREA) MONITORING may be conducted by the District to ensure that the Contractor is complying with all regulations and is conducting the work in a manner which minimizes airborne asbestos levels as well as minimizes the contamination of the District's facilities.
- A. The Contractor is responsible to complete all regulatory required area monitoring and all area monitoring that is required by the Contractors liability insurance company.
- 2.02 Throughout the removal and subsequent cleaning operations, PERSONAL AIR MONITORING shall be conducted by the Contractor. Such samples shall be taken in order to establish an 8-hour TWA (for example, a minimum time of 480 minutes at 2.0 lpm) and exposure for each type of employee operation. Analytical results of personal air samples shall be sent to the Districts ES&A Department and provided to the Districts asbestos consultant on a 72 hour turn-around basis. Electronic PDF final reports shall be e-mailed directly to the District ES&A department directly from the Contractor's laboratory. Personal monitoring will be conducted on 50% of the workers. The workers shall wear personal monitoring devices, and all sampling will be conducted in each workers breathing zone only. Asbestos Consultants hired by WCSO, and supervising asbestos abatement projects, are required to strictly enforce these Personal Air Monitoring requirements, so Contractors must plan accordingly. Failure for the Contractor to provide air sampling results within 72 hours requires that the District's consultant supervising the project must stop the job. No exceptions. To that end, District Consultants must monitor the situation and provide the Contractor a written 24 hours notification, after 48 hours that results have not been received. After these 24 hours have transpired, the Consultant must stop the job awaiting submittal of required sampling results. No exceptions.
- A. For each set of air samples submitted to a laboratory by the Contractor for analysis, the Contractor shall submit a blank cassette for analysis (minimum of 10 percent). Each blank cassette shall be submitted as a part of the Contractor's quality control program.
- B. Any PCM air sample submitted by the Contractor for analysis shall be to an independent laboratory currently enrolled in the AIHA/NIOSH proficiency Analytical Testing (PAT) program.
- C. The Contractor shall use factory pre-numbered air monitoring cassettes and note each cassette's numbers on the daily log or a separate monitoring cassette log. The number on each cassette shall be recorded **PRIOR** to use. Each cassette's number will also be listed on the laboratory analysis request form and also be referenced on the Laboratory sample analysis report. A copy of the daily log or separate monitoring cassette log will be e-mailed to the ES&A department **and** the District's asbestos consultant **daily** for all projects in progress. Asbestos Consultants hired by WCSO and supervising asbestos abatement projects are required to strictly enforce these requirements so they must monitor and document this process as a part of the Consultants project monitoring process.

- D. Daily project personal air sample logs must be kept and submitted. As a minimum the sample log must include, date sample taken, air flow measurements taken at the start and finish of the sampling duration, time started and stopped, the factory assigned cassette number, employee sampled, and the activity of the employee. Legible sample logs will be submitted in the completed job package along with an original laboratory analysis report. Consultants hired by WCSD and supervising asbestos abatement projects are required to strictly enforce these requirements so they must monitor and document this process as a part of the Consultants project monitoring process.
- E. A credit of \$25.00 per sample will be deducted from the Contractors final invoice for each documented case, that a required sample per contract specifications (50% of the workforce is NOT monitored) was not taken or submitted for analysis. In addition, this credit will also apply to samples that were not taken properly or the data required by contract specifications is not provided. Consultants hired by WCSD and supervising asbestos abatement projects are required to strictly enforce these requirements so they must monitor and document this process as a part of the Consultants project monitoring process.

PART 3 - SUPPORT ACTIVITIES AND PERSONNEL

3.01 TRAINING

- A. Training by a EPA accredited training provider shall be provided by the Contractor to **all** employees or agents or subcontractors who may be required to disturb asbestos-containing or asbestos-contaminated materials for abatement and auxiliary purposes and to all Contractor supervisory personnel who may be involved in planning, execution, or inspection of abatement projects. **No on-line training certificates for Lead or Asbestos training will be accepted.**
- B. Training shall provide, at a minimum, information on the following topics:
 - 1. The health hazards of asbestos including the nature of various asbestos related diseases, routes or exposure, known dose-response relationships, the synergistic relationship between asbestos exposure and cigarette smoking, latency periods for disease and health basis for standards.
 - 2. The physical characteristics of asbestos including fiber size, aerodynamic properties, physical appearance and uses.
 - 3. Employee personal protective equipment including the types and characteristics of respirator classes, limitations of respirators, proper selection, inspection, donning, use, maintenance and storage of respirators, field testing the facepiece-to-face seal (positive and negative pressure fitting tests), qualitative and quantitative fit testing procedures,

variations between laboratory and field fit factors, factors that affect respirator fit (e.g., facial hair), selection and use of disposable clothing, non-skid shoes, gloves, eye protection, and hard hats.

4. Medical monitoring requirements for workers including required and recommended tests, reasons for medical monitoring, and employee access to records.
 5. Air monitoring procedures and requirements for workers including description of equipment and procedures, reasons for monitoring, types of samples, and current standards with recommended changes.
 6. Work practices for asbestos abatement including purpose, proper construction and maintenance of plastic barriers, job set-up of airlocks, worker decontamination systems and waste transfer airlocks, posting of warning signs, engineering controls, electrical and ventilation system lockout, proper working techniques, waste cleanup, and storage and disposal procedures.
 7. Personal hygiene including entry and exit procedures for the work area, use of showers and prohibition of eating, drinking, smoking, and chewing in the work area.
 8. Special safety hazards that may be encountered including electrical hazards, air contaminants (CO, wetting agents, encapsulant, materials from Owner's operation), fire and explosion hazards, scaffold and ladder hazards, slippery surfaces, confined spaces, heat stress, and noise.
 9. Workshops affording both supervisory personnel and abatement workers the opportunity to see (and experience) the construction of containment barriers and decontamination facilities.
- C. Training is to have occurred within 12 months prior to the initiation of abatement activities.
- D. Contractor must document training by providing date(s) of training, training entity, course outline, and names and qualifications of trainers.
- E. Submit documentation to the District indicating that all employees have taken the required AHERA training for the type of work they will be performing per Section 02110, Part 3, 3.01, B, of these specifications.
- F. An employee of the Contractor or subcontractor who is deemed incompetent, disorderly, or otherwise objectionable by the Owner, shall be removed promptly by the Contractor, and not re-employed on the work. Any employee of the Contractor that is observed that is not utilizing his personal protective equipment will be immediately removed from a project and not allowed on any other District projects. Should any disagreements result regarding the identification of the employee or his/her proper use of personal protective equipment, the determination of the District AHERA Program Supervisor/ Technicians or District hired Consultant will be considered final and

conclusive. The Contractors Asbestos Abatement Supervisors who allow employees to not utilize their personal protective equipment will be immediately removed from a project and not allowed on any other District projects. Contractors will be required to replace removed employees/Supervisors and no additional time will be allowed to complete the project.

PART 4 - MEDICAL MONITORING

- A. Medical monitoring must be provided by the Contractor to any employee or agent that may be exposed to asbestos in excess of background levels during any phase of the abatement project. The purposes of a medical monitoring program, in addition to meeting the requirements of the law, are to document the state of health of workers for workers' compensation and to determine work relatedness of disease as well as to ensure fitness for duty, particularly ability to wear a respirator. Smokers should be made aware of the synergistic effects of cigarette smoking and asbestos exposure. The medical monitoring program provides the appropriate setting to share this information. Employers should also be aware of the potential cost of this additional risk. Medical monitoring shall include at a minimum the requirements of OSHA 29 CFR 1910.1001 (1).
1. A work/medical history to elicit symptomatology of respiratory disease (see CFR 1910.1001), Appendix D, Medical Questionnaires).
 2. A chest X-ray (posterior-anterior, 14 x 17 inches) taken by a certified radiology technician and evaluated by a certified B-reader.
 3. A pulmonary function test, including forced vital capacity (FVC) and forced expiratory volume at one second (FEV.), and FEV/FVC ratio (administered by a NIOSH or A.T.S. Certified Pulmonary Technician and interpreted and compared to standardized normals by a Board Certified Occupational Physician or Pulmonary Specialist).
 4. Employees shall be given the opportunity to be evaluated by a physician to determine their capability to work safely while breathing through the added resistance of a respirator. (Examining physicians shall be aware of the nature of respiratory protective devices and their contributions to breathing resistance. They shall also be informed of the specific types of respirators the employees shall be required to wear and the work they will be required to perform, as well as special workplace conditions such as high temperatures, high humidity, and chemical contaminants to which they may be exposed. Evaluation of groups of workers should take into consideration epidemiologic principals as suggested by the American Thoracic Society in their statement on the work relatedness of disease adopted in 1982).

SECTION 02140

EXECUTION

PART 1 - PREPARATION

1.01 WORK AREA;

- A. The following procedures are to be utilized to establish a work area and containments for all projects except mini work areas and mini-containments;
1. Shut down electrical power as necessary. When and where required, provide temporary power and lighting and ensure safe installation of temporary power sources and equipment per applicable electrical code requirements and provide safety lighting and ground fault interrupter circuits as power source for electrical equipment.
 2. Shut down and isolate heating, cooling, ventilating air systems to prevent contamination and fiber dispersal to other areas of the structure. During the work, vents or openings within the work area shall be sealed with tape and at least 2 layers of 6 mil poly sheeting.
 3. As directed by the District, pre-clean fixed objects within the proposed work areas using HEPA filtered vacuum equipment and wet cleaning methods, and enclose all fixed objects with a minimum of clear 6 mil plastic sheeting sealed with tape. This is in addition to the splash protection layer specified in item F below. All edges of the 6 mil will sealed with duct tape.
 4. As directed by the District, pre-clean the proposed work areas using HEPA-filtered vacuum equipment and wet cleaning methods. Methods that raise dust, such as dry sweeping or vacuuming with equipment not equipped with HEPA filters shall not be used. Failure to pre-clean may increase the nuisance fiber level inside the containment and thereby raise personal monitoring results.
 5. Seal off all openings with critical barriers, including, but not limited to, windows, corridors, doorways, skylights, duct, grille, or diffuser openings and any other penetrations of the work areas, with clear 6 mil plastic sheeting sealed with tape. Doorways, windows and corridors which will not be used for passage during work must be sealed with two layers of 6 mil plastic barriers. Doors and windows can be taped around the edges and then covered with one layer of clear 6 mil plastic to achieve the two layer requirement. Any opening that requires support such as hallways or large opening or other large criticals must be supported with 2x4 studs, 24 inches on center
 6. All doors will be left in place unless approved by the ES&A Director. Doors are much more secure than plastic critical which is why these will not allowed to be removed. If there is tile/mastic under the door in the door opening the following is the only procedure that will be allowed. The contractor shall create the entire containment except for sealing the doors that have tile under them. The containment and negative air will be in place and running and the containment, other than the doors will have been inspected and

approved. Once this has happened, the contractor shall have a worker don proper personal protective equipment (PPE) and then do a spot abatement in the area under the door using manual methods. The worker shall complete spot abatement under the door and the door will be secured and sealed per #5 above. No abatement shall take place inside the containment, other than doorway spot abatement. The number of doorways that can be spot abated at one time will be no more than two at a time.

7. If the Contractor is removing asbestos containing materials, and the flooring material within the containment is not identified for abatement, cover floor surfaces with at least 2 layers of 6 mil poly. Use a minimum of two layers of clear 6 mil poly. Cover the floor **first** so that the 2 layers of plastic that extends at least 12 inches up on the walls. Depending on the material of the roof and its practicality of being wet wiped the Owner may require that one clear layer of 4 or 6 mil plastic layer be installed for a ceiling.
8. Cover wall surfaces with plastic sheeting sealed with tape. Use a minimum of one (1) clear layer of 4 mil plastic on walls. Cover walls so that the plastic extends eight (8) feet above the area of work. Seams should overlap a minimum of six (6) inches.
9. Build airlocks at entrances to and exits from the work area. Airlocks should be built in a manner which allows for in-flow air. The installation of air locks which restrict the air flow of make-up air through the Decon will not be permitted. Additional make-up air, if required to achieve eight (8) air changes, shall be admitted through specially constructed vents which prevent contaminated air from leaving the work area.
10. Contractor may be required to install one clear layer of 4 or 6 mil plastic layer for a ceiling in the containment depending upon the ceilings construction, asbestos design considerations, and its air permeability and the ability to maintain negative pressure inside the containment.
11. Establish negative air pressure system which produces no less than eight (8) air changes per hour in the work area and maintains a pressure differential of 0.05 inch water gauge between the inside and outside of the work area. The location and identification of each individual negative air unit shall be provided to the District for each work area. The District, as certified Project managers reserves the right to direct the contractor to relocate the negative air machines. Identification (for example, labels) shall be clearly visible in the work area and at the unit's exhaust location.
12. The Contractor shall provide two manometers, located as directed by the Owner. The first manometer shall be a continuous printout type with an adjustable set-point audible alarm. The alarm may not be deactivated. The second shall be a standard inclined manometer, Dwyer Model 250.5 AF or approved equal.
13. As directed by the District, remove and clean ceiling or wall mounted objects, such as lights and other items not previously sealed off, that interferes with asbestos abatement. Use localized water spraying or HEPA filtered vacuum equipment during fixture removal to reduce the fiber dispersal.

14. Maintain emergency and fire exits from the work areas, or establish adequately marked alternative exits satisfactory to the District. The contractor will have on site before the start of the project a fire extinguisher and first aid kit.
 15. The Contractor shall place a job board with all MSDS, emergency numbers (24 Hour), safety procedures, air monitoring results, etc., at an accessible location to employees and visitors. The job board may be placed in the clean room overnight if the entrance to a containment is outside and the board's security is in question.
 16. Contractor shall provide a clear 18" x 18" plexi-glass view windows at locations designated by the Owner. Contractor will add or move viewing windows at any time throughout the project at the Owners request. View windows will never be covered once installed.
 17. Use smoke methods to test effectiveness of barriers and the negative pressure system when directed by the District.
- B. The following procedures shall be utilized to establish a work area and mini-containment for small scale/short duration projects. The Owner shall determine if a mini-containment is more practical or cost affective then the containment of the entire room space;
1. Prior to the construction of the mini-containment enclosure, the Contractor will consult with the Owner and receive Owner approval of the containments proposed design prior to the start of a mini-containment enclosure.
 2. Contractor shall construct a 2 layer, clear 6 mil poly enclosure with walls, a roof and a floor. The containment will be supported by means of wooden studs, PVC pipe, or other rigid materials. It will be sufficiently supported to ensure that negative pressure will not damage the containment. It will be large enough to ensure the material can be removed without puncturing the containment.
 3. Negative pressure inside the mini-containment will be provided by a small adjustable flow negative air machine. All mini-containments will require negative pressure and a HEPA vacuum cleaner will not be allowed to provide negative pressure except in very small mini-containments and only with prior written approval of the Owner.
 4. A two cell decontamination enclosure shall be installed to provide access to the containment and serve as a decontamination enclosure. Air-locks shall be installed at the entrance to the decontamination cell and the abatement containment. Minimum size of the decontamination enclosure shall be six feet high by 5 feet wide.
 5. Waste load-out and double bagging will be accomplished in the decontamination enclosure.

6. All other provisions of these contract documents and specifications apply to mini-containment enclosures except for the modification to the work area, decontamination enclosure and waste load-out addressed in 1 thru 4 above.
- C. The following procedures shall be utilized to establish a work area and perform abatement for windows and window sealant abatement. The following window procedure will be utilized to remove the window frame with possible asbestos containing putty, and asbestos containing window sealant (Caulking) from WCSD window openings.
1. From the inside of the school, inside of each classroom install Plywood ½” over the window opening. Install 2 layers of 6-mil polyethylene plastic (poly) on the exterior surface of the plywood, to assist with clean up of the plywood surface prior to installation of the plywood. After the plywood is installed, install 2 layers of 6 mil poly over the interior surface extending out past the edge of the plywood, and attach with tape in an adequate fashion to completely seal off the exterior window opening from the inside of the building. The removal cannot proceed until an airtight poly seal has been created between the inside and the outside of the window opening. This contractor will not be able to proceed with any removal until District’s ES&A personnel or District’s asbestos consultant approves the prep of each window. This will be documented in the contractor’s daily log and initialed by the District’s ES&A personnel or the District’s asbestos consultant.
 2. Washoe County Health Department personnel can be expected to visit the abatement site. The contractor will be required to cooperate and comply with all WCHD requests.
 3. Isolate the HVAC for the entire wing or area being abated, prior to the start of abatement.
 4. It may be necessary to isolate the wings adjacent to the building being abated, based upon the discretion of the District’s ES&A personnel or assigned asbestos consultant.
 5. Install 6-mil poly drop that extends out at least 20’ out and adjacent from each window opening. If any window debris leaves the poly drop area, the contractor will be required to HEPA vacuum the ground as directed by the District’s ES&A personnel or the District’s asbestos consultant.
 6. Place safety tape to isolate the area of the broken window from the public. At least 50 ‘ has to be isolated. Contractor will need to ensure that only abatement workers or the District’s ES&A personnel or the District’s asbestos consultant enter this area during abatement. No personnel or school staff will be allowed to work on the same side of the school wing when abatement activities are taking place. If a wing is directly across from the abatement activity that wings classrooms on the side of the abatement cannot be occupied.

7. As needed, use a glasscutter to score the inside of window glass to ease with glass removal. **A power tool cannot be used** for the removal of the window frame. Hand tool may be utilized.
8. As needed, remove glass by tapping on scored part of glass breaking it out, remove all glass present except the pieces behind putty. This makes it easier and safer to remove the frame without the glass being in the way.
9. Damage to and disturbance to the putty and sealant should be limited to the extent possible, and removed as intact as possible.
10. Pick up and dispose of the glass, asbestos debris and frame, in contractor's vehicle or dumpster for transport for proper asbestos disposal at a remote site. Do not dispose of debris in the District dumpster.
11. From the outside, clean up the internal area of the window frame, ledge and window jamb up to the poly window opening seal of any debris. The block opening will need to scraped, so that no sealant material is left behind before the window frame will pass a visual clearance, conducted by the District's ES&A personnel or the District's asbestos consultant. HEPA vacuum all areas of abatement surfaces, including the inside of the window opening prior to requesting a visual clearance.
12. When the window frame has been completely removed and the removal passes a visual clearance conducted by the District's ES&A personnel or District's asbestos consultant, carefully roll up the exterior poly drop that is on the ground, with the debris in it, and dispose at a remote location as asbestos waste. Do not dispose of any window poly/debris in the District dumpster.
13. Spray on encapsulate will be sprayed onto the window opening and poly surface of the plywood on the exterior side of the window opening.
14. Air Quality Air Samples may be taken once a wing is completed inside a number of the classrooms inside the wings by the District's ES&A personnel or the District's asbestos consultant and analyzed by TEM analysis. No personnel except the District's ES&A personnel or the District's asbestos consultant properly protected will be allowed inside the building being abated prior to receiving air sampling results or visual clearance. The plywood on the window openings will be left in place, and secured until air-sampling results or a visual clearance is received from the District's ES&A personnel or the District's asbestos consultant.
15. The window replacement contractor can work in the window opening, once the removal has passed a visual clearance, but cannot enter the area of demarcation or work on the same side of a building, while abatement is being conducted. Once abatement activities have been completed for the day, the replacement contractor could then work on that side of the building until abatement activities are resumed.

1.02 DECONTAMINATION ENCLOSURE SYSTEM AND WASTE LOAD-OUT AREA

A. Construct a worker decontamination enclosure system contiguous to the work area as follows:

1. The decontamination enclosure shall be constructed of two layers of 6 mil poly sealed with tape. At the discretion of the Owner the contractor may be required to construct a decontamination enclosure outside of the building. The exterior Decon shall be constructed with a minimum of 2x4 studs 24 inches on center and 1/2 inch plywood and to a standard which insures the security of the building. The outside chamber shall have a solid lockable door that shall remain locked whenever the Contractor is not on site. A key will be given to the Owner. The location of any decontamination enclosures will be determined by the Owner.
2. An equipment or dirty room with two doorways, one to the work area and one to the shower room. Pop-up Decon chambers typically will not be approved for use by the District. The use of Pop- up Decon Chambers will be reviewed on a case by case basis and the District reserves the right to require that they not be used.
3. A **metal** shower room with two doorways, one to the equipment room and one to the clean room. The shower room shall contain at least one shower with hot and cold water. Careful attention shall be paid to the shower enclosure to ensure against leaking of any kind. Ensure a supply of soap and shampoo at all times in the shower room. Clean and dry towels shall be available for employees and owner-authorized visitors and personnel. A three-stage water filtration system must be employed prior to release of shower water into the local sewage system. The shower must comply with all applicable backflow prevention/cross connection requirements including the Districts. Any shower or water device that does not meet the minimum air gap requirement will have to be fitted with the appropriate backflow prevention device. Proof of the required testing of any employed backflow prevention assembly will be required. Non-metal pop up showers are not acceptable.
4. A clean room with one doorway into the shower and one entrance or exit to non-contaminated areas of the building or outside. The clean room shall have sufficient space for storage of the workers' street clothes, towels and other non-contaminated items. Individual lockers shall be available to workers within the clean room. Pop-up Decon chambers typically will not be approved for use by the District. The use of Pop- up Decon Chambers will be reviewed on a case by case basis and the District reserves the right to require that they not be used.

B. As directed by the District, construct using (2) two layer of 6 mil. Poly, a waste load-out area contiguous to the work area which is utilized for transportation of ACM to a landfill.

1. The decontamination enclosure may only be used as a waste load out area with Owner approval, and only when it exits to the exterior of a building and there are no other exterior doors inside the containment. All waste load out activities will be accomplished through a waste load out enclosure exiting an exterior door whenever one is available.

The Decontamination enclosure will only be considered for use as a waste load out enclosure when all other avenues of exit are not deemed practical by the Owner.

1.03 MAINTENANCE OF ENCLOSURE SYSTEMS:

- A. Ensure that barriers and plastic linings are effectively sealed and taped. Repair damaged barriers and remedy defects immediately upon discovery.
- B. Visually inspect enclosures and negative air units at the beginning of each work period or shift. Details of the inspections are to be included in the Contractor's daily log. The contractor will be required to note the manometer readings of the containment in the daily log at the start and end of the shift and every 1/2 hour while on the job site. **The Contractor will be required to inspect containments at locations that are awaiting final clearance sampling results twice daily, once in the morning and once late in the afternoon before the building is scheduled to be locked up.**
- C. Use smoke methods to test effectiveness of barriers and the negative air pressure system when directed by the District.

1.04 ASBESTOS REMOVAL WORK SHALL NOT COMMENCE UNTIL;

- A. Arrangements have been made for disposal of waste at an acceptable site.
- B. Arrangements have been made for containing and/or disposal of waste water resulting from showering and other abatement activities.
- C. Work areas, decontamination enclosure system, and waste load-out area are effectively segregated.
- D. Tools, equipment and material waste receptacles are on-site.
- E. The Type "C" supplied air respirator system(s) or other approved air filtration system is (are) on-site and fully operative, when required by the District.
- F. All other preparatory steps have been taken and applicable notices posted and permits obtained.
- G. A visitor and employee log-in/log-out system is in place at the job site. All persons entering the site will be required to sign-in and sign-out.
- H. Plexi-glass view windows have been installed in all locations requested by the Owner.
- I. The containment has been inspected and written approval has been given by the Owner.

PART 2 - ASBESTOS REMOVAL

2.01 ORDER OF OPERATIONS

- A. In general, work shall progress in the following order of operations; this listing is not provided to suggest that abatement sequences or additional requirements may not be required of the Asbestos Abatement Contractor to comply with regulatory requirements depending on the specific nature of each particular asbestos abatement projects:
1. Site preparations (See Section 02140, PART 1).
 2. Removal of all asbestos debris and contaminated fixtures from the work site.
 4. Rough clean and remove all remaining asbestos debris.
 5. Detail clean and removal all asbestos containing asbestos debris and residual asbestos contaminants.
 4. Encapsulate all areas from which asbestos was removed. Any encapsulant installed must be compatible with any new products that will be installed over the encapsulation such as flooring products. Encapsulation will be done prior to taking air clearance samples or after air samples have been sampled to ensure that the project encapsulation activity complies with Nevada regulations. (See Section 02140, Part 2, 2.03)
 5. Clean up site (See Section 02140, PART 2, 2.04).
 6. Remove final (splash protection) layer of polyethylene sheeting from walls.
 7. Nothing in Section 02140, PART 2, 2.01 is meant to supersede the inspection procedures noted in Section 02150, PART 2.

2.02 REMOVAL PROCEDURES

- A. Floor covering may be removed physically, mechanically, or chemically. The work may include the abatement of asbestos containing material (ACM) on floors. New flooring materials will be installed over abatement areas so mastic removal techniques employed by the abatement contractor are to be done so that installed flooring products are able to be warranted by the flooring manufacturers. If the abatement contractor is being hired by a flooring contractor the abatement contractor must consult the flooring installer and ensure their employed removal techniques do not void any warranties for new installed products. It is quite possible that chemical mastic removers may not be able to be utilized to achieve this requirements. No power tools may be utilized to remove flooring materials. As feasible, all removal shall be conducted using wet methods to reduce the release of fibers. If chemical mastic removers are used, follow

the manufacturers recommended procedures.

- B. Remove the asbestos material in small sections. As it is removed, pack the wetted material in impermeable plastic bags (2) of 6 mil minimum thickness. Plastic waste bags will be then placed into waste containers prior to removal from the abatement area. Material shall not be allowed to leak out or dry out prior to insertion into the containers.
 - 1. Contractor shall adhere to disposal authorities' size and weight requirements for containers (bags or packages).
 - 2. All ACM or asbestos-contaminated material that has been removed shall be bagged at the end of each work shift (that is, debris on the floor cannot be allowed to accumulate).
 - 3. All ACM or asbestos-contaminated material which has been bagged or wrapped in the work area cannot be allowed to accumulate; all bagged or wrapped material must be placed in the dumpster after every shift.
- C. Remove bagged or wrapped material to waste load-out area. Re-bag or re-wrap all material in a second impermeable 6 mil bag or second 6 mil layer of plastic, respectively and then place into a waste container, except carpet rolls. Clean external surfaces of bags by wet sponging prior to being put into the waste container. The exterior of the containers shall be wet wiped inside the waste load out decon and place caution labels on containers in accordance with OSHA regulation 29 CFR 1926.58. **No abatement activities may be taking place inside the containment during waste load out. The decon shall be sealed up during waste load out.** Egress through the decon shall take place prior to or after waste load out.
 - 1. **Under no circumstance will waste bags or containers be allowed to be stored inside a building.** The waste will be removed from the containment and **immediately** be transported outside the building and placed into the waste disposal receptacle.
- D. In the event that no work is performed in a given area for any period which exceeds thirty-six (36) hours, all visible ACM on the plastic walls and all bagged and containered ACM or asbestos-contaminated material shall be locked and secured in the dumpster. If the amount of material exceeds the storage capacity of the dumpster, all material must be properly disposed of at the landfill prior to that 36-hour, non-work period.
- E. The chemical mastic remover(s) shall be used in accordance with the manufacturer's directions at all times. Due to the combustible nature of chemical mastic removers, the District reserves the right to limit the amount of mastic remover used at any one time.

2.03 ENCAPSULATION PROCEDURES:

- A. On friable asbestos abatement projects, the State of Nevada requires that air clearance samples be taken prior to encapsulation. Contractors will take direction from the District ES&A personnel

or District hired asbestos consultant to determine if encapsulation will be done prior to taking air clearance samples or after air samples have been sampled to ensure that the project encapsulation activity complies with Nevada regulations. Prior to air clearance sampling or after and upon approval by the Owner, either Contractor shall apply a penetrating encapsulant to bind any remaining non-visible asbestos fibers; encapsulant shall be applied according to manufacturer's directions. Contractor shall submit product information for prior approval by the District.

- B. The encapsulant shall be clear in color. Any encapsulant installed must be compatible with any new products that will be installed over the encapsulate such as flooring products.

2.04 CLEAN-UP

- A. Remove all visible accumulations of asbestos material and debris. Wet clean all surfaces within the work area.
- B. The windows, doors, and HVAC vents shall remain sealed and any HEPA filtered negative air pressure systems, waste load-out, and decontamination enclosure systems shall remain in service.
 - 1. All equipment used in the work area shall be included in the clean-up and shall be removed from work areas via the decontamination enclosure system or waste load-out, at appropriate times in the cleaning sequence.
 - 2. **Under no circumstances will contaminated materials, tools or equipment that has been removed from the containment be allowed to be placed inside a building outside containment.** All items will be **immediately** transported to a lockable storage unit or placed inside a Contractor's vehicle. Items will also not be allowed to accumulate outside of a building.
- C. As directed by the District, clean all remaining surfaces in the work area (including the HVAC system, see Section 02160) and any other contaminated areas with water and with HEPA filtered vacuum equipment. After cleaning the work area, wait an appropriate period of time to allow for settlement of dust, and again wet clean a second time and clean with HEPA filtered vacuum equipment all surfaces in the work area. After completion of the second cleaning operation, perform a complete visual inspection of the work area to ensure that the work area is free of visible asbestos debris.
 - 1. If the District, after the second cleaning finds visible accumulations of asbestos debris in the work area, the Contractor shall repeat the wet cleaning until the work area is in compliance, all at the Contractor's expense.
 - 2. Wet clean as necessary.
 - 3. Remove splash guards as directed by the District.
 - 4. Nothing in this section is meant to relieve the Contractor of his responsibility to meet the

final clean criteria as established by these contract documents or any other applicable laws or regulations.

- D. When a final inspection determines that the work area is free of accumulations of visible asbestos debris, and fiber levels continue to remain at or below .010 fibers/cc the District will proceed with the final TEM clearance sampling (see criteria as set forth in Section 02110, PART 4, 4.01).
- E. WHEN CLEAN-UP IS COMPLETE, AFTER AIR CLEARANCE IS RECEIVED;
 - 1. Remove final polyethylene barriers from windows, doors, corridors, and so on; remove negative air pressure system from area.
 - 2. Relocate objects moved to temporary locations in the course of the work to their former positions.
 - 3. Where applicable, establish HVAC, mechanical and electrical systems in proper working order. Install new filters, furnished by the Owner, and dispose of used filters as asbestos-contaminated waste.
 - 4. When more than one work or containment area is required, install new clean barriers (6 mil plastic or better) to separate adjoining areas.
 - 5. Contractor shall mop the abatement area floor with two coats of a product that will remove any residue but does not void and product being installed over the abatement areas such as flooring materials. Additional coats of clear water will then be mopped onto the floor until the product utilized to do the final wash residue is removed.

2.05 DISPOSAL

- A. As the work progresses, and to prevent exceeding available dumpster storage capacity on site, remove asbestos waste and dispose of such at an authorized disposal site in accordance with the requirements of the disposal authority. Submit documentation regarding disposal to the District. Contractor is responsible for all costs regarding waste including waste characterization sampling.
 - 1. All ACM or asbestos-contaminated material must be double-bagged (or wrapped) in 6 mil bags and then placed into a waste container (drum). All materials that are generated from the asbestos containment must be disposed of as asbestos waste to include the poly containment materials or any other materials used to create the containment that are present inside or with surfaces that are inside the containment.
 - 2. All ACM or asbestos-contaminated material must be damp when delivered to the disposal site.
 - 3. **Under no circumstance will waste bags or containers be allowed to be stored inside a building.** The waste will be removed from the containment and **immediately** be transported outside the building and placed into the waste disposal receptacle.

4. Chemical mastic remover will be separated from the asbestos waste and disposed of in accordance with all applicable regulations. It is the Contractors responsibility to determine the proper disposal based upon the type and amount of mastic remover.
 5. All waste load out activities will be scheduled for and inspected by the Owner.
- B. Sealed plastic bags may be dumped into the burial site unless the bags have been broken or damaged. Damaged bags shall remain in the drum and the entire contaminated drum shall be buried. Uncontaminated drums may be recycled.
- C. Dumpsters or any EPA-approved hazardous waste container system capable of being totally secured can be used in lieu of drums for transport to the disposal site. Absolutely no uncovered, unlockable dumpsters will be allowed to be used as a waste container system. This includes dumpster for construction debris that is associated with an asbestos abatement project. Open dumpsters, vehicles or trailers with wood covering installed will not be allowed for use as a waste container system.
1. All loads are to be delivered in an enclosed vehicle. No open pick-ups will be allowed.
- D. Each load must be accompanied by a Uniform Hazardous Waste Manifest (EPA Form-22) or equivalent and any other certificate required by State or local agencies.
1. Original copies of the Hazardous Waste Manifest shall be provided to the District.

SECTION 02150

WORK SCHEDULE AND INSPECTION PROCEDURES

PART 1 - WORK SCHEDULE

- 1.01 The work is to be carried out diligently to completion with utmost speed. The Contractor shall furnish to the District a final working schedule showing anticipated starting and completion dates for each removal zone or area. This schedule shall be furnished to the District within at least five (5) calendar days from issuance of the District's written Notice to Proceed.
- 1.02 If, in the opinion of the District, it becomes necessary to work additional men for maintaining the schedule and for the completion of any phase of the project within the specified time, the Contractor must immediately do so upon written request by the District.
- 1.03 Work shall proceed immediately upon receipt of Contractor's Notice to Proceed from the District. Facilities shall be available to the Contractor as agreed upon. All work must be completed no later than agreed upon.

PART 2 - INSPECTIONS BY THE DISTRICT

- 2.01 The District shall inspect the site preparation work within the building as outlined in Section 02140, PART 1 to ensure that the facility is adequately sealed off, the negative air pressure system is functioning properly, the decontamination enclosure system, and waste area are in place. The Contractor **SHALL NOT PROCEED** with the gross removal until such time as the District has inspected the site preparation work and given the Contractor a Notice to Proceed (PREP).
- 2.02 The District shall inspect the removal work and work area upon its completion within the building or section thereof to ensure that all visible ACM or asbestos-contaminated material has been removed. The Contractor **SHALL NOT PROCEED** with the next phase of the work or spray any materials on the building systems until such time as the District has inspected the facility and given the Contractor a Notice to Proceed (REMOVAL AND DETAIL).
- 2.03 After encapsulation, the District will inspect the adequacy of encapsulation within each building or section thereof. The Contractor **SHALL NOT PROCEED** with final clean-up until a Notice to Proceed has been issued (ENCAPSULATION).
- 2.04 The District will inspect the facilities on a daily basis as necessary to ensure compliance with this Contract. Representatives of the District may be on-site at all times during the performance of this Contract.
 - A. The District is not limited by the inspection requirements as noted above in Sections 2.01 through 2.03; additional safety and health inspections as well as inspections by the Owner will occur randomly. Contractor will not attempt to control access to asbestos containments to District asbestos personnel.

SECTION 02160

MECHANICAL

PART 1 - SCOPE OF WORK

- 1.01 Remove as directed all HVAC ventilation grilles and registers, including ceiling or wall access panels. Each shall be wet-cleaned and stored by the Contractor except those designated to be disposed of as asbestos waste. Or seal all grilles, registers, and ceiling or wall access panels in plastic sheeting.
- 1.02 Contractor will ensure that the all equipment has been properly locked out and all procedures to secure all equipment, including mechanical equipment, will comply with all requirements of the OSHA and the Districts Lock out/tag out procedures.
- 1.03 As directed by the District, during final cleaning, wet-clean and vacuum all HVAC ventilation ducts with HEPA filtered vacuum equipment.
 - A. Cleaning may include, but is not limited to, the first six feet of all supply, return and exhaust air ducts adjacent to the work area.

SECTION 02170

ELECTRICAL

PART 1 - SCOPE OF WORK

- 1.01 Disconnect all circuits in the work area at the main panel box and lock out same as approved by the District.
- 1.02 Where required, remove all existing electrical fixtures including, but not limited to, ceiling and wall lights, clocks, alarms, and sound system fixtures. Each shall be wet-cleaned, location tag attached and store as directed by the District.
 - A. Nonfunctional electrical fixtures or systems shall be brought to the attention of the District in writing prior to commencement of work. Failure to notify the District in writing of any nonfunctional electrical fixtures or systems will not act to relieve the Contractor of the provisions of Section 02170, PART 2, 2.04.
- 1.03 Protect all exposed wires.
- 1.04 Contractor will ensure that the all equipment has been properly locked out and all procedures to secure all equipment, including electrical equipment, will comply with all requirements of the OSHA and the Districts Lock out/tag out procedures.

SECTION 02180

RESTORATION

PART 1 - RESTORATION WORK

- 1.01 Existing conditions disturbed by the Contractor's operations shall be restored to a condition satisfactory to the District and shall match existing adjacent surfaces. Damage due to tape, staples, nails, spray-poly, water, including unforeseen actions, is the responsibility of the Contractor and must be restored to the prior to final acceptance of the facility by the District.
- 1.02 The Contractor shall survey and detail all existing damage to walls, floors and floor coverings, fixtures and so on. This survey shall be submitted to the District in writing prior to set-up and preparation of the worksite.
- 1.03 All restoration must be completed within two weeks after the abatement project containment is torn down. Failure to complete the restoration in the two week time frame will result in the District hiring an outside vendor to complete the restoration. The cost of services for the restoration will be deducted from the projects final payments or any payments outstanding to the contractor.
- 1.04 The contractor is responsible for supplying all labor and materials to properly perform the restoration.
- 1.05 The contractor is responsible for the security of items removed by the contractor that require reinstallation. The District assumes not responsibility for the security of items left in District facilities. The contractor is responsible for replacing at no cost to the District any item removed by the contractor that is found to be missing or damaged at the time of reinstallation.

PART 2 - WALL AND FLOOR COVERING

- 2.01 It is the Contractor's responsibility to ensure that all wall areas are adequately sealed with 6 mil plastic in order to prevent water accumulation and asbestos contamination. Any wall material which is stained or otherwise damaged during any phase of the work shall be replaced in its entirety with materials of equal quality and selected by the District.
- 2.02 The Contractor shall restore all painted, varnished, lacquered, paneled or enameled surfaces (including factory finished surfaces) should damage occur from tape, staples, nails, water, and so on. Should such procedures be unacceptable to the District, the District may require, at its option, the entire replacement, refinishing, repainting or resurfacing of the damaged surface area.

PART 3 - FIXTURES

- 3.01 Any electrical fixtures, HVAC grilles, registers, and access doors lost or damaged by the Contractor shall be replaced at Contractor's expense.
- 3.02 Any other fixtures, furniture, appliances, and equipment not specifically mentioned must be replaced or repaired at Contractor's expense if lost or damaged.

PART 4 - SEWER SYSTEM

- 4.01 Should the Contractor, his employees, or subcontractors utilize existing sewer facilities for disposal of any ACM, asbestos contaminated material, or asbestos contaminated water, Contractor shall thoroughly clean the entire building's sewage system including, but not limited to, all sink, shower, floor, and toilet drains and traps, all primary and secondary sewage lines, and all lines wherever located and extending underground to the main sewer service connection.

PART 5 - EXTERIOR OF BUILDING

- 5.01 It is the Contractor's responsibility to repair or replace any and all damaged external areas of the building including, but not limited to, walls, doors, sidewalks, driveways, parking lots, concrete curbs, shrubbery, grass, sprinkler systems, and so on.
 - A. Damaged areas will be repaired or replaced at the option of the District.
- 5.02 Any ground areas external to the building which may become contaminated with asbestos shall be decontaminated at the Contractor's expense.
 - A. Decontamination procedures shall require removal of dirt to a depth of 4 inches which shall be disposed of as asbestos waste.
 - B. All areas from which soil was decontaminated shall be restored to its original condition at the option of the District.

SECTION 02190

TRANSITE SUPPLEMENTAL SPECIFICATIONS

Asbestos Abatement Specifications Washoe County School District Transite Panels at District Sites

Background

Washoe County School District (WCSD) will be performing the abatement of transite wall, ceiling panels, pipes and/or window panels at various District sites. This supplemental spec as well as the District specs will apply to the removal of all transite materials. The abatement contractor shall be prepared to abate the transite materials as identified in the site-specific architectural drawings provided for the individual site or information provided prior to bidding.

The contractor will need to note when additional asbestos-containing materials are to be abated within the same containment area and perform that work within the same negative pressure enclosure, if applicable. The contractor's onsite supervisor, or project estimator during bidding, will need to confer with either WCSD or the District's independent third-party consultant, for the expected containment areas and number of containments at a particular site.

Scope of Work

The contractor awarded the project will be responsible for all costs associated with the abatement of the transite.

The project scope shall be determined by the site-specific architectural drawings prepared for the individual site. The Contractor is responsible for reviewing the architectural drawings and the WCSD Regulated Systems and Assessment (ES&A) Material Disturbance Permit to determine which materials, including any sealants, in the project area are asbestos-containing.

The District has retained an independent third-party abatement consultant to draft these specifications, who may provide oversight during the projects, conduct visual clearance inspections and collect clearance air samples at the conclusion of these abatement projects. All oversight or additional oversight and collection of air samples may be performed by the District's ES&A Department as well at their discretion.

In addition to complying with these supplemental specifications, the Contractor must also comply with all other asbestos abatement requirements listed in these asbestos abatement specifications. If Contractors find any conflicting information in the supplemental specifications, the Contractor must comply with the requirements listed herein that are deemed most stringent by the District or District hired asbestos consultant supervising the abatement.

Project Requirements

Contractor shall be approved by the WCSD ES&A Department to perform asbestos abatement activities within the District. **Approval of firms that have not performed activities impacting asbestos for the District previously, will need to submit all necessary documentation outlined in the WCSD ES&A Technical Specifications for the project at least ten (10) business days prior to work commencing for approval.**

All workers certifications – asbestos training and licensing and medical clearance – shall be submitted to the WCSD ES&A at least five (5) working days prior to project commencement at minimum for approval.

Contractor is responsible for reviewing WCSD ES&A worker roster for the company to assure all workers to be used on the project have been approved prior to arrival onsite. Workers not identified on the approved worker list for the contractor will not be allowed to perform any activities onsite, even if documentation is provided onsite at time of the project commencement.

The abatement contractor's onsite supervisor shall have a copy of these Specifications onsite at all times and be familiar with the project requirements prior to arrival onsite at the project. Failure to follow requirements of these Specifications, or lack of knowledge of requirements to be followed during the project, are grounds for replacement of the abatement contractor's onsite supervisor.

Only the abatement contractor will be allowed to occupy the project area once abatement activities are scheduled to start. This applies to all WCSD non-ES&A staff/personnel and site staff/personnel. The area shall only be occupied by the abatement contractor, WCSD ES&A staff, and District's independent third-party abatement consultant. Other personnel will not be allowed to occupy the building during asbestos abatement activities.

Contractor shall adhere to the requirements of these Specifications, WCSD ES&A Technical Specifications, Federal, State, and Local regulations.

Water and Electricity

Water and electricity are available onsite, but long hoses and cords may be necessary. The contractor is responsible for any damage to water or power systems caused by their use of those systems.

Contractor shall provide a GFI at the primary plug-in of all electrical trains used for electrical equipment. Hose washers shall be provided at all hose connections to prevent leakage of water and potential damage to District facilities.

Pre-Cleaning

Pre-cleaning is not expected to be necessary; however, Contractor may need to remove some debris or clean surfaces to facilitate building containment area.

Notifications

Contractor is responsible for timely notifications (including courtesy notifications if applicable) to Nevada Division of Industrial Relations and Washoe County Health Department. Notifications shall be filed in advance of any waiting periods in lieu of the proposed project start date or other requirements for pre-work notification. Any revisions to notifications including project scope, start date, duration of project, or any other changes are the Contractor's responsibility. Valid notifications shall be posted onsite during the project, and copies shall be provided to the District's onsite third-party consultant.

Equipment

Contractor is responsible for providing all necessary equipment in sufficient quantities to complete the project in the schedule provided for the project. All equipment must arrive onsite clean and in proper functioning order. Any equipment that arrives onsite dirty or not in proper functioning order shall be removed from the project site for cleaning and/or repairs.

Training

Workers performing asbestos abatement activities as part of this project must have AHERA Worker training with at least one worker trained to the AHERA Contractor-Supervisor level. All workers shall be licensed by the Nevada DIR for asbestos work. The crew lead Contractor-Supervisor may not leave the site anytime asbestos abatement operations are being performed.

As noted previously, all workers certifications must be approved by the WCSD ES&A prior to arrival onsite to start work. Copies of the worker certs shall be provided to the District's onsite third-party consultant as well.

Personal Protection Equipment

The contractor is responsible for adhering to Nevada Division of Industrial Relations and OSHA requirements for worker respiratory protection. At a minimum, workers shall wear half-face, negative pressure respirators with HEPA (P-100) filters during any activities which disturb asbestos-containing materials.

Workers shall wear Tyvek-level disposable coveralls, hard hats, work gloves, and safety glasses (if not using a full face-piece respirator.) Street clothes may be worn under disposable coveralls.

All employees shall have a valid medical clearance and fit test for respirators to be used. Medical clearance shall be provided for approval to the WCSD ES&A prior to the project commencement. Copies of the medical clearance and fit test shall be provided to the District's onsite third-party consultant as well.

Personal Air Monitoring

The contractor is responsible for the collection of personal air samples on workers during all abatement activities for asbestos. Personal air samples shall be collected in accordance with OSHA sampling protocols and analyzed by a laboratory with the proper accreditation.

Laboratories to be used for personal air sample analysis must be approved by WCSD ES&A.

Copies of the personal air sampling results, along with laboratory accreditation, shall be submitted to the WCSD ES&A and District's independent third-party consultant.

In addition, the contractor will comply with all requirements regarding personal air monitoring listed in Section 02130, Part 2- - Air Monitoring, 2.02.

Security and Safety

The contractor is responsible for security of all equipment and safety of all employees. Contractor shall provide any storage containers or security needed for tools and equipment if needed.

Contractor is responsible for all worker safety and following all applicable regulations, namely Nevada and Federal OSHA, including for asbestos and respirable crystalline silica exposures.

Occupancy

As noted previously, the project area will be limited to the abatement contractor, WCSD ES&A staff, and District's independent third-party consultant once abatement activities are ready to commence. Once the area has been cleared, other parties may occupy.

Emergency services may also occupy areas in the event of an emergency during the project.

Challenge Testing

All HEPA-filtered equipment to be used on this project shall have been challenge tested (DOP or equivalent) within the previous 30 days prior to use onsite. Copies of the challenge testing results shall be provided to the WCSD ES&A and/or District's independent third-party consultant.

Asbestos Abatement Containment and Abatement Requirements

ALL POLY USED ON PROJECT SHALL BE 6-MIL AND FIRE-RETARDANT UNLESS EXEMPTED IN REQUIREMENTS BELOW.

WHERE POSSIBLE, TRANSITE PANELS SHALL BE REMOVED FROM THE EXTERIOR SIDE.

Interior Transite Panel Abatement

1. Contractor shall seal all critical barriers (HVAC, windows, doors, etc.) in each area with one layer of 6-mil poly. Doors leading outside of the containment area shall remain in place for security.

2. All walls, floors, and any fixed objects that cannot be removed from the containment shall be covered with one layer of 6-mil poly. An additional layer of 4-mil poly may be applied to covered surfaces for use as a cleaning barrier. Vertical barriers may be installed to decrease the size of containment areas; however, such barriers shall be constructed with wood framing and ½" plywood backing.
3. Poly critical barriers with wood framed ½" plywood backing shall be installed on the exterior side of the transite panel to contain the interior space and secure the wall opening. Two layers of poly shall be used to cover the plywood with an additional two layers installed on exterior side of the plywood which will extend out 2" on each side of the plywood.
4. A minimum three-stage decontamination unit with operable shower shall be contiguous with each containment. See "Decontamination Chamber Requirements" in this specification for further requirements.
5. Negative pressure shall be established and a recording manometer shall be attached to each containment. Copies of the manometer recordings shall be provided on 8.5"x11" paper by the Contractor.
6. An air pressure differential of -0.050" WC must be established and maintained throughout all phases of abatement and through receipt of passing air clearance.
7. Workers shall wet all materials prior to, and during, removal using amended water.
8. Transite panels shall be removed intact wherever possible.
9. Any sealants at edges of transite panels, or other suspect materials that may need to be disturbed by the transite panel removal shall be considered to be asbestos-containing materials unless sampled and proven otherwise.
10. Following removal of all transite panels, all poly shall be wet-wiped or HEPA-vacuumed clean as part of detail cleaning. Any 4-mil poly cleaning barriers may be removed as part of this detail cleaning.
11. All waste shall be placed into two separate waste bags of 6-mil thickness. The outer waste bag shall be sealed in a "goose-neck" fashion to create a leak-tight container.

Exterior Transite Panel Abatement

1. Contractor shall seal all critical barriers (HVAC, windows, doors, etc.) within 20 feet of the work area with one layer of 6-mil poly.
2. Poly drop sheets shall be installed in the work area, extending 20 feet out from any transite panel to be removed, and this work area shall be demarcated with warning signs / tape. The Contractor shall control access to this regulated area to a distance of 50 feet out, demarcating the perimeter with caution tape.

3. Poly critical barriers with wood framed ½" plywood backing shall be installed on the interior side of the transite panel to seal off the interior space and secure the wall opening. The plywood will be covered with two layers of 6-mil poly on both the interior and exterior side. The interior poly barriers shall extend out two inches on each side.
4. Decontamination facilities shall be sited adjacent to the work area, and shall include a drop sheet. A water source shall be provided, along with soap and towels. Dirty water shall be contained. A privacy barrier shall also be installed as needed.
5. Workers shall wet all materials prior to, and during, removal using amended water.
6. Transite panels shall be removed intact wherever possible.
7. Any sealants at edges of transite panels, or other suspect materials that may need to be disturbed by the transite panel removal shall be considered to be asbestos-containing materials unless sampled and proven otherwise.
8. Following removal of all transite panels, all poly shall be wet-wiped or HEPA-vacuumed clean as part of detail cleaning.
9. All waste shall be placed into two separate waste bags of 6-mil thickness. The outer waste bag shall be sealed in a "goose-neck" fashion to create a leak-tight container.

Decontamination Requirements

A three stage decon unit including a shower is required for any interior asbestos containments. Each chamber of the decon must have self-closing Z-flaps that seal air tight. A four-inch barrier must exist at the floor of each chamber to prevent the transfer of water and debris from chamber to chamber. This barrier will also provide a seal for the flaps between each chamber. Equipment and bag out chambers do not require a shower, but a washing station must exist and they must be three-stages. The washing station must be constructed in a manner that prevents water from splashing or traveling out of the central decon chamber. Equipment and bag out chambers must also have flaps that seal air tight.

Shower units must be equipped with an overflow pan to catch water which overfills the drain system, or is splashed out of the chamber during employee showers. Showers must be supplied with hot water, soap, shampoo, and towels for the workers. Showers shall be sited in the central decon chamber. Showers and washing station must also be equipped with a filtering system that includes a 0.5 micron filter. If filtering system is not available or is not functioning correctly, shower water must be bagged and disposed of as asbestos-containing waste.

All chambers of the decon, including the clean chamber, must be kept clean and dry (except shower) at all times. Abatement work will be stopped if decon is not kept in acceptable condition.

Regulated Area Signage

Asbestos Danger signs shall be posted at all entrances or exits to the containment area, even if the entrance or exit is sealed as a critical barrier. Signs shall also be posted on the flap leading into the shower station of

decontamination chambers. Signage will be set once a pre-start visual is passed and work may begin in the containment, but no work will start until all signs are posted. Signage shall meet the revised requirements set forth in 29 CFR 1926.1101(k)(7).

Air Pressure Differential – Full Containment Areas Only

Air pressure differential must be established and maintained at -0.05 inches water differential or better before start of abatement and air pressure differential must be maintained through all phases of project, including collection of clearance air samples and receipt of results. A minimum of eight air changes per hour is required for the project. Work will be halted if the air pressure drops below -0.05 inches water differential and can resume when air pressure differential of -0.05 inches is established again.

Air pressure differential must be displayed and recorded on a properly calibrated and fully functioning manometer. Copies of the manometer recording must be provided by the contractor on 8.5" x 11" paper at completion of project.

All negative air machines must be exhausted to the exterior of the building using wire-reinforced flex duct. All negative air machines must be used inside containment. No machines shall be attached to the exterior of the containment with the intake only inside.

Any exterior or interior barricades need to be constructed of a minimum ½" plywood and shall be made secure.

Make-Up Air Sources

Available, but may need to be HEPA-filtered. Any make-up holes in critical barriers must be equipped with a challenge/DOP-tested HEPA filter. Placing a pre-filter in the make-up air hole will not be allowed.

Disposal Requirements

All asbestos waste generated on this project will need to be double-bagged in 6-mil poly waste bags, or double-wrapped in 6-mil polyethylene sheeting. All waste bags must be sealed in a "gooseneck" fashion and "burrito-wrapped" materials shall have staggered seams. All non-friable debris shall be properly labeled and identified for disposal as an asbestos-containing waste. Materials that have become friable or which removal methods have made friable shall be labeled and identified for disposal as regulated asbestos-containing material (RACM).

The contractor will need to provide a lockable waste bin for all waste created on this project. Waste bin will need to be labeled with asbestos signage once the waste is loaded into the bin. Waste bins shall be lined with one layer of 6-mil poly prior to waste being loaded.

Waste bins will need to arrive onsite clean of debris or any other waste and in proper functioning order. Waste bins may be rejected by WCSD ES&A staff or District's independent third-party consultant if these conditions are not met, with no extra charge to the District.

Clearance

Upon completion of asbestos abatement activities, a final visual inspection will be performed by either WCSD ES&A staff or District's independent third-party consultant. This inspection will be performed only after the abatement contractor crew supervisor has performed their own final visual clearance. Areas must be free of all three-dimensional material with all surfaces clean of dust and debris and all materials abated within the containment area.

The visual inspection will serve as final clearance for exterior transite panel removal. Following a successful visual clearance inspection, the Contractor shall apply a lock-down encapsulant, then remove containment drop sheets, signage, equipment, etc. The barriers at window / wall openings shall be left in place.

For interior removal of transite panels within full containment, final clearance shall be through aggressive air sampling conducted by the District's independent third-party consultant. A set of five air samples will be collected inside the containment to be analyzed in accordance with AHERA completion of response action criteria using either phase contrast microscopy (PCM) or transmission electron microscopy (TEM), depending on the quantity of materials abated.

Clearance criteria for PCM sample analysis, in accordance with AHERA, is 0.01 fibers per cubic centimeter (0.01 f/cc) or less for each of the five samples.

Clearance criteria for TEM sample analysis, in accordance with AHERA, is an average of 70 structures per square millimeter (70 s/mm²) or fewer for the inside-containment set of five samples.

Contractor shall return to the site to apply a lock-down encapsulant, remove poly barriers and equipment upon notification of passing clearance air samples. The barriers at window / wall openings shall be left in place.

SECTION 02200

SUPPLEMENTAL FLOOR TILE & MASTIC SPECIFICATIONS

Asbestos Abatement Specifications Washoe County School District Floor Tile and Mastic at District Sites

Background

Washoe County School District (WCSD) will be performing the abatement of vinyl floor tile (VFT) and mastic at various District sites. This supplemental spec as well as the District specs will apply to the removal of all Floor Tile and Mastic materials. The abatement contractor shall be prepared to abate flooring materials as identified in the site-specific architectural drawings provided for the individual site or information provided prior to bidding.

The contractor will need to note when additional asbestos-containing materials are to be abated within the same containment area and perform that work within the same negative pressure enclosure. The contractor's onsite supervisor, or project estimator during bidding, will need to confer with either WCSD or the District's independent third-party consultant, for the expected containment areas and number of containments at a particular site.

Scope of Work

The contractor awarded the project will be responsible for all costs associated with the abatement of flooring materials.

The project scope shall be determined by the site-specific architectural drawings prepared for the individual site. The Contractor is responsible for reviewing the architectural drawings and the WCSD Regulated Systems and Assessment (ES&A) Material Disturbance Permit to determine which materials, including baseboards and mastic, in the project area are asbestos-containing.

The District has retained an independent third-party abatement consultant to draft these specifications, who may provide oversight during the projects, conduct visual clearance inspections and collect clearance air samples at the conclusion of these abatement projects. All oversight or additional oversight and collection of air samples may be performed by the District's ES&A Department as well at their discretion.

In addition to complying with these supplemental specifications, the Contractor must also comply with all other asbestos abatement requirements listed in these asbestos abatement specifications. If Contractors find any conflicting information in the supplemental specifications, the Contractor must comply with the requirements listed herein that are deemed most stringent by the District or District hired asbestos consultant supervising the abatement.

Most floors in the District are concrete, but wood floors may be encountered. Since cleaning flooring mastics are difficult if not impossible on wood floors, whenever there is more than is one layer of flooring sub-floor, one layer will be removed as a part of the abatement process and properly disposed as asbestos containing materials.

Project Requirements

Contractor shall be approved by the WCSD ES&A Department to perform asbestos abatement activities within the District. **Approval of firms that have not performed activities impacting asbestos for the District previously, will need to submit all necessary documentation outlined in the WCSD ES&A Technical Specifications for the project at least ten (10) business days prior to work commencing for approval.**

All workers certifications – asbestos training and licensing and medical clearance – shall be submitted to the WCSD ES&A at least five (5) working days prior to project commencement at minimum for approval. Contractor is responsible for reviewing WCSD ES&A worker roster for the company to assure all workers to be used on the project have been approved prior to arrival onsite. Workers not identified on the approved worker list for the contractor will not be allowed to perform any activities onsite, even if documentation is provided onsite at time of the project commencement.

The abatement contractor's onsite supervisor shall have a copy of these Specifications onsite at all times and be familiar with the project requirements prior to arrival onsite at the project. Failure to follow requirements of these Specifications, or lack of knowledge of requirements to be followed during the project, are grounds for replacement of the abatement contractor's onsite supervisor.

Only the abatement contractor will be allowed to occupy the project area once abatement activities are scheduled to start. This applies to all WCSD non-ES&A staff/personnel and site staff/personnel. The area shall only be occupied by the abatement contractor, WCSD ES&A staff, and District's independent third-party abatement consultant. Other personnel will not be allowed to occupy the building during asbestos abatement activities.

Contractor shall adhere to the requirements of these Specifications, WCSD ES&A Technical Specifications, Federal, State, and Local regulations.

Water and Electricity

Water and electricity are available onsite, but long hoses and cords may be necessary. The contractor is responsible for any damage to water or power systems caused by their use of those systems.

Contractor shall provide a GFI at the primary plug-in of all electrical trains used for electrical equipment. Hose washers shall be provided at all hose connections to prevent leakage of water and potential damage to District facilities.

Pre-Cleaning

Pre-cleaning is not expected to be necessary; however, Contractor may need to remove some debris or clean surfaces to facilitate the building of negative pressure enclosure.

Notifications

Contractor is responsible for timely notifications (including courtesy notifications if applicable) to Nevada Division of Industrial Relations and Washoe County Health Department. Notifications shall be filed in advance of any waiting periods in lieu of the proposed project start date or other requirements for pre-work notification. Any revisions to notifications including project scope, start date, duration of project, or any other changes are the Contractor's responsibility. Valid notifications shall be posted onsite during the project, and copies shall be provided to the District's onsite third-party consultant.

Equipment

Contractor is responsible for providing all necessary equipment in sufficient quantities to complete the project in the schedule provided for the project. All equipment must arrive onsite clean and in proper functioning order. Any equipment that arrives onsite dirty or not in proper functioning order shall be removed from the project site for cleaning and/or repairs.

Training

Workers performing asbestos abatement activities as part of this project must have AHERA Worker training with at least one worker trained to the AHERA Contractor-Supervisor level. All workers shall be licensed by the Nevada DIR for asbestos work. The crew lead Contractor-Supervisor may not leave the site anytime asbestos abatement operations are being performed.

As noted previously, all workers certifications must be approved by the WCSD ES&A prior to arrival onsite to start work. Copies of the worker certs shall be provided to the District's onsite third-party consultant as well.

Personal Protection Equipment

The contractor is responsible for adhering to Nevada Division of Industrial Relations and OSHA requirements for worker respiratory protection. At a minimum, workers shall wear half-face, negative pressure respirators with HEPA (P-100) filters during any activities which disturb asbestos-containing materials.

Workers shall wear Tyvek-level disposable coveralls, hard hats, work gloves, and safety glasses (if not using a full face-piece respirator.) Street clothes may not be worn under disposable coveralls.

All employees shall have a valid medical clearance and fit test for respirators to be used. Medical clearance shall be provided for approval to the WCSD ES&A prior to the project commencement. Copies of the medical clearance and fit test shall be provided to the District's onsite third-party consultant as well.

Personal Air Monitoring

The contractor is responsible for the collection of personal air samples on workers during all abatement activities for asbestos. If removal activities or methods are expected to disturb any substrates which contain silica, the contractor is also responsible for collection of personal air samples for respirable crystalline silica

exposure. Asbestos and silica personal air samples shall be collected in accordance with OSHA sampling protocols and analyzed by a laboratory with the proper accreditation.

Laboratories to be used for personal air sample analysis must be approved by WCSD ES&A.

Copies of the personal air sampling results, along with laboratory accreditation, shall be submitted to the WCSD ES&A and District's independent third-party consultant.

In addition, the contractor will comply with all requirements regarding personal air monitoring listed in Section 02130, Part 2- - Air Monitoring, 2.02.

Security and Safety

The contractor is responsible for security of all equipment and safety of all employees. Contractor shall provide any storage containers or security needed for tools and equipment if needed.

Contractor is responsible for all worker safety and following all applicable regulations, namely Nevada and Federal OSHA, including for asbestos and respirable crystalline silica exposures.

Occupancy

As noted previously, the project area will be limited to the abatement contractor, WCSD ES&A staff, and District's independent third-party consultant once abatement activities are ready to commence. Once the area has been cleared, other parties may occupy.

Emergency services may also occupy areas in the event of an emergency during the project.

Challenge Testing

All HEPA-filtered equipment to be used on this project shall have been challenge tested (DOP or equivalent) within the previous 30 days prior to use onsite. Copies of the challenge testing results shall be provided to the WCSD ES&A and/or District's independent third-party consultant.

Asbestos Abatement Containment and Abatement Requirements

ALL POLY USED ON PROJECT SHALL BE 6-MIL AND FIRE-RETARDANT UNLESS EXEMPTED IN REQUIREMENTS BELOW.

Vinyl Floor Tile and Mastic Abatement

1. Contractor shall seal all critical barriers (HVAC, windows, doors, etc.) in each containment area with one layer of 6-mil poly. Doors leading outside of the containment area shall remain in place for security.
2. The contractor shall setup a regulated area and abate those areas of tiles that extend below door threshold prior to sealing of doorways as critical barriers as applicable.

3. All walls and any fixed objects that cannot be removed from the containment shall be covered with one layer of 6-mil poly. One additional layer of 4-mil poly may extend up from the floor to a height of 4' to act as a cleaning barrier.
4. A false-ceiling, minimum of 4-mil poly, shall be installed as directed by the owner or if needed to achieve and maintain sufficient negative air pressure differential as noted below. Mastic to be removed by hydro-blasting or grinding will require installation of a 4-mil poly ceiling. See hydro-blasting and grinding sections below.
5. A minimum three-stage decontamination unit with operable shower shall be contiguous with each containment. See "Decontamination Chamber Requirements" in this specification for further requirements.
6. Negative pressure shall be established and a recording manometer shall be attached to each containment. Copies of the manometer recordings shall be provided on 8.5"x11" paper by the Contractor to the District and third-party independent consultant.
7. An air pressure differential of -0.050" WC must be established and maintained throughout all phases of abatement and through receipt of passing air clearance.
8. Workers shall wet all materials prior to, and during, removal using amended water.
9. Baseboard removal shall not take place until containment is established.
10. At the conclusion of abatement, the floor surface shall be HEPA-vacuumed clean and all mastic removed. The criteria for mastic removal shall be no three-dimensional material, including mastic that may have become liquefied and entered slab divots, joints, or any other areas during the removal process.
11. All poly shall be wet-wiped or HEPA-vacuumed clean as part of detail cleaning. The 4-mil poly cleaning barrier may be removed as part of this detail cleaning unless required for maintaining sufficient air pressure differential.
12. All waste shall be placed into two separate waste bags of 6-mil thickness. The outer waste bag shall be sealed in a "gooseneck" fashion to create a leak-tight container.

For the hydro-blasting of the concrete substrate to remove mastic and for areas which must have the top surface of the concrete removed, as directed by the flooring subcontractor(s), the following requirements must be met by the Contractor:

1. For hydro-blasting, a full negative pressure containment must be constructed, including a ceiling of 4-mil poly.

2. All critical barriers must be sealed with one layer of 6-mil poly. Any fixed objects that cannot be moved out of the containment area shall be covered with one layer of 6-mil poly.
3. Contractor shall use a hydro-blasting unit to “power wash” the floors clear of mastic, including any cracks or seams in the concrete slab. This system shall have a man-operated unit that will capture the water with vacuum pressure at the front of the machine as it is operating to prevent the build-up of water in the containment.
4. The hydro-blasting unit shall be set to remove mastic on the substrate surface, cracks, and seams, without damage to the concrete slab. For areas where the top surface layer of the concrete is to be removed, at the direction of the flooring subcontractor(s), the abatement contractor shall set the hydro-blasting unit to remove the surface to a depth specified by the flooring subcontractor(s).
5. The abatement contractor shall anticipate the unit not being able to hydro-blast all areas of the containment (corners, along walls) and shall plan to use alternate methods to remove mastic or the top concrete surface in such areas. Any mechanical means to remove the mastic will need to have HEPA-filtered local exhaust.
6. At the conclusion of the hydro-blasting, the abatement contractor shall clean the floor of the containment using HEPA-vacuums followed by wet-cleaning, and HEPA-vacuuming again to assure that surfaces have been cleaned sufficiently.
7. All poly surfaces, including the ceiling, shall be wet-wiped clean as part of detail cleaning.
8. Contractor shall perform treatment of waste water prior to discharge if water will not be treated as a hazardous waste. Waste water must meet the levels of requirements provided in City of Reno Municipal Code 12.16.565.
9. Contractor shall follow all requirements, including collection of any necessary permits, for the discharge of contaminated water as required by City of Reno Municipal Code 12.16.
10. If abatement contractor will dispose of all water, they shall be responsible for profiling water for disposal. Copies of the waste profile results, along with chain of custody, shall be provided to HMS, Inc. Project Manager prior to disposal.

For the grinding of concrete floor surfaces, the work shall be performed within the same containment erected for floor tile and mastic abatement (as applicable). If areas being ground are not within a contained area (such as non-asbestos floor removal), a negative pressure enclosure shall be constructed as listed in the hydro-blasting section above. In addition to the requirements as noted above, the following engineering controls shall be met by the contractor performing the grinding of floor surfaces.

1. All power equipment to be used for the grinding of concrete floor surfaces shall have an approved shroud system that provides local exhaust.

2. A HEPA-vacuum shall be attached to the shroud system to provide the local exhaust.
3. An airless sprayer or equivalent shall be used to provide water for the suppression of any visible emissions that may be released by the work and to keep surfaces wet prior to cleaning.
4. All slurries or dust remaining within the containment area shall be HEPA-vacuumed cleaned. Additional wet-wiping to assure all dust has been cleaned in the containment area may be required.

Decontamination Requirements

A three stage decon unit including a shower is required for asbestos containments. Each chamber of the decon must have self-closing Z-flaps that seal air tight. A four-inch barrier must exist at the floor of each chamber to prevent the transfer of water and debris from chamber to chamber. This barrier will also provide a seal for the flaps between each chamber. Equipment and bag out chambers do not require a shower, but a washing station must exist and they must be three-stages. The washing station must be constructed in a manner that prevents water from splashing or traveling out of the central decon chamber. Equipment and bag out chambers must also have flaps that seal air tight.

Shower units must be equipped with an overflow pan to catch water which overfills the drain system, or is splashed out of the chamber during employee showers. Showers must be supplied with hot water, soap, shampoo, and towels for the workers. Showers shall be sited in the central decon chamber. Showers and washing station must also be equipped with a filtering system that includes a 0.5 micron filter and heated water. If a filtering system is not available or is not functioning correctly, shower water must be bagged and disposed of as asbestos-containing waste with no extra compensation being given to the Contractor.

All chambers of the decon, including the clean chamber, must be kept clean and dry (except shower) at all times. Abatement work will be stopped if decon is not kept in acceptable condition.

Regulated Area Signage

Asbestos Danger signs shall be posted at all entrances to the containment area, even if the entrance is sealed as a critical barrier. Signs shall also be posted on the flap leading into the shower station of decontamination chambers. Signage will be set once a pre-start visual is passed and work may begin in the containment, but no work will start until all signs are posted.

Signage shall meet the revised requirements set forth in 29 CFR 1926.1101(k)(7).

Air Pressure Differential

Air pressure differential must be established and maintained at -0.05 inches water differential or better before start of abatement and air pressure differential must be maintained through all phases of project, including collection of clearance air samples and receipt of results. A minimum of eight air changes per hour is required for the project. Work will be halted if the air pressure drops below -0.05 inches water differential and can resume when air pressure differential of -0.05 inches is established again.

Air pressure differential must be displayed and recorded on a properly calibrated and fully functioning

manometer. Copies of the manometer recording must be provided by the contractor on 8.5" x 11" paper at completion of project.

All negative air machines must be exhausted to the exterior of the building using wire-reinforced flex duct. All negative air machines must be used inside containment. No machines shall be attached to the exterior of the containment with the intake only inside.

Any exterior barricades need to be constructed of a minimum 1/2" plywood and lockable for security. Contractor is responsible for providing a lock to any exterior barricades, and keys shall be provided to WCSD site facilities coordinator and District's independent third-party consultant.

Make-Up Air Sources

Available, but may need to be HEPA-filtered. Any make-up holes in critical barriers must be equipped with a challenge/DOP-tested HEPA filter. Placing a pre-filter in the make-up air hole will not be allowed.

Disposal Requirements

All asbestos waste generated on this project will need to be double-bagged in 6-mil poly waste bags. At least one of the waste bags must be sealed in a "gooseneck" fashion. All non-friable debris shall be properly labeled and identified for disposal as an asbestos-containing waste. Materials that have become friable or which removal methods have made friable shall be labeled and identified for disposal as regulated asbestos-containing material (RACM).

The contractor will need to provide a lockable waste bin for all waste created on this project.

Waste bin will need to be labeled with asbestos signage once the waste is loaded into the bin. Waste bins shall be lined with one layer of 6-mil poly prior to waste being loaded.

Waste bins will need to arrive onsite clean of debris or any other waste and in proper functioning order. Waste bins may be rejected by WCSD ES&A staff or District's independent third-party consultant if these conditions are not met, with no extra charge to the District.

Clearance

Upon completion of asbestos abatement activities, a final visual inspection will be performed by either WCSD ES&A staff or District's independent third-party consultant. This inspection will be performed only after the abatement contractor crew supervisor has performed their own final visual clearance. Areas must be free of all three-dimensional material with all surfaces clean of dust and debris and all materials abated within the containment area. Once the containment has been successfully visually inspected and cleared, the Contractor shall apply a lock-down encapsulant to contaminated surfaces in the containment area. The contractor will need to use care to not apply encapsulant to floor surfaces which may prevent adhesion of new flooring materials.

Final clearance shall be through aggressive air sampling conducted by the District's independent third-party

consultant or a District AHERA certified technician. A set of five air samples will be collected inside the containment to be analyzed in accordance with AHERA completion of response action criteria using either phase contrast microscopy (PCM) or transmission electron microscopy (TEM), depending on the quantity of materials abated.

Clearance criteria for PCM sample analysis, in accordance with AHERA, is 0.01 fibers per cubic centimeter (0.01 f/cc) or less for each of the five samples.

Clearance criteria for TEM sample analysis, in accordance with AHERA, is an average of 70 structures per square millimeter (70 s/mm²) or fewer for the inside-containment set of five samples.

Contractor shall return to the site to remove poly barriers and equipment upon notification of passing clearance air samples. Contractor is also responsible for washing the floor using an approved detergent cleaner and water to provide a clean surface for the new floor installation.

In the event that floor grinding is required to be completed within the same containment area, clearance air samples will be collected at the conclusion of grinding and cleaning of the surfaces within the containment area.

**Supplemental Asbestos Abatement Specifications
Washoe County School District
Thermal System Insulation at District Sites**

Background

Washoe County School District (WCSD) will be performing the abatement of thermal system insulation (TSI) materials at various District sites. This supplemental spec as well as the District specs will apply to the removal of all asbestos containing Thermal System Insulation. The abatement contractor shall be prepared to abate TSI materials as identified in the site-specific architectural drawings provided for the individual site or information provided prior to bidding.

The contractor will need to note when additional asbestos-containing materials are to be abated within the same containment area and perform that work within the same negative pressure enclosure. The contractor's onsite supervisor, or project estimator during bidding, will need to confer with either WCSD or the District's independent third-party consultant, for the expected containment areas and number of containments at a particular site.

Scope of Work

The contractor awarded the project will be responsible for all costs associated with the abatement of TSI materials.

The project scope shall be determined by the site-specific architectural drawings prepared for the individual site. The Contractor is responsible for reviewing the architectural drawings and the WCSD Regulated Systems and Assessment (ES&A) Material Disturbance Permit to determine which TSI materials in the project area are asbestos-containing and will be required to be abated.

The District has retained an independent third-party abatement consultant to draft these specifications, who may provide oversight during the projects, conduct visual clearance inspections and collect clearance air samples at the conclusion of these abatement projects. All oversight or additional oversight and collection of air samples may be performed by the District's ES&A Department as well at their discretion.

In addition to complying with these supplemental specifications, the Contractor must also comply with all other asbestos abatement requirements listed in these asbestos abatement specifications. If Contractors find any conflicting information in the supplemental specifications, the Contractor must comply with the requirements listed herein that are deemed most stringent by the District or District hired asbestos consultant supervising the abatement.

Project Requirements

Contractor shall be approved by the WCSD ES&A Department to perform asbestos abatement activities within the District. **Approval of firms that have not performed activities impacting asbestos for the District previously, will need to submit all necessary documentation outlined in the WCSD ES&A Technical Specifications for the project at least ten (10) business days prior to work commencing for approval.**

All workers certifications – asbestos training and licensing and medical clearance – shall be submitted to the WCSD ES&A at least five (5) working days prior to project commencement at minimum for approval. Contractor is responsible for reviewing WCSD ES&A worker roster for the company to assure all workers to be used on the project have been approved prior to arrival onsite. Workers not identified on the approved worker list for the contractor will not be allowed to perform any activities onsite, even if documentation is provided onsite at time of the project commencement.

The abatement contractor's onsite supervisor shall have a copy of these Specifications onsite at all times and be familiar with the project requirements prior to arrival onsite at the project. Failure to follow requirements of these Specifications, or lack of knowledge of requirements to be followed during the project, are grounds for replacement of the abatement contractor's onsite supervisor.

Only the abatement contractor will be allowed to occupy the project area once abatement activities are scheduled to start. This applies to all WCSD non-ES&A staff/personnel and site staff/personnel. The area shall only be occupied by the abatement contractor, WCSD ES&A staff, and District's independent third-party abatement consultant. Other personnel will not be allowed to occupy the building during asbestos abatement activities.

Contractor shall adhere to the requirements of these Specifications, WCSD ES&A Technical Specifications, Federal, State, and Local regulations.

Water and Electricity

Water and electricity are available onsite, but long hoses and cords may be necessary. The contractor is responsible for any damage to water or power systems caused by their use of those systems.

Contractor shall provide a GFI at the primary plug-in of all electrical trains used for electrical equipment. Hose washers shall be provided at all hose connections to prevent leakage of water and potential damage to District facilities.

Pre-Cleaning

Pre-cleaning of debris may be required during setup and prior to abatement of TSI.

If required, cleanup will be performed once HVAC is shut down and tagged out by the contractor, with District approval, and critical barriers are sealed with 6-mil poly. Workers performing pre-cleaning will use HEPA-vacuums to vacuum debris and dust from the area. Workers will need to wear half-mask respirator fitted with HEPA (P-100) filters and tyvek quality disposable coveralls with attached hood and boots.

Notifications

Contractor is responsible for timely notifications (including courtesy notifications if applicable) to Nevada Division of Industrial Relations and Washoe County Health Department. Notifications shall be filed in advance of any waiting periods in lieu of the proposed project start date or other requirements for pre-work notification. Any revisions to notifications including project scope, start date, duration of project, or any other changes are

the Contractor's responsibility. Valid notifications shall be posted onsite during the project, and copies shall be provided to the District's onsite third-party consultant and ES&A Department.

Equipment

Contractor is responsible for providing all necessary equipment in sufficient quantities to complete the project in the schedule provided for the project. All equipment must arrive onsite clean and in proper functioning order. Any equipment that arrives onsite dirty or not in proper functioning order shall be removed from the project site for cleaning and/or repairs.

Training

Workers performing asbestos abatement activities as part of this project must have AHERA Worker training with at least one worker trained to the AHERA Contractor-Supervisor level. All workers shall be licensed by the Nevada DIR for asbestos work. The crew lead Contractor-Supervisor may not leave the site anytime asbestos abatement operations are being performed.

As noted previously, all workers certifications must be approved by the WCSD ES&A prior to arrival onsite to start work. Copies of the worker certs shall be provided to the District's onsite third-party consultant as well.

Personal Protection Equipment

A tight-fitting powered air-purifying respirator (PAPR) fitted with HEPA filters shall be worn for respiratory protection when performing TSI abatement.

A full facepiece, supplied-air respirator operated in the pressure-demand mode shall be worn by workers performing Class 1 work if the negative exposure assessment, or air sampling performed by ES&A or the District's third-party consultant, indicates that the exposure level will be above 1 f/cc as an 8-hour TWA.

Workers shall wear Tyvek-level disposable coveralls, hard hats, and work gloves. Street clothes may not be worn under disposable coveralls.

All employees shall have a valid medical clearance and fit test for respirators to be used. Medical clearance shall be provided for approval to the WCSD ES&A prior to the project commencement. Copies of the medical clearance and fit test shall be provided to the District's onsite third-party consultant as well.

Personal Air Monitoring

The contractor is responsible for the collection of personal air samples on workers during all abatement activities for asbestos. These samples shall be collected in accordance with OSHA sampling protocols and analyzed by a laboratory with the proper accreditation.

Laboratories to be used for personal air sample analysis must be approved by WCSD ES&A.

Copies of the personal air sampling results, along with laboratory accreditation, shall be submitted to the WCSD ES&A and District's independent third-party consultant.

In addition, the contractor will comply with all requirements regarding personal air monitoring listed in Section 02130, Part 2- - Air Monitoring, 2.02.

Security and Safety

The contractor is responsible for security of all equipment and safety of all employees. Contractor shall provide any storage containers or security needed for tools and equipment if needed.

Contractor is responsible for any ladder, scaffolding, or any other worker safety measures needed to facilitate the TSI abatement as required by state or Federal regulation.

Contractor is responsible for all worker safety and following all applicable regulations, namely Nevada and Federal OSHA.

Occupancy

As noted previously, the project area will be limited to the abatement contractor, WCSD ES&A staff, and District's independent third-party consultant once abatement activities are ready to commence. Once the area has been cleared, other parties may occupy.

Emergency services may also occupy areas in the event of an emergency during the project.

Challenge Testing

All HEPA-filtered equipment to be used on this project shall have been challenge tested (DOP or equivalent) within the previous 30 days prior to use onsite. Copies of the challenge testing results shall be provided to the WCSD ES&A and/or HMS, Inc.

Asbestos Abatement Containment and Abatement Requirements

ALL POLY USED ON PROJECT SHALL BE 6-MIL AND FIRE-RETARDANT UNLESS EXEMPTED IN REQUIREMENTS BELOW.

1. The Contractor shall develop a regulated area that meets the requirements of OSHA regarding posting and limited access.
2. The Contractor shall follow the procedures recommended by the manufacturer of the glovebags, and the specifications required by OSHA regulations.
3. All critical openings within the regulated area shall be sealed prior to set up of the containment using two layers of 6 mil poly.

4. At least one layer of 6 mil poly must be used to contain the abatement area, including ceiling. Two layers of 6 mil poly shall be placed on the floor of the containment. The bottom layer of floor poly must be black to assist with visual clearance.
5. Stationary objects in the immediate area of the room which cannot be removed from the work area must be covered with at least one layer of 6 mil poly sheeting after being pre-cleaned.
6. A minimum three stage decontamination unit with a shower shall be contiguous with the containment. See "Decontamination Chamber Requirements" in this specification for further requirements.
7. Negative pressure shall be established and a recording manometer shall be attached to the containment. Copies of the manometer recordings shall be provided on 8.5"x11" paper by the Contractor.
8. A HEPA-filtered vacuum shall be in the immediate area for use in conjunction with the bags or in case of a spill.
9. Glovebags may not be used on surfaces where temperatures exceed 150 degrees Fahrenheit.
10. Glovebags will be utilized only used inside of a full negative pressure containment.
11. Glovebags may be used only once, and may not be moved or slid for removal of a second section of TSI.
12. At least two persons shall perform glovebag removal.
13. Before beginning the operation, loose and friable material adjacent to the glovebag operation shall be wrapped and sealed in two layers of 6 mil poly sheeting or otherwise rendered intact using encapsulating cloth.
14. The Contractor shall apply a sufficient volume of amended water to wet all pipewrap removed from the pipes while it is enclosed in the glovebag.
15. Prior to placement in the disposal bag, glovebags shall be collapsed by removing air within them using a HEPA-vacuum.
16. Upon detachment, the glovebag must be immediately placed into a 6 mil thick disposal bag. The disposal bags must be sealed using the "gooseneck" sealing technique. Waste bags shall be properly labeled as a regulated asbestos containing waste.
17. Where pipes enter walls, floors, or ceilings which are not within the scope of the project, the pipewrap shall be removed at least 1" into the structure and the pipewrap end must be sealed with bridging encapsulant and/or wettable cloth.
18. The Contractor shall be responsible for ensuring the piping system remains adequately supported at all times. This may be achieved by readjusting existing hanger brackets as insulation is removed, or by other approved methods, such as inserting wood blocks to replace the thickness of the removed insulation.

Decontamination Requirements

A three stage decon unit including a shower is required for asbestos containments. Each chamber of the decon must have self-closing Z-flaps that seal air tight. A four-inch barrier must exist at the floor of each chamber to prevent the transfer of water and debris from chamber to chamber. This barrier will also provide a seal for the flaps between each chamber. Equipment and bag out chambers do not require a shower, but a washing station must exist and they must be three-stages. The washing station must be constructed in a manner that prevents water from splashing or traveling out of the central decon chamber. Equipment and bag out chambers must also have flaps that seal air tight.

Shower units must be equipped with an overflow pan to catch water which overfills the drain system, or is splashed out of the chamber during employee showers. Showers must be supplied with hot water, soap, shampoo, and towels for the workers. Showers shall be sited in the central decon chamber. Showers and washing station must also be equipped with a filtering system that includes a 0.5 micron filter. If filtering system is not available or is not functioning correctly, shower water must be bagged and disposed of as asbestos-containing waste.

All chambers of the decon, including the clean chamber, must be kept clean and dry (except shower) at all times. Abatement work will be stopped if decon is not kept in acceptable condition.

Regulated Area Signage

Asbestos Danger signs shall be posted at all entrances to the containment area, even if the entrance is sealed as a critical barrier. Signs shall also be posted on the flap leading into the shower station of decontamination chambers. Signage will be set once a pre-start visual is passed and work may begin in the containment, but no work will start until all signs are posted.

Signage shall meet the revised requirements set forth in 29 CFR 1926.1101(k)(7).

Air Pressure Differential

Air pressure differential must be established and maintained at -0.05 inches water differential or better before start of abatement and air pressure differential must be maintained through all phases of project, including collection of clearance air samples and receipt of results. A minimum of eight air changes per hour is required for the project. Work will be halted if the air pressure drops below -0.05 inches water differential and can resume when air pressure differential of -0.05 inches is established again.

Air pressure differential must be displayed and recorded on a properly calibrated and fully functioning manometer. Copies of the manometer recording must be provided by the contractor on 8.5" x 11" paper at completion of project.

All negative air machines must be exhausted to the exterior of the building using wire-reinforced flex duct. All negative air machines must be used inside containment. No machines shall be attached to the exterior of the containment with the intake only inside.

Any exterior barricades need to be constructed of a minimum ½" plywood and lockable for security. Contractor is responsible for providing a lock to any exterior barricades, and keys shall be provided to WCSD site facilities coordinator and HMS, Inc. Project Manager.

Make-Up Air Sources

Available, but may need to be HEPA-filtered. Any make-up holes in critical barriers must be equipped with a challenge/DOP-tested HEPA filter. Placing a pre-filter in the make-up air hole will not be allowed.

Disposal Requirements

All asbestos waste generated on this project will need to be double-bagged in 6-mil poly waste bags, or double-wrapped in 6-mil polyethylene sheeting. All waste bags must be sealed in a “gooseneck” fashion. All waste shall be properly labeled and identified for disposal as a regulated asbestos-containing material (RACM).

The contractor will need to provide a lockable waste bin for all waste created on this project. Waste bin will need to be labeled with asbestos signage once the waste is loaded into the bin. Waste bins shall be lined with one layer of 6-mil poly prior to waste being loaded.

Waste bins will need to arrive onsite clean of debris or any other waste and in proper functioning order. Waste bins may be rejected by WCSD ES&A staff or District’s independent third-party consultant if these conditions are not met, with no extra charge to the District.

Clearance

Upon completion of asbestos abatement activities, a final visual inspection will be performed by either WCSD ES&A staff or District’s independent third-party consultant. This inspection will be performed only after the abatement contractor crew supervisor has performed their own final visual clearance. Areas must be free of all three-dimensional material with all surfaces clean of dust and debris and all materials abated within the containment area.

Final clearance shall be through aggressive air sampling conducted by the District’s independent third-party consultant. A set of five air samples will be collected inside the containment to be analyzed in accordance with AHERA completion of response action criteria using either phase contrast microscopy (PCM) or transmission electron microscopy (TEM), depending on the quantity of TSI abated.

Clearance criteria for PCM sample analysis, in accordance with AHERA, is 0.01 fibers per cubic centimeter (0.01 f/cc) or less for each of the five samples. Clearance criteria for TEM sample analysis, in accordance with AHERA, is an average of 70 structures per square millimeter (70 s/mm²) or fewer for the inside-containment set of five samples.

Contractor shall return to the site to apply a lock-down encapsulant, remove poly barriers and equipment upon notification of passing clearance air samples.

BID FORM

Washoe County School District - Purchasing Department
14101 Old Virginia Road - Reno, Nevada 89521
Phone: 775-850-8025 Email: solicitations@washoeschools.net

Bid #: 25-44-B-01-DA
PWP # WA-2025-145

Having carefully examined all of the Bid Specifications entitled **Roof Replacement of Sections A, A1, B, and B1** dated January 8, 2025; and the Drawings dated December 13, 2024; the addenda numbered _____; as well as the premises and the conditions affecting the work, the undersigned proposes to furnish for the stipulated sum of:

ITEM	DESCRIPTION	AMOUNT
A.	BASE BID 1	\$
B.	FORCE ACCOUNT	\$165,000.00
C.	TOTAL – BASE BID 1 AND FORCE ACCOUNT (The Sum of Box A + Box B): All labor and materials for the ROOF REPLACEMENT OF SECTIONS A, A1, B, AND B1 AT ROY GOMM ELEMENTARY SCHOOL as drawn and specified, the sum of _____ Dollars (\$_____).	

UNIT PRICES/ALLOWANCES

The District reserves the right to reject any unit price submitted if in its' opinion is unreasonable and/or not within standard industry pricing.

1. Contractor shall provide a Quantity Unit Price for all items listed in Table A, including any Allowance with a zero (0) quantity.
2. Contractor shall provide total of each Line Item in Table A by Quantity Unit Price multiplied by Allowance Quantity. If Allowance is zero (0), the Total will be zero (0).
3. Contractor shall total all of items listed and include in their Base Bid for this Project.
4. For changing specified quantities of work from those indicated by the contract drawings and specifications, upon written instructions of the Owner, the following unit prices shall prevail. The proposed unit prices shall include all labor, overhead, profit, materials, equipment, taxes and freight.
5. Only a single unit price shall be given and it shall apply for either more or less than the specified quantity required by the contract documents.
6. Refer to Benchmark's Section 01 22 00 – UNIT PRICES for a description of stipulated quantity allowances to be included in the Bid, where applicable.

7. In the event of more or less units than required, change orders shall be issued for the increased or decreased amount.

**THE FOLLOWING TOTALS BELOW SHALL BE INCLUDED IN YOUR BASE BID PRICE
TABLE A**

Description	Quantity Unit Price	Allowance	Total
Add or Delete Lumber/Nailer		0 Board Foot	\$
Add or Delete Plywood		0 Square Foot	\$
Install Roof System Walkway		0 Linear Foot	\$
Repair Steel Decking		0 Square Foot	\$
Paint Surface Rusted Steel Decking		0 Square Foot	\$

Total to be included in Base Bid \$ _____

Any bid submission will be disqualified and rejected if the bid submission is not signed.

Bids shall be submitted on the provided Bid Form (PUR-F523) only, and all of the blank spaces shall be completed; numbers shall be stated both in writing and in figures, the signature shall be in longhand; and the completed form shall be without interlineation, alteration or erasure. Washoe County School District only accepts signatures done manually (also known as a wet signature) or electronic digital signatures that are certified. Non-certified electronic digital signatures will NOT be accepted. A typed signature, even in cursive font, DOES NOT meet the requirements of an official digital signature. A digital signature must be accompanied by a certified digital stamp issued through programs like Adobe Acrobat, Docu-Sign or other similar programs that produce a digital stamp certifying the electronic digital signature. Any signatures on required forms that do not meet these requirements will not be accepted and the Contractor's submission will be deemed "Non-Responsive" and will be rejected. If you have any questions about this requirement, please submit your question by the question deadline, so that it can be answered prior to quote submission deadline. In the event of a discrepancy on the Bid Form, NRS 104.3114 Contradictory terms of instrument states that, "If an instrument contains contradictory terms, typewritten terms prevail over printed terms, handwritten terms prevail over both, and WORDS PREVAIL OVER NUMBERS." WCSD will record the bid amount stated in WORDS in Box C. Only bids on the form(s) provided will be accepted. No additional pages containing inclusions, exclusions or clarifications will be accepted as part of the bid. Any clarifications, additions or exclusions made by the Washoe County School District (WCSD/ OWNER) will be considered incorporated into the specifications.

Bidder shall proofread his/her bid carefully for errors.

WCSD reserves the right to award the bid for the best proposal for each individual item or to award on the best total proposal, whichever is deemed by the Owner to be in their best interests. WCSD also reserves the right to reject any or all bids and to waive irregularities or informalities in any bid for any reason whatsoever.

If they be notified of the acceptance of this proposal within forty-five (45) days of the time set for opening of bids, Contractor agrees to execute a contract for the above work for the above-stated compensation in the form of the contract attached within these bid specifications and to commence the physical work no fewer than ten (10) days after the execution thereof.

The undersigned agrees, if awarded the contract, work is to be commenced as phased in the Special Notifications and shall be completed on or before August 1, 2025. The commencement date for the physical work shall be coordinated by the Capital Projects Department upon the receipt of said Notice to Proceed. The undersigned further agrees that the Owner may retain from the monies due the Contractor One Thousand Dollars (\$1,000) per day as a direct result of the Contractor's delay for not completing the project in the required time allowance plus approved time extensions.

The undersigned agrees, if awarded the contract, to execute and deliver to the Owner, within ten (10) calendar days after delivery of notice of award of contract, an executed contract, satisfactory insurance, a performance bond for each awarded contract, and a labor & materials bond for each awarded contract in accordance with the specifications.

Enclosed is a bid bond or other surety in the amount of five percent (5%) of each total proposal (must be provided for each individual base bid item), as required in the Instructions to Bidders.

Enclosed, on the attached form, is a complete listing of the names of each subcontractor who will provide labor or a portion of the work or improvement to the prime contractor for which the subcontractor will be paid equal to or exceeding 5 percent of the prime contractor's total bid. The prime Contractor shall also add his/her name if they are performing any portion of work, including supervision, equal to or exceeding 5 percent of the total bid.

Within two (2) hours after the completion of the opening of the bids, the contractors who submitted the three lowest bids must submit on the form attached a list of each subcontractor who will provide labor or a portion of the work or improvement to the prime contractor for which they will be paid an amount equal to or exceeding 1 percent of the prime contractor's total bid or \$50,000, whichever is greater, and the number of the license issued to the subcontractor pursuant to chapter 624 NRS. If a prime contractor fails to submit such a list within the required time, their bid shall be deemed not responsive.

I have read and acknowledge that our company is in compliance with all WCSD Drug & Alcohol Requirements specified in Section 00800 – Supplementary General Conditions.

NOTE: Any bid submission will be disqualified and rejected if the bid submission is not signed.

Washoe County School District only accepts signatures done manually (also known as a wet signature) or electronic digital signatures that are certified. Non-certified electronic digital signatures will NOT be accepted. A typed signature, even in cursive font, DOES NOT meet the requirements of an official digital signature. A digital signature must be accompanied by a certified digital stamp issued through programs like Adobe Acrobat, Docu-Sign or other similar programs that produce a digital stamp certifying the electronic digital signature. Any signatures on required forms that do not meet these requirements will not be accepted and the Contractor's submission will be deemed "Non-Responsive" and will be rejected. If you have any questions about this requirement, please submit your question by the question deadline, so that it can be answered prior to bid submission deadline.

Interested parties may NOT contact anyone else regarding this solicitation. Any interested Bidder contacting any other individual including, but not limited to, WCSD staff, officials, evaluation committee members, or Board of Trustees may have their Bid submission rejected from evaluation and award consideration.

BID #: 25-44-B-01-DA

FIRM NAME:		NEVADA LICENSE #:
NAME OF AUTHORIZED REPRESENTATIVE:		
ADDRESS:		
PHONE #:	FAX #:	
EMAIL ADDRESS:		DATE:
SIGNATURE:		

5% LIST

To be submitted with the bid in accordance with Article 5.2.1 of the General Conditions as modified and Chapter 338.141 of NRS. **If the Prime Contractor is performing any work, including Supervision, that is 5% or greater they must list themselves per NRS 338.**

PROJECT NAME: **ROOF REPLACEMENT OF SECTIONS A, A1, B, AND B1 AT ROY GOMM ELEMENTARY SCHOOL**

BID #: **25-44-B-01-DA**

DESCRIPTION OF WORK	SUBCONTRACTOR	LICENSE #

Signature: _____
Authorized Firm Representative

Title: _____ Date: _____

1% LIST

To be submitted within two (2) hours after bid opening in accordance with Chapter 338.141 of NRS. Since all Subcontractors listed on the Bidder's 5% List are over 1% of the Bid amount, those Subcontractors shall automatically be deemed incorporated into this 1% List and need not be re-listed below. **If there are no further Subcontractors to list, please write "NONE" or "N/A" and sign document.**

PROJECT NAME: **ROOF REPLACEMENT OF SECTIONS A, A1, B, AND B1 AT ROY GOMM ELEMENTARY SCHOOL**

BID #: **25-44-B-01-DA**

DESCRIPTION OF WORK	SUBCONTRACTOR	LICENSE #

Signature: _____
Authorized Firm Representative

Title: _____ Date: _____

**PREFERENTIAL BIDDER STATUS AFFIDAVIT FOR BIDS SUBMITTED IN ACCORDANCE WITH
NRS 338.0117 VALUED \$250,000 OR MORE**

Although Washoe County School District prefers this form is submitted with the bid response, this form may be submitted within two (2) hours of the bid opening.

Note: The Certificate of Eligibility for Preferential Bidder Status issued by the State Contractor's Board must be submitted with the bid response.

I, _____ ("Affiant"), on behalf of _____ ("Contractor"), swear and affirm that in order to be in compliance with NRS 338.0117, and be eligible to receive a preference in bidding for Project No. _____, Project Name _____ ("Project"), certify that for the duration of the project, collectively, and not on any specific day:

(a) At least 50 percent of the workers employed on the public work, including, without limitation, any employees of the contractor, applicant or design-build team and of any subcontractor engaged on the public work, will hold a valid driver's license or identification card issued by the Department of Motor Vehicles of the State of Nevada;

(b) All vehicles used primarily for the public work will be:

(1) Registered and partially apportioned to Nevada pursuant to the International Registration Plan, as adopted by the Department of Motor Vehicles pursuant to NRS 706.826; or

(2) Registered in this State;

(c) If applying to receive a preference in bidding pursuant to subsection 3 of NRS 338.1727 or subsection 2 of NRS 408.3886, at least 50 percent of the design professionals working on the public work, including, without limitation, employees of the design-build team and of any subcontractor or consultant engaged in the design of the public work, will have a valid driver's license or identification card issued by the Department of Motor Vehicles of the State of Nevada; and

(d) The contractor, applicant or design-build team and any subcontractor engaged on the public work will maintain and make available for inspection within this State his or her records concerning payroll relating to the public work.

If the contractor fails to comply with any requirements of this Affidavit, a public body may recover, by civil action against the party responsible for a failure to comply with a requirement of this affidavit, a penalty as described below for a failure to comply with a requirement of this affidavit. If a public body recovers a penalty pursuant to this subsection, the public body shall report to the State Contractors' Board the date of the failure to comply, the name of each entity which failed to comply and the cost of the contract to which the entity that failed to comply was a party. The Board shall maintain this information for not less than 6 years. Upon request, the Board shall provide this information to any public body or its authorized representative.

If a contractor, applicant or design-build team submits this affidavit, receives a preference in bidding described in this affidavit and is awarded the contract as a result of that preference, the contract between the contractor, applicant or design-build team and the public body, each contract between the contractor, applicant or design-build team and a subcontractor and each contract between a subcontractor and a lower tier subcontractor must provide that:

a) If a party to the contract causes the contractor, applicant or design-build team to fail to comply with a requirement of this affidavit, the party is liable to the public body for a penalty in the amount of 1 percent of the cost of the largest contract to which he or she is a party;

- b) The right to recover the amount determined pursuant to paragraph (a) by the public body pursuant to this affidavit may be enforced by the public body directly against the party that caused the failure to comply with a requirement of this affidavit; and
- c) No other party to the contract is liable to the public body for a penalty.

By: _____ Title: _____
(Print Name of Affiant)

Signature of Affiant: _____ Date: _____

Signed and sworn to (or affirmed) before me on this _____ day of _____, 20_____,
by _____ (name of Affiant).

State of _____)
)ss. _____
County of _____)
Notary Signature
STAMP & SEAL

Proof of Authorization to Sign Affidavit

The person must establish his/her actual authority to act on behalf of the business organization. The individual must be the person indicated in the table below and provide written documentation clearly indicating the person's position within that business organization. If the individual signing the Affidavit is an employee of the business organization, written documentation, on organization letterhead, clearly indicating the person's authority to act on behalf of the business organization must be provided. The written documentation must be signed by the authorized person identified on the table.

If the individual making application for the business organization is not one of the persons identified in the table or an authorized employee, a valid power of attorney executed by an authorized person on behalf of the business organization must be provided. The power of attorney must be made not more than 90 days before the Affidavit is signed.

BUSINESS ENTITY	PERSON WHO HAS AUTHORITY TO COMPLETE AFFIDAVIT
Sole Proprietorship	Sole Proprietor
Partnership	A Partner
Corporation	1. Director, if Authorized 2. Executive Officer as indicated in the Article of Incorporation
Limited Liability Company	1. Member, if Member-Managed LLC 2. Manager, if Manager-Managed LLC

WASHOE COUNTY SCHOOL DISTRICT PUBLIC DISCLOSURE FORM

VENDOR/CONTRACTOR

THIS IS A REQUIRED FORM TO BE COMPLETED, SIGNED, AND SUBMITTED BY THE VENDOR/CONTRACTOR

VENDOR/CONTRACTOR (EMPLOYEE) FIRST/LAST NAME: _____

VENDOR/CONTRACTOR NAME: _____

I understand that per NRS 281A.020, a public office is a public trust and shall be held for the sole benefit of the people, and a public officer or employee must commit themselves to avoid conflicts between the private interests of the public officer or employee and those of the general public whom the public officer or employee serves.

Furthermore, I understand that pursuant to Washoe County School District (WCSD) Board of Trustees Policy 4505 and per NRS 281A.400, WCSD employees (as public officers) shall not seek and/or accept any gift, work/service, favor, employment, engagement, emolument, and/or economic opportunity, including, but not limited to, unlawful compensation, salary, retainer, augmentation, expense allowance, commission, personal profit, pecuniary interest in the course of performing WCSD duties. In addition, WCSD employees (as public officers) shall not use their positions to secure and/or grant unwarranted privileges, preferences, exemptions, and/or advantages for the public officer or employee with any business entity.


By signing this form, I certify and acknowledge that I am a duly authorized agent of the VENDOR/CONTRACTOR named above and that failure to disclose all facts relative to a conflict and/or potential conflict of interest (ethical standards) with regard to the specific solicitation, project, and/or contract to which the VENDOR/CONTRACTOR named above is submitting to WCSD may result in a rejection of said solicitation, project, and/or submission and/or termination of any resulting contract should the above-named VENDOR/CONTRACTOR be selected and/or awarded. Furthermore, I also certify that I have completed the following and have provided true and accurate information to the best of my knowledge:

- A. I certify that, to the best of my knowledge, **NO** current or former WCSD employees, officers, or trustees have a private pecuniary interest in the VENDOR/CONTRACTOR. ☐ **AGREE** ☐ **DISAGREE**

If you **DISAGREE** and cannot certify, then please explain:

- B. To the third degree of consanguinity (refer to the chart below), I have listed all of my and the principal(s) and key personnel of my organization's personal relationships, partnerships, correlations, and relatives (by blood and/or marriage) between WCSD, Officers of WCSD, key employees of WCSD, current and former WCSD Board of Trustees members and any other current and former WCSD personnel. ☐ **AGREE** ☐ **DISAGREE**

If you **DISAGREE** and cannot certify, then please explain:

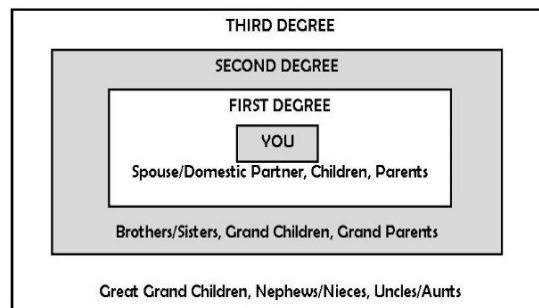

SIGNATURE: _____

DATE: _____

BID BOND

KNOW ALL PERSONS BY THESE PRESENTS, that we, the undersigned _____,
as Principal, and _____ as
Surety, are hereby held and firmly bound unto the Board of Trustees, Washoe County School
District, as Owner, in the sum of _____
_____ Dollars (\$_____)
for payment of which, well and truly to be made, we hereby jointly and severally bind ourselves,
our heirs, executors, administrators, successors, and assigns.

Signed this _____ day of _____, 20_____.

The condition of the above obligation is such that whereas the Principal has submitted to
the Board of Trustees, Washoe County School District, a certain bid, attached hereto and hereby
made a part hereof, to enter into a Contract in writing for: _____
_____.

NOW, THEREFORE, if said bid shall be rejected, or in the alternative, if said bid shall be
accepted and the Principal shall execute and deliver a Contract in the form of Contract attached
hereto (properly completed in accordance with said Bid) and shall furnish a Bond for its faithful
performance of said Contract, and a Bond for the payment of all persons performing labor or
furnishing materials in connection therewith, and shall in all other respects perform the contract
created by the acceptance of said Bid, then this obligation shall be void.

Otherwise, the same shall remain in force and effect, and the sum herein specified paid
over to the Owner; it being expressly understood and agreed that the liability of the Surety for
any and all claims hereunder shall, in no event, exceed the amount of this obligation as herein
stated.

The Surety, for value received, hereby stipulates and agrees that the obligations of said
Surety and its bond shall be in no way impaired or affected by an extension of the time within

which the Owner may accept such bid; and said Surety does hereby waive notice of any such extension.

IN WITNESS WHEREOF, the Principal and the Surety have hereunto set their hands and seals, and such of them as are corporations have caused their corporate seals to be hereto affixed and these presents to be signed by their officers, the day and year first set forth above.

(Seal)

Principal

By: _____

Surety

By: _____

Address:

(Seal)

Phone: _____

LABOR AND MATERIALS BOND

KNOW ALL PERSONS BY THESE PRESENTS: That WHEREAS, the Board of Trustees, Washoe County School District in the State of Nevada has awarded to _____, hereinafter designated as "Principal", a contract dated _____, for _____ a copy of which contract is attached hereto and by reference made a part hereof, and hereinafter referred to as the "Contract".

And WHEREAS, said Principal is required under the terms of said Contract and by law under the provisions of N.R.S. 339 to furnish a Bond for the labor and materials used in said Contract;

NOW, THEREFORE, we, the Principal, and _____, as Surety, are held and firmly bound unto the Board of Trustees, Washoe County School District in the State of Nevada in the sum of _____ Dollars (\$_____), lawful money of the United States, being not less than one hundred percent (100%) of the estimated Contract cost of the work, for the payment of which sum will and truly to be made, we bind ourselves, our heirs, executors, administrators, and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that if the above-bounden Principal, or its heirs, executors, administrators, successors or assigns shall fail to pay for any materials, provisions, supplies implements or machinery used in, upon, for, or about the performance of the work contracted to be done, or for any work or labor thereon of any kind, or for amounts due under the Unemployment Compensation Law with respect to such work or labor, as required by the Provisions of N.R.S. 339, the Surety hereon will pay for the same within thirty (30) calendar days an amount not exceeding the sum specified in this bond, and the above obligation shall then be null and void. Otherwise, it shall remain in full force and virtue.

THE SURETY, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Contract, or to the work to be

performed thereunder, or to the specifications accompanying the same, shall in any way affect its obligations on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Contract or to the work, or to the specifications.

And the said Surety, for value received, further stipulates and agrees that should the Board of Trustees, Washoe County School District, or other obligees, incur attorney's fees or other expenses for the enforcement of the Contract or this bond, the same shall be paid by the Surety to the contracting body, subcontractors, workmen laborers, mechanics and furnishers of material as their interests may appear.

IN WITNESS WHEREOF, the above-bounded parties have executed this instrument under their seals this _____ day of _____, 20____, the name and corporate seal of each corporate party being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

(Seal)

Principal

By: _____

Surety

By: _____

Address:

(Seal)

Phone: _____

PERFORMANCE BOND

KNOW ALL PERSONS BY THESE PRESENTS: That WHEREAS, the Board of Trustees, Washoe County School District in the State of Nevada has awarded to _____,
Hereinafter designated as "Principal": a contract dated _____,
for _____

_____ a copy of which contract is attached hereto and by reference made a part hereof, and hereinafter referred to as the "Contract".

And WHEREAS, said Principal is required under the terms of said Contract and by law under the provisions of N.R.S. 339 to furnish a Bond for the faithful performance of said Contract;

NOW, THEREFORE, we, the Principal, and _____
_____, as Surety, are held and firmly bound unto the Board of Trustees, Washoe County School District in the State of Nevada in the sum of _____
Dollars (\$_____), lawful money of the United States, being no less than one hundred per cent (100%) of the estimated Contract Cost of the work, for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators, and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that if the above bounden Principal, or its heirs, executors, administrators, successors, or assigns, shall in all things stand to and abide by and well and truly keep the faithfully perform the covenants, conditions, and agreements in the Contract and any alterations made as therein provided, on his or its part to be kept and performed at the respects according to their true intent and meaning; and shall indemnify and save harmless the Board of Trustees, Washoe County School District in the State of Nevada, its officers and agents, as therein stipulated; then this obligation shall become null and void. Otherwise, it shall be and remain in full force and virtue.

As a condition precedent to the satisfactory completion of the Contract, the above obligation shall hold good for a period of one (1) year after completion and acceptance of the work done, during which time if the above-bounden Principal, his or its heirs, executors, administrators, successors, or assigns shall fail to make full, complete, and satisfactory repair and replacements or totally protect the Board of Trustees, Washoe County School District in the State of Nevada from loss or damage made evident during said period of one (1) year from the date of acceptance of said work, and resulting from or caused by defective materials or faulty workmanship in the prosecution of the work done, the above obligation in the said sum of _____ Dollars (\$_____) shall remain in full force and virtue; otherwise, the above obligation shall be void.

THE SURETY, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Contract, or to the work to be performed thereunder, or to the specifications accompanying the same, shall in anyway affect its obligations on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Contract, or to the work, or to the specifications.

And the said Surety, for value received, further stipulates and agrees that should the Board of Trustees, Washoe County School District, incur attorney's fees or other expenses for the enforcement of the Contract or his/her bond, the same shall be paid by the Surety to the Board of Trustees, Washoe County School District.

IN WITNESS WHEREOF, the above-bounden parties have executed this instrument under their seals this _____ day of _____, 20____, the name and corporate seal of each corporate party being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

Principal

(Seal)

By: _____

Surety

By: _____

Address:

(Seal)

Phone: _____

SECTION 01001 – CONSTRUCTION PROCEDURES FOR EXISTING SCHOOL SITES

PART 1 – GENERAL

1.1 DESCRIPTION

- A. All work activities under this contract shall be coordinated with the requirements of the Washoe County School District's (WCSD) Facilities Management Department. WCSD shall be contacted prior to any service shutdown and advised when such shutdown shall be commenced. All materials and equipment shall be stored in spaces assigned by WCSD. The Contractor will be required to maintain a neat and orderly operation and to limit or keep noise and nuisance to a minimum.
- B. WCSD reserves the right to remove any person from the property for the safety and security of the facility

1.2 GENERAL REQUIREMENTS FOR WORK INSIDE THE EXISTING PERIMETER AND EXISTING BUILDINGS

- A. It is a felony to transport any alcoholic beverages, drugs, weapons or ammunition of any kind on WCSD property
- B. Any contact or conversation with students is prohibited.
- C. Smoking is prohibited on all WCSD property.
- D. Working hours inside the existing perimeter and existing building will be coordinated with WCSD.
- E. Storage of materials inside the existing perimeter and buildings will be coordinated with WCSD Facilities Management Department.
- F. Construction operations shall be confined to the areas permitted under the contract. Areas beyond indicated work areas are not to be disturbed. Conform to site rules and regulations affecting the work.
- G. Keep driveways and entrances serving the premises clear and available at all times. Do not use these areas for parking or storage of materials.
- H. Passenger cars, trucks and motorized construction equipment, when parked and unattended, shall be locked and the ignition key removed. Do not leave any such vehicle with the motor running.
- I. Limitations on site usage, as well as specific requirements that impact site utilization are indicated on the drawings and any other contract documents. Allocate available space equitably among sub-contractors needing both access and space so as to produce the best overall efficiency. Schedule deliveries to minimize space and time requirements for storage of materials and equipment.

SECTION 01001 – CONSTRUCTION PROCEDURES FOR EXISTING SCHOOL SITES

J. All refuse will be removed daily.

PART 2 – PRODUCTS (Not Applicable)

PART 3 – EXECUTION (Not Applicable)

END OF SECTION 01001

SECTION 01010 - SUMMARY OF WORK

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all contract documents and addendums associated with this project shall apply to this section.

1.2 PROJECT DESCRIPTION

- A. Project to entail work as described in scope of work.
- B. The project shall consist of all on and off-site improvements, as shown in the contract documents.

1.3 CONTRACTOR USE OF PREMISES

- A. General: During the construction period the Contractor shall have full use of the premises (construction area) for construction operations. The Contractor's use of the premises (construction area) is limited only by the Owner's right to perform construction operations with its own forces or to employ separate contractors on portions of project.
- B. Keep driveways and entrances serving the premises clear and available to the Owner and the Owner's employees at all times. Do not use these areas for parking or storage of materials. Schedule deliveries to minimize space and time requirements for storage of materials and equipment site.

1.4 OWNER OCCUPANCY

- A. Partial Owner Occupancy: The Owner reserves the right to occupy and to place and install equipment in completed areas of the building, prior to substantial completion provided that such occupancy does not interfere with completion of the work. Such placing of equipment and partial occupancy shall not constitute acceptance of the total work.

1.5 OWNER FURNISHED ITEMS

- A. The Owner will provide certain pieces of equipment and accessories that are to be installed and connected by the Contractor.
 - 1. The Owner will arrange and pay for delivery of Owner furnished items in accordance with the Contractor's construction schedule, and will inspect deliveries for damage.
 - 2. If Owner furnished items are damaged, defective or missing, the Owner will arrange for replacement. The Owner will also arrange for manufacturer's field

SECTION 01010 - SUMMARY OF WORK

services and the delivery of manufacturer's warranties and bonds to the Contractor.

3. The Contractor is responsible for designating the delivery dates of Owner furnished items in the Contractor's construction schedule and for receiving, unloading and handling Owner furnished items at the site. The Contractor is responsible for protecting Owner furnished items from damage, including damage from exposure to the elements, and to repair or replace items damaged as a result of the Contractor's operations.
4. Owner furnished and Contractor installed and connected equipment shall be as indicated in the contract documents.

END OF SECTION 01010

SECTION 01015 – SCHEDULE OF DRAWINGS

R0.01	TITLE SHEET
R0.02	SUMMARY OF WORK
R1.01	ROOF PLAN
R1.02	DESIGN DATA AND ATTACHMENT PLAN
R2.01	ATTACHMENT DETAILS
R2.02	SHEET METAL SCHEDULE AND DETAILS
R2.03	DETAILS
R2.04	DETAILS
R2.05	DETAILS
R2.06	DETAILS

SECTION 01020 – PERSONNEL SAFETY CHECK APPLICATION

PART 1 -GENERAL

1.1 RELATED DOCUMENTS

- A. General provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for submittals required for performance of the work for all entities/individuals including, but not limited to, the following:
 - 1. General Contractor
 - 2. Sub-Contractor
 - 3. Sub-Contractor of Sub-Contractor
 - 4. Quality Control Personnel
 - 5. Special Inspection Personnel
 - 6. Security Personnel
 - 7. Consultant Personnel
- B. Administrative Submittals: Refer to other Division 1 sections and other Contract Documents for requirements for administrative submittals.

1.3 SUBMITTAL PROCEDURES

A. Required Submittals

- 1. Each company, engaged on a project, shall report to the Washoe County School District all required certifications for every employee who will be on a Washoe County School District site. This includes all personnel whom the Contractor engages for work on the project site as defined in 1.2 (A). This information must be submitted within twenty-one (21) calendar days prior to commencement of work by the Contractor, and any sub-contractor, regardless of tier. Such submittals required include:
 - a. Certification by Company Regarding Personnel Safety Check Application.

PART 2- PRODUCTS (Not Applicable)

PART 3- EXECUTION (Not Applicable)

SECTION 01020 – PERSONNEL SAFETY CHECK APPLICATION

**CERTIFICATION BY COMPANY REGARDING
PERSONNEL SAFETY CHECK APPLICATION**

Washoe County School District – Capital Improvement Projects

I certify on behalf of the company/firm named below that adequate background check procedures have been or will be performed for all employees that will work on Washoe County School District project _____ (Project Name) regarding _____ (Company/Firm Name) to determine that their employees meet the qualifications required by the Washoe County School District.

With this certification, I confirm that:

- All employees working on a Washoe County School District project shall not have been arrested, convicted, pled guilty, or pled nolo contendere for any offenses related to:
 - Sexual assault or sexual activities with a minor
 - Child abuse
 - Felony drug possession
 - Felony weapons possession
- All employees working on a Washoe County School District project shall not:
 - Have any active Wants/Warrants
 - Is a Registered Sex Offender
 - Is on a Terrorist list.

I understand that the Washoe County School District maintains the right to remove any individuals from the project who do not comply with the above requirements.

I certify the information provided on this application is true, complete, and correct to the best of my knowledge and belief and is provided in good faith. I understand that a knowing and willful false statement on this application can be an automatic disqualification.

I hereby release, discharge, exonerate and hold harmless the Washoe County School District, its agents and representatives and persons furnishing information from any and all liability arising out of the disseminating and inspection of my records.

Company/Firm Name

Name of Executive Officer

Title

Signature

Date

SECTION 01027 – APPLICATIONS FOR PAYMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section specifies administrative and procedural requirements governing the Contractor's Applications for Payment.
- B. Related Sections: The following sections contain requirements that relate to this section.
 - 1. Schedules: The Contractor's Construction Schedule and Submittal Schedule are specified in SECTION 01300 - SUBMITTALS.

1.3 SCHEDULE OF VALUES

- A. Coordination: Coordinate preparation of the Schedule of Values with preparation of the Contractor's Construction Schedule.
 - 1. Correlate line items in the Schedule of Values with other required administrative schedules and forms, including:
 - a. Contractor's Construction Schedule
 - b. Application for Payment forms, including continuation sheets
 - c. List of all tier Sub-Contractors
 - d. List of products
 - e. List of principal suppliers and fabricators
 - f. Schedule of Submittals
 - g. Schedule of Allowances
 - h. Schedule of Alternates
 - 2. Submit the Schedule of Values to the Architect at the earliest possible date but no later than seven (7) calendar days before the date scheduled for submittal of the initial Application for Payment.
 - 3. Sub-schedules: Where Work is separated into phases requiring separately phased payments, provide sub-schedules showing values correlated with each phase of payment.
- B. Format and Content: Use the Project Manual Table of Contents as a guide to establish the format for the Schedule of Values. Provide at least one line item for

SECTION 01027 – APPLICATIONS FOR PAYMENT

each Specification Section by site improvements, by each individual building new or addition construction, and by each individual building remodel or revitalization.

1. Arrange Schedule with subtotals for the following:
 - a. General Conditions
 - b. Fee including overhead, proffit, all insurances
 - c. Site Improvements
 - d. Each individual building new or addition;
 - e. Each individual building remodel or revitalization
2. Identification: Include the following Project identification on the Schedule of Values:
 - a. Project name and location
 - b. Name of the Architect
 - c. Project Number
 - d. Contractor's name and address
 - e. Date of submittal
3. Arrange the Schedule of Values in tabular form with separate columns to indicate the following for each item listed:
 - a. Related Specification Section or Division including general conditions broken down catagorically.
 - b. Description of Work
 - c. Name of Sub-Contractor
 - d. Name of manufacturer or fabricator
 - e. Generic Name of supplier
 - f. Change Orders (numbers) that affect value
 - g. Dollar value
 1. Percentage of Contract Sum to nearest one-hundredth percent, adjusted to total 100 percent.
4. Provide a breakdown of the Contract Sum in sufficient detail to facilitate continued evaluation of Application for Payment and progress reports. Coordinate with the Project Manual Table of Contents. Break principal subcontract amounts down into several line items. Include a line item for Force Accounts and unit price items, as applicable.
5. The total shall equal the Contract Sum.
6. For each part of the work where an Application for Payment may include materials or equipment, purchased or fabricated and stored on or off-site, provide separate line items on the Schedule of Values for cost of those materials.

SECTION 01027 – APPLICATIONS FOR PAYMENT

- a. If the Contractor is requesting payment for materials or equipment that are stored off-site, those materials must be stored in a bonded and insured third party warehouse, and they must be segregated from other stored materials and they shall be identified according to project name, material and/or equipment description, and quantity. These materials must be observed in their stored condition by either the Architect or the Owner's representative prior to approval of the Application for Payment. In lieu of bond for stored materials offsite the contractor/subcontractor may provide an appropriate insurance policy approved by the owner to provide for the full replacement cost coverage for all materials stored. Any coverage for materials or equipment stored off-site shall include Owner as loss payee with respect to its interests. These materials must be observed in their stored condition by either the Architect or the Owner's representatives prior to approval of the Application for Payment.
 - b. All stored material payment requests shall include material supplier invoicing and shall not include labor or delivery costs.
7. Temporary facilities and other major cost items that are not direct cost of actual work-in-place shall be shown as separate line items in the Schedule of Values
- a. General Conditions shall be broken down by major cost items and categories including breakout of labor and material.
 - b. General Conditions performed by subcontract work shall be broken down to individual categories on the schedule of values. No internal changes to subcontracts shall be allowed without formal Change Order Documentation and reflected on the schedule of values.
8. Schedule Updating: Update and resubmit the Schedule of Values prior to the next Application for Payment when Change Orders or Construction Change Directives result in a change in the Contract Sum.

1.4 APPLICATIONS FOR PAYMENT

- A. Each Application for Payment shall be consistent with previous applications and payments as certified by the Architect and Owner's representative and paid for by the Owner.
 1. The initial Application for Payment, the Application for Payment at time of Substantial Completion, and the final Application for Payment involve additional requirements
- C. Each application for payment shall include sufficient documentation to substantiate completed work including but not limited to: subcontractor invoicing, all tiers; general conditions cost breakdown, etc.

SECTION 01027 – APPLICATIONS FOR PAYMENT

- C. Payment Application Times: The date for each progress payment is as indicated in the Contract. The period covered by each Application for Payment is the period indicated in the Contract.
- D. Payment Application Forms: Use Washoe County School District Certificate for Payment form only. This form is available in both hard copy format or electronic format.
- E. Application Preparation: Complete every entry on the form. The execution of this form shall be by a person authorized to sign legal documents on behalf of the Contractor. The Owner will return incomplete applications without action.
 - 1. Entries shall match data on the Schedule of Values and the Contractor's Construction Schedule. Use updated schedules if revisions were made.
 - 2. Include amounts of Change Orders and Construction Change Directives issued prior to the last day of the construction period covered by the application.
- F. Pre-Approval of Application: Percentages of completed work are to be verified by the Owner's Representative and Architect prior to transmittal to the Architect.
 - 1. It shall be established at the Pre-Construction meeting the protocols that are acceptable to each party for the review of payment application percentages.
- G. Record Drawings and Record Specifications: Prior to transmittal of the Application for Payment, Record Drawings and Record Specifications must be reviewed and approved by the Owner's Representative and Architect.
 - 1. It shall be established at the Pre-Construction meeting the protocols that are acceptable to each party for the review of Record Drawings and Specifications.
- H. Transmittal: Submit one (1) signed original copy of each Application for Payment to the Architect by a method ensuring receipt within twenty-four (24) hours. The submitted copy shall be complete, including waivers of lien and similar attachments, when required.
 - 1. Transmit each copy with a transmittal form listing attachments and recording appropriate information related to the application, in a manner acceptable to the Architect.
 - 2. Obtain Owner's Representative's initials as established during the Pre-Construction meeting and in sub-section 1.4, items E & F above.
- I. Waivers of Mechanic's Lien: With each Application for Payment, submit conditional waivers of mechanic's lien from every entity who is lawfully entitled to file a

SECTION 01027 – APPLICATIONS FOR PAYMENT

mechanic's lien arising out of the Contract and related to the work covered by the payment.

1. Waiver Forms: Submit waivers of lien on forms, and executed in a manner, acceptable to the Owner.
- J. Initial Application for Payment: Administrative actions and submittals, that must precede or coincide with submittal of the first Application for Payment, include the following:
1. List of Sub-Contractors (all tiers)
 2. List of principal suppliers and fabricators
 3. Schedule of Values
 4. Contractor's Construction Schedule
 5. Schedule of principal products
 6. Submittal Schedule
 7. List of Contractor's staff assignments
 8. List of Contractor's principal consultants
 9. Copies of Building Permits
 10. Copies of authorizations and licenses from governing authorities for performance of the work
 11. Initial Progress Report
 12. Report of Pre-Construction meeting
 13. Data needed to acquire the Owner's insurance
 14. Initial settlement survey and damage report, if required, (existing facility condition)
 15. Record Drawings *
 16. Record Specifications*

* Record Drawings and Specifications must be reviewed and approved by the Owner's Representative prior to the Application for Payment.

SECTION 01027 – APPLICATIONS FOR PAYMENT

K. Continuing Application for Payments: Administrative actions and submittals, that must precede or coincide with submittal of the Application for Payment, include the following:

1. Updated Contractor's Construction Schedule
2. Progress report
3. Record Drawings*
4. Record Specifications*

*Record Drawings and Specifications must be reviewed and approved by the Owner's Representative prior to the Application for Payment.

L. Application for Payment at Substantial Completion: Following issuance of the Certificate of Substantial Completion, submit an Application for Payment.

1. This application shall reflect Certificates of Partial Substantial Completion issued previously for Owner occupancy of designated portions of the work.
2. Administrative actions and submittals that shall precede or coincide with this application include:
 - a. Occupancy permits and similar approvals
 - b. Changeover information related to Owner's occupancy, use, operation, and maintenance
 - c. Final cleaning
 - d. Application for reduction of retainage and consent of surety
 - e. Advice on shifting insurance coverages
 - f. List of incomplete work, recognized as exceptions to Architect's Certificate of Substantial Completion
 - g. Record Drawings*
 - h. Record Specifications*
 - i. Meter Readings
 - j. Change of door locks to Owner's access

*Record Drawings and Specifications must be reviewed and approved by the Owner's Representative prior to the Application for Payment.

M. Final Payment Application: Administrative actions and submittals that must precede or coincide with submittal of the final Application for Payment include the following:

1. Completion of project closeout requirements
2. Completion of items specified for completion after Substantial Completion

SECTION 01027 – APPLICATIONS FOR PAYMENT

3. Ensure that unsettled claims will be settled
4. Ensure that incomplete work is not accepted and will be completed without undue delay
5. Completion and final reporting of all prevailing wage and apprentice utilization including unsettled prevailing wage and apprentice utilization claims
6. Transmittal of required project construction records to the Owner
7. Proof that taxes, fees, and similar obligations were paid
8. Removal of temporary facilities and services
9. Removal of surplus materials, rubbish, and similar elements
10. Certified property survey
11. Warranties (Guarantees) and Maintenance Agreements
12. Test/adjust/balance records
13. Operation and Maintenance Manuals
14. Startup performance reports
15. Final progress photographs

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 01027

SECTION 01035 - MODIFICATION PROCEDURES

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section specifies administrative and procedural requirements for handling and processing contract modifications.
- B. Related Sections: The following sections contain requirements that relate to this Section:
 - 1. Division 1 SECTION 01300 – SUBMITTALS for requirements for the Contractor's Construction Schedule.
 - 2. Division 1 SECTION 01027 – APPLICATIONS FOR PAYMENT for administrative procedures governing Applications for Payment.
 - 3. Division 1 SECTION 01631 – SUBSTITUTIONS for administrative procedures for handling requests for substitutions made after award of the Contract.

1.3 MINOR CHANGES IN THE WORK

- A. The Architect will issue supplemental instructions authorizing minor changes in the work, not involving adjustment to the contract sum or contract time, as an Architect's Supplemental Instruction.

1.4 CHANGE ORDER PROPOSAL REQUESTS

- A. Owner-Initiated Proposal Requests: The Architect will issue a detailed description of proposed changes in the work that will require adjustment to the contract sum or contract time. If necessary, the description will include supplemental or revised drawings and specifications.
 - 1. Proposal requests issued by the Architect are for information only. Do not consider them as an instruction either to stop work in progress or to execute the proposed change.
 - 2. Within fourteen (14) working days of receipt of a proposal request, submit an estimate of cost necessary to execute the change to the Architect for the Owner's review.

SECTION 01035 - MODIFICATION PROCEDURES

- a. Include a list of quantities of products required and unit costs, with the total amount of purchases to be made. Where requested, furnish survey data to substantiate quantities.
 - b. Indicate applicable taxes, delivery charges, equipment rental and amounts of trade discounts.
 - c. Include a statement indicating the effect the proposed change in the work will have on the contract time.
 - d. Include all subcontractor and contractor overhead and profit per contract documents.
- B. Contractor-Initiated Proposals: When latent or unforeseen conditions require modifications to the Contract, the Contractor may propose changes by submitting a request for a change to the Architect.
1. Include a statement outlining the reasons for the change and the effect of the change on the work. Provide a complete description of the proposed change. Indicate the effect of the proposed change on the contract sum and contract time.
 2. Include a list of quantities of products required and unit costs, with the total amount of purchases to be made. Where requested, furnish survey data to substantiate quantities.
 3. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
 4. Comply with requirements in SECTION 01631 – SUBSTITUTIONS if the proposed change requires substitution of one product or system for a product or system specified.
 5. Include a list of all associated cost that would be incurred, including subcontractor and contractor overhead and profit per contract documents.
- C. The Contractor shall prepare his response in accordance with the requirements set forth in the General Conditions.
- D. Proposal Request Form: Use AIA Document G709-2001 for Change Order Proposal Requests or Change Order Request Form (CP-F107).

1.5 CONSTRUCTION CHANGE DIRECTIVE

- A. Construction Change Directive: When the Owner and the Contractor disagree on the terms of a Proposal Request, the Owner and Architect may issue a Construction

SECTION 01035 - MODIFICATION PROCEDURES

Change Directive. The Construction Change Directive instructs the Contractor to proceed with a change in the work, for subsequent inclusion in a Change Order. The Construction Change Directive will be approved upon email confirmation from the Owner.

1. The Construction Change Directive contains a complete description of the change in the work. It also designates the method to be followed to determine change in the contract sum or contract time.
- B. Documentation: Maintain detailed records on a time and material basis of work required by the Construction Change Directive.
 1. After completion of the change, submit an itemized account and supporting data necessary to substantiate cost and time adjustments to the Contract.
- C. Notification: Contractor shall notify Owner prior to any "Not to Exceed" items being over run. Additional Construction Change Directive may be required for over run work.

1.6 CHANGE ORDER PROCEDURES

- A. Upon the Owner's approval of a Proposal Request, the Architect will issue a Change Order for signatures of the Owner and the Contractor on AIA Form G701-2000/2001 or WCSD's Change Order Form (CP-F107).

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 01035

SECTION 01035 - MODIFICATION PROCEDURES

ARCHITECT / OWNER
SAMPLE PRICE REQUEST

Date: _____ Price Request # _____

Contractor: _____

Bid/Quote #: _____

Project: _____

Please submit a Price Quotation for the following changes being considered. Quote the change within fourteen (14) calendar days - ADD or DEDUCT - in the Contract Sum and any change in the Contract Time. Also, please state how long the price quoted is effective before job conditions warrant an increase in price. This is NOT authorization to proceed with this work.

REFERENCE: _____

CHANGE: _____

REQUESTED BY: _____

REASON: _____

SECTION 01035 - MODIFICATION PROCEDURES

CONTRACTOR / OWNER
SAMPLE CHANGE ORDER REQUEST

Date: _____ Price Request # _____

Contractor: _____

Bid/Quote #: _____

Project: _____

Please submit a Price Quotation for the following changes being considered. Quote the change within five (14) calendar days - ADD or DEDUCT - in the Contract Sum and any change in the Contract Time. Also, please state how long the price quoted is effective before job conditions warrant an increase in price. This is NOT authorization to proceed with this work.

REFERENCE: _____

CHANGE: _____

REQUESTED BY: _____

REASON: _____

SECTION 01035 - MODIFICATION PROCEDURES

SAMPLE CLARIFICATION

DATE: _____

TO: _____

FROM: _____

SUBJECT: _____

REFERENCE: _____

CLARIFICATION: _____

THIS INFORMATION IS PROVIDED FOR CLARIFICATION ONLY AND DOES NOT INVOLVE ANY CHANGE IN CONTRACT PRICE OR TIME.

SIGNATURE: _____

TITLE: _____

DATE: _____ CLAR. NO.: _____

SECTION 01035 - MODIFICATION PROCEDURES

SAMPLE REQUEST FOR INFORMATION

DATE: _____

TO: _____

FROM: _____

SUBJECT: _____

REFERENCE:

Specification Section: _____ Paragraph: _____

Drawing Number: _____ Details: _____

INFORMATION REQUIRED: _____

SIGNATURE: _____

TITLE: _____

DATE: _____

REPLY TO ABOVE RFI: _____

THIS INFORMATION IS PROVIDED FOR CLARIFICATION ONLY AND DOES NOT INVOLVE ANY CHANGE IN CONTRACT PRICE OR TIME.

SIGNATURE: _____

TITLE: _____

DATE: _____ CLAR. NO.: _____

SECTION 01040 – COORDINATION

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and supervisory requirements necessary for coordinating construction operations including, but not necessarily limited to, the following:
 - 1. General project coordination procedures
 - 2. Conservation
 - 3. Coordination Drawings
 - 4. Administrative and supervisory personnel
 - 5. Cleaning and protection
- B. Related Sections: The following sections contain requirements that relate to this Section:
 - 1. Division 1 Section 01050 – FIELD ENGINEERING specifies procedures for field engineering services, including establishment of benchmarks and control points.
 - 2. Division 1 Section 01200 – PROJECT MEETING for progress meetings, coordination meetings, and pre-installation conferences.
 - 3. Division 1 Section 01300 – SUBMITTALS for preparing and submitting the Contractor's construction schedule.
 - 4. Division 1 Section 01600 – MATERIALS AND EQUIPMENT for coordinating general installation.
 - 5. Division 1 Section 01700 – CONTRACT CLOSEOUT for coordinating contract closeout.

1.3 COORDINATION

- A. Coordinate construction operations included in various sections of these Specifications to assure efficient and orderly installation of each part of the work.

SECTION 01040 – COORDINATION

Coordinate construction operations included under different sections that depend on each other for proper installation, connection, and operation.

1. Schedule construction operations in the sequence required to obtain the best results where installation of one part of the work depends on installation of other components, before or after its own installation.
 2. Coordinate installation of different components to assure maximum accessibility for required maintenance, service, and repair.
 3. Make provisions to accommodate items scheduled for later installation.
- B. Where necessary, prepare memoranda for distribution to each party involved, outlining special procedures required for coordination, include such items as required notices, reports, and attendance at meetings.
1. Prepare similar memoranda for the Owner and separate contractors where coordination of their work is required.
- C. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities to avoid conflicts and assure orderly progress of the work. Such administrative activities include, but are not limited to, the following:
1. Preparation of schedules
 2. Installation and removal of temporary facilities
 3. Delivery and processing of submittals
 4. Progress meetings
 5. Project closeout activities
- D. Conservation: Coordinate construction operations to assure that operations are carried out with consideration given to conservation of energy, water, and materials.
1. Salvage materials and equipment involved in performance of, but not actually incorporated in, the work.
- E. Coordinate the installation of all motor starters. General Contractor is responsible for costs associated with supplying and installing all required motor starters.

SECTION 01040 – COORDINATION

- F. Dimensions: The Structural drawings are to be used in conjunction with the Architectural, Mechanical and Electrical drawings. Primary structural elements are dimensioned on the structural plans and details. Not all secondary dimensions are shown, such as exact door and window locations, wall configurations, slab slopes, depressions, curbs, etc. Coordination of the structure of the dimensions as shown on the drawings and architectural items to be embedded into, or attached to the structure, is the responsibility of the Contractor. Any dimensions discrepancies between the Architectural, Civil Structural, Mechanical and Electrical drawings shall be reported to the Owner's Representative and Architect before proceeding with the work.
- G. Intent of Drawings:
1. The work of the Contractor and subcontractor shall conform to the intent of the architectural and coordination drawings as reviewed by the Architect. Drawings are partly diagrammatic and do not intend to show in details all features of work. The Contractor shall carefully review the work to be performed by other trades, compare related drawings and shall thoroughly understand the building conditions affecting their work.
 2. All changes required in the work caused by failure to do so shall be at no expense to the Owner.
- H. Interfaces and Right-of-Way:
1. Make proper provisions to avoid interfaces.
 2. Where conflicts occur, architectural and structural has right-of-way over mechanical and electrical work; concealed mechanical work has right-of-way over concealed electrical work; exposed electrical fixtures have right-of-way over mechanical fixtures.
 3. Submit conflicts which cannot be resolved by right-of-way to the Owner for direction.
 4. Submit reflected ceiling coordination plans showing work by all applicable trades for review and approval by the Architect.
- I. Masonry Wall Coordination Drawings:
1. Contractor shall be responsible for providing masonry wall coordination drawings for all concrete masonry unit walls. Drawings shall consist of wall elevations drawn to scale at not less than $\frac{1}{4}" = 1'0"$.
 2. Wall elevations shall include dimensioned sizes and locations for all door, window and mechanical openings and penetrations, beam and joist

SECTION 01040 – COORDINATION

bearing pockets, ledger angles, embedded plate connections, and anchor bolts. All miscellaneous steel to be embedded in the masonry unit wall shall be referenced by show drawing mark number or structural detail number.

3. Masonry wall coordination drawings shall be reviewed and approved by interfacing trades prior to submittal to the Architect. Shop drawings for masonry reinforcement shall be an 'overlay' of the masonry wall coordination drawings. Detail, fabricate and place per ACI 315. Reinforcing shop drawings elevations shall show all vertical and horizontal reinforcing layouts; special reinforcement at lintels and jams at doors, windows, mechanical openings and as called out on Structural drawings.

1.4 SUBMITTALS

- A. Coordination Drawings: Prepare coordination drawings where careful coordination is needed for installation of products and materials fabricated by separate entities. Prepare coordination drawings where limited space availability necessitates maximum utilization of space of efficient installation of different components.
 1. Show the relationship of components shown on separate Shop drawings.
 2. Indicate required installation sequences.
 3. Comply with requirements contained in Section 01300 - SUBMITTALS.
- B. Staff Names: Within 15 days of commencement of construction operations, submit a list of the Contractor's principal staff assignments, including the Superintendent and other personnel in attendance at the project site. Identify individuals and their duties and responsibilities. List their addresses and telephone numbers.
 1. Post copies of the list in the Project Meeting Room, the temporary field office and each temporary telephone.

PART 2 – PRODUCTS (Not Applicable)

PART 3 – EXECUTION

3.1 GENERAL COORDINATION PROVISIONS

- A. Inspection of Conditions: Require the Installer of each major component to inspect both the substrate and conditions under which work is to be performed. Do not proceed until unsatisfactory conditions have been corrected in an acceptable manner.

SECTION 01040 – COORDINATION

- B. Coordinate temporary enclosures with required inspections and tests to minimize the necessity of uncovering completed construction for that purpose.

3.2 CLEANING AND PROTECTION

- A. Clean and protect construction in progress and adjoining materials in place, during handling and installation. Apply protective covering where required to assure protection from damage or deterioration at Substantial Completion.
- B. Clean and provide maintenance on completed construction as frequently as necessary through the remainder of the construction period. Adjust and lubricate operable components to assure operability without damaging effects.
- C. Limiting Exposures: Supervise construction operations to assure that no part of the construction completed or in progress, is subject to harmful, dangerous, damaging, or otherwise deleterious exposure during the construction period. Where applicable, such exposures include, but are not limited to, the following:
 - 1. Excessive static or dynamic loading
 - 2. Excessive internal or external pressures
 - 3. Excessively high or low temperatures
 - 4. Thermal shock
 - 5. Excessively high or low humidity
 - 6. Air contamination or pollution
 - 7. Water or ice
 - 8. Solvents
 - 9. Chemicals
 - 10. Light
 - 11. Radiation
 - 12. Puncture
 - 13. Abrasion
 - 14. Heavy traffic
 - 15. Soiling, staining and corrosion
 - 16. Bacteria
 - 17. Rodent and insect infestation
 - 18. Combustion
 - 19. Electrical current
 - 20. High-speed operation
 - 21. Improper lubrication
 - 22. Unusual wear or other misuse
 - 23. Contact between incompatible materials
 - 24. Destructive testing
 - 25. Misalignment
 - 26. Excessive weathering
 - 27. Unprotected storage

SECTION 01040 – COORDINATION

- 28. Improper shipping or handling
- 29. Theft
- 30. Vandalism

END OF SECTION 01040

SECTION 01041 – PROJECT MANAGEMENT SOFTWARE

1. SUMMARY

- a. Web based construction project management collaboration software to submit, track, distribute and collaborate on project documentation and action items.
- b. The intent of utilizing a web-based construction management application is to reduce cost and schedule risk, improve quality and safety, and maintain a healthy team dynamic by improving information flow, reducing non-productive activities, reducing rework and decreasing turnaround times.
- c. WCSD to work with Contractor to ensure directory for project is current and to be responsible for establishing and managing necessary permissions for users through duration of project.
- d. WCSD will hold a kickoff meeting with the Contractor and applicable consultants at the beginning of the project to discuss how the software will be used, routing & naming protocols, permissions & restrictions, roles & responsibilities, etc.

2. SOFTWARE CAPABILITIES (including but not limited to)

- a. Daily Log
 - i. Provides daily log entry from web and mobile with automatic capture of daily weather conditions.
 - ii. Provides ability to attach photographs to entries directly from mobile.
 - iii. Provides reporting capabilities to easily report on man-hours and activities for a certain time frame and contractor.
- b. Dashboards
 - i. Provides a dashboard that shows the status of all currently assigned items with drill down capability to see the subject, assignee and due date of each item.
- c. Deficiency Tracking
 - i. Provides a means for recording, assigning and confirming completion of any deficiency or observation noted during the course of construction.
- d. Directory
 - i. Provides a directory of all team member's contact information that is accessible from web and mobile.
- e. Documents
 - i. Provides a storage location for miscellaneous project documents with the ability to have a folder hierarchy and privacy settings on folders.

SECTION 01041 – PROJECT MANAGEMENT SOFTWARE

- ii. No storage limit.
 - iii. Provides download tracking.
- f. Drawings
 - i. Provides access to a system maintained current set of drawings on web and mobile, with access to all previous revisions as well.
 - ii. Provides automatic hyperlinking capability for detail callouts.
 - iii. Provides drawing markup capabilities on web and mobile.
 - iv. Provides ability to link RFIs, Submittals, Punchlist Items, Photos and Project Documents to the drawings.
 - v. Drawing Markups can be carried forward when new revisions are uploaded.
 - vi. Markups and linked documentation are able to be public or private.
- g. Financial Management
 - i. Provides ability to manage contracts, payment applications and change orders.
 - ii. Provides ability to view contracts and change orders from web and mobile.
- h. Inspections
 - i. Provides ability to create inspections from web and mobile.
 - ii. Provides ability to create a deficiency item from an inspection that can be assigned and tracked to completion.
- i. Meetings
 - i. Provides ability to create, edit and view meeting minutes from web and mobile.
 - ii. Provides ability to create action items with assignees and due dates from a meeting item.
- j. Mobile Accessibility
 - i. Provide native mobile applications for iOS and Android phones at a minimum that provide access to relevant project documentation, including as-built versions of Drawings and Specifications, even when there is no internet access.
- k. Photos
 - i. Provides ability to upload and view photos from web and mobile.
 - ii. Provides ability to markup photos from mobile to clarify anything important in the photo.
 - iii. Provides ability to link photos to specific locations on drawings.
- l. Punchlist
 - i. Provides ability to create punchlist items from web and mobile and link them to specific locations on the drawings.

SECTION 01041 – PROJECT MANAGEMENT SOFTWARE

- ii. Provides ability to distribute punchlist items to all contractors, for contractors to mark them as resolved with photographic proof of resolution via mobile, and for the items to be marked as complete via mobile or web.
- m. Requests for Information (RFIs)
 - i. Provides ability to create RFIs with assignees, due dates and attachments.
 - ii. Provides ability for assignees to respond to RFIs both via the software and by responding to the system generated email.
 - iii. Provides an auto-generated log of all RFIs.
- n. Schedule
 - i. Provides ability to display schedules from typical scheduling software.
- o. Specifications
 - i. Provides ability to upload project specifications and manage them at the individual specification level.
 - ii. Provides ability to view and search specifications on web and mobile.
 - iii. Provides ability to upload revisions to individual specifications and maintain all revision history.
 - iv. Provides an auto-generated current specification log that provides access to the current version of each specification.
 - v. Provides ability to link specifications to submittals and view the specification from the submittal.
- p. Submittals
 - i. Provides ability to upload a submittal register of all expected submittals.
 - ii. Provides ability to create multi-step approval workflows for submittals, with reminder notifications for the current assignee.
 - iii. Provides the ability to upload any file type without size restrictions.
 - iv. Provides an auto-generated submittal log.

3. TECHNOLOGY

- a. Fully web based with mobile apps for Windows, iOS and Android phones.
- b. Accessible without logging in through a virtual private network (VPN).
- c. Works on the current version of Internet Explorer, Google Chrome, Mozilla firefox and Apple Safari browsers.
- d. Can generate emails automatically, and all attachments are included in the emails via download links to avoid emails not being delivered due to size.

SECTION 01041 – PROJECT MANAGEMENT SOFTWARE

- e. PDF output of forms such as RFIs, Submittals, Meetings, Change Orders, etc. are available and customizable.

4. TRAINING AND SUPPORT

- a. Procore has learning portal certifications and support available online.

5. PROCEDURES

- a. RFIs and Submittals
 - i. The Contractor will be responsible for submitting all RFIs and Submittals through the software and assigning them to the appropriate parties.
 - ii. WCSD / Architects / Engineers / Consultants etc. are responsible for posting all responses to these items via the software, including all relevant attachments.
 - iii. The Contractor will distribute responses to all affected subcontractors and confirm agreement with the response by closing the item.
- b. Construction Documentation
 - i. The Contractor will manage Drawings, Specifications and Documents in the software to ensure that the current version of all applicable construction documentation is available to the entire team via web and mobile.
 - ii. The Contractor will ensure that all RFIs which modify the current drawings are posted to the drawings and available via web and mobile within 24 hours of the RFI being responded to.
- c. Contractor will record and distribute action items via the software.
- d. Contractor will take daily site photos and make them publicly available.
- e. Punchlist
 - i. All punch list items will be managed through the software.
 - ii. Punchlist items will be created by the Contractor while walking with the Owner and applicable consultants.

6. PRICING

- a. The cost of Procore Technologies services (software fee) has been paid in full by WCSD, but the contractor's bid shall include any costs the Contractor deems necessary to execute the use of Procore as identified above.

END OF SECTION 01041

SECTION 01045 - CUTTING AND PATCHING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all contract documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for cutting and patching.
- B. Related Sections: The following sections contain requirements that relate to this section:
 - 1. Division 1 SECTION 01040 - COORDINATION for procedures for coordinating cutting and patching with other construction activities.
 - 2. Division 2 SELECTIVE DEMOLITION for demolition of selected portions of the building for alterations.
 - 3. Refer to other sections for specific requirements and limitations applicable to cutting and patching individual parts of the work.
 - a. Requirements of this section apply to mechanical and electrical installations. Refer to Division 15 and 16 sections for other requirements and limitations applicable to cutting and patching mechanical and electrical installations.

1.3 SUBMITTALS

- A. Cutting and Patching Proposal: Submit a proposal describing procedures well in advance of the time cutting and patching will be performed if the Owner requires approval of these procedures before proceeding. Request approval to proceed. Include the following information, as applicable, in the proposal:
 - 1. Describe the extent of cutting and patching required. Show how it will be performed and indicate why it cannot be avoided.
 - 2. Describe anticipated results in terms of changes to existing construction. Include changes to structural elements and operating components as well as changes in the building's appearance and other significant visual elements.
 - 3. List products to be used and firms or entities that will perform work.

SECTION 01045 - CUTTING AND PATCHING

4. Indicate dates when cutting and patching will be performed.
5. Utilities: List utilities that cutting and patching procedures will disturb or affect. List utilities that will be relocated and those that will be temporarily out-of-service. Indicate how long service will be disrupted.
6. Approval by the Architect to proceed with cutting and patching does not waive the Architect's right to later require complete removal and replacement of unsatisfactory work.

1.4 QUALITY ASSURANCE

- A. Requirements for Structural Work: Do not cut and patch structural elements in a manner that would change their load-carrying capacity or load-deflection ratio.
 1. Obtain approval of the cutting and patching proposal before cutting and patching the following structural elements:
 - a. Foundation construction
 - b. Bearing and retaining walls
 - c. Structural steel
 - d. Lintels
 - e. Miscellaneous structural metals
 - f. Piping, ductwork, vessels, and equipment
- B. Operational Limitations: Do not cut and patch operating elements or related components in a manner that would result in reducing their capacity to perform as intended. Do not cut and patch operating elements or related components in a manner that would result in increased maintenance or decreased operational life or safety.
 1. Obtain approval of the cutting and patching proposal before cutting and patching the following operating elements or safety related systems:
 - a. Primary operational systems and equipment
 - b. Air or smoke barriers
 - c. Water, moisture or vapor barriers
 - d. Membranes and flashings
 - e. Fire protection systems
 - f. Noise and vibration control elements and systems
 - g. Control systems
 - h. Communication systems
 - i. Electrical wiring systems
 - j. Operating systems of special construction in Division 13 sections

SECTION 01045 - CUTTING AND PATCHING

- C. Visual Requirements: Do not cut and patch construction exposed on the exterior or in occupied spaces in a manner that would, in the Architect's opinion, reduce the building's aesthetic qualities. Do not cut and patch construction in a manner that would result in visual evidence of cutting and patching. Remove and replace construction cut and patched in a visually unsatisfactory manner.
 - 1. If possible, retain the original installer or fabricator to cut and patch the exposed work. If it is impossible to engage the original installer or fabricator, engage another recognized experienced and specialized firm.

1.5 WARRANTY

- A. Existing Warranties: Replace, patch and repair material and surfaces cut or damaged by methods and with materials in such a manner as not to void any warranties, required or existing.

PART 2 - PRODUCTS

2.1 MATERIALS, GENERAL

- A. Use materials identical to existing materials. For exposed surfaces, use materials that visually match existing adjacent surfaces to the fullest extent possible if identical materials are unavailable or cannot be used. Use materials whose installed performance will equal or surpass that of existing materials.

PART 3 - EXECUTION

3.1 INSPECTION

- A. Examine surfaces to be cut and patched and conditions under which cutting and patching is to be performed before cutting. If unsafe or unsatisfactory conditions are encountered, take corrective action before proceeding.
 - 1. Before proceeding, meet at the Project Site with parties involved in cutting and patching, including mechanical and electrical trades. Review areas of potential interference and conflict. Coordinate procedures and resolve potential conflicts before proceeding.

3.2 PREPARATION

- A. Temporary Support: Provide temporary support of work to be cut.
- B. Protection: Protect existing construction during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of the Project that might be exposed during cutting and patching operations.

SECTION 01045 - CUTTING AND PATCHING

- C. Avoid interference with use of adjoining areas or interruption of free passage to adjoining areas.
- D. Avoid cutting existing pipe, conduit, or ductwork serving the building but scheduled to be removed or relocated until provisions have been made to bypass them.

3.3 PERFORMANCE

- A. General: Employ skilled workers to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time and complete without delay.
 - 1. Cut existing construction to provide for installation of other components or performance of other construction activities and the subsequent fitting and patching required to restore surfaces to their original condition.
- B. Cutting: Cut existing construction using methods least likely to damage elements retained or adjoining construction. Where possible, review proposed procedures with the original installer; comply with the original installer's recommendations.
 - 1. In general, where cutting, use hand or small power tools designed for sawing or grinding, not hammering and chopping. Cut holes and slots as small as possible, neatly to size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 - 2. To avoid marring existing finished surfaces, cut or drill from the exposed or finished side into concealed surfaces.
 - 3. Cut through concrete and masonry using a cutting machine, such as a carborundum saw or a diamond-core drill.
 - 4. Comply with requirements of applicable Division 2 sections where cutting and patching requires excavating and backfilling.
 - 5. Where services are required to be removed, relocated or abandoned, bypass utility services, such as pipe or conduit, before cutting. Cut-off pipe or conduit in walls or partitions to be removed. Cap, valve or plug and seal the remaining portion of pipe or conduit to prevent entrance of moisture or other foreign matter after bypassing and cutting.
- C. Patching: Patch with durable seams that are as invisible as possible. Comply with specified tolerances.
 - 1. Where feasible, inspect and test patched areas to demonstrate integrity of the installation.

SECTION 01045 - CUTTING AND PATCHING

2. Restore exposed finishes of patched areas and extend finish restoration into retained adjoining construction in a manner that will eliminate evidence of patching and refinishing.
3. Where removing walls or partitions extends one finished area into another, patch and repair floor and wall surfaces in the new space. Provide an even surface of uniform color and appearance. Remove existing floor and wall coverings and replace with new materials, if necessary, to achieve uniform color and appearance.
 - a. Where patching occurs in a smooth painted surface, extend final paint coat over entire unbroken surface containing the patch after the area has received primer and second coat.
4. Patch, repair or rehang existing ceilings as necessary to provide an even plane surface of uniform appearance.

3.4 CLEANING

- A. Clean areas and spaces where cutting and patching are performed. Completely remove paint, mortar, oils, putty and similar items. Thoroughly clean piping, conduit and similar features before applying paint or other finishing materials. Restore damaged pipe covering to its original condition.

END OF SECTION 01045

SECTION 01110 – PREVAILING WAGE AND APPRENTICESHIP UTILIZATION SPECIFICATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents, addendums and all NRS 338 Prevailing Wage and Apprenticeship Utilization Act requirements associated with this project shall apply to this section. Various forms and information can be found on the Office of the Labor Commissioner's website <https://labor.nv.gov/>

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for submittals required for performance of the work, including the following:
 - 1. Contractor/Subcontractor Notification
 - 2. Completion Notification
 - 3. Weekly Wage and Hour Report of Public Works Contractors.
 - 4. Weekly Wage and Hour Report submittal log.
 - 5. Certification of bidder regarding penalties for noncompliance
 - 6. Certification of bidder, proposed contractor or subcontractor regarding debarment, suspension, ineligibility of voluntary exclusion.
- B. Related Sections: The following section(s) may contain requirements that relate to this section if included:
 - 1. SECTION - 01027 APPLICATIONS FOR PAYMENT
 - 2. SECTION – 01300 SUBMITTALS

1.3 SUBMITTAL PROCEDURES

- A. Compensation:

1. No extension of contract time, overhead, or profit will be authorized because of failure to transmit any required submittals or payroll report submittals to the Owner sufficiently in advance of progress payment submittals.
2. No extension of contract time will be authorized because of failure to transmit or report of any forms.

B. Required Submittals

1. CONTRACTOR/SUBCONTRACTOR NOTIFICATION

- a. The Apparent Low Bidder is requested to submit the information on the Comprehensive Contractor/Subcontractor List for the Prime Bidder and all named (used) Subcontractors whom they engage for work within two (2) business days after Recommendation of Award, which will be supplied by the Purchasing Department.
- b. It shall be the Contractor's responsibility to comply and submit any required forms directly to the Office of the Labor Commissioner's as required by NRS 338.

2. COMPLETION NOTIFICATION

The contractor shall notify Washoe County School District when completion of all work performed under the contract is complete.

3. WEEKLY WAGE AND HOUR REPORTING OF PUBLIC WORKS CONTRACTORS

- a. The contractor and all subcontractors are required to submit Certified Weekly Wage and Hour Reports of Public Work Contractors for each weekly payroll to Washoe County School District through the use of LCP Tracker, a paperless online system for filling certified payroll. The first weekly report will begin on the Notice to Proceed date and conclude on the following Saturday. If the Notice to Proceed date falls on a Saturday, the first report will only include reporting for that day. All successive reports will begin on the following Sunday and conclude on the following Saturday. All subcontractor report numbers shall coincide with the General Contractors report numbers. If the contractor or subcontractors do not work during any weekly reporting period they still must submit a report

indicating no public work project hours were performed for that weekly period. When contract scope of work is completed including punch list work, the last report is to be clearly marked "FINAL REPORT."

- b. Weekly Wage and Hour Report of Public Works Contractors and Weekly Wage and Hour Report submittal log must be submitted into Washoe County School District LCP Tracker system within fifteen (15) calendar days following the end of the month being reported.
- c. The Prime contractor is required to designate an individual as Prime Approver for the project. The Prime Approver will oversee the reporting for all subcontractors of all tiers on the project. WCSD will set up the Prime Approver Account for the project. Thereafter, the Prime Approver will have the responsibility to use the Account to approve all payroll on the project.
- d. The prime contractor is required to assign subcontractors within the LCP Tracker system to the project and to ensure that all subcontractors are aware of the necessity to file payrolls electronically, are set up within the system and all required payrolls are filed by subcontractors of all tiers.

1.4 OWNER'S ACTION

- A. The owner will review each submittal, mark to indicate action taken, and provide review and acceptance.
 - 1. Compliance with submittal requirements is the Contractor's responsibility.

1.5 POSTINGS/SIGNAGE

- A. Each contractor engaged on a public work must post the applicable prevailing rate of wages for the project on the site of the public work in a generally visible place to workmen.
- B. Each contractor engaged in a public work must provide a sign with a white background and 6" black lettering stating, "Posted prevailing wages apply to this public works project". This sign must be posted on the site of the public work in a generally visible place to workmen. This will be maintained by the Contractor throughout the construction phase from the Notice to Proceed date through completion of the project.

PART 2 – PRODUCTS (Not Applicable)

PART 3 – EXECUTION (Not Applicable)

END OF SECTION 01110

WASHOE COUNTY SCHOOL DISTRICT

WEEKLY WAGE AND HOUR REPORT SUBMITTAL LOG

Report Number	Contractor	Week Ending Date	Date Submitted

--	--	--	--



WEEKLY WAGE AND HOUR REPORT OF PUBLIC WORK CONTRACTORS FOR THE PAYROLL PERIOD ENDING

Month and Day Year

Pursuant to Chapter 338 of NRS and NAC, respectively, the contractor and each subcontractor shall keep or cause to be kept an accurate record showing the name and the actual per diem, wages and benefits paid to each workman employed by him in connection with the public work. The contractor or subcontractor shall ensure that a copy of the record for each calendar month is received by the public body awarding the contract no later than 15 days after the end of the month.

Report # ☐ Regular Weekly Report ☐ Final Report Bid/Project # PWP-

Project Title Public Body Awarding Contract **Washoe County School District**

Prime Contractor Name & Address License #

Subcontractor Name & Address License #

Employee Name & State/Jurisdiction that Issued Identification	Work Classification	Hours Worked By Day								Total Hours For Week	Hourly Rate Of Pay including fringe	Hourly Fringe Benefit Contribution					Gross Amount Earned For Week	Net Wage Paid For Week
			S	M	T	W	T	F	S			H & W	Pen.	Vac.	App. Trg	Other		
		S								0								
		O								0								
		S								0								
		O								0								

Report Hours For Above Referenced Public Works Project Only

Employee Name & State/Jurisdiction that Issued Identification	Work Classification	Hours Worked By Day								Total Hours For Week	Hourly Rate Of Pay including fringe	Hourly Fringe Benefit Contribution					Gross Amount Earned For Week	Net Wage Paid For Week
			S	M	T	W	T	F	S			H & W	Pen.	Vac.	App. Trg	Other		
			1/0	1/0	1/0	1/0	1/0	1/0	1/0									
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								

Report Hours For Above Referenced Public Works Project Only

Employee Name & State/Jurisdiction that Issued Identification	Work Classification	Hours Worked By Day								Total Hours For Week	Hourly Rate Of Pay including fringe	Hourly Fringe Benefit Contribution					Gross Amount Earned For Week	Net Wage Paid For Week
			S	M	T	W	T	F	S			H & W	Pen.	Vac.	App. Trg	Other		
			1/0	1/0	1/0	1/0	1/0	1/0	1/0									
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								

Report Hours For Above Referenced Public Works Project Only

Employee Name & State/Jurisdiction that Issued Identification	Work Classification	Hours Worked By Day								Total Hours For Week	Hourly Rate Of Pay including fringe	Hourly Fringe Benefit Contribution					Gross Amount Earned For Week	Net Wage Paid For Week
			S	M	T	W	T	F	S			H & W	Pen.	Vac.	App. Trg	Other		
			1/0	1/0	1/0	1/0	1/0	1/0	1/0									
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								

Report Hours For Above Referenced Public Works Project Only

Employee Name & State/Jurisdiction that Issued Identification	Work Classification	Hours Worked By Day								Total Hours For Week	Hourly Rate Of Pay including fringe	Hourly Fringe Benefit Contribution					Gross Amount Earned For Week	Net Wage Paid For Week
			S	M	T	W	T	F	S			H & W	Pen.	Vac.	App. Trg	Other		
			1/0	1/0	1/0	1/0	1/0	1/0	1/0									
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								

Report Hours For Above Referenced Public Works Project Only

Employee Name & State/Jurisdiction that Issued Identification	Work Classification	Hours Worked By Day								Total Hours For Week	Hourly Rate Of Pay including fringe	Hourly Fringe Benefit Contribution					Gross Amount Earned For Week	Net Wage Paid For Week
			S	M	T	W	T	F	S			H & W	Pen.	Vac.	App. Trg	Other		
			1/0	1/0	1/0	1/0	1/0	1/0	1/0									
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								
		S								0								
		O								0								

Report Hours For Above Referenced Public Works Project Only

STATE OF NEVADA
Office of the Labor Commissioner
STATEMENT OF COMPLIANCE

In compliance with the provisions of Chapters 338 of NRS and NAC, respectively, I, as an officer, owner or director of the undersigned contractor, hereby certify that this report is a true and accurate statement of worker's earnings employed on this Public Works contract by the undersigned contractor for the following payroll period:

_____, _____, _____ to _____, _____, _____
Month and Day Year Month and Day Year

I further certify:

1. That no deductions have been made from the wages earned by any person so listed other than those permissible or required by law.
2. That any apprentice listed herein is registered in a bona fide apprenticeship program.
3. Check all that apply:
 - ☐ The contractor is signatory to a collective bargaining agreement with some or all of its employees.
 - ☐ Each employee listed has been paid the required applicable wages plus the amount of fringe benefits listed in their contract.
 - ☐ Each employee listed has been paid the required applicable wages per hour with no fringe benefit contributions paid by the contractor.

 - ☐ Prime Contractor
 - ☐ Subcontractor

Contractor Name:	Address:
Telephone:	Fax:

Printed Name / Title Signature Date

NRS 338.070:

4. The contractor and each subcontractor shall keep or cause to be kept an accurate record showing the name and the actual per diem, wages and benefits paid to each workman employed by him in connection with the public work.
5. The record must be open at all reasonable hours to the inspection of the public body awarding the contract, and its officers and agents. The contractor or subcontractor shall ensure that a copy of the record for each calendar month is received by the public body awarding the contract no later than 15 days after the end of the month. The copy must be open to public inspection as provided in NRS 239.010. The record in the possession of the public body awarding the contract may be discarded by the public body 2 years after final payment is made by the public body for the public work.
6. Any contractor or subcontractor, or agent or representative thereof, performing work for a public work who neglects to comply with the provisions of this section is guilty of a misdemeanor.



NON-PERFORMANCE PAYROLL REPORT FOR PUBLIC WORKS PROJECTS

Pursuant to Chapter 338 of NRS and NAC, respectively, the contractor and each subcontractor shall keep or cause to be kept an accurate record showing the name and the actual per diem, wages and benefits paid to each workman employed by him in connection with the public work. The contractor or subcontractor shall ensure that a copy of the record for each calendar month is received by the public body awarding the contract no later than 15 days after the end of the month.

Report #	<input type="text"/>	<input type="checkbox"/> Regular Weekly Report	<input type="checkbox"/> Final Report	Bid/Project #	<input type="text"/>	PWP-	<input type="text"/>
Project Title	<input type="text"/>			Public Body Awarding Contract	WASHOE COUNTY SCHOOL DISTRICT		
Prime Contractor Name & Address	<input type="text"/>					License #	<input type="text"/>
Subcontractor Name & Address	<input type="text"/>					License #	<input type="text"/>
Payroll period	<input type="text"/> Month and Day	<input type="text"/> Year	to	<input type="text"/> Month and Day	<input type="text"/> Year		

I hereby certify that no employees or owner/operators were used on the construction of this Public Works project during the payroll period above.

<input type="text"/>	<input type="text"/>	<input type="text"/>
Name & Title (please print)	Signature	Date

STATE OF NEVADA

JOE LOMBARDO
GOVERNOR

DR. KRISTOPHER SANCHEZ
DIRECTOR

BRETT K. HARRIS, ESQ.
LABOR COMMISSIONER



OFFICE OF THE LABOR COMMISSIONER
1818 COLLEGE PARKWAY, SUITE 102
CARSON CITY, NV 89706
PHONE: (775) 684-1890
FAX (775) 687-6409
OFFICE OF THE LABOR COMMISSIONER
3340 WEST SAHARA AVENUE
LAS VEGAS, NV 89102
PHONE: (702) 486-2650
FAX (702) 486-2660
EMAIL: PUBLICWORKS@LABOR.NV.GOV

2025 PREVAILING WAGE RATES WASHOE COUNTY REGION

DATE OF DETERMINATION: October 1, 2024

**APPLICABLE FOR PUBLIC WORKS PROJECTS OVER \$100,000 BID/AWARDED
OCTOBER 1, 2024 THROUGH SEPTEMBER 30, 2025**

Pursuant to Nevada Revised Statutes (NRS) section 338.030(9)(a), "If the contract for a public work: (a) Is to be awarded pursuant to a competitive bidding process, the prevailing wages in effect at the time of the opening of the bids for a contract for a public work must be paid until the completion or termination of the contract or for the 36 months immediately following the date on which the bids were opened, whichever is earlier." For contracts not awarded pursuant to competitive bidding, please see NRS section 338.030(9)(b). However, if a project exceeds 36 months new wage rates may apply pursuant to NRS section 338.030(9)(10). Prevailing Wage Rates may be adjusted based on Collective Bargaining Agreements (CBA's) and adjustments to those agreements. (See NRS 338.030)

PREVAILING WAGE DETERMINATIONS - NRS 338.030 subsection 7, the wages so determined must be:

- (a) Issued by the Labor Commissioner on October 1 of the odd-numbered year in which the survey was conducted and, except as otherwise provided in subsection 8, remain effective for 2 years after that date; and
- (b) Made available by the Labor Commissioner to any public body which awards a contract for any public work.

Senate Bill 243 passed during the 80th Nevada Legislative Session (2019) and set forth in NRS section 338.025, now requires the Labor Commissioner to calculate the Prevailing Wage Rates by region. NRS section 338.025 Prevailing wage regions. For the purpose of determining the prevailing rate of wages pursuant to NRS section 338.030, four prevailing wage regions are hereby established in this State as follows:

1. The Washoe Prevailing Wage Region consisting of Washoe County;
2. The Northern Rural Prevailing Wage Region consisting of Carson City and the counties of Churchill, Douglas, Elko, Eureka, Humboldt, Lander, Lyon, Mineral, Storey, Pershing and White Pine;
3. The Clark Prevailing Wage Region consisting of Clark County, and
4. The Southern Rural Prevailing Wage Region consisting of the counties of Esmeralda, Lincoln and Nye.

OBJECTIONS TO PREVAILING WAGE DETERMINATIONS – NRS section 338.030 subsection 2. Objections to the Prevailing Wage Determinations must be submitted within 30 days after the Prevailing Wage Determinations are issued.

Pursuant to NRS section 338.030 subsection 8, the Labor Commissioner will review the prevailing wage rates in each even-numbered year to determine if adjustments should be made.

As Amendments/Revisions are made to the wage rates, they will be posted on the website for each respective Region. Please review regularly for any Amendments/Revisions that are posted or contact our offices directly for further assistance.

Air Balance Technician	4
Alarm Installer.....	5
Boilermaker	6
Bricklayer.....	7
Carpenter.....	8
Cement Mason	9
Electrician – Communication Technician	10
Electrician - Lineman	11
Electrician – Neon Sign.....	13
Electrician - Wireman.....	14
Elevator Constructor	15
Fence Erector	17
Flagperson.....	18
Floor Coverer.....	19
Glazier	20
Highway Striper	22
Hod Carrier-Brick Mason	23
Hod Carrier – Plasterer Tender.....	24
Ironworker.....	26
Laborer	29
Lubrication And Service Engineer (Mobile And Grease Rack).....	30
Mechanical Insulator	31
Millwright.....	32
Operating Engineer.....	35
Operating Engineer – Steel Fabricator & Erector.....	35
Operating Engineer – Piledriver	36
Painter	38
Piledriver (Non-Equipment)	40
Plasterer	42
Plumber/Pipefitter	43
Refrigeration	44
Roofer.....	45
Sheet Metal Worker	46
Soils and Material Tester.....	47
Sprinkler Fitter	47
Surveyor	48
Taper	49
Tile/Terrazzo Worker/Marble Mason Finisher	50
Tile/Terrazzo Worker/Marble Mason.....	51
Traffic Barrier Erector.....	53
Truck Driver	54
Well Driller	56
Group Classifications	
Labor Group Classifications	57
Operating Engineers.....	61

NRS section 338.010 subsection (25) “Wages” means:

- a) The basic hourly rate of pay; and
- b) The amount of pension, health and welfare, vacation and holiday pay, the cost of apprenticeship training or other similar programs or other bona fide fringe benefits which are a benefit to the worker.

NRS section 338.035 Bona Fide Fringe Benefits - Discharge of part of obligation of contractor or subcontractor engaged on public work to pay wages by making certain contributions in name of workman. “Bona fide fringe benefit” means a benefit in the form of a contribution that is made not less frequently than monthly to an independent third party pursuant to a fund, plan or program: (a) Which is established for the sole and exclusive benefit of a worker and his or her family and dependents; and (b) For which none of the assets will revert to, or otherwise be credited to, any contributing employer or sponsor of the fund, plan or program. The term includes, without limitation, benefits for a worker that are determined pursuant to a collective bargaining agreement and included in the determination of the prevailing wage by the Labor Commissioner pursuant to NRS section 338.030.

Please see NRS sections 338.010, 338.020, and 338.035 and Nevada Administrative Code (NAC) sections 338.0097 and 338.092 through 338.100 for further details on “Bona fide fringe benefits” and reporting requirements and exceptions.

Job Descriptions for Recognized Classes of Workers

Regarding job descriptions for public works projects, please take notice of the following:

1. The job description links have been redacted to include ONLY the scope of work for the craft.
2. Pursuant to NAC section 338.0095(1)(a) - A worker employed on a public work must be paid the applicable prevailing rate of wage for the type of work that the worker actually performs on the public work and in accordance with the recognized class of the worker.
3. The work description for a particular class is not intended to be jurisdictional in scope.
4. Any person who believes that a type of work is not classified, or who otherwise needs clarification pertaining to the recognized classes or job descriptions, shall contact the Labor Commissioner in writing for a determination of the applicable classification and pay rate for a particular type of work.
5. The job descriptions set forth or referenced herein supersede any, and all descriptions previously agreed upon by the Labor Commissioner in any settlement agreements or stipulations arising out of contested matters.
6. The following specific provisions, where applicable, shall prevail over any general provisions of the job descriptions:
 - Amendments to the prevailing wage determinations.
 - Group Classifications and/or descriptions recognized by the Labor Commissioner and included with wage determinations for a particular type of work in a particular county.

Zone Rates

The zone rate has been added to each applicable craft.

Premium Pay Premium pay for hours worked in excess of a shift of 8 hours or 12 hours, or such other time increment set forth in the Collective Bargaining Agreement or on a weekend or holiday.

Craft: AIR BALANCE TECHNICIAN (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Air Balance Technician Journeyman.....	77.37
Air Balance Technician-Foreman.....	82.06
Air Balance Technician-General Foreman.....	86.75

ADD ZONE RATE

In addition to AIR BALANCE rates add the applicable amounts per hour, calculated based on a road from the courthouse in Reno, Nevada:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 100 miles	\$5.00
Zone 3	Over 100 miles	\$10.00 the employee shall be provided reasonable lodging and meal expenses.

ADD PREMIUM PAY

All hourly rates are subject to Over Time (One and one half 1 ½) of the Regular rate:

1. For all hours worked over Eight (8) Hours in one day or shift.
2. For the first Eight (8) Hours work on Saturday.

All hourly rates are subject to Double Time of the Regular Rate:

1. For all hours worked over Ten (10) Hours in one day or shift.
2. For all hours worked over Eight (8) Hours on Saturday.
3. For all hours worked on Sunday, New Year's Day, Memorial Day, Independence Day, Friday before Labor Day, Labor Day, Nevada Day, Thanksgiving Day, Day after Thanksgiving, Day before Christmas, and Christmas Day.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Independence Day, Friday before Labor Day, Labor Day, Nevada Day, Thanksgiving Day, Day after Thanksgiving, Day before Christmas, and Christmas Day

JOB DESCRIPTION: Excerpt from Sheet Metal Local 26 Collective Bargaining Agreement

(a) manufacture, fabrication, assembling, handling, erection, installation, dismantling, conditioning, adjustment, alteration, repairing and servicing of all ferrous or nonferrous metal work and all other materials used in lieu thereof and of all HVAC systems, air veyor systems, exhaust systems, and air-handling systems regardless of material used including the setting of all equipment and all reinforcements in connection therewith; (b) all lagging over insulation and all duct lining; (c) testing and balancing of all air-handling equipment and duct work; (d) the preparation of all shop and field sketches whether manually drawn or computer assisted used in fabrication and erection, including those taken from original architectural and engineering drawings or sketches; (e) metal exterior wall systems, metal roofing; and (f) all other work included in the jurisdictional claims of International Association of Sheet Metal, Air, Rail and Transportation Workers.

Craft: ALARM INSTALLER (Non-Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Alarm Installer.....39.90

JOB DESCRIPTION:

Includes but is not limited to:

1. Installing or testing electrical protective signaling systems used to provide notification of fire, burglary or other irregularities on the premises of the subscriber of the system;
2. Installing of wiring and signaling units;
3. Repairing electrical protective signaling systems
4. Starting up, programming and documenting systems;

Craft: BOILERMAKER (Union Rate)
Prevailing wage rates include the base rate as well as all applicable fringes

Boilermaker.....	74.61
Boilermaker Foreman.....	78.59

ADD PREMIUM PAY

Premium pay for hours worked in excess of a shift of 8 hours or 12 hours or such other time increment set forth in the Collective Bargaining Agreement or on a weekend or holiday.

PER DIEM payments and TRAVEL pay shall be paid as follows:

The Contractor shall pay the employee Per Diem in the amount of seventy-five dollars (\$75.00) per day worked where the job site is 70 miles or more but less than 120 miles from the dispatch point.

For mileage of 120 miles or more, the daily Per Diem amount shall be ninety dollars (\$90.00) per day worked.

Where the job site is over 120 miles or more from the dispatch point, employees shall receive the I.R.S. maximum allowable per mile for transportation between the dispatch point and the job site at the beginning and conclusion of their employment.

Where a job is located two hundred and forty (240) miles or more from the dispatch point, the employee will receive one additional day's Per Diem at the beginning of employment and one additional day's Per Diem at the conclusion of employment.

JOB DESCRIPTION:

Includes but is not limited to:

1. Constructing, assembling, maintaining and repairing stationary steam boilers and boiler house auxiliaries;
2. Aligning structures or plate sections to assemble boiler frame tanks or vats;
3. Assisting in the testing of assembled vessels, directing cleaning of boilers and boiler furnaces;
4. Inspecting and repairing boiler fittings, including, without limitation, safety valves, regulators, automatic-control mechanisms, water columns and auxiliary machines.

Craft: BRICKLAYER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Bricklayer Journeyman.....	53.96
Bricklayer Foreman.....	55.21

ADD ZONE PAY in addition to BRICKLAYER rates add the applicable amounts per hour, calculated based on road miles of over thirty-five (35) miles from the Washoe County Courthouse in Reno, Nevada:

Zone 1	0 to 35 miles	\$0.00
Zone 2	35 to 75 miles	\$2.50
Zone 3	Over 75 miles	\$8.12

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from midnight to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday.
New Year's Day, President's Day, Memorial Day, Fourth of July, Labor Day, Admission Day,
Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between No, NV Masonry Contractors and LIUNA Local 169.

This shall apply to and cover the work of Brick/Block Masonry, Stone Masonry, Artificial Masonry Marble Masonry.

Craft: CARPENTER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Carpenter Journeyman.....	61.42
Carpenter Foreman.....	65.26
Carpenter General Foreman.....	69.48

ADD ZONE RATE

(Building and Heavy Highway and Dam Construction)

In addition to CARPENTER rates add the applicable amounts per hour, calculated from the Washoe County Courthouse:

Zone 1	Within 75 road miles	\$0.00
Zone 2	Between 75 to 150 road miles	\$6.00
Zone 3	Between 150 to 300 road miles	\$7.00
Zone 4	In excess of 300 road miles	\$8.00

ADD PREMIUM PAY

Any work performed over eight (8) hours per day and on Saturdays shall be compensated at time and one-half (1-1/2x) the appropriate hourly rate. All work performed on Sundays, holidays and over twelve (12) hours in one (1) day shall be compensated at two times (2x) the appropriate hourly rate. In the event a day's work is lost because of severe weather conditions or major mechanical breakdown, work may be performed on a voluntary basis on a Saturday at the straight time hourly rate for eight (8) hours provided the straight time hours worked in one (1) week do not exceed forty (40) hours.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, 4th of July, Labor Day, Admission's Day, Thanksgiving Day, the Friday after Thanksgiving, Christmas Day.

JOB DESCRIPTION Excerpt from Southwest Regional Council of Carpenters and Affiliated Local Unions Master Labor Agreement

(1) All building construction, including but not limited to the construction, erection, alteration, repair, modification, demolition, addition, or improvement in whole or in part of any building structure. All rigging of Carpenters', and Piledrivers' materials.

(2) All heavy, highway and engineering construction, including but not limited to the construction, improvement, modification and demolition of all or any part of the streets, highways, bridges, viaducts, railroads, tunnels, airports, water supply, irrigation, flood control and draining systems, sewers and sanitation projects, dams, power houses, refineries, aqueducts, canals, river and harbor projects, wharves, docks, breakwaters, jetties, quarrying of breakwaters or rip rap stone or operations incidental to such heavy construction work and whether such work is above or below the water line level.

(3) The character of such work covered by this Agreement shall include but not be limited to all carpenter, concrete form work, shoring, drywall, metal stud, drywall finishing, plaster, scaffold, modular furniture, trade show work, insulation, acoustical, and lathing work on such construction, including but not limited to plastics and such work in connection with new methods of construction or use of materials.

(4) All interior and/or exterior wall finish work, including EIFS and other wet wall finish work.

Craft: CEMENT MASON (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Cement Mason - Journeyman.....	54.42
Cement Mason - Foreman.....	58.92

ADD ZONE RATE

In addition to CEMENT MASON rates add the applicable amounts per hour, calculated from the Washoe County Courthouse:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$6.00
Zone 3	150 to 300 miles	\$7.00
Zone 4	More than 300 miles	\$8.00

ADD PREMIUM PAY

OVERTIME – Any worked performed over eight (8) hours per day shall be compensated at time and one half the hourly rate. All work performed after twelve (12) consecutive hours shall be paid at double the hourly rate. All worked performed on Saturdays shall be compensated at time and one half the hourly rate. All Sunday and Holiday work shall be paid for at double time.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Independence Day, Labor Day, Admissions Day, Thanksgiving Day and the following Friday following Thanksgiving Day, and Christmas

JOB DESCRIPTIONS

1. All building construction, including but not limited to the construction, erection, alteration, repair, modification, demolition, addition, or improvement in whole or in part of any building structure.
2. All heavy, highway and engineering construction, including but not limited to construction, improvement, modification, demolition, of all or any part of streets and highways (including sidewalks, curbs and gutters), bridges, viaducts, rail roads, tunnels, airports, water supply, irrigation, flood control and drainage systems, sewers and sanitation projects, dams, power houses, refineries, aqueducts, canals, river and harbor projects, wharves, docks, breakwaters, jetties, quarrying of breakwater or rip-rap stone, or operation incidental to such heavy construction work.

3. The work to be performed by Cement Masons shall include but not be limited to the following, when tools of the Cement Masons trade are used or required:

Setting screeds, screed pins, curb forms and curb and gutter forms, rodding, spreading and tamping concrete, hand application of curing compounds, applying topping (wet or dry) colors or grits; using Darby and push floats, hand troweling or hand floating; marking edging, brooming or brushing, using base cove or step tools; chipping, and stoning, patching or sacking; dry packing; spreading and finishing gypsum, operating mechanical finishers (concrete) such as Clary, Jackson, Bidwell Bridge Deck Paver or similar types; grinding machines; troweling machines, floating machines powered concrete saws; finishing of epoxy and resin materials, bush hammering and exposed finishes for architectural work.

Operation of skill saw, chain saw, Laser Screed, Laser Level, Curb and Slipform machines, Epoxy Type Injection pumps, stamps or other means of texturing, any new devices, which are beneficial to the construction of or with concrete or related products.

Craft: ELECTRICIAN COMMUNICATION TECHNICIAN (Non-Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Communication Technician.....41.13

JOB DESCRIPTION:

ELECTRONIC COMMUNICATION TECHNICIAN, includes but is not limited to:

1. Pulling cable, installing and trimming devices, terminating loops, circuits, or other data gathering points;
2. Termination of main control panels, racks, or other head end equipment, as well as testing of all circuits from the field devices to the main control panels and/or equipment; 2016-2017 Prevailing Wage Rates – Washoe County 13
3. Utilizing test equipment for the purpose of troubleshooting and verifying the integrity of the circuits in question;
4. Using hand tools to assemble and install data communication lines and equipment computer systems, antennas and towers;
5. Disassembling equipment to adjust, repair or replace parts using hand tools;
6. Starting up, programming and documenting systems;
7. Measuring, cutting, splicing, connecting, soldering and installing wire and cable associated with communication systems.

Craft: ELECTRICIAN LINEMAN/GROUNDMAN/HEAVY EQUIPMENT OPERATOR
(Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Electrician-Groundman.....	39.57
Lineman-Journeyman.....	67.30
Lineman-Foreman.....	73.99
Lineman-General Foreman.....	80.76
Lineman-Equipment Man.....	51.75

ADD PREMIUM PAY

Premium pay for hours worked in excess of a shift of 8 hours or 12 hours or such other time increment set forth in the Collective Bargaining Agreement or on a weekend or holiday.

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Memorial Day, Fourth of July, Labor Day, Nevada Day, Thanksgiving Day and the Friday following, Christmas Day.

JOB DESCRIPTION:

Outside, overhead and underground construction and maintenance work on electrical transmission lines, switch yards, substations and distribution systems which shall include:

1. Pole line work (whether built of wood, metal or other material): the digging and back-filling of holes for poles or anchors (by hand or mechanical equipment); the loading or unloading, handling, sorting and moving of materials; the assembly or erection of all materials including the guying, stringing of conductors and fiber optics or other work necessary on through to the ultimate completion of such pole work.

2. Steel or metal structures used for the purpose of carrying electrical wire, conductors, or equipment (this includes transmission towers, outdoor substations, switch racks, or similar electrical structures); the moving of men, tools or equipment; the loading or unloading, handling, sorting and moving of materials; the assembly and erection of all materials used on the job site, including the assembly of the grillage and foundations, on through to the ultimate completion of such structures. Work covered shall include the grounding of all such structures except the bonding of stub-angle to rebar cage; the stringing and installation of wires, cables and insulators or other electrical equipment suspended from structure; also the handling and placing of transformers or O.C.B.'s and other related electrical equipment.

The moving of men, tools or equipment; the loading or unloading, handling, sorting and moving of materials; the assembly of all electrical materials on race-ways such as ducts, shall be performed by workmen under the Agreement. This shall also include CIC (cable in conduit), CC (coilable conduit), the placing of fish wire, the pulling of cables or wires through such race-ways, installing and making up of termination and the splicing of such conductors.

Street lighting systems where such work properly comes under the outside jurisdiction shall be handled in the same manner as pole line construction.

Installing and maintaining the catenary and trolley work and bonding of rails shall be handled in the same manner as pole line, and steel construction.

In connection with all of the above items, it is understood the scope of this Agreement shall include not only new installation work but shall also govern the repair, maintenance or dismantling of such structures, lines or equipment; the handling and operating of all equipment used to transport men, tools and/or

materials on the job site as well as the equipment used to move, raise or place materials used in the Outside Branch of the Electrical Industry shall be performed by workmen under this Agreement unless otherwise excluded herein.

Craft: ELECTRICIAN – NEON SIGN (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Electrician Neon Sign Journeyman.....	63.15
Electrician Neon Sign Foreman.....	65.15
Electrician Neon Sign Truck Foreman supervising (4) or more.....	67.65

ADD PREMIUM PAY

One and one half (1 ½X) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift, either before or after the shift.
2. For up to 8 hours worked on Saturday from midnight to midnight.

Double (2X) the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over eleven (11) hours in one day or shift, Monday thru Friday.
2. For all hours worked in excess of 8 hours on Saturday, Sundays or Holidays.

SHIFT DIFFERENTIAL

Second Shift (Swing) will be an additional \$1.25 cents per hour.

Third Shift (Graveyard) will be an additional \$1.50 per hour.

HIGH TIME (Working at heights)

1. All employees working at height of 65 feet and subject to a direct fall shall be paid an additional \$2.75 per hour in addition to their normal rate for a minimum of 2 hours.
2. All employees working at height of 125 feet or when repelling below 65 feet shall be paid an additional \$4.00 per hour in addition to their normal rate for a minimum of 4 hours.

FOREMAN/TRUCK FOREMAN

1. First employee on the job (TRUCK FOREMAN) must have a CDL and Welder certification and shall be paid \$2.00 per hour

in addition to their normal rate of pay.

2. When the first employee on the job (FOREMAN) is supervising (4) or more workers, he or she shall be paid an additional \$2.50 per hour. In addition to their normal rate of pay.

3. When the first employee on the job (TRUCK FOREMAN and FOREMAN) has a CDL and Welder certification and is supervising (4) or more workers, he or she shall be paid an additional \$4.50 per hour. In addition to their normal rate of pay.

RECOGNIZED HOLIDAYS

New Year's Day, Martin Luther King Day, President's Day unpaid holiday; double time for any hours worked, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Eve ½ day (4 hours) unpaid holiday; straight time for first four hours worked and double time for hours worked after four hours, Christmas Day.

JOB DESCRIPTION Includes but is not limited to:

1. Installing, servicing and repairing plastic, neon and illuminated signs.
2. Ascending ladders or operating hydraulic or electric hoist to install, service, or examine sign to determine cause of malfunction.
3. Wiring, rewiring or removing defective parts and installing new parts using electrician's tools.
4. Removing sign or part of sign for repairs, such as structural fabrication, scroll repair, or transformer repair.

Craft: ELECTRICIAN WIREMAN (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Wireman.....	73.88
Wireman-Cable Splicer.....	78.33
Wireman Foreman.....	79.95
Wireman General Foreman.....	86.02

ADD ZONE RATE

In addition to ELECTRICIAN-Wireman, rates, add the applicable amounts per hour, calculated from Washoe County Courthouse, Reno Nevada:

Zone 1	0 to 70 miles	\$0.00
Zone 2	70 to 90 miles	\$8.00
Zone 3	90 miles and over	\$10.00

ADD PREMIUM PAY

Premium pay for hours worked in excess of a shift of 8 hours or 12 hours or such other time increment

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For the first eight (8) hours worked on Saturday

Double the regular straight time hourly rate shall be paid for all time:

3. For all hours worked over ten (10) hours in one day or shift.
4. For any hours worked on Sunday
5. For any hours worked on Holidays

Shift Rates

1. Swing shift to be paid at seventeen-point three (17.3) percent the regular straight time rate for hours between 4:30 p.m. and 1:00 a.m.
2. Graveyard shift to be paid at thirty-one-point four (31.4) percent the regular straight time rate for hours between 12:30 a.m. and 9:00 a.m.
3. Shifts are established for at least five (5) consecutive days or double the regular straight time rate shall be paid.

****Note – Double the straight time rate is the max rate paid. (No pyramiding of overtime rates)**

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Independence Day, Labor Day, Admission Day, Veteran's Day, Thanksgiving Day, Friday following Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between NECA and Local Union 401, IBEW

All electrical construction, installation, or erection work including fabrication or prefabrication of boxes, brackets, bends and nipples and all electrical maintenance thereon including the final running tests. This shall include the installation and maintenance of temporary wiring and the installation of all electrical lighting, heat and power equipment, installation of all raceway systems, including underground conduits and all supports, underground utility conduits, photovoltaic power generation systems, wind power generation systems and geothermal power generating systems. Further all salvage of electrical work shall be included.

Craft: ELEVATOR CONSTRUCTOR (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Elevator Constructor-Journeyman Mechanic.....	126.41
Elevator Constructor-Journeyman Mechanic In Charge.....	137.32

ADD PREMIUM PAY

Work performed on Construction Work on Saturdays, Sundays and before and after 30 the regular working day on Monday to Friday, inclusive, shall be classed as overtime, and paid for at double the rate of single time.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Independence Day, Labor Day, Nevada Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement of International Union of Elevator Constructors Local 8.

The handling and unloading of all equipment coming under the jurisdiction of the Elevator Constructor, from the time such equipment arrives at or near the building site, shall be handled and unloaded by the Elevator Constructors. Mechanical equipment such as a forklift or truck mounted swing boom may be used by the Elevator Constructors. A derrick, crane or material hoist can be used under the supervision of Elevator Constructors to handle and unload the heavy material described in

Par. 5(a). Where unusual conditions are expected to exist prior to delivery of equipment at or near the building site in regard to handling and unloading of equipment in the primary or secondary jurisdiction of the local union, the Company shall contact the Local's Business Representative to make appropriate arrangements for the handling and unloading of such equipment. In areas outside the jurisdiction of the local union, the Company shall contact the Regional Director.

(b) The erecting and assembling of all elevator equipment to wit: electric, hydraulic, steam, belt, dumbwaiters, residence elevators, parking garage elevators (such as Bowser, Pigeon Hole, or similar types of elevators), shuttles, compressed air and handpower, automatic people movers, monorails, airport shuttles and like-named devices used in the transportation of people for short distances of travel (less than 5 miles), as well as vertical reciprocating conveyor systems.

(c) It is understood and agreed that the preassembly of all escalators, moving stairways and link belt carriers that may be done in the factory shall include the following:

1. Truss or truss sections with tracks, drive units, machines, handrail drive sheaves, drive chains, skirts on the incline sections but not curved sections, step chains and steps installed and permanently aligned.
2. Balustrade brackets may be shipped attached but not aligned.
3. Setting of all controllers and all wiring and conduit from the controller.

All other work on escalators, moving stairways and link belt carriers shall be performed in the field before or after the truss or truss sections are joined and/or hoisted and placed in permanent position. This includes any and all work not done in the factory. The erecting and assembly of all theater stage and curtain elevator equipment and guides and rigging thereto, organ consoles and orchestra elevators

- (d) All wiring, conduit, and raceways from main line feeder terminals on the controller to other elevator apparatus and operating circuits. Controllers are not to be shipped from the factory with extended wiring attached thereto.
- (e) The erecting of all guide rails.
- (f) The installation of all grating under the control of the Company. The installation of all counterweight screens, overhead work, either wood or iron, and all material used for mounting of elevator apparatus in machine room, overhead or below.
- (g) The drilling of overhead beams for attaching machines, sheaves, kick angles, and all other elevator equipment.
- (h) The setting of all templates.
- (i) All foundations, either of wood or metal, that should take the place of masonry.
- (j) The assembly of all cabs complete.
- (k) The installation of all indicators.
- (l) The erecting of all electrical or mechanical automatic or semi-automatic gates complete.
- (m) The hanging of all automatic or semi-automatic elevator hoistway doors, together with the installation of hangers and tracks.
- (n) The installation of all devices for opening and closing and locking of elevator car and hoistway doors and gates.
- (o) The drilling of doors for mounting of closing devices.
- (p) The drilling of angle supports for mounting of closing devices except one template hole.
- (q) The drilling of sills for sill trips.
- (r) The operating of temporary cars.
- (s) The setting of all elevator pressure open or pit tanks.
- (t) The setting of hydraulic power units (power units include: motor, pump, drive valve system, internal piping, muffler, internal wiring, controller and tank). Where power units arrive in parts, they shall be assembled at the job site. The wiring and piping to and between multiple hydraulic power units shall be performed at the job site.
- (u) All air cushions with the exception of those built of brick or those put together with hot rivets.
- (v) Landing door entrances.

Craft: FENCE ERECTOR (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Fence Erector.....51.03

ADD ZONE RATE

In addition to FENCE ERECTOR rates add the applicable amounts per hour, calculated based on a road miles from either the Carson City Courthouse or the Washoe County Courthouse:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$6.00
Zone 3	150 to 300 miles	\$7.00
Zone 4	300 miles or over	\$8.00

No remote area pay shall be paid within ten (10) miles of employee's permanent place of residence in the State of Nevada.

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from midnight to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday.
New Year's Day, President's Day, Memorial Day, Fourth of July, Labor Day, Admission Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION:

Includes but is not limited to:

1. Erecting or repairing chain link, wooden, tortoise, wire/wire mesh, or temporary fencing;
2. Mixing and pouring concrete around bases of posts and tamping soil into post hole to embed post;
3. Digging post holes with a spade, post hole digger or power-driven auger;
4. Aligning posts through the use of lines or by sighting;
5. Verifying vertical alignment of posts with a plumb bob or spirit level.

Craft: FLAG PERSON (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Flag Person.....48.91

ADD ZONE RATE

In addition to FLAG PERSON add the applicable amounts per hour, calculated based on a road miles from either the Carson City Courthouse or the Washoe County Courthouse:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$6.00
Zone 3	150 to 300 miles	\$7.00
Zone 4	300 miles or over	\$8.00

No remote area pay shall be paid within ten (10) miles of employee's permanent place of residence in the State of Nevada.

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from midnight to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday. New Year's Day, President's Day, Memorial Day, Fourth of July, Labor Day, Admission Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION

FLAG PERSON, includes but is not limited to:

1. Directing movement of vehicular traffic through construction projects;
2. Distributing traffic control signs and markers along site in designated pattern;
3. Informing drivers of detour routes through construction sites;

Craft: FLOOR COVERER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Floor Coverer Journeyman.....	60.65
Floor Coverer Foreman.....	64.49

ADD PREMIUM PAY

Any work performed over eight (8) hours per day and on Saturdays shall be compensated at time and one-half (1-1/2x) the appropriate hourly rate. All work performed on Sundays, holidays and over twelve (12) hours in one (1) day shall be compensated at two times (2x) the appropriate hourly rate. In the event a day's work is lost because of severe weather conditions or major mechanical breakdown, work may be performed on a voluntary basis on a Saturday at the straight time hourly rate for eight (8) hours provided the straight time hours worked in one (1) week do not exceed forty (40) hours.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Independence Day, Labor Day, Admissions Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Southwest Mountain States Regional Council of Carpenters.

All work in connection with the installation of floor coverings (with the exception of wood floors which are covered by the Master Labor Agreement) such as measuring, cutting, installing, or removal and other preparation for installation of all types of floor covering. All types of floor covering regardless of material (except wood flooring), including but not limited to all types of carpeting, linoleum, vinyl, cork, laminate floors; glue down wood floor applications; rubber, cork, asphalt, linoleum or other types of tile; artificial turf and sports surfaces; any type of resilient flooring such as epoxy, polyurethane or similar materials regardless of how applied; and ceramic tile and stone. Included in the work covered is the application or installation of any type of moisture barrier and any type of underlayment or subfloor in connection with a flooring installation.

Craft: GLAZIER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Glazier Journeyman.....	33.96
Glazier Foreman.....	36.41
Glazier Superintendent.....	37.63

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For first two (2) hours worked over eight (8) on a regular five (5) day week.
2. For all hours worked on Saturday. Employees shall not work less than four (4) hours.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked beyond ten (10) hours shall be paid at two (2 X) times the straight time rate.
2. For all hours worked on Saturday beyond 8 hours (2 X) times the straight time rate.
3. For hours worked Sunday and Recognized Holidays. Employees shall not be employed for less than four (4) hours.

*Also, if there is less than 10 hours between shifts, the 2nd shift becomes an extension of the 1st shift.

*Shift Differential: To be paid for all work performed between the hours of 5:30 pm to 5 am and it will be compensated at 10% differential for all hours worked including overtime. Overtime that falls between these hours will still be paid at the appropriate overtime rate.

20.1 High Pay – work that is thirty (30) or more feet in height above grade on an elevated, mechanically operated platform (including but not limited to: swing stage, boatswain chair, crane basket, heck lift, boom lift), rappelling work, work at slab edge outside the perimeter safety cable or work at slab edge inside the perimeter safety cable if the work being performed puts the employee in a free fall situation because the perimeter safety cable is no longer at or near waist level shall be paid at the rate of one dollar (\$1.00) per hour above the straight time rate for actual hours worked. High time shall be paid in addition to all other premiums involved.

25.2 Foremen:

a) The selection of the individual to act as foreman shall be at the discretion of the Employer. On outside jobs lasting three (3) days or more and which four (4) workers or more are employed, one (1) foreman will be designated and he shall be paid ten percent (10%) per hour over the highest journeyman Glazier supervised. Inside foreman shall receive ten percent (10%) per hour above the journeyman's wage scale.

b) When a glazier is requested to perform welding on the job site, he/she will be compensated one dollar (\$1.00) over his regular rate of pay. All equipment, including hoods, leather and gloves, will be supplied by the Employer.

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between DC 16 and Glazing Contractors Associations of NV and Independent Contractors

General Glazing shall include the layout and setting by hand or with machines, cutting, preparing handling or removal of the following and incidental and supplemental to such work: setter of art glass, prism glass,

beveled glass, leaded glass, automobile glass, window glass, mirrors of all types, wire glass, ribbed glass, ground glass, colored glass, figured glass, vitrolite glass, carrara glass, and all other types of opaque glass; glass chalk boards, structural glass, tempered and laminated glass, thiokal, neoprene and all other types of glass cements, all types of insulating glass units, solar heat collectors containing glass or glass substitutes, glass hand rail, electric glass, bathroom fixtures, all plastics when used in place of glass, all other similar materials when used in place of moldings, tubber, lead and all types of mastic in wood, iron, aluminum or sheet metal, sash skylights, doors, frames, stone, wall cases, show cases, books cases, sideboards, partitions, automatic doors, automatic sliding doors, revolving doors, luminous ceilings, gaskets, and plastic mirrors, the installation of the above materials, temporary or permanent, on or for any building in the course of repair, remodel, construction or alteration.

The installation of all glass framing or support systems for the same such as extruded, rolled or fabricated metals or any materials that replace the same, such as plastics, metal tubes, mullions, metal facing materials, muttins, facia trim moldings, porcelain panels, skylights, showcase doors and relative materials, including those in any or all of the buildings related to the store front and window wall, curtain wall, stop wall, skylight and dome construction. Glazing and installation of door and window frames, such as patio sliding or fixed doors, vented or fixed windows, shower doors, bath tub enclosures, screens storm stash where the glass becomes an integral part of the finished products, the tinting and coating of glass for the reflecting of heat and light, showcase tops, glass shelving of all types and table tops. In addition, such caulking, glass to glass, glass to metal, metal to concrete and panel to panels.

Production, maintenance, including all incidental and supplemental to, but not limited to Employees, and Employees who are engages int eh cutting, preparing, handling and selecting of glass and /or mirror, bevellers, silverers, blockers, scratch polishers, sand-blasters, flat glass wheel cutters, miters cutters, engraver, hole-drilling machine operations, belt sanding, automatic beveling, multi-grove edging machines, semi- and automatic-cutting machines, grinding, polishing unpacking ad racking or glass, glass packing, glass and mirror cleaning, mirror stripping, all operations in the manufacturing, framing and fabrication and assembling of all insulating units, assembling of all glass insulated solar heat collectors containing glass or glass substitutes, molding or mirrors, manufactured and assembly of sliding glass or mirror doors, the operating of all machines and equipment for these operations, oven operations, glass hangers, glass benders and operators, safety glass fabricators, inspectors, janitors, maintenance mechanics, loading and unloading or truck and railroad cars.

Craft: Highway Striper (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Highway Striper.....	53.53
Highway Striper Foreman.....	54.03

ADD ZONE RATE

In addition to HIGHWAY STRIPER rates add the applicable amounts per hour, calculated based on a road miles from either the Carson City Courthouse or the Washoe County Courthouse:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$6.00
Zone 3	150 to 300 miles	\$7.00
Zone 4	300 miles or over	\$8.00

No remote area pay shall be paid within ten (10) miles of employee's permanent place of residence in the State of Nevada.

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from mid night to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday.

New Year's Day, Memorial Day, 4th of July, Labor Day, Admission Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION:

Includes but is not limited to:

1. Painting highways, streets and parking surfaces by using manually propelled or mechanically propelled machines, brushes, rollers or spray guns;
2. Installing any device or application of any material used in lieu of paint for traffic direction, including, without limitation, buttons, tapes, plastics, rumble bars and other similar materials;

Craft: Hod Carrier-Brick Mason Tender (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Brick Mason Journeyman.....	51.28
Brick Mason Foreman.....	51.68

ADD ZONE RATE

In addition to Hod Carrier Brick Mason Tender rates add the applicable amounts per hour, calculated based on road miles from either the Carson City Courthouse or the Washoe County Courthouse:

Zone Rate	75 miles and over	\$8.13
-----------	-------------------	--------

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from midnight to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday.

New Year's Day, President's Day, Memorial Day, Fourth of July, Labor Day, Admission Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between No, NV Masonry Contractors and LIUNA Local 169

Conveying of all materials used by the Brick and Stone Masons from the first point of delivery to the Mechanic whether done manually or by a piece of machinery or equipment devised to replace the wheelbarrow or buggy, including but not limited to the forklift. The handling of Bricks, Blocks, mortar, or any other material to serve the bricklayer in any capacity building and dismantling scaffolds of any kind or type used by Bricklayers for masonry work including but not limited to tower scaffolds, access scaffolds, or other specialty scaffolds, mixing and tempering mortar by hand and/or machine, mixing grout and cleaning up after the bricklayer, the repairing and maintenance of all equipment, either on the job or in the yard.

Craft: Hod Carrier-Plasterer Tender (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Plasterer Tender-Journeyman.....	51.62
Plasterer Tender- Gun Tender.....	52.62
Plasterer Tender-Foreman.....	52.98

ADD ZONE RATE

In addition to: HOD CARRIER-PLASTERER TENDER rates add the applicable amounts per hour, calculated based on road miles from either the Carson City Courthouse or the Washoe County Courthouse:

Zone Rate	75 miles and over	\$8.00
-----------	-------------------	--------

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from midnight to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday. New Year's Day, President's Day, Memorial Day, Fourth of July, Labor Day, Admission Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between Plasterers Contractors and LIUNA Local Union 169

Any Employee within the scope of this division tending or serving any other worker performing plasterers work, any plasterer, plasterers, or apprentices in any capacity performing plasterers work including but not limited to, handling and conveying of all materials after delivery used by plasters, including but not limited to, inside finish coat, outside finish coat, brown coat, scratch coat, sprayed or trowled on fireproofing, EIFS systems, and other materials or systems for the same or similar purpose whether done manually or by a piece of machinery or equipment devised to replace the wheelbarrow or buggy, including but not limited to the forklift, tusk hoist, and rigging and signaling for cranes to the point or points of application or installation, making mixing and preparing after delivery all materials used by plasters, whether by hand or machine including but not limited to mixers, pumps for plaster or fire proofing, plaster, finish coats, fireproofing, including Monocoat, Cafco or other materials for the same or similar use, moving any rolling scaffolding, building and handling all necessary trestle, scaffolding and planking of scaffolding for plasterers and lathers, building mortar boxes, mortar boards and stands, and the repairing and maintenance of all equipment either on the job or in the yard, the spreading of all temporary protective drop cloths, building paper or plastic covers and taping of same (in a composite crew with the plasterers when necessary), the cleaning of all floors, and debris, behind the plasterers or any other worker performing plasterers work in connection with the work performed all work necessary for cold weather protection and cure including but not limited to handling installing or tending to blankets, visqueen, and space heaters, and running putty.

Tending to plasterers or any other worker performing plasterers work on EFIS system work shall include all work after the wallboard is installed including but not limited to any preparatory sealing or leveling, placing foam, mesh, and plaster including any rough, finish, and color coats.

For sprayed on fire proofing work only, including Monocoat, Cafco or other materials for the same or similar use an Employer signatory to this Agreement and the Local 169, Laborers Master Agreement may employ Laborers at the Group 1 wage rate to perform overspray protection, the spreading of all temporary protective drop cloths, building paper or plastic covers and taping of same, the cleaning of all floors, and debris, cold weather protection and cure including but not limited to handling installing or tending to blankets, visqueen, and space heaters and moving rolling scaffolding.

Craft: Ironworker (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Ironworker - Journeyman.....	82.86
Ironworker - Foreman.....	87.61

ADD ZONE RATE

In addition to Iron Worker rates add the applicable amounts per day, calculated based on a road mile from the Reno City Hall or Las Vegas City Hall.

Zone 1	60 to 75 miles	\$20.00
Zone 2	75 to 100 miles	\$25.00
Zone 3	100 miles and over	\$75.00

ADD PREMIUM PAY

One and one half (1X) the regular straight time hourly rate shall be paid:

1. For the first two (2) hours worked in excess of eight (8) on a regular workday Monday-Friday
2. For the first eight (8) hours on Saturday

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over ten (10) hours in one day or shift.
2. For any hours worked on Sunday.
3. For all hours worked over eight (8) on Saturday
4. For all hours worked on Holidays

Shift Pay

1. 2nd shift add 6% of hourly wage
2. 3rd shift add 13% of hourly wage
3. Dedicated shift add 6% of hourly wage

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Memorial Day, Independence Day, Labor Day, Admission (Nevada) Day, Veterans Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB CLASSIFICATION: Excerpt from Agreement between NV AGC and DC of Ironworkers

Field fabrication and/or erection or deconstruction of structural, ornamental and reinforcing steel, including but not limited to the fabrication, rigging and signaling, erection and construction of all iron and steel, ornamental lead, bronze, brass, copper and aluminum, plastics and all other substitute materials, including, but not limited to, composites, carbon fiber and fiberglass, all barrier railings, handrail, aluminum, steel, glass and plastic, reinforced concrete structures or parts thereof; bridges, viaducts, inclines, dams, docks, dredges, vessels, locks, gates, guides, aqueducts, reservoirs, spillways, flumes, caissons, cofferdams, subways, tunnels, cableways, tramways, monorails, blast furnaces, stoves, kilns, coolers, crushers, agitators, pulverizers, mixers, concentrators, ovens, cupolas, roof decking such as but not limited to "Cofar", "Trusdeck", Mahon "M"; smoke conveyors, penstocks, flag poles, drums, shafting, shoring, fur and storage rooms, fans and hot rooms, stacks, bunkers, conveyors, dumpers, elevators, vats, tanks, enamel tanks, enamel vats, towers, pans, hoppers, plates, anchors, caps, corbels, lintels, Howe and combination trusses, grillage and foundation work, grating, bucks, partitions, hanging ceilings, hangers, clips, brackets, flooring, floor construction and domes, rolling shutters, curtains, frames; aluminum, rolling fire, won and iron doors, including supports; cast tiling, air ducts, duct and trench frames and plates; wire work, railings, wire cable including pipe, guards, fencing, grill work, sidewalk and vault lights, skylights, roofs, canopies, light steel

framing, marquees, awnings and other related equipment elevator and dumb waiter enclosures, elevator cars, tracks, fascias, aprons, operating devices, steel and aluminum sash, hardware and screens, frames, fronts, lockers, racks, book stacks, tables, shelving, metal furniture, seats, chutes, escalators, stairways including pre-engineered stairs, ventilators, boxes, fire escapes, signs, jail and cell work, safes, vaults, vault doors, safe deposit boxes, corrugated sheets when attached to steel frames, including insulation; frames in support of boilers; materials altered in field such as framing, cutting, bending, drilling, burning and welding including by acetylene gas and electric machines; metal forms and false work pertaining to concrete construction; seismic isolation systems and dampening systems including base isolators, sectional water tube and tubular boilers and stokers; traveling sheaves, vertical hydraulic elevators, bulkheads, skip hoists, making and installation of articles made of wire and fibrous rope, rigging in connection with pumps, compressors, forced and induced draft fans, air meters, Bailey meters, agitators, oxygen converters, cinder machines, pelletizing machines, reactor vessels, reactor spheres, completed tanks and assembled sections of completed tanks, scroll cases, refineries, hydroelectric power houses and steam plants, cogeneration plants, vessels and government departments; false work, travelers, scaffolding, pile drivers, sheet piling, derricks and powered derrick swinger including the erection, installation, handling and operating. Cranes erection, installation, handling and operating of same on all forms and types of construction work. The operation of Valla and Spider type battery and/or propane powered portable floor cranes having no operator seat utilized to install ironworker scope of work and the same on all forms and types of construction work. Crane work at the ports, including hammer-head cranes, container cranes and rubber tire cranes. Offloading, relocations, and commissioning of all burning and removal of sea bracing track layout; erection of apex boom extensions, back reach extensions, and rail replacement. Includes all welding, containment and structural modifications of the aforementioned items; railroad bridge work including maintenance thereof; moving, hoisting and lowering of machinery, modules, skid modules and placing of same on foundation, including bridges, cranes, intermittent use forklifts, derricks, buildings, piers and vessels; loading, unloading, necessary maintenance, erection, installation, removal, wrecking and dismantling of all of the above and all reinforcing work and submarine diving in connection with or about same; erection of steel towers, chutes and spouts for concrete where attached to towers and handling and fastening of cables and guys for same; unloading, racking, sorting, cutting, bending, hoisting, placing and tying including the use of any and all mechanical tying devices, burning and welding including stud welding of all iron, steel and metal in reinforced concrete construction including mesh for floor arches and the making of hoops and stirrups, metal forms and metal supports thereof; jacking of slip forms, installation of all wire, cable, parabolic cans, steel and all other materials, including, but not limited to, composites, carbon fiber and fiberglass, used for the purposes of prestressing including grouting of ducts, post stressing concrete girders, beams, columns, etc.; loading, unloading, hoisting, handling, signaling, placing and erection of all prestressed, post stressed, precast materials, G.F.R.C., Dryvit System, including the securing by bolting and/or welding and the installation of steeltex and wire mesh of any type when used for reinforced concrete construction; erection of all curtain wall; glass handrail; stay in place deck; automated and/or mechanical parking structures; offloading, staging, hoisting and setting of modular structures and micro-units; curtain wall systems and associated sealants. Window wall and entrances, panels, insulated and non-insulated, factory and field assembled, porcelain enameled panels, ceramic, laminated spandrelite, louvers and sunscreens; application of thiokol, neoprene and other sealants used to seal materials installed by Iron Workers; installation and handling of phenolic panels, including but not limited to, Trespa products and all similarly related materials and/or systems; installation of metal window stools and sills; installation of aluminum, bronze and steel thresholds; erection and dismantling of all types of cranes and changing of booms; erection of rock, sand and gravel plants, dismantling and loading out conveyors, aggregate plants, batch plants, abeleways, refrigeration plants, etc.; erection and dismantling of Monigan walking dragline, launchhammer bucket wheel excavator and other trenching equipment; signaling on highlines, whirley cranes and derricks, buck hoists, man hoists, fork lifts, material towers and scanning antennae; metal and steel supports of all types; fabrication, assembling and erection of offshore drilling platforms or similar installations; dust collectors, precipitators, multi-plate, specialty welding processes, unloading, loading, hoisting, handling and rigging of all building materials delivered to the job site; hanging ceilings, tees, channels, beams, acoustical elements, sound barriers, computer floors, etc.;

installation of stage rigging (including counterweights), curtains, draperies, traverse rods, tracks, cables, window cleaning equipment, powered work platforms, including and loading and unloading, erection installation and removal of powered chassis mounted elevating mast climbing work platforms, rigging in connection with display shows; ski lifts, etc.; wrecking of bridges, viaducts, elevated roads and structural steel and iron in buildings; all steel frames for openings, all porches, verandas, canopies and balconies; all overhead travelers, duo rails, tram rails; erection, setting, repairing of guard or collision rails on bridges and approaches, road ways or any other structures; handling and setting of all types of steel and metal joists, including metal box joists for truss lab and preformed keystone shaped metal joists; erection of steel and metal houses and packaged buildings; all translucent and plastic material on steel frame construction; the erection of solar energy systems, including but not limited to, photo voltaic, heliostat and parabolic systems, energy producing windmill type towers, wind turbine erection to included, but not limited to, prep work, boltup, tensioning or torque of bolts on base and all tower section turbine and blade assemblies; nuclear reactors, electromagnetic shielding plates and atomic vessels including all component parts; the plumbing, aligning and leveling of all materials and equipment through the use of optical instruments, LASER beams, etc., and the use of instruments to establish layout, installation and disposition of ironworker installed scope of work; the unloading, distributing, stockpiling and handling of all materials coming under the jurisdictional claims of the UNION such as to rail heads, storage yards, loading and unloading, hoisting, handling, signaling of all fabricated material and equipment at the jobsite (except FOB deliveries) related to the Iron Workers jurisdiction that is within the individual employers' contractual scope of work including from and to barge and ships to a lay down yard or construction project, etc., shall be done by the Iron Workers.

All reinforcing work in connection with field fabrication, including but not limited to the pre-assembly of reinforcing cages, loading and unloading, handling, racking, sorting, cutting, bending, hoisting, intermittent use of forklifts, placing, burning, welding and tying of all material including the use of any and all mechanical tying devices, or substitute materials, including but not limited to, composites, carbon fiber and fiberglass, stainless steel, used to reinforce concrete construction shall be done by Iron Workers within the individual employers' scope of work at the jobsite, excluding FOB deliveries. A working Iron Worker shall be employed for maintenance on jobs of substantial size while concrete is being poured on reinforcing steel, wire mesh and paper back steeltex but will not be required as a stand-by man. All work in connection with the installation, alignment, repair & modification of panelized roofing systems, pre-engineered fabric structures, aluminum clarifier coverings, carports, ministorages, and dock planks. All work in connection with the installation, alignment, repair and modification of bleachers, planking and stadium seating. All work in connection of installation of amusement rides including, but not limited to, the erection and alignment of all track, machinery and related components.

Craft: Laborer (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Landscaper	45.62
Furniture Mover	47.12
Group 1.....	50.78
Group 1A.....	48.91
Group 2.....	50.88
Group 3.....	51.03
Group 3A.....	54.46
Group 4.....	51.28
Group 4A.....	53.78
Group 5.....	51.58
Group 5A.....	53.53
Group 5A Foreman.....	54.03
Group 6	
Nozzlemen, Rodmen.....	50.58
Gunmen, Materialmen.....	50.58
Reboundmen.....	50.93
Gunit Foreman.....	51.98

ADD ZONE RATE

In addition to LABORER rates add the applicable amounts per hour, calculated based on a road miles from either the Carson City Courthouse or the Washoe County Courthouse:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$6.00
Zone 3	150 to 300 miles	\$7.00
Zone 4	300 miles or over	\$8.00

No remote area pay shall be paid within ten (10) miles of employee's permanent place of residence in the State of Nevada.

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from midnight to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday.
New Year's Day, President's Day, Memorial Day, Fourth of July, Labor Day, Admission Day,
Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between AGC and LIUNA Local 169

The construction, erection, alteration, repair, modification, demolition, addition, improvement of all building, heavy and highway, utility, industrial and all other type(s) of construction.

SEE GROUP CLASSIFICATIONS

Craft: LUBRICATION AND SERVICE ENGINEER (MOBILE AND GREASE RACK) (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Lubrication and Service Engineer (mobile and grease rack).....74.93

ADD ZONE RATE

In addition to: **LUBRICATION AND SERVICE ENGINEER (MOBILE AND GREASE RACK)** rates add the applicable amounts per hour calculated based on a road miles from the Carson City Courthouse or Washoe County Courthouse.

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$5.00
Zone 3	150 to 300 miles	\$6.00
Zone 4	300 miles and over	\$7.00

ADD PREMIUM PAY

1. One and one-half (1-1/2) times the applicable straight-time rate for the day, shift, work, equipment and classification shall be paid for all work (including repair work and field survey work) performed on Saturday and before a shift begins and after it ends, except when operating equipment servicing a craft that is receiving double time on commercial building construction, in which case double time shall be paid.
2. Overtime. The following rates shall apply on Sundays and holidays and all work before a shift begins and after it ends:

RECOGNIZED HOLIDAYS

Holidays. Double the applicable straight-time rate shall be paid for all work (including repair, maintenance and field survey work) performed on Sundays and the following holidays: New Year's Day (January 1); Memorial Day (last Monday in May); Independence Day (July 4); Labor Day (1st Monday in September); Nevada Admission Day (last Friday in October); Thanksgiving Day (4th Thursday in November); the day after Thanksgiving Day; and Christmas Day (December 25). Holidays falling on Sunday shall be observed on the following Monday. Holiday hours shall be reckoned on the same basis as Sunday hours.

Saturday Shift Period. On any shift, Saturday shall be the twenty-four-hour period commencing at 12:00 midnight Friday.

Sunday Shift Period. On any shift, Sunday shall be the twenty-four-hour period commencing at 12:00 midnight Saturday.

3. For hours worked in excess of 12) on any such workday, an Employee shall be paid two (2) times the regular straight-time rate of pay for each hour so worked.

Craft: Mechanical Insulator (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Mechanical Insulator-Mechanic.....	78.46
Mechanical Insulator-Foreman.....	82.46
Mechanical Insulator-General Foreman	84.46

ADD ZONE RATE

In addition to MECHANICAL INSULATOR rates add the applicable amounts per DAY, calculated based on a radius figured from Reno City Hall:

Zone 1	0 to 20 miles	\$15.00
Zone 2	21 to 40 miles	\$25.00
Zone 3	41 to 60 miles	\$35.00
Zone 4	Over 60 miles	\$100.00
Zone 4: Up to \$140.00 per day with receipts		

ADD PREMIUM PAY

One and one half times the minimum hourly wage rate shall be paid for the first two (2) hours of overtime work, directly following eight (8) hours Monday through Friday, and for the first ten (10) hours worked on Saturdays. Double the minimum hourly wage rate shall be paid for all other overtime worked Monday through Friday and in excess of ten (10) hours on Saturdays.

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Good Friday, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from the Int'l Assoc. of Heat and Frost Insulators and Allied Workers Local 16 and the No. CA Chapter. Western Insulation Contractors Assoc.

65. Lining of all mechanical room surfaces and air handling shafts.
66. The filling and damming of fire stops and penetrations including, but not limited to, electrical and mechanical systems.
67. All foam applications for the purpose of thermal, acoustical, or fire protective purposes, including RTV foams or equivalents, applied to mechanical or electrical systems.
68. All duct lining, and duct wrapping, done on the job site, direct application and installation of fire protection of grease ducts, exhaust systems, or any other ductwork for acoustical or thermal purposes.
69. The insulation of all field joints on pre-insulated underground piping, and the pouring of Gilsilite or its equivalent.
70. Any finish material which is contiguous to the thermal or acoustical application.
71. The preparation, distribution of materials on job sites, assembling, molding, spraying, pouring, mixing, hanging, adjusting, repairing, dismantling, reconditioning, maintaining, finishing, and weather proofing of hot or cold thermal or acoustical insulation with such materials as may be specified.
72. The application of any material, including metal and PVC jacketing, Alumaguard or equivalent, on piping, fittings, valves, flanges, boilers, ducts, plenums, flues, tanks, vats, equipment and any other hot or cold surface for the purpose of thermal control.
73. The Agreement shall cover all other work of a specialty nature.

Craft: MILLWRIGHT (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Millwright Journeyman.....	77.22
Millwright Welder.....	80.22
Millwright Foreman.....	81.90
Millwright General Foreman.....	87.04

ADD ZONE RATE

In addition to MILLWRIGHT rates add the applicable amounts per hour, calculated from Reno, Nevada City Hall. The Employer agrees to provide each employee zone pay as established below if the project is further than forty-five (45) miles calculated via the "shortest route" filter using Google Maps from the address of city hall of respective dispatch points.

Zone 1	Up to 45 Miles	\$0.00
Zone 2	More than 45 miles but less than 101 Miles	\$4.00
Zone 3	101 or more Miles	\$6.00

ADD PREMIUM PAY

Monday through Friday, the first four (4) hours of overtime after eight (8) hours of straight-time work shall be paid at one and one half (1½) times the straight-time rate of pay. All additional overtime will be paid at two (2) times the straight-time rate of pay.

All work performed on Sunday and Holidays shall be paid at two (2) times the straight-time rate of pay. Any work performed on Labor Day shall be paid at triple (3x) the regular straight time hourly wage rate.

Lodging: If the project is further than forty-five (45) miles calculated via the "shortest route" filter using Google Maps from the address of city hall of the respective dispatch points listed above, the Employer agrees to furnish acceptable single occupancy lodging to each employee. Employers are encouraged to use commercial facilities and lodges, however, when such facilities are not available, per diem in lieu of room and lodging shall be paid at the rate of one hundred ten dollars (\$110.00) per day, or part thereof, from the date of hire for the project to the date of termination of employment on the project.

RECOGNIZED HOLIDAYS

New Year's Day, Washington's Birthday (President's Day), Memorial Day, 4th of July, Labor Day, Veteran's Day, Thanksgiving Day, Friday after Thanksgiving, Christmas Day.

JOB DESCRIPTION Excerpt from Southwest Regional Council of Carpenters' Millwright Regional Master Construction Agreement.

Section 1.4 Millwright Jurisdiction.

The machinery, equipment, processes and associated components listed below which are identified for the purpose of description only, falls within the jurisdiction of the United Brotherhood of Carpenters and Joiners of America (Millwrights). Although some components of machinery and/or equipment may be described in one application or location and not in another, it shall not be excluded from our craft jurisdiction when, to avoid repetition, it is not described in other applications, and such jurisdiction shall be applied to the initial commissioning, maintenance, decommissioning, and recommissioning of all associated machinery and/or equipment.

Section 1.4.1

Millwright craft jurisdiction shall include the loading, unloading, hoisting, rigging by any means, transferring, moving, cleaning, disassembling, assembling, moving and setting and removal of skids, welding, burning, erecting, calibrating, precision grouting, supporting, aligning, starting-up and testing, adjusting, repairing, and the maintaining of all machinery and equipment, be it powered by, or receiving power from, steam, gas, gasoline, diesel, biodiesel,

hydrogen, jet, electric, pneumatic, magnetism, adiabatics, diabatics, isothermics, water, hydropneumatics, solar, thermal, mineral, atomic, rocket, nuclear, chemical, wind, waste product of any kind or any other source, regardless of whether or not such machinery or equipment is temporarily or permanently installed or located.

Section 1.4.2

Millwright craft jurisdiction shall include all activities necessary to: set all engines, motors, dynamos, generators, diesel generators, motor restraints and supports; install, measure and align with optical and/or electronic instruments when necessary the reactors, control, push and shut-down rods, rod pressure housing, drives, guide sleeves and other related equipment in reactors, turbines, castings, combustion chambers and all its related components; the attachment and final connection of the inlet manifolds and exhaust ducts, cylinders, diaphragms, gaskets, containment barriers, rotors, blade rings, blade or bucket assemblies, hydrogen coolers, blower assemblies, packing joints on hydrogen coolers, exciter or Alterex and all others, turning gear, extension box, welding of extension box, lagging, stretching of coupling bolts or others; perform oil flush; install turbine lube oil tank, pumps and related component skids, filters, thrust bearings, magnetic bearings, the sweating on and shrinking of bearings, couplings, shafts and others, sole plates and machine bases; perform all precision grouting using the following materials: epoxy, wet, non-shrink, dripacking or other types; perform demineralizing and hydromation; install mechanical dust systems, sensors, air compressors, super charges, coolers, boiler controls and linkage, thermal management systems, Bailey Meters or similar devices and their linkages; installation, maintenance and removal of all instrumentation, gauges, antennae and other communication devices, fluid drives, power drive trains, embedded guides for traveling screens, traveling screens, roller, slide, knife, lock and sluice gates, limit torques on mechanical valves, gates and others, tainter valves, limit switches, trips, triggers or switches, including the brackets that are attached to, stop logs, dam rollers, transfer cars and gear head motors.

Section 1.4.3

The setting of variable drives, fans, coal cranes, truck cranes or other types, including servicing and the adjusting and aligning of mechanical equipment within the cranes, crane rails and all other types of rails which would carry mechanically activated equipment, including their alignment, installation, removal, servicing, and alignment of hydraulic and pneumatic lifts and passenger boarding bridges, monorail (all sizes), magnetic propulsion systems, trolleys, pumps and their associated components, packaging equipment, refrigerating equipment, chillers, and related equipment, lantern rings, packing glands, packing for pumps, pollution equipment, carbon absorbers and filtration, heat exchanges, grain, ball, hammer, roller mills, pulverizers and others, crushers and beaters, hoppers, bins, chutes and spouts, turn tables, shears, casing machines, robots, air-veyors, conveyors of all sizes, types, and styles regardless of the materials they are constructed with, or mechanically powered conveyances of any type, including their supports, people movers, x-ray and imaging & scanning machines, elevator and platform lifts, dock levelers and locks, roll-up and sectional doors, operable partitions, retractable roofs, magnetic separators, hoists, feeding machinery, Z-loaders, S-loaders, palletizers, Triax equipment, mechanical equipment in scrubbers, pack towers, precipitators, cooling towers and air cooled condensers.

Section 1.4.4

Sewage, Brackish, Desalination, Water Treatment and Mineral Extraction Plants — the disassembly, fabricating, rigging, erecting and aligning of skimmers, rake mechanisms, feed wells, baffles, scum troughs, de-gritting equipment, bar screens, comminutors, mixers, pumps, aeration systems, blowers, membrane filtration systems, sequencing batch reaction systems, including related, filter presses, sand filtration systems, ultra violet rack systems, mechanical drive assemblies, conveyors, lines, piping, flanges, brackets, supports, mono rails, gates and setting odor control and detection equipment, (excluding heating, ventilating and air conditioning work). The setting of thru-clean bar, straight line bar, trash, tritor drum, and disc screens, straight line grit, circuline grit, circuline sludge, and circuline mixer collectors, straight line, flash, horizontal slow, vertical slow, and vibra flow feeder machines, pre-aeration and settling tanks, covers for tanks, bowls and basins including stationary or mechanical covers regardless of materials, thickeners, rotoline distributors, sludge bed and settling pond cleaners, digestion systems, heaters, dyna-grind sewage screening grinders, screw pumps, spiral classifier, agitators, junk remover, hydro pulper, cooling fans, lube systems, selectifier screens, hydrosensors, fuel blowers, grizzly screens, trommels, table feeders, dryers, optical sorters, high tension separators, grip dewatering screens, flash mixer, horizontal slow mixer, vertical slow mixer, filter, cone and rotary presses, comminutors, barminutors, degreasers, rotometers, dehumidifiers, benches, pressure cleaning systems & devices, washers for cars, trucks, buses, trains, planes unmanned and autonomous vehicles and other types, hydraulic, servo and pneumatic units, shroud boxes, silencers, scales, load cells, eddy current clutches, disintegrators, dehairing machines, grain handling devices, laboratory equipment, machine shop equipment, ladle cars, stunning pens and doors and gates, activation equipment, racks, material handling platforms, access & egress platforms, catwalks,

transition pieces, the handling and installation, of pulleys, gears, fluid couplings, sheaves and fly wheels, air vacuum, worm, belt, friction, rope, magnetic, chain and gear drives that are directly or indirectly coupled to motors, belts, chains, shafts, or screws, installation of legs, boots, guards and boot tanks, all bin and diverter valves, turn hands and indicators, shafting, bearing cable sprockets, cutting of all key seats in old and new work, troughs, chippers, calenders, rolls, winders, rewinders, slitters, cutters, wrapping machines, blowers, forging machines, pneumatic, electric and hydraulic rams, servo actuators, extractors, expellers and extruders, ball and dust collectors, splicing of ropes and cables.

Millwright craft jurisdiction on energy generation facilities shall include all loading, unloading, movement, hoisting, preparation, uncrating, preparation of nacelle units prior to installation or removal, installation, setting, removal, alignment, and final torquing and tensioning of any mechanical component used in the generation of power, including any incidental wiring or piping. This shall include all aspects of power trains, drive and tracking systems, elevation and azimuth drives, energy collection optimization systems, all rams, dampers and other stabilization devices, antennae, bearing housing assemblies and units, actuators, pulleys, gears, access points, rotational connections, mounting and alignment of tracks, axles, bearings, rotational joints, or any other device which allows for the automated or manual movement of equipment post-installation, all turbines, and wind, wave and tidal analysis equipment. It shall also include all work associated with energy collection and storage facilities, including the loading, unloading, movement, hoisting, preparation, installation, setting, and alignment of racking systems, torque tubes, modules, batteries, energy storage systems, cooling or control systems, inertia systems or other equipment or machinery, and all incidental wiring or piping thereof.

Section 1.4.5

The laying out, fabrication and installation of protecting equipment including: machinery guards; the making and setting of templates for machinery; the fabrication of bolts, nuts, pans; the drilling or creating of holes in machinery for any equipment which the Millwrights install, remove, service or inspect, regardless of material; installation of all methods of access and egress and safety devices whether temporary or permanent; all welding and burning regardless of type; the fabrication of all lines, hose or tubing used in the lubrication, operation, cooling or heating of machinery, including the installation of all fluids used to operate, lubricate, cool or heat equipment installed by Millwrights; the cleaning or pressure cleaning of machinery; the machining, grinding, milling, broaching, boring, threading, lapping, field machining, technical bolting and keying that may be necessary for any part of equipment, including the starting up, breaking in, trial running and operational or functional testing of any equipment or machinery installed or handled by the Millwrights, the initial programing of robotics for startup, and the incidental connection and disconnection of machinery and equipment from piping and electrical systems.

Section 1.4.6

Rock, sand and gravel plants, mineral processing plants and batch or aggregate plants: Installation, removal and maintenance of all recycling equipment, separators, centrifuges, classifiers, grates, crushers, conveyors, chutes or piping from one piece of mechanical equipment into another piece of mechanical equipment, or from a vessel into a conveyor, or into other places or mechanical equipment or other mechanical equipment used (for the purpose of description only) to excavate material from one area to another from highways, roadways, waterways or elsewhere.

Section 1.4.7

When optical instruments such as total stations or similar devices, automatic levels, builder's transits, precision jig transits, tilting levels, theodolites or other precision tools and instruments are used to locate, set, scan-to-BIM or as-Built measure and verify machines, these tools are considered a tool of the Millwright trade and are to be used by Millwrights to set the equipment or machinery.

Section 1.4.8

Incidental asbestos removal on equipment in which Millwrights normally remove during maintenance and repair work.

Section 1.4.9

Any new equipment or technology designed to replace any of the equipment described above shall remain in the craft jurisdiction of the Millwrights.

Craft: OPERATING ENGINEER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Operating Engineers	(SEE GROUP CLASSIFICATIONS)
Group 1.....	69.91
Group 1A.....	72.67
Group 2.....	73.20
Group 3.....	73.47
Group 4.....	74.21
Group 5.....	74.51
Group 6.....	74.68
Group 7.....	74.93
Group 8.....	75.52
Group 9.....	75.84
Group 10.....	76.19
Group 10A.....	76.38
Group 11.....	76.62
Group 11A.....	78.26
Group 11B.....	79.07
Foreman.....	78.26
Add 12.5% to base rate for "Special" Shift	

Add Operating Engineers Zone Pay

Add Premium Pay

Craft: OPERATING ENGINEER (Union Rate)
STEEL FABRICATOR & ERECTOR

Prevailing wage rates include the base rate as well as all applicable fringes

Operating Engineers	(SEE GROUP CLASSIFICATIONS)
Group 1.....	85.21
Group 1 Truck Crane Oiler.....	79.04
Group 1 Oiler.....	77.08
Group 2.....	83.70
Group 2 Truck Crane Oiler.....	78.79
Group 2 Oiler.....	76.87
Group 3.....	82.46
Group 3 Truck Crane Oiler.....	78.57
Group 3 Oiler.....	76.65
Group 3 Hydraulic.....	78.24
Group 4.....	80.73
Group 5.....	79.63
Add 12.5% to base rate for "Special" Shift	

Add Operating Engineers Zone Pay

Add Premium Pay

Craft: OPERATING ENGINEER (Union Rate)
PILEDRIIVER

Prevailing wage rates include the base rate as well as all applicable fringes

Operating Engineers	(SEE GROUP CLASSIFICATIONS)
Group 1.....	84.68
Group 1 Truck Crane Oiler.....	79.22
Group 1 Oiler.....	77.30
Group 2.....	83.14
Group 2 Truck Crane Oiler.....	79.01
Group 2 Oiler.....	77.10
Group 3.....	81.69
Group 3 Truck Crane Oiler.....	78.79
Group 3 Oiler.....	76.87
Group 4.....	80.18
Group 5.....	79.07
Group 6.....	75.79
Group 7.....	77.00
Group 8.....	76.04
Add 12.5% to base rate for "Special" Shift	

ADD ZONE RATE

In addition to: **OPERATING ENGINEER, STEEL FABRICATOR & ERECTOR, and OPERATING ENGINEER PILEDRIIVER**, rates add the applicable amounts per hour calculated based on a road miles from the Carson City Courthouse or Washoe County Courthouse

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$5.00
Zone 3	150 to 300 miles	\$6.00
Zone 4	300 miles over	\$7.00

ADD PREMIUM PAY

1. One and one-half (1-1/2) times the applicable straight-time rate for the day, shift, work, equipment and classification shall be paid for all work (including repair work and field survey work) performed on Saturday and before a shift begins and after it ends, except when operating equipment servicing a craft that is receiving double time on commercial building construction, in which case double time shall be paid.

2. Overtime. The following rates shall apply on Sundays and holidays and all work before a shift begins and after it ends:

RECOGNIZED HOLIDAYS

Holidays. Double the applicable straight-time rate shall be paid for all work (including repair, maintenance and field survey work) performed on Sundays and the following holidays: New Year's Day (January 1); Memorial Day (last Monday in May); Independence Day (July 4); Labor Day (1st Monday in September); Nevada Admission Day (last Friday in October); Thanksgiving Day (4th Thursday in November); the day after Thanksgiving Day; and Christmas Day (December 25). Holidays falling on Sunday shall be observed on the following Monday. Holiday hours shall be reckoned on the same basis as Sunday hours.

Saturday Shift Period. On any shift, Saturday shall be the twenty-four-hour period commencing at 12:00 midnight Friday.

Sunday Shift Period. On any shift, Sunday shall be the twenty-four-hour period commencing at 12:00 midnight Saturday.

3. For hours worked in excess of 12) on any such workday, an Employee shall be paid two (2) times the regular straight-time rate of pay for each hour so worked.

JOB DESCRIPTION, includes but is not limited to:

Operate one or several types of power construction equipment, such as motor graders, bulldozers, scrapers, compressors, pumps, derricks, shovels, tractors, or front-end loaders to excavate, move, and grade earth, erect structures, or pour concrete or other hard surface pavement.

Craft: PAINTER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Brush/Roller Painter.....	53.14
Spray Painter/Paperhanger.....	55.72
Sandblaster.....	55.14
Structural Steel & Steeplejack.....	55.14
Swing Stage.....	55.64
Special Coating Application-Brush.....	55.14
Special Coating Application-Spray.....	55.14
Special Coating Application-Spray Steel.....	55.14
Foreman.....	\$2.50 above highest Journeyman

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift unless the Union is notified when four (4) tens (10's) are instituted.
2. For any hours worked on Saturday from midnight to midnight
3. For any work performed in excess of the regular work week of forty (40) hours.

Double the regular straight time hourly rate shall be paid for all time:

1. For any hours worked on Sunday from midnight to midnight
2. For any hours worked on holidays from midnight to midnight

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between Painters and Allied Trades DC 16 and Independent Painting Contractors of No Nevada.

a. All painting of residences, buildings, structures, industrial plants, tanks, vats, pipes, vessels, bridges, light poles, high tension poles, traffic and parking lines on highways, parking lots, playgrounds, factories, and air line strips; all sign, pictorial, coach, car automobile, carriage, aircraft machinery, ship and railroad equipment, mural and scenic painting; spackling of all surfaces where adhesive materials are used; and all drywall pointing, taping and finishing.

b. All decorators, paperhangers, hard wood finishers, grainers, glaziers, varnishers, enamellers

1. Paperhangers work shall be all material of whatever kind or quality applied to walls or ceilings with paste or adhesive; all tacking on the muslin or other materials which is used as wall or ceiling coverings or covered with material pasted on.

2. The scraping off of old paper, preparing of walls, etc., for paper hangers work.

3. The application of relief, stucco, plaster or decorative work shall not be considered paperhanger's work exclusively.

(c) All men engaged in applying or removing paints, pigments, extenders, metal primers and metal pigments, clear pigments, binders, thinners and dryers, primers and sealers, oil paints and enamels, water

colors and emulsions, clear coatings, waxes, stains, mastics, cement enamels and other special coatings, plastics, adhesives, coatings and sheet rubber and other linings, oils, varnishes, water colors, wall paper, wall coverings or other materials used in the various branches of the trade, and the cleaning and bleaching of all interior and exterior walls and surfaces with liquid, steam, sandblast or any other process and all work incidental thereto.

Craft: PILEDRIVER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Piledriver-Journeyman.....	61.92
Piledriver-Welder.....	62.92
Piledriver-Foreman.....	65.81
Piledriver-General Foreman.....	70.09
Tender.....	65.81
Stand-By Diver.....	66.81
Diver-Diving (Wet Pay).....	110.58

ADD ZONE RATE

In addition to PILEDRIVER rates add the applicable amounts per hour, calculated from the Washoe County Courthouse:

Zone 1	Within 75 miles	\$0.00
Zone 2	Between 75 to 150 road miles	\$6.00
Zone 3	Between 150 to 300 road miles	\$7.00
Zone 4	In excess of 300 road miles	\$8.00

Workmen performing outside of the free zones shall receive the appropriate remote area allowance for not less than eight (8) hours per day. Remote area differential shall be considered part of the basic wage rate for the purpose of computing overtime hourly wage rates.

ADD PREMIUM PAY

First two (2) hours outside the regular constituted shift shall be at the rate of time and one-half (1½X). Saturdays up to the first twelve (12) hours shall be at the rate of time and one-half (1½X). All additional hours and Sundays and holidays shall be the rate of double time (2X). No work shall be performed on Labor Day, except to preserve life and property.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, 4th of July, Labor Day, Admission Day, Thanksgiving Day, the Friday after Thanksgiving, Christmas Day.

JOB DESCRIPTION

104.1 The Carpenters claim the layout, rigging, tagging, signaling, cutting, burning, welding, chain sawing, driving, setting and pulling of all soldier piles and soldier beams together with all necessary waling, shoring, underpinning, struts, bracing, capping and lagging necessary for construction of subterranean structures of all types to include, but not limited to subways, subway stations, buildings, storm drains, sewers, pipelines and all open cut and cover construction projects. The Carpenters further claim construction of all covers and access mats to include all necessary rigging for setting and removing, whether intermittently or regularly and installation and removal of timber decking.

(a) In addition to the work identified in Article I, the Pile Drivers claim the operation of the following types of equipment when the operation of same is incidental to that work which falls under the jurisdiction of the United Brotherhood of Carpenters and Joiners of America or Pile Drivers Local Union No. 2375; mechanical forklifts of all types, boom trucks and any other mobile equipment as assigned by the employer necessary to complete the work. In addition, the operation of the power pack and vibratory hammer controls when driving or pulling, sheet pile, pile, soldier beams, cassinos or casing. . The work includes work on cast & drill holes and operation of the ABI machine.

(1) In the construction of waterfront and marine facilities, such as docks, piers, wharves, bulkheads, jetties, and similar structures, the pile driver classification should continue to apply, up to and including the decking thereof.

- (2) On all pile driving and caisson work on both land and water, the Pile Driver classification should apply.
- (3) In the construction of wooden bridges whether over land or over water, when composed of heavy timber, the Pile Driver classification should apply.
- (4) In the construction of concrete or steel bridges over land, the Pile Driver classification shall apply to the driving of piles and/or caisson work including the forms required for the capping of the piles or caissons immediately top of the piles or caissons. The capping of the piles is herein interpreted as being that concrete, wood, or other material resting on the top of the piles where driven or placed and does not include any further form work above the capping. In many instances it has been found that the capping is called the girder. The above shall apply on such concrete or steel bridges constructed over land, highways, railroads, overpasses and include cloverleaves, interchanges, etc.
- (5) In the construction of concrete or steel bridges over water, the Pile Driver classification shall apply up to and including all of the form work to the top of the column, piers, or abutments supporting the steel and/or any other superstructures.
- (6) In the erection of false work, when necessary for the support of work under the Pile Driver classification, then such false work shall fall within their classification. False work necessary for the support of work under the Carpenter classification shall be done within such Carpenter classification, with the exception that where pile driving or power equipment is used for heavy timber false work, then such work shall come under the Pile Driver classification. This would include all rigging, signaling and tagging incidental to the placing of the heavy timber.
- (7) In the construction of open-cut sewers, the Pile Driver classification shall apply on all piling including wood, steel or concrete sheet piling, all bracing timber and form work incidental to the construction thereof.

Craft: PLASTERER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Plasterer-Journeyman.....	55.62
Plasterer-Foreman.....	59.57

ADD ZONE RATE

In addition to PLASTERER rates add the applicable amounts per hour, calculated from the South Virginia and Mill Street, Reno, Nevada:

Zone 1	0 to 70 miles	\$0.00
Zone 2	70 miles and over	\$8.00

ADD PREMIUM PAY

OVERTIME: Eight (8) consecutive hours (exclusive of a meal period) shall constitute a day's work at straight time. Five (5) consecutive days of eight (8) consecutive hours (exclusive of a meal period), Monday through Friday, shall constitute a week's work. One and one half (1 ½) the regular straight time hourly rate shall be paid for the first two (2) hours worked over eight (8) hours Monday through Friday. Double the regular straight time rate shall be paid for all hours worked over ten (10) hours Monday through Friday. One and one half (1 ½) the regular straight time rate shall be paid for the first ten (10) hours on Saturday. Double the regular straight time rate shall be paid for all hours worked over ten (10) hours on Saturday. All hours worked on Sunday shall be paid at double the regular straight time rate.

RECOGNIZED HOLIDAYS

All work performed on the following holidays shall be paid for at double the regular straight time rate: New Year's Day, Memorial Day, Fourth of July, Labor Day, Admissions Day, Thanksgiving Day and the Friday after Thanksgiving and also Christmas Day.

If any of the above holidays fall on Sunday, the Monday following shall be considered a holiday.

No work shall be permitted on the Fourth of July or Labor Day, regardless of compensation or donation, except in case of emergency or to protect life and property. Permission to work shall be granted by the representative of the Union or its officer.

JOB DESCRIPTION: Excerpt from Agreement No NV. Plasterers Master Labor Agreement

This includes but is not limited to:

1. All building construction, including but not limited to the construction, erection, alteration, repair, modification, demolition, addition, or improvement in whole or in part of any building structures.
2. All interior or exterior plastering construction, restoration, repair and inspection of cement, stucco, stone imitation or any patent material when ornamental molded plaster, and the setting of same. All specialty finishes such as veneer, venetian, marmoreno and grasello. All custom and specialty finishes, including but not limited to custom rock, carved plaster, brick and block veneer, stone and wood. Smooth and finish surfaces of full system E.I.F.S. including sticking and shaping of foam pieces or surfaces by adhesive or mechanical installation. All spray or troweled on fireproofing, including cementitious and intumescent products. All plaster acoustical finish systems including, but not limited to, BASWA Phon and Fellert.
3. All work processes which represent technological change, replacement, modification or substitution for the work described above. In addition, all work and use of new materials or *2020-2024 Reno Plasterers Master Labor Agreement* 4 techniques involved in plaster construction including but not limited to what is known as green or sustainable construction technology.

Craft: PLUMBER/PIPEFITTER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Plumber/Pipefitter-Journeyman.....	76.10
Plumber/Pipefitter-Foreman.....	81.19
Plumber/Pipefitter-General Foreman.....	86.28

ADD ZONE RATE

In addition to PLUMBER/PIPEFITTER rates add the applicable amounts per statute air mile radius from the Nevada freeway interchange of Interstate 80 and 580.

Zone 1	0 to 75	\$0.00
Zone 2	Over 75 miles	\$8.00

A separate free zone will be established for employees permanently residing and working within a seventy-five (75) statute air mile radius of the Elko, Nevada Post Office.

Zone 1	0 to 75	\$0.00
Zone 2	Over 75 miles	\$8.00

ADD PREMIUM PAY

Premium pay for hours worked in excess of a shift of 8 hours or 12 hours or such other time increment set forth in the Collective Bargaining Agreement or on a weekend or holiday.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Fourth of July, Labor Day, Nevada Admission Day, Thanksgiving Day, the Friday after Thanksgiving Day, Day Before Christmas and Christmas Day and any Friday preceding a Holiday falling on a Saturday, if worked, holidays shall be compensated at the double time rate.

JOB DESCRIPTION Excerpt from Agreement between LU 350 of United Assoc. of Journeymen and Apprentices of the Plumbing and Pipefitting Industry of United States and Canada

Installation of all heating and refrigeration systems and competent parts thereof, including fabrication, assembling, erection installation, dismantling, repairing, reconditioning, adjusting, altering servicing, handling, distributing, and tying on all piping materials appurtenances and equipment by method, including all hangars and supports of every description, all other work including the the trade relevant to oil burner and all other types of heating and refrigeration equipment including low voltage controls.

Craft: REFRIGERATION MECHANIC (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Refrigeration-Journeyman.....	67.14
Refrigeration -Foreman.....	67.64

ADD PREMIUM PAY

Premium pay for hours worked in excess of a shift of 8 hours or 12 hours or such other time increment set forth in the Collective Bargaining Agreement or on a weekend or holiday.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Fourth of July, Labor Day, Nevada Admission Day, Thanksgiving Day, the Friday after Thanksgiving Day, Day Before Christmas and Christmas Day and any Friday preceding a Holiday falling on a Saturday, if worked, holidays shall be compensated at the double time rate.

JOB DESCRIPTION Excerpt from Agreement between LU 350 of United Assoc. of Journeymen and Apprentices of the Plumbing and Pipefitting Industry of United States and Canada

Installation of all heating and refrigeration systems and competent parts thereof, including fabrication, assembling, erection installation, dismantling, repairing, reconditioning, adjusting, altering servicing, handling, distributing, and tying on all piping materials appurtenances and equipment by method, including all hangars and supports of every description, all other work including the trade relevant to oil burner and all other types of heating and refrigeration equipment including low voltage controls.

Craft: ROOFER (Non-Union Rate)
(Does not include sheet metal roofs)

Prevailing wage rates include the base rate as well as all applicable fringes

Roofer-Journeyman.....33.64

JOB DESCRIPTION

Includes but is not limited to:

1. Installing and covering roofs and structures with slate, asphalt, wood and other related materials, other than sheet metal, by using brushes, knives, punches, hammers and other tools;
2. Spraying roofs, sidings and walls with material to bind, seal, insulate or soundproof sections of a structure;
3. Installation of all plastic, slate, slag, gravel, asphalt and composition roofing, and rock asphalt mastic when used for damp and waterproofing;
4. Installation of all damp resisting preparations when applied on roofs with mop, three-knot brush, roller, swab or spray system;
5. All types of preformed panels used in waterproofing;
6. Handling, hoisting and storing of all roofing, damp and waterproofing materials;
7. The tear-off and/or removal of roofing and roofing materials.

Craft: SHEET METAL WORKERS (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Sheet Metal Worker Journeyman.....	77.37
Sheet Metal Worker -Foreman.....	82.06
Sheet Metal Worker -General Foreman.....	86.75

ADD ZONE RATE

A separate free zone will be established for employees permanently residing and working within a seventy-five (75) mile radius of the Elko, Nevada Post Office. In addition to SHEET METAL rates add the applicable amounts per hour, calculated based on a road from the courthouse in Reno, Nevada:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 100 miles	\$5.00
Zone 3	Over 100 miles	\$10.00 the employee shall be provided reasonable lodging and meal expenses.

ADD PREMIUM PAY

All hourly rates are subject to Over Time (One and one half 1 ½) of the Regular rate:

1. For all hours worked over Eight (8) Hours in one day or shift.
2. For the first Eight (8) Hours work on Saturday.

All hourly rates are subject to Double Time of the Regular Rate:

1. For all hours worked over Ten (10) Hours in one day or shift.
2. For all hours worked over Eight (8) Hours on Saturday.
3. For all hours worked on Sunday, New Year's Day, Memorial Day, Independence Day, Friday before Labor Day, Labor Day, Nevada Day, Thanksgiving Day, Day after Thanksgiving, Day before Christmas, and Christmas Day.

RECOGNIZED HOLIDAYS

New Year's Day, Memorial Day, Independence Day, Friday before Labor Day, Labor Day, Nevada Day, Thanksgiving Day, Day after Thanksgiving, Day before Christmas, and Christmas Day

JOB DESCRIPTION: Excerpt from Sheet Metal Local 26 Collective Bargaining Agreement

(a) manufacture, fabrication, assembling, handling, erection, installation, dismantling, conditioning, adjustment, alteration, repairing and servicing of all ferrous or nonferrous metal work and all other materials used in lieu thereof and of all HVAC systems, air veyor systems, exhaust systems, and air-handling systems regardless of material used including the setting of all equipment and all reinforcements in connection therewith; (b) all lagging over insulation and all duct lining; (c) testing and balancing of all air-handling equipment and duct work; (d) the preparation of all shop and field sketches whether manually drawn or computer assisted used in fabrication and erection, including those taken from original architectural and engineering drawings or sketches; (e) metal exterior wall systems, metal roofing; and (f) all other work included in the jurisdictional claims of International Association of Sheet Metal, Air, Rail and Transportation Workers.

Craft: SOILS and MATERIAL TESTER (Non-Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Soil Tester (Certified).....	46.81
Soils and Materials Tester.....	46.81

Craft: SPRINKLER FITTER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Sprinkler Fitter-Journeyman.....	65.31
Sprinkler Fitter Foreman.....	68.31
Sprinkler Fitter General Foreman.....	70.56

ADD ZONE RATE

In addition to SPRINKLER FITTER rates add the applicable amounts per hour, calculated based on a road from the courthouse in Reno, Nevada:

Zone 1	0 to 60 miles	\$0.00
Zone 2	60 to 80 miles	\$23.00
Zone 3	80 to 100 miles	\$33.00
Zone 4	Over 100 miles	\$125.00

JOB DESCRIPTION

Installing, dismantling, maintenance, repairs, adjustments and corrections of all fire protection and fire control systems Including the unloading, handling by hand, power equipment and installation of all piping or tubing, appurtenances and equipment pertaining thereto, including both overhead and underground water mains, fire hydrants and hydrant mains, standpipes, and hose connections to sprinkler systems, sprinkler tank heaters, air lines and thermal systems used in connection with sprinkler and alarms systems, also all tanks and pumps connected thereto. Also including shall be CO2 and Cardox Systems, Dry Chemical Systems, Foam Systems and all other fire protection systems, but excluding steam fire protection systems.

Craft: SURVEYOR (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes.

Rodman/Chainman	72.97
Instrumentman.....	74.43
Chief of Party Surveyor.....	75.69

ADD ZONE RATE

In addition to: **OPERATING ENGINEER, STEEL FABRICATOR & ERECTOR, and OPERATING ENGINEER PILEDRIVER**, rates add the applicable amounts per hour calculated based on a road mile from the Carson City Courthouse or Washoe County Courthouse

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$5.00
Zone 3	150 to 300 miles	\$6.00
Zone 4	300 miles over	\$7.00

ADD PREMIUM PAY

1. One and one-half (1-1/2) times the applicable straight-time rate for the day, shift, work, equipment and classification shall be paid for all work (including repair work and field survey work) performed on Saturday and before a shift begins and after it ends, except when operating equipment servicing a craft that is receiving double time on commercial building construction, in which case double time shall be paid.

2. Overtime. The following rates shall apply on Sundays and holidays and all work before a shift begins and after it ends:

Saturday Shift Period. On any shift, Saturday shall be the twenty-four-hour period commencing at 12:00 midnight Friday.

Sunday Shift Period. On any shift, Sunday shall be the twenty-four-hour period commencing at 12:00 midnight Saturday.

3. For hours worked in excess of 12 on any such workday, an Employee shall be paid two (2) times the regular straight-time rate of pay for each hour so worked.

RECOGNIZED HOLIDAYS

Holidays. Double the applicable straight-time rate shall be paid for all work (including repair, maintenance and field survey work) performed on Sundays and the following holidays: New Year's Day (January 1); Memorial Day (last Monday in May); Independence Day (July 4); Labor Day (1st Monday in September); Nevada Admission Day (last Friday in October); Thanksgiving Day (4th Thursday in November); the day after Thanksgiving Day; and Christmas Day (December 25). Holidays falling on Sunday shall be observed on the following Monday. Holiday hours shall be reckoned on the same basis as Sunday hours.

JOB DESCRIPTION includes but is not limited to:

1. Planning ground surveys designed to establish base lines, elevation and other geodetic measurements;
2. Compiling data relevant to the shape, contour, gravitation, location, elevation and dimension of land and land features on or near the surface of the Earth for engineering, map making, mining, land evaluation, construction and other purposes;
3. Surveying bodies of water to determine navigable channels and to secure data for construction of breakwaters, piers and other marine structures;
4. Computing data necessary for driving and connecting underground passages, underground storage and volume of underground deposits.

Craft: TAPER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Taper-Journeyman.....	59.26
Taper-Foreman.....	63.54

ADD ZONE RATE

In addition to: TAPER rates add the applicable amounts per hour Zone Pay shall commence from the Washoe County Courthouse in Reno, Nevada, and shall be paid as follows:

Zone 1	0 to 40 miles	\$0.00
Zone 2	40 to 60 miles	\$2.50
Zone 3	over 60 miles	\$4.25

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day. When holiday falls on a Sunday, the Monday following shall be observed as the holiday; holidays falling on Saturday shall be observed on the prior Friday.

ADD PREMIUM PAY

All overtime, except Sundays and holidays, will be time and one-half (1 1/2).

Sundays and holidays will be paid double time (2X). Any and all work performed in excess of the regular workday of eight (8) hours, or ten (10) hours if mutually agreed to, and the regular workweek of forty (40) hours shall be considered overtime and shall be paid for at one and one-half (1 1/2) times the regular hourly rate.

JOB DESCRIPTION: Excerpt from Agreement between DC 16 and the independent Drywall Contractors of Northern Nevada

SECTION 1 -- The scope of work covered by this Agreement shall include (but not be limited to) all work operations, including distribution to the point of application, as follows:

(a) Work or services pertaining to the preparation, spotting, pointing, detailing, flushing, sanding and finishing of interior and/or exterior gypsum, drywall, thin wall, concrete, steel, wood and plaster surfaces, spackling of all surfaces where adhesive materials are used; and all drywall pointing, taping and finishing.

(b) Work or services pertaining to the application of all finish or flushing materials regardless of method of application or type of surface on which materials are applied, including but not limited to texture and simulated acoustic materials of all types and the application of radiant heat fill and steel fireproofing materials.

(c) Work or services pertaining to the installation of protective coverings and masking prior to the application of finish materials.

(d) The operation and care of all taping tools and texturing equipment used in the finishing and texturing of drywall and other surfaces including brushes, rollers, spray texturing equipment, miscellaneous hand, mechanical, and power tools, and the operation and maintenance of compressors required in the finishing and texturing of such surfaces.

(e) No limitation shall be placed on the work covered by this Agreement by reason of the surface, type of material or purpose for which the materials used are designed or intended.

(f) The cleanup of all materials and debris occasioned by any job operation at the site of construction, alteration, or repair undertaken whether such operation occurs on the interior or exterior of a building structure.

Craft: TILE SETTER/TERRAZZO WORKER/MARBLE MASON FINISHER (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Tile Setter/Terrazzo Worker/Marble Mason - Finisher.....	42.32
Tile Setter/Terrazzo Worker/Marble Mason - Finisher Foreman.....	44.32
Tile Setter/Terrazzo Worker/Marble Mason Finisher- General Foremen.....	68.32

ADD ZONE RATE

In addition to TILE/TERRAZZO WORKER/MARBLE MASON FINISHER wage rates, employees shall receive the following hourly zone pay for all jobs located more than forty (40) miles from the Washoe County Courthouse in Reno, Nevada:

Zone 1	0 to 40 miles	\$0.00
Zone 2	40 to 50 miles	\$3.75
Zone 3	50 to 70 miles	\$5.00
Zone 4	Over 70 miles	\$10.00

ADD PREMIUM PAY

All work in excess of forty (40) hours during the established work week shall be paid at the rate of one and one-half (1-1/2) times the hourly base wage rate in effect.

Employees shall be paid one and one-half (1-1/2) times the hourly wage rate for all hours worked over eight (8) in a single day and double time after ten (10) hours in a single day, Monday through Friday, except recognized holidays.

Daily Overtime Saturdays the first ten (10) hours performed on Saturday shall be paid at one and one-half (1-1/2) times the straight time wage rate.

Daily Overtime Sunday- Employees shall be paid double time on Sundays if forty (40) straight time hours have been worked during the proceeding work week.

Holidays shall be paid double time for hours owed on recognized holidays.

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day. Any holiday falling on a Sunday will be observed on Monday.

JOB DESCRIPTION: Excerpt from Agreement between BAC 13 Nevada of the Mountain West Administrative District Council Master Labor Agreement

FINISHER'S WORK:

Finisher's work shall consist of assisting, helping or supporting the tile, marble and terrazzo mechanic by performing their historic and traditional work assignments. required to complete the proper installation of the work covered by Sections 5, 7 and 8 of this Code.

Craft: TILE SETTER/TERRAZZO WORKER/MARBLE MASON (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Tile Setter - Journeyman.....	52.37
Tile Setter - Foreman.....	54.37
Tile Setter - General Foreman....	58.37
Terrazzo/Marble Mason - Journeyman	53.87
Terrazzo/Marble Mason - Foreman	55.87
Terrazzo/Marble Mason - General Foreman.....	59.87

ADD ZONE RATE

In addition to TILE SETTER/TERRAZZO/MARBLE MASON wage rates, employees shall receive the following hourly zone pay for all jobs located more than forty (40) miles from the Washoe County Courthouse in Reno, Nevada:

Zone 1	0 to 40 miles	\$0.00
Zone 2	40 to 50 miles	\$3.75
Zone 3	50 to 70 miles	\$5.00
Zone 4	Over 70 miles	\$10.00

ADD PREMIUM PAY

All work in excess of forty (40) hours during the established work week shall be paid at the rate of one and one-half (1-1/2) times the hourly base wage rate in effect.

Employees shall be paid one and one-half (1-1/2) times the hourly wage rate for all hours worked over eight (8) in a single day and double time after ten (10) hours in a single day, Monday through Friday, except recognized holidays.

Daily Overtime Saturdays the first ten (10) hours performed on Saturday shall be paid at one and one-half (1-1/2) times the straight time wage rate.

Daily Overtime Sunday- Employees shall be paid double time on Sundays if forty (40) straight time hours have been worked during the proceeding work week.

Holidays shall be paid double time for hours owed on recognized holidays.

RECOGNIZED HOLIDAYS

New Year's Day, President's Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day. Any holiday falling on a Sunday will be observed on Monday.

JOB DESCRIPTION: Excerpt from Agreement between BAC 13 Nevada of the Mountain West Administrative District Council Master Labor Agreement

TILE LAYERS' WORK:

Tile laying shall consist of, but not be limited to, the following work procedures and installation of the following materials:

A. The laying, cutting or setting of all tile where used for floors, walls, ceilings, walks, promenade roofs, stair treads, stair risers, facings, hearths, fireplaces, and decorative inserts, together with any marble plinths, thresholds or window stools used in connection with any tile work; also, preparing and setting all concrete, cement, brickwork, or other foundation or materials that may be required to properly set and complete such work; setting or bedding all tiling, stone, marble, composition, glass, mosaic, or other materials forming the facing, hearth or fireplace of a mantel, or the mantel complete, together with setting of all cement, brickwork, or other materials required in connection with the above work; also the slabbing and fabrication of tile mantels, counters and tile panels of every description, and the erection and installation of same; the building, shaping, forming, construction or repairing of all fireplace work, whether in connection with a mantel hearth facing or not, and the setting and preparing of all material, such as cement, plaster, mortar, brickwork, iron work or other materials necessary for the proper and safe construction and completion of such work, except that a mantel made exclusively of brick, marble or stone, shall be conceded to be bricklayers', marble setters' or stonemasons' work, respectively.

B. It will be understood that the word "tile" refers to all burned clay products, as used in the tile industry, either glazed or unglazed, and to all composition materials made in single units up to 15"x20"x2", except quarry tiles larger than 9"x9"x1 1/4", also to mixtures in tile form of cement, plastics and metals that are made for and intended for use as a finished floor surface, whether upon interior or exterior floors, stair treads, promenade roofs, garden walks, interior walls, ceilings, swimming pools, and all places where tile may be used to form a finished surface for practical use, sanitary finish or decorative purposes, for setting all accessories in connection therewith, or for decorative inserts in other materials.

C. All terra cotta called unit tile in sizes of 6"x12" or under, regardless of method of installation, quarry tile 9"x9"x1 1/4" or less; split brick or quarry tile or similar material where the bed is floated or screeded and the joints grouted. Where the work is installed by tile layers, the grouting and cleaning shall be supervised by the mechanic. The bedding, jointing, and pointing of the above materials shall be the work of the craft installing the same. All clay products known as terra cotta tile, unit tile, ceramic veneer and machine-made terra cotta, and like materials in sizes 6"x12" and less regardless of the method of installation. Where the preponderance of materials to be installed comes within the provisions of this Section and when there is also some material in excess of the sizes provided for in this Section, the tile setter shall install all such materials.

D. The preparation, setup, calibration, operation, cleaning, and routine maintenance of any mechanical devices or robotics used to install tile and related materials, or that otherwise assist the tile layer in performing any of the work described in Article II and Code 1 of the IU Constitution, as well as the preparation and ongoing maintenance of the work area to allow proper installation of tile and related materials.

Craft: TRAFFIC BARRIER ERECTOR (Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Traffic Barrier Erector.....50.78

ADD ZONE RATE

In addition to LABORER rates add the applicable amounts per hour, calculated based on a road miles from either the Carson City Courthouse or the Washoe County Courthouse:

Zone 1	0 to 75 miles	\$0.00
Zone 2	75 to 150 miles	\$5.00
Zone 3	150 to 300 miles	\$6.00
Zone 4	300 miles and over	\$7.00

No remote area pay shall be paid within ten (10) miles of employee's permanent place of residence in the State of Nevada.

ADD PREMIUM PAY

One and one half (1 ½) the regular straight time hourly rate shall be paid:

1. For all hours worked over eight (8) hours in one day or shift.
2. For any hours worked on Saturday from midnight to midnight.

Double the regular straight time hourly rate shall be paid for all time:

1. For all hours worked over twelve (12) hours in one day or shift.
2. For any hours worked on Sunday from midnight to midnight.
3. For any hours worked on holidays from midnight to midnight.

RECOGNIZED HOLIDAYS

If any of these holidays fall on Sunday, the Monday following shall be considered a Holiday.

New Year's Day, President's Day, Memorial Day, Independence Day, Labor Day, Veteran's Day, Thanksgiving Day, Day after Thanksgiving Day, Christmas Day.

JOB DESCRIPTION: Excerpt from Agreement between AGC and LIUNA Local 169

1. Distributing traffic control signs and markers along site in designated pattern;
2. Informing drivers of detour routes through construction sites;

Craft: Truck Driver (Non-Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Dump Trucks (Single or Multiple Units Including Semi's & Double Transfer Units), Dumpcretes and Bulk Cement Spreader

Under 4 yds. (water level).....	32.25
4 yds. & under 8 yds. (water level).....	32.25
8 yds. & under 18 yds. (water level).....	32.25
18 yds. & under 25 yds. (water level)	32.25
25 yds. & under 60 yds. (water level).....	32.25
60 yds. & under 75 yds. (water level)).....	32.25
75 yds. & under 100 yds. (water level)).....	32.25
100 yds. & under 150 yds. (water level)).....	32.25
150 yds. & under 250 yds. (water level)).....	32.25
250 yds. & under 350 yds. (water level)).....	32.25
350 yds. & over (water level).....	32.25

Transit Mix

Under 8 yds.....	32.25
Under 8 yds & including 12 yds.....	32.25
Over 12 yds.....	32.25

Transit Mix (Using Boom)

Transit mix with boom shall receive 16 cents per hour above the appropriate yardage classification rate of pay when such boom is used.....	32.25
--	-------

Water & Jetting Trucks

Up to 2,500 gallons.....	32.25
Up to 2,500 gallons & over.....	32.25
DW 20's & 21's & other similar Cat type, Terry Cobra LeTourneau pulls, Tournerocker, Euclid, & similar type equipment when pulling Aqua/Pak, Water Tank Trailers, & Fuel, and/or Grease Tank Trailer, or other miscellaneous Trailers, (except as defined under "Dump Trucks")	
Heavy Duty Transport (High Bed).....	32.25
Heavy Duty Transport(Gooseneck low bed).....	32.25
Tiltbed or Flatbed Pull Trailers..	32.25
Bootman, Comb. Bootman & Road Oiler.....	32.25
Flat Rack (2 or 3 axle unit).....	32.25

Bus & Manhaul Drivers

Up to 18,000 lbs. (single unit).....	32.25
18,000 lbs. and over	32.25
Warehousemen Spotter	32.25

Winch Truck & "A" Frame Drivers

Up to 18,000 lbs.	32.25
18,000 lbs. and over.....	32.25
Warehousemen Spotter.....	32.25
Warehouse Clerk.....	32.25
Tire Repairmen.....	32.25
Truck Repairmen.....	32.25
Pick Up Truck & Pilot Cars (Jobsite)	32.25
Pick Up Truck & Pilot Cars (Over the road)	32.25
Truck Oil Greaser.....	32.25
Fuel Truck Driver.....	32.25
Fuel Man & Fuel Island Man.....	32.25
Oil Tanker.....	32.25

Oil Tanker with Pup.....	32.25
Foreman.....	32.25

TRUCK DRIVER

Includes but is not limited to:

Driving a tractor trailer combination or a truck to transport goods or materials at the site of a public work or between sites of a public work. (Also, see descriptions listed with Truck Driver rates, if any.)

Craft: WELL DRILLER (Non-Union Rate)

Prevailing wage rates include the base rate as well as all applicable fringes

Well Driller.....60.78

JOB DESCRIPTION

1. Setting, operating or tending to portable drilling rig machinery and related equipment to drill wells;
2. Extending stabilizing jackscrews to support and level a drilling rig;
3. Installing water well pumps;
4. Drillings wells for industrial water supplies, irrigation water supplies or water supplies for any other purpose; dewatering or other similar purposes; exploration; hole drilling for geologic and hydrologic information; and core drilling for geologic information.

GROUP CLASSIFICATIONS

LABORER, includes but is not limited to:

Group 1

- All cleanup work of debris, grounds, and building including windows and tile
- Dumpmen or Spotter (other than asphalt)
- Handling and Servicing of Flares, Watchmen
- General Laborer
- Guideposts and Highway Signs
- Guardrail Erection and Dismantling
- Limber, Brushloader and Piler
- Pavement Marking and Highway Striping
- Traffic Barrier Erector
- Tending to portable space heaters
- Profilograph work all types manual, self propelled or carts
- Gabion basket, building, handling, installation and rigging
- Dry set paver work
- Traffic Barrier Erector

Group 2

- Choker setter or Rigger (clearing work only) Pittsburgh
- Chipper and similar type brush shredders
- Concrete worker (wet or dry) all concrete work not listed in Group 3 included but not limited to: concrete forms stripping, handling, cleaning, oiling and moving to the next point of installation.
- Crusher or Grizzly Tender
- Greasing Dowels
- Guinea Chaser (Stakemen)
- Panel Forms (wood or metal) handling, cleaning and stripping of Loading and unloading, (Carrying and handling of all rods and material for use in reinforcing concrete
- Railroad Trackmen (maintenance, repair or builders)
- Sloper
- Semi-Skilled Wrecker (salvaging of building materials other than those listed in Group 3)
- Waterproofing work
- Epoxy rebar/dowels and anchoring dowel baskets
- Placement pouring of concrete including any epoxy resin or similar materials, rodding, spreading and tamping concrete, brooming or brushing, hand application of curing compounds, applying topping (wet or dry) colors or grits, and exposed finishes for architectural work
- Concrete patching, dry packing, chipping, stoning, and grouting
- Concrete cold weather/rain protection and curing
- Placement /anchoring of all earth stabilization/filters fabrics,
- Mechanically stabilized Earth (MSE) and Keystone type retaining walls rigging, placing , aligning, backfilling and installation of dead men and any stabilization components

Group 3

- Asphalt Workers (Ironers, Shovelers, Cutting Machine)
- Buggymobile
- Chainsaw, Faller, Logloader and Bucker

- Compactor (all types)
- Concrete Mixer under 1/2 yard
- Concrete Pan Work (Breadpan type), handling, cleaning\stripping
- Concrete Saw, Chipping, Grinding, Sanding, Vibrator
- Cribbing, Shoring, Lagging, Trench Jacking, Hand-Guided Lagging Hammer
- Curbing or Divider machine
- Curb Setter (precast or cut)
- Ditching Machine (hand-guided)
- Drillers Helper, Chuck Tender
- Fence erector including safety, chain link, turtle, field and barbe wire fencing
- Form Raiser, Slip Forms
- Grouting of Concrete Walls, Windows and Door Jams
- Headerboardmen
- Jackhammer, Pavement Breaker, Air Spade
- Mastic Worker (wet or dry)
- Pipewrapper, Kettlemen, Potmen, and men applying asphalt, creosote and similar type materials
- All Power Tools (air, gas, or electric), Post Driver
- Riprap-Stonepaver and RockSlinger, including placing of sack concrete wet or dry
Rototiller
- Rigging and Signaling in connection with Laborers' work
- Sandblaster, Potmen, Gunmen or Nozzlemen water blasting not covered in group 5A
- Vibra-screed
- All demolition and wrecking work including but not limited to any torch work cutting, burning, plasma arc, dust control, and salvaging (removing and salvaging of all materials, windows, doors, plumbing, and electrical fixtures) and use of customary tools and equipment for demolition and wrecking
- All underpinning foundation work, digging and underpinning pits, removal of debris with tuggers or other methods, cutting, handling and installing all shoring boards and lagging boards used for underpinning and foundation work, placement and tying of steel reinforcing for underpinning piers, all tiebacks and soil nail work drilling and grouting, all soldier beam work and use of customary tools and equipment for underpinning foundation work

Group 3A

- Concrete Specialist
- Setting screeds
- Screed pins
- Curb forms and curb and gutter forms,
- Using Darby and push floats,
- Hand trowels or hand floating
- Marking edging
- Using base cove or step tools
- Spreading and finishing gypsum
- Concrete grinding machines (the terms does not include Rotomill machines for highway overlay grinding)
- Troweling machines,
- Floating machines
- Finishing of epoxy or resin materials,
- Operation of skill saw
- Laser Screed
- Laser Level

- Curb and Slipform machines,
- Stamps or other means or texturing,
- Any new devices which are beneficial to the construction of or with concrete or related products.

Group 4

- Burning and Welding in connection with Laborers' work
- Joy Drill Model TWM-2A, Gardner Denver Model DN143 and similar type drills (in accordance with Memorandum of Understanding between Laborers and Operating Engineers dated at Miami, Florida, Feb. 3, 1954) and Track Drillers, Diamond Core Drillers, Wagon Drillers, Mechanical Drillers on Multiple Units
- High scalers including but not limited to laying, anchoring, pinning, cabling and stretching of any rock fall netting, mesh or wire fabric and use of customary tools and equipment for high scaling
- Concrete pump operator
- Heavy Duty Vibrator with Stinger 5" diameter or over
- Pipelayer, Caulker and Bander
- Pipelayer-waterline, Sewerline, Gasoline, Conduit and all other types of composition for any purpose buried under ground outside of building including, stringing, trench shoring, backfilling sanding, caution taping, all walk behind equipment and spotting
- Laborer work in connection with micro tunneling, directional drilling and pipe-jacking
- Cathodic protection, grounding for pipe work
- Cleaning of Utility Lines
- Slip Lining of Utility Lines (including operation of Equipment)
- TV Monitoring and Grouting of Utility Lines
- Asphalt Rakers and Asphalt dump Man
- All mechanical and pressurized pipe work, including the installation of pipe above and below ground, cathodic protection, bolt up, and support installation in connection to water conveyance, c

Group 4A

- Foreman

Group 5

- Construction Specialists
- Blasters and Powdermen, all work of loading, placing, and blasting of all powder and explosives of any type, regardless of method used for such loading and placing
- Asbestos removal
- Lead abatement
- Hazardous waste
- Material removal

Group 5A

- Pavement Marking and Highway Striping
- Pavement Marking and Highway Striping Foreman
- Pavement Marking and Highway Striping work includes but is not limited to: All work by any method performed in connection with the permanent or temporary application and installation of pavement marking of any kind, brand, type or style on parking lots, airfields, highways, streets and other such surfaces and all work performed in connection with removal of pavement.

Group 6

- Guniting Foremen, Nozzlemen, Rodmen, Gunmen, Materialmen, Reboundmen

- Tunnel and shaft workers/miners and use of customary tools and equipment for tunnel and mine work All work performed in a compressed air tunnel shaft or chamber including the use of hand, power tools or equipment as necessary in connection with compressed air work
-

OPERATING ENGINEER, includes but is not limited to:

Group 1

- Engineer Assistant

Group 1A

- Oiler (Construction)
- Partsman

Group 2

- Compressor Operator
- Material Loader and/or Conveyor Operator (handling building materials)
- Pump Operator

Group 3

- Bobcat or similar loader, 1/4 cu. yd. or less
- Concrete Curing Machines (streets, highways, airports, canals)
- Conveyor Belt Operator (tunnel)
- Forklift (under 20)
- Engineer Generating Plant (500 K.W.)
- Mixer Box Operator (concrete plant)
- Motorman
- Rodman/Chainman
- Rotomist Operator
- Oiler (truck crane)

Group 4

- Concrete Mixer Operator, Skip type
- Dinky Operator
- Forklift (20' or over) or Lumber Stacker
- Ross Carrier
- Skip Loader Operator (under one (1) cu. yd.)
- Tie Spacer

Group 5

- Concrete Mixers (over one (1) cu. yd.)
- Concrete Pumps or Pumpcrete Guns
- Elevator and Material Hoist (one (1) drum)
- Groundman for Asphalt Milling and similar

Group 6

- Auger type drilling equipment up to and including 30 ft. depth digging capacity M.R.C.
- Boom Truck or Dual-Purpose a-Frame Truck
- B.L.H. Lima Road Pactor or similar
- Chip Box Spreader (Flaherty type or similar)
- Concrete Batch Plant (wet or dry)
- Concrete Saws (highways, streets, airports, canals)
- Locomotives (over thirty (30) tons)
- Maginnis International Full Slab Vibrator (airports, highways, canals and warehouses)
- Mechanical Finishers (concrete) (Clary, Johnson, Bidwell Bridge Deck or similar types)

- Mechanical Burn, Curb and/or Curb and Gutter Machine (concrete or asphalt)
- Pavement Breaker, Truck Mounted, with compressor combination
- Pavement Breaker or Tamper (with or without compressor combination)
- Power Jumbo Operator (setting slip-forms, etc., in tunnels)
- Roller Operator (except asphalt)
- Self-Propelled Tape Machine
- Self-Propelled Compactor (single engine)
- Self-Propelled Power Sweeper Operator
- Slip-Form Pump (power-driven by hydraulic, electric, air, gas, etc. lifting device for concrete forms)
- Small Rubber-Tired Tractors
- Snooper Crane, Paxton-Mitchell or similar
- Stationary Pipe Wrapping, Cleaning and Bending Machine Operator

Group 7

- Auger type drilling equipment over 30 ft. depth digging capacity M.R.C.
- Compressor (over 2)
- Concrete Conveyor or Concrete Pump, truck or equipment mounted (any assistance required shall be performed by an Assistant to Engineer) Boom length to apply Concrete Conveyor, Building Site
- Drilling and Boring Machine, vertical and horizontal (not to apply to waterliners, wagon drills or jack hammers)
- Crusher Plant Engineer
- Generators
- Instrument Man
- Kolman Loader
- Material Hoist (two (2) or more drums)
- Mine or Shaft Hoist
- Pipe Bending Machines (pipeline only)
- Pipe Cleaning Machines (tractor-propelled and supported)
- Pipe Wrapping Machines (tractor-propelled and supported)
- Portable Crushing and Screening Plants
- Post Driller And/or Driver
- Pumps (over 2)
- Screedman (except asphaltic or concrete paving)
- Self-Propelled Boom-Type Lifting Device (center mount) (on ten (10) ton capacity or less)
- Slusher Operator
- Soil Tester (Certified)
- Soils and Materials Tester
- Surface Heater and Planer Operator
- Trenching Machine (maximum digging capacity three (3) ft. depth) (Any assistance in the operation, if needed, shall be performed by an Assistant to Engineer)
- Truck-Type Loader
- Welding Machines (gasoline or diesel)

Group 8

- Articulated on-Site Dump Trucks
- Asphalt Plant Engineer
- Asphalt Milling Machine

- Cast-In-Place Pipe-Laying Machine
- Combination Slusher and Motor Operator
- Concrete Batch Plant (multiple units)
- Dozer Operator
- Drill Doctor
- Elevating Grader Operator
- Stiff Frame Off Road Haul Trucks
- Grooving and Grinding Machine (highways)
- Ken Seal Operator
- Marination Plant
- Loader (up to and including two and one-half (2 1/2) cu. yds)
- Mechanical Finishers or Spreader Machine (asphalt, Barber-Greene or similar)
- Shuttle Buggy
- Mechanical Trench Shield
- Mixermobile
- Push Cats
- Road Oil Mixing Machine Operator Wood-Mixer (and other similar Pugmill equipment)
- Roller Operator (asphalt)
- Rubber-Tired Earthmoving Equipment (up to and including thirty-five (35) cu. yds. "struck " M.R.C., Euclids, T-Pulls, DW10, 20, 21 and similar)
- Water Pull
- Screedman (Barber-Greene and similar) (asphaltic or concrete paving)
- Self-Propelled Compactors with Dozer; Hyster 450, Cat 825 or similar
- Sheepfoot
- Small Tractor (with boom)
- Soil Stabilizer (P & H or equal)
- Timber Skidder (rubber-tired) or similar equipment
- Track Loader
- Tractor-Drawn Scraper
- Tractor Operator
- Tractor-Mounted Compressor Drill Combination
- Trenching Machine Operator (over three (3) feet depth)
- Tri-Batch Paver
- Tunnel Badger or Tunnel Boring Machine Operator
- Tunnel Mole Boring Machine
- Vermeer T-600b Rock Cutter
- Vacuum Truck(excludes trailer mounted vaccums)

Group 9

- Chicago Boom
- Combination Backhoe and Loader (up to and including 3/8 cu. yd.)
- Combination Mixer and Compressor (gunite)
- Heavy Duty Repairman and/or Welder
- Lull Hi-Lift (twenty (20) feet or over)
- Mucking Machine
- Sub-Grader (Gurries or other types)
- Tractor (with Boom) (D6 or larger)
- Track-Laying-Type Earthmoving Machine (single engine with tandem scrapers)

Group 10

- Boom-Type Backfilling Machine
- Bridge Crane
- Carg-Lift or similar
- Chemical Grouting Machine
- Chief of Party
- Derricks (two (2) Group 10 Operators required when swing engine remote from hoist)
- Derrick Barges (except excavation work)
- Euclid Loader and similar types
- Heavy Duty Repairman
- Heavy Duty Rotary Drill Rigs
- Lift-Slab (Vagtborg and similar types)
- Loader (over two and one-half (2 1/2 cu. yds. up to and including four (4) cu. yds.)
- Locomotive (over one hundred (100) tons, single or multiple units)
- Multiple-Engine Earthmoving Machines (Euclid Dozers, etc.)
- Pre-Stress Wire Wrapping Machine
- Rubber-Tired Scraper, Self-Loading
- Single-Engine Scraper (over thirty-five (35) cu. yds.)
- Shuttle Car (Reclaim Station)
- Train Loading Station
- Trenching Machine multi-engine with sloping attachments (Jefco or similar)
- Vacuum Cooling Plant
- Whirley Crane (up to and including twenty-five (25) tons)

Group 10A

- Backhoe-Hydraulic (up to and including one (1) cu. yd.)
- Backhoe (up to and including one (1) cu. yd.) (Cable)
- CMI Dual Lane Auto-Grader SP30 or similar type
- Cranes (not over twenty-five (25) tons) (hammerhead and gantry)
- Finish Blade
- Gradalls (up to and including one (1) cu. yd.)
- Motor Patrol Operator
- Power Shovels, Clamshells, Draglines, Cranes (up to and including one (1) cu. yd.)
- Rubber-Tired Scraper, Self-Loading (twin engine)
- Self-Propelled Boom-Type Lifting Device, center mount (over 10 tons up to and including 25 tons)

Group 11

- Automatic Asphalt or Concrete Slip-Form Paver
- Automatic Railroad Car Dumper
- Canal Trimmer
- Carg Lift, Campbell or similar type
- Cranes (over twenty-five (25) tons)
- Euclid Loader when controlled from the Pullcat
- Finish Blade
- Gradesetter, Grade Checker
- Highline Cableway Operator
- Loader (over four (4) cu. yds. up to and including twelve (12) cu. yds.)
- Multi-Engine Earthmoving Equipment (up to and including seventy-five (75) cu. yds. struck m.r.c.)
- Multi-Engine Scrapers (when used to Push Pull)

- Power Shovels, Clamshells, Draglines, Backhoes Gradalls (over one (1) cu. yd. and up to and including seven (7) cu. yds. m.r.c.)
- Self-Propelled Boom-Type Lifting Device (center mount) (over 25 tons m.r.c.)
- Self-Propelled Compactor (with multiple-propulsion power units)
- Single-Engine Rubber-Tired Earthmoving Machine, with Tandem Scraper
- Slip-Form Paver (concrete or asphalt)
- Tandem Cats and Scraper
- Tower Crane Mobile (including Rail Mount)
- Truck Mounted Hydraulic Crane when remote control equipped (over 10 tons up to and including 25 tons)
- Universal Liebherr and Tower Cranes (and similar types)
- Wheel Excavator (up to and including seven hundred fifty (750) cu. yds. per hour)
- Whirley Cranes (over twenty-five (25) tons)

Group 11A

- Band Wagons (in conjunction with Wheel Excavators)
- Operator of Helicopter (when used in construction work)
- Loader (over twelve (12) cu. yds.)
- Multi-Engine Earthmoving Equipment (over seventy-five (75) cu. yds. "struck" m.r.c.)
- Power Shovels, Clamshells, Draglines, Backhoes, and Gradalls (over seven (7) cu. yds. m.r.c.)
- Remote-Controlled Earth Moving Equipment
- Wheel Excavator (over seven hundred fifty (750) cu. yds. per hour)

Group 11B

- Holland Loader or similar or Loader (over 18 cu. yds.)
-

OPERATING ENGINEERS - Steel Fabricator & Erector

Group 1

- Cranes over 100 tons
- Derrick over 100 tons
- Self-Propelled Boom Type Lifting Devices over 100 tons

Group 2

- Cranes over 45 tons up to and including 100 tons
- Derrick, 100 tons and under
- Self-Propelled Boom Type Lifting Device, over 45 tons
- Tower Crane

Group 3

- Cranes, 45 tons and under
- Self-Propelled Boom Type Lifting Device, 45 tons and under

Group 4

- Chicago Boom
- Forklift, 10 tons and over
- 59
- Heavy Duty Repairman/Welder

Group 5

- Boom Cat
-

OPERATING ENGINEER -PILEDRIIVER**Group 1**

- Derrick Barge Pedestal mounted over 100 tons
- Clamshells over 7 cu. yds.
- Self-Propelled Boom Type Lifting Device, over 100 tons
- Truck Crane or Crawler, land or barge mounted over 100 tons

Group 2

- Derrick Barge Pedestal mounted 45 tons up to and including 100 tons
- Clamshells up to and including 7 cu. yds.
- Self-Propelled Boom Type Lifting Device over 45 tons
- Truck Crane or Crawler, land or barge mounted, over 45 tons up to and including 100 tons

Group 3

- Derrick Barge Pedestal mounted under 45 tons
- Self-Propelled Boom Type Lifting Device 45 tons and under
- Skid/Scow Piledriver, any tonnage
- Truck Crane or Crawler, land or barge mounted 45 tons and under

Group 4

- Assistant Operator in lieu of Assistant to Engineer
- Forklift, 10 tons and over
- Heavy Duty Repairman/Welder

Group 5

No current classification

Group 6

- Deck Engineer

Group 7

No current classification

Group 8

- Deckhand
 - Fireman
-

SECTION 01200 - PROJECT MEETINGS

PART 1- GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for project meetings including, but not limited, to the following:
 - 1. Pre-Construction Conference
 - 2. Pre-Installation Conferences
 - 3. Coordination Meetings
 - 4. Progress Meetings
 - 5. Start-up / Training
 - 6. Service, maintenance, warranty review.
- B. Construction Schedules are specified in Division 1 SECTION 01310-A – PROGRESS SCHEDULES.

1.3 PRE-CONSTRUCTION CONFERENCE

- A. The Contractor shall schedule a pre-construction conference and organizational meeting at the project site or other convenient location no later than fifteen (15) days after execution of the Contract and prior to commencement of any construction activities. The Contractor shall conduct the meeting to review scope, responsibilities, personnel assignments, Permits, submittals, safety, emergency action plans, contacts, schedule, etc.
- B. Attendees: Owner; Architect, and their consultants; Contractor and their Superintendent and major sub-contractors; and manufacturers, suppliers and other concerned appropriate parties shall each be represented at the conference by persons familiar with and authorized to conclude matters relating to the work.
- C. Agenda: Discuss items of significance that could affect progress including such topics as:
 - 1. Construction schedule

SECTION 01200 - PROJECT MEETINGS

2. Critical work sequencing
3. Designation of responsible personnel
4. Procedures for processing field decisions and change orders
5. Procedures for processing Applications for Payment
6. Submittal of Shop Drawings, product data and samples
7. Preparation of Record Documents
8. Use of the premises
9. Office, work and storage areas
10. Equipment deliveries and priorities
11. Safety and Security, emergency procedures
12. Housekeeping
13. Working hours

1.4 PRE-INSTALLATION CONFERENCES

- A. Conduct a pre-installation conference at the site before each major construction activity that requires coordination with other construction. The installer and representatives of manufacturers and fabricators involved in or affected by the installation, and its coordination of integration with other materials and installations that have preceded or will follow, shall attend the meeting. The Contractor shall advise the Architect of scheduled meeting dates.
- B. Review the progress of other construction activities and preparations for the particular activity under consideration at each pre-installation conference, including requirements for:
 1. Contract Documents
 2. Options
 3. Related Change Orders
 4. Purchases
 5. Deliveries

SECTION 01200 - PROJECT MEETINGS

6. Shop Drawings, products data and quality control samples
 7. Possible conflicts
 8. Compatibility problems
 9. Time schedules
 10. Weather limitations
 11. Manufacturer's recommendations
 12. Compatibility of materials
 13. Acceptability of substrates
 14. Temporary facilities
 15. Space and access limitations
 16. Governing regulations
 17. Inspection and testing requirements
 18. Required performance results
 19. Recording requirements
 20. Protections
- C. Record significant discussions and agreements and disagreements of each conference, along with the approved schedule. Distribute the minutes of the meeting to everyone concerned, promptly, including the Owner and the Architect.
- D. Do not proceed if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of work and reconvene the conference at the earliest feasible date.

1.5 PROGRESS MEETINGS

- A. Conduct a weekly progress meeting at the project site at regularly scheduled intervals. Coordinate with the Owner and the Architect of scheduled meeting dates. Coordinate dates of meetings with preparation of the payment request, Change Order request, mockup reviews, etc.

SECTION 01200 - PROJECT MEETINGS

- B. Attendees: In addition to representatives of the Owner, Architect, Construction Manager each sub-contractor, supplier or other entity concerned with current progress or involved in planning, coordination or performance of future work shall be represented at these meetings by persons familiar with the project and authorized to conclude matters relating to progress.
- C. Agenda: Review and correct or approve minutes of the previous progress meeting. Review other items of significance that could affect progress. Include topics for discussion as appropriate to the current status of the project.
 - 1. Contractor's Construction Schedule: Review progress since the last meeting. Determine where each activity is in relation to the Contractor's construction schedule, whether on time or ahead or behind schedule. Determine how construction that is behind schedule will be expedited; and secure commitments from parties involved to do so. Discuss whether schedule revisions are required to ensure that current and subsequent activities will be completed within the allotted contract time.
 - 2. Review the present and future needs of each entity present, including such items as:
 - a. Interface requirements
 - b. Time
 - c. Sequence
 - d. Deliveries
 - e. Off-site fabrication problems
 - f. Access
 - g. Site utilization
 - h. Temporary facilities
 - i. Hours of work
 - j. Hazards of work
 - k. Housekeeping
 - l. Quality and work standards
 - m. Change Orders
 - n. Documentation of information for payment requests
- D. Reporting: No later than three (3) days after each progress meeting date, distribute copies of minutes of the meeting to each party present and to other parties who should have been present. Include a brief summary, in narrative form, of progress since the previous meeting and report.
 - 1. Schedule Updating: update the construction progress schedule after each progress meeting where modifications to the schedule have been made or recognized. Issue the updated schedule concurrently with the report of each meeting.

SECTION 01200 - PROJECT MEETINGS

1.6 GUARANTEE/WARRANTIES; BONDS; AND SERVICE AND MAINTENANCE CONTRACTS REVIEW MEETING:

- A. Eleven (11) months following the date of Substantial Completion of the work, hold a meeting for the purpose of review of guarantees/warranties; bonds; and service and maintenance contracts for materials and equipment.
- B. Meeting location shall be at a mutually agreed upon site, as convenient as possible for all parties.
- C. Attending shall be representatives of the following:
 - 1. Owner
 - 2. Architect
 - 3. Owner's and Architect's Consultants, as appropriate to the agenda
 - 4. Construction Manager
 - 5. Commissioning Agent
 - 6. Contractor
 - 7. Sub-contractors, as appropriate to the agenda
 - 8. Suppliers, as appropriate to the agenda
 - 9. Others, as appropriate to the agenda
- D. Owner will prepare an agenda for the meeting and distribute it to the attendees a minimum of seven (7) calendar days in advance of the scheduled meeting date.
- E. The Contractor shall take action as appropriate to implement repair or replacement of defective items and to extend service and maintenance contracts.
- F. Owner or Owners Representative shall take meeting notes and distribute them to all attendees. Attendees taking exception to anything in the meeting notes shall state in writing to the Owner within five (5) working days, following receipt of meeting notes.

PART 2 – PRODUCTS (Not Applicable)

PART 3 – EXECUTION (Not Applicable)

END OF SECTION 01200

SECTION 01300 – SUBMITTALS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for submittals required for performance of the work, including the following:
 - 1. Submittal Schedule
 - 2. Daily Construction Reports
 - 3. Shop Drawings
 - 4. Product Data
 - 5. Samples
 - 6. Quality Assurance Submittals
 - 7. Record Drawings
 - 8. Record Specifications
- B. Administrative Submittals: Refer to other Division 1 Sections and other contract documents for requirements for administrative submittals. Such submittals include, but are not limited to, the following:
 - 1. Permits
 - 2. Applications for Payment
 - 3. Performance and Labor & Material Bonds
 - 4. Insurance Certificates
 - 5. List of Sub-Contractors
- C. Related Sections: The following sections contain requirements that relate to this section:

SECTION 01300 – SUBMITTALS

1. Division 1 SECTION 01027 – APPLICATION FOR PAYMENT specifies requirements for submittal of the Schedule of Values.
2. Division 1 SECTION 01040 - COORDINATION specifies requirements governing preparation and submittal of required coordination drawings.
3. Division 1 SECTION 01200 – PROJECT MEETING specifies requirements for submittal and distribution of meeting and conference minutes.
4. Division 1 SECTION 01400 – QUALITY CONTROL specifies requirements for submittal of inspection and test reports.
5. Division 1 SECTION 01700 – CONTRACT CLOSEOUT specifies requirements for submittal of project Record Documents and warranties at project closeout.

1.3 DEFINITIONS

- A. Coordination drawings show the relationship and integration of different construction elements that require careful coordination during fabrication or installation to fit in the space provided or to function as intended.
 1. Preparation of coordination drawings is specified in Division 1 SECTION 01040 - COORDINATION and may include components previously shown in detail on Shop Drawings or Product Data.
- B. Field samples are full size physical examples erected onsite to illustrate finishes, coatings or finish materials. Field samples are used to establish the standard by which the work will be judged.
- C. Mockups are full size assemblies for review of construction, coordination, testing or operation; they are not samples.

1.4 SUBMITTAL PROCEDURES

- A. Coordination: Coordinate preparation and processing of submittals with performance of construction activities. Transmit each submittal sufficiently in advance of performance of related construction activities to avoid delay.
 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals and related activities that require sequential activity.
 2. Coordinate transmittal of different types of submittals for related elements of the work so processing will not be delayed by the need to review submittals concurrently for coordination.

SECTION 01300 – SUBMITTALS

- a. The Architect reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received.
3. Processing: To avoid the need to delay installation as a result of the time required to process submittals, allow sufficient time for submittal review, including time for resubmittals.
 - a. Allow three (3) weeks for initial review. Allow additional time if the Architect must delay processing to permit coordination with subsequent submittals, or needs additional information to complete review.
 - b. If an intermediate submittal is necessary, process the same as the initial submittal.
 - c. Allow two (2) weeks for reprocessing each submittal.
 - d. No extension of contract time, overhead or profit will be authorized because of failure to transmit submittals to the Architect sufficiently in advance of the work to permit processing.
 - e. Allow four (4) weeks for initial review of any submittal requiring review by Authority Having Jurisdiction (AHJ). A listing of these known submittals is indicated on the contract drawings, but this is not necessarily exhaustive.
- B. Submittal Preparation: Place a permanent label or title block on each submittal for identification. Indicate the name of the entity that prepared each submittal on the label or title block.
 1. Provide a space approximately 4" x 5" (100 x 125 mm) on the label or beside the title block on the Shop Drawings to record the Contractor's review and approval markings and the action taken.
 2. Include the following information on the label for processing and recording action taken:
 - a. Project Name
 - b. Date
 - c. Name and Address of the Architect
 - d. Name and Address of the Contractor
 - e. Name and Address of Sub-Contractor
 - f. Name and Address of Supplier
 - g. Name of the Manufacturer
 - h. Number and Title of appropriate specification section
 - i. Drawing Number and detail references, as appropriate
- C. Submittal Transmittal: Package each submittal appropriately for transmittal and handling. Transmit each submittal from the Contractor to the Architect using a transmittal form. The Architect will not accept submittals received from sources other than the Contractor.

SECTION 01300 – SUBMITTALS

1. On the transmittal, record relevant information and requests for data. On the form, or separate sheet, record deviations from contract document requirements, including variations and limitations. Include Contractor's certification that information complies with contract document requirements.
2. Transmittal Form: Use AIA Document G810.

1.5 SUBMITTAL SCHEDULE

- A. After development and acceptance of the Contractor's construction schedule, prepare a complete schedule of submittals. Submit the schedule within ten (10) days of the date required for submittal of the Contractor's construction schedule.
 1. Coordinate submittal schedule with the list of sub-contracts, schedule of values and the list of products as well as the Contractor's construction schedule.
 2. Prepare the schedule in chronological order. Provide the following information:
 - a. Scheduled date for the first submittal
 - b. Related section number
 - c. Submittal category (Shop Drawings, Product Data or Samples)
 - d. Name of the Sub-Contractor
 - e. Description of the part of the work covered
 - f. Scheduled date for resubmittal
 - g. Scheduled date for the Architect's final release or approval
- B. Distribution: Following response to the initial submittal, print and distribute copies to the Architect, Owner, Sub-Contractors and other appropriate parties required to comply with submittal dates indicated. Post copies in the project meeting room and field office.
 1. When revisions are made, distribute to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned portion of the work and are no longer involved in construction activities.
- C. Schedule Updating: Revise the schedule after each meeting or activity where revisions have been recognized or made. Issue the updated schedule concurrently with the report of each meeting.

1.6 DAILY CONSTRUCTION REPORTS

- A. Prepare a daily construction report recording the following information concerning events at the site and submit duplicate copies to the Architect and Owner daily:

SECTION 01300 – SUBMITTALS

1. List of sub-contractors at the site
2. Exact count of personnel at the site from each contractor or sub-contractor
3. Time spent by each person working on site vs off the job site
4. High and low temperatures, general weather conditions
5. Accidents and unusual events
6. Meetings and significant decisions
7. Stoppages, delays, shortages and losses
8. Emergency procedures
9. Orders and requests of governing authorities
10. Change Orders received, implemented
11. Services connected, disconnected
12. Equipment or system tests and startups
13. Partial Completions, occupancies
14. Substantial Completions authorized
15. Record Drawing identified changes
16. Record Specification identified changes

1.7 SHOP DRAWINGS

- A. Submit newly prepared information drawn accurately to scale. Highlight, encircle or otherwise indicate deviations from the contract documents. Do not reproduce contract documents or copy standard information as the basis of Shop Drawings. Standard information prepared without specific reference to the project is not a Shop Drawing.
- B. Shop Drawings include fabrication and installation drawings, setting diagrams, schedules, patterns, templates and similar drawings. Include the following information:
 1. Dimensions

SECTION 01300 – SUBMITTALS

2. Identification of products and materials included by sheet and detail number
3. Compliance with specified standards
4. Notation of coordination requirements
5. Notation of dimensions established by field measurement
6. Sheet Size: Except for templates, patterns and similar full size drawings, submit Shop Drawings on sheets at least 8½" x 11" but, no larger than 30" x 42".
7. Submit in the quantity the Contractor requires to be returned, together with four (4) additional copies each of brochures, catalog cuts and similar material for mechanical, electrical, hardware and elevator items; and three (3) additional copies for all others.
8. Do not use Shop Drawings without an appropriate final stamp indicating action taken.

1.8 PRODUCT DATA

- A. Collect Product Data into a single submittal for each element of construction or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing in diagrams and templates, standard wiring diagrams and performance curves.
 1. Mark each copy to show applicable choices and options. Where printed, Product Data includes information on several products that are not required, mark copies to indicate the applicable information. Include the following information:
 - a. Manufacturer's printed recommendations
 - b. Compliance with trade association standards
 - c. Compliance with recognized testing agency standards
 - d. Application of testing agency labels and seals
 - e. Notation of dimensions verified by field measurement
 - f. Notation of coordination requirements
 2. Do not submit Product Data until compliance with requirements of the contract documents has been confirmed.
 3. Preliminary Submittal: Submit a preliminary single copy of Product Data where selection of options is required.

SECTION 01300 – SUBMITTALS

4. Submittals: Submit three (3) copies of each required submittal; submit four (4) copies where required for maintenance manuals. The Architect will retain one and will return one (1) marked with action taken and corrections or modifications required. One (1) copy with review comments will be supplied to the Owner.
 - a. Unless non-compliance with contract document provisions is observed, the submittal may serve as the final submittal.
5. Distribution: Furnish copies of final submittal to installers, sub-contractors, suppliers, manufacturers, fabricators and others required for performance of construction activities. Show distribution on transmittal forms.
 - a. Do not proceed with installation until a copy of Product Data is in the installer's possession.
 - b. Do not permit use of unmarked copies of Product Data in connection with construction.

1.9 SAMPLES

- A. Submit full size, fully fabricated samples cured and finished as specified and physically identical with the material or product proposed. Samples include partial sections of manufactured or fabricated components, cuts or containers of materials, color range sets and swatches showing color, texture and pattern.
 1. Mount or display samples in the manner to facilitate review of qualities indicated. Prepare samples to match the Architect's sample. Include the following:
 - a. Specification section number and reference
 - b. Generic description of the sample
 - c. Sample source
 - d. Product name or name of the manufacturer
 - e. Compliance with recognized standards
 - f. Availability and delivery time
 2. Submit samples for review of size, kind, color, pattern, texture, and lead content testing for all paints and painted materials. Submit Samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.
 - a. Where variation in color, pattern, texture or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show approximate limits of the variations.

SECTION 01300 – SUBMITTALS

- b. Refer to other specification sections for requirements for samples that illustrate workmanship, fabrication techniques, details of assembly, connections, operation and similar construction characteristics.
 - c. Refer to other sections for samples to be returned to the Contractor for incorporation in the work. Such samples must be undamaged at time of use. On the transmittal, indicate special requests regarding disposition of sample submittals.
 - d. Samples not incorporated into the work, or otherwise designated as the Owner's property, are the property of the Contractor and shall be removed from the site prior to Substantial Completion.
 - e. Samples that are tested by WCSD to have any lead content shall be rejected.
 3. Preliminary Submittals: Submit a full set of choices where samples are submitted for selection of color, pattern, texture or similar characteristics from a range of standard choices.
 - a. The Architect will review and return preliminary submittals with the Architect's notation, indicating selection and other action.
 4. Submittals: Except for samples illustrating assembly details, workmanship, fabrication techniques, connections, operation and similar characteristics, submit three (3) sets. The Architect will return one set marked with the action taken.
 5. Maintain sets of samples, as returned, at the project site, for quality comparisons throughout the course of construction.
 - a. Unless non-compliance with contract document provisions is observed, the submittal may serve as the final submittal.
 - b. Sample sets may be used to obtain final acceptance of the construction associated with each set.
- B. Distribution of Samples: Prepare and distribute additional sets to sub-contractors, manufacturers, fabricators, suppliers, installers and others as required for performance of the work. Show distribution on transmittal forms.
 1. Field samples are full size examples erected on site to illustrate finishes, coatings or finish materials and to establish the project standard.
 - a. Comply with submittal requirements to the fullest extent possible. Process transmittal forms to provide a record of activity.

1.10 QUALITY ASSURANCE SUBMITTALS

SECTION 01300 – SUBMITTALS

- A. Submit quality control submittals, including design data, certifications, manufacturer's instructions, manufacturer's field reports and other quality control submittals as required under other sections of the specifications.
- B. Certifications: Where other sections of the specifications require certification that a product, material or installation complies with specified requirements, submit a notarized certification from the manufacturer certifying compliance with specified requirements.
 - 1. Signature: Certification shall be signed by an officer of the manufacturer or other individual authorized to sign documents on behalf of the company.
- C. Inspection and Test Reports: Requirements for submittal of inspection and test reports from independent testing agencies are specified in Division 1 SECTION 01400 – QUALITY CONTROL.

1.11 ARCHITECT'S ACTION

- A. Except for submittals for the record or information, where action and return is required, the Architect will review each submittal, mark to indicate action taken and return promptly.
 - 1. Compliance with specified characteristics is the Contractor's responsibility.
- B. Action Stamp: The Architect will stamp each submittal with a uniform, action stamp. The Architect will mark the stamp appropriately to indicate the action taken, as follows:
 - 1. Final Unrestricted Release: When the Architect marks a submittal "No Exceptions Taken," the work covered by the submittal may proceed provided it complies with requirements of the contract documents. Final payment depends on that compliance.
 - 2. Final-But-Restricted Release: When the Architect marks a submittal "Implement Exception Noted," the work covered by the submittal may proceed provided it complies with notations or corrections on the submittal and requirements of the contract documents. Final payment depends on that compliance.
 - 3. Returned for Resubmittal: When the Architect marks a submittal "Not Approved, Revise and Resubmit," do not proceed with work covered by the submittal, including purchasing, fabrication, delivery or other activity. Revise or prepare a new submittal according to the notations; resubmit without delay. Repeat if necessary to obtain different action mark.

SECTION 01300 – SUBMITTALS

- a. Do not use, or allow others to use, submittals marked "Not Approved, Revise and Resubmit" at the project site or elsewhere where work is in progress.
 - b. When the submittal review action stamp is marked "Rejected", do not proceed with that portion of the work covered by the submittal including, but not limited to, purchasing, fabrication, delivery or other activity. Make a new submittal in accordance with the review notations on the submittal and resubmit without delay in the same manner and number as for the original submittal. Resubmit as often as necessary as required to obtain an unrestricted or restricted release action. "Rejected" review action stamp notation shall not be construed by the Contractor as a valid reason for an increase in contract time.
4. Other Action: Where a submittal is for information or record purposes or special processing or other activity, the Architect will return the submittal marked "Action Not Required."
- C. Unsolicited Submittals: The Architect will return unsolicited submittals to the sender without action.

PART 2 – PRODUCTS (Not Applicable)

PART 3 – EXECUTION (Not Applicable)

END OF SECTION 01300

SECTION 01310A – PROGRESS SCHEDULES

PART 1 - GENERAL

1.1 THIS SECTION INCLUDES:

- A. Schedule Submittal Requirements
- B. Schedule Submittal Format
- C. CPM Schedule Structural Requirements
- D. Updating Schedules
- E. Schedule Revisions
- F. Time Extensions
- G. Three (3) Week Projection Schedule

1.2 RELATED SECTIONS

- A. Division 1 SECTION 01010 – SUMMARY OF WORK
- B. Schedule of Values
- C. Division 1 SECTION 01027 – APPLICATION FOR PAYMENT
- D. Change Order Procedures
- E. Division 1 SECTION 01300 – SUBMITTALS

1.3 SCHEDULE SUBMITTAL REQUIREMENTS

- A. Submit, in duplicate, as described in Part 1.5 A., to the Owner and the Architect at the Pre-Construction Conference the following preliminary documents defining planned operations:
 - 1. Baseline Schedule
- B. The Architect and the Owner will review schedule submittals; such review shall not constitute an approval or acceptance of the Contractor's construction means, methods, sequencing or its ability to complete the work in a timely manner.
- C. The preliminary documents will illustrate, at a minimum, a detailed baseline schedule for those activities commencing within the first ten (10) calendar days after the Notice to Proceed is issued by the Owner.

SECTION 01310A – PROGRESS SCHEDULES

- D. The Contractor shall submit the completed Baseline documents to the Architect within thirty (30) calendar days from the Notice of Award. The schedules shall integrate the activities of the preliminary schedules, and include all activities required for contract completion.
 - 1. Within fifteen (15) calendar days after receipt of the complete Baseline Schedule, the Owner and Architect will communicate in writing their comments and concerns to the Contractor. Within five (5) working days, the Contractor shall adjust the schedule and progress curve to incorporate comments from the Owner and Architect and resubmit.
 - 2. Upon Owner and Architect receipt and acknowledgment of revisions to the Baseline Schedule, it shall become part of the contract documents. Payment to the Contractor shall be withheld until such schedule, satisfactory in form and substance to the Owner and Architect, has been received.
- E. Changes in logic and/or durations shall not be made without first noticing on the need to change with the Owner and Architect. Changes will be accepted where they are reasonable. Changes will be accepted or denied without liability. Changes to simply accommodate a perception of still being on schedule will not be accepted. At the discretion of the Architect and the Owner, the Baseline Schedule no longer represents the actual prosecution and progress of the work, the Architect and Owner will require a Recovery Schedule.
- F. Failure to provide the required schedule information at the required times will result in denial of the relative portion of progress payments until such time that the schedule information is submitted in the correct format at the sole option of the Owner.

1.4 SCHEDULE SUBMITTAL FORMAT

- A. Follow the guidelines below when submitting a baseline, update, or projection schedule.
 - 1. Required Diagrams:
 - a. Gantt/Bar Chart or Time Scaled Logic Diagram; sheet size to be a maximum of 30 x 42 inches, organized by building and/or area, sorted by early start and early finish dates.
 - b. The formatting of the (hard copy submission) Baseline Schedule, schedule updates and three (3) week projection schedules shall include the following information (order and content of columns):
 - i. Activity Description
 - ii. Original Duration

SECTION 01310A – PROGRESS SCHEDULES

- iii. Remaining Duration
 - iv. Percent Complete
 - v. Total Float
 - vi. Target Early Start (except on Baseline Schedule)
 - vii. Target Early Finish (except on Baseline Schedule)
 - viii. On all updates and projections, show Baseline Schedule as Target (with Target Early Start and Target Early Finish dates)
 - ix. Format title block to include (at a minimum) the Contractor's name, school name, project number, file name, data date and run date.
- c. The Contractor will be responsible for planning, scheduling, managing, and reporting the progress of the work in accordance with all of the specific methods and submittals described in this section.
 - d. The construction schedule shall be prepared by a competent scheduler, and used by the Contractor to plan, prosecute and coordinate the work in an orderly and expeditious manner. The schedule will be used by the Owner and the Architect to evaluate progress and status at the various stages of the project, allocate funds, determine the impact of any changes to the Contract and establish the basis for progress payments.

1.5 CPM SCHEDULE STRUCTURAL REQUIREMENTS

- A. The following requirements have been defined in an effort to create consistency across all project schedules for purpose of analysis.
 - 1. Structure of Schedule:
 - a. The schedule should be broken down into logical areas of work. We suggest separate areas of the building and that sitework be divided into appropriate areas. We expect to see, at a minimum, the following areas (where applicable):
 - i. Milestones
 - ii. Prepare & Issue Submittals
 - iii. Review Submittals
 - iv. Material Procurement & Delivery
 - v. On Site Work
 - vi. Off Site Work
 - vii. Area A
 - viii. Area B
 - ix. Area C
 - x. Area D
 - xi. Plant

SECTION 01310A – PROGRESS SCHEDULES

- xii. Etc.
- b. Tasks related to the submittal/procurement of material or equipment shall be included as separate activities in the project schedule. Examples of procurement activities include, but are not limited to:
 - i. Material/Equipment submittal preparation
 - ii. Submittal and approval of material/equipment
 - iii. Delivery of O&M manuals
 - iv. Material/equipment fabrication and delivery
 - v. Delivery of extra parts/extra stock/special tools
 - vi. Notification of Owner furnished materials/equipment delivery requirements
 - vii. Contractor's original network diagram submittal shall become the Baseline Schedule, once it is found acceptable by the Owner. The Baseline Schedule shall be duplicated and utilized as the Current Schedule and shown graphically over the Baseline.
- c. Construction activities shall include at a minimum, but are not limited to:
 - i. Tasks corresponding to each specification section covered in the Specification Index in Divisions 2 through 16
 - ii. Tasks related to mobilization / demobilization
 - iii. Tasks related to Owner; Owner provide materials, FFE delivery and setup, Move in prior to substantial and final completion
 - iii. The installation of temporary or permanent work by tradesman
 - iv. Testing and inspections of installed work by technicians, inspectors, or engineers
 - v. System utility outages and tie ins
 - vi. Start up and testing of equipment, commissioning of building and related systems
 - vii. Scheduling of specified manufacturer's representatives
 - viii. Final clean up
 - ix. Training to be provided
 - x. Punch list completion
 - xi. Maintenance period
 - xii. Administrative tasks necessary to start, proceed with, accomplish or finalize the contract

1.6 UPDATING SCHEDULES

- A. Updated Schedules shall accompany the monthly Application for Payment, reflecting progress since previous month's submittal.

SECTION 01310A – PROGRESS SCHEDULES

- B. The schedule update shall show the status of all activities, including those in progress, completed or not started, indicated by start and finish dates, whether forecasted or actual, completion percentages based on time, original and remaining durations, any changes in network logic or activity durations and any other relevant information. Refer to Part 1.8 for revisions to the Schedule.
- C. Identify activities modified since previous submittal, major changes in work, changes associated with approved Change Orders and any other identifiable changes.
- D. Actual start and finish dates shall not be automatically updated by default mechanisms that may be included in the CPM scheduling software system. Actual start and actual finish dates on the CPM schedule shall match the dates of actual work accomplished in the field and not on projected completion dates. Out of sequence progress (if applicable) shall be handled through Retained Logic, not the option of Progress override.
- E. With each updated schedule submission, the Contractor shall submit a brief narrative report, including descriptions of schedule revisions such as changes in network logic, planned activity start dates, duration or in the critical path. The report will include a description of the amount of progress during the last month, a description of any problem areas, current or anticipated delays and their estimated schedule impacts. In the narrative report, the Contractor shall provide explanation for any slippage in contractual completion or other milestone dates. Additionally, the Contractor shall propose remedial measures necessary to recover any lost time, whether actual or forecasted. Contractor shall take such additional steps as are necessary in order to effectively eliminate or minimize such delays and to comply with the contract schedule.

1.7 SCHEDULE REVISIONS

- A. Updating the schedule to reflect actual progress made up to the data date of a schedule update shall not be considered revisions to the Baseline Schedule.
- B. If, as a result of a schedule update, it appears the baseline schedule no longer represents the actual prosecution and progress of the work, the Architect or Owner shall request a revised schedule from the Contractor. The revision shall address the Contractor's current construction plan for completing the work without impacting contract time and cost. Approved

revisions to the schedule shall be incorporated into the Baseline Schedule at the next schedule update submission.
- C. If the Architect or Owner recognizes at any time, regardless of, reason that the work has fallen behind the scheduled contract time, milestone, phase dates or for work activity on the latest schedule that indicates more than a critical five (5) day delay to

SECTION 01310A – PROGRESS SCHEDULES

the project, the Contractor shall submit a written and documented Recovery Schedule within seven (7) calendar days of the Architect's/Owner's written request. The Contractor will document in the Recovery Schedule and narrative, all additional resources, including materials equipment and labor and modifications of operations which will be provided so as to meet the schedule. The Contractor will provide all such additional resources and modifications of operations without additional cost to the Owner. Such additional resources and modifications shall include but not be limited to:

1. Required overtime for the Contractor's personnel
2. Increased construction manpower in such quantities as will substantially eliminate the backlog of work and put the project back on schedule
3. Increase numbers of shifts per working day, working days per week or the amount of construction equipment or any combination of the foregoing which will put the project back on schedule
4. Reschedule activities to achieve the maximum practical concurrence of accomplishment of activities to put the project back on schedule
5. Supplemental progress schedules detailing the specific operation changes instituted to regain the contract schedule

The Contractor will implement the Recovery Schedule without additional cost to the Owner and provide for completion of the work in accordance with the remaining milestone dates without a time extension. Should the logic and/or durations of the Recovery Schedule not receive acceptance of the Architect and the Owner, the Contractor is responsible to use concurrent operations, additional manpower, additional shifts, overtime, etc., including 24 hour production work day, seven (7) day work week operation, as required to put the project back on schedule at no additional cost to the Owner.

- D. The Contractor may also request revisions to the Baseline Schedule in the event the Contractor's planning for the work is revised. If the Contractor desires to make changes in the Baseline Schedule to reflect revisions in its method of operating and scheduling of the work, the Contractor shall notify the Architect and Owner in writing stating the reason for the proposed revisions and accompanied by a copy of the Contractor's electronic CPM Schedule. The revision shall address the Contractor's current construction plan for completing the work without impacting contract time and cost. Accepted revisions to the schedule shall be incorporated into the Baseline Schedule at the next schedule update submission.
- E. If changes in the method of operation and scheduling are desired, the Owner and/or Architect shall be notified in writing stating the reasons for the change. If the Owner and/or Architect considers these changes to be of a major nature, the Contractor

SECTION 01310A – PROGRESS SCHEDULES

may be required to revise and submit for acceptance, without additional cost to the Owner, the network diagrams and required sorts. A change may be considered of a major nature if the estimated time required or actually used for an activity or the network logic is varied from the original plan to a degree that there is a reasonable doubt as to the effect on the contract completion date(s) (or phase completion dates). Changes that affect activities with adequate float time shall be considered a major change when their cumulative effect could extend the contract completion dates.

- F. Use of float suppression techniques, such as:
1. Preferential sequencing (arranging critical path through activities more susceptible to Owner and/or Architect caused delay);
 2. Special lead/lag logic restraints;
 3. Zero total or free float constraints;
 4. Extended activity times, or imposing constraint dates other than as required by the contract;

shall be cause for rejection of the project schedule or its updates. The use of resource Leveling (or similar software features) used for the purpose of artificially adjusting activity durations to consume float and influence the critical path is expressly prohibited.

- G. Definitions of Float or Slack
1. Free float is the length of time the start of an activity can be delayed without delaying the start of a successor activity.
 2. Total float is the length of time along a given network path that the actual start and finish of activity(ies) can be delayed without delaying the project completion date.
 3. Project float is the length of time between the Contractor's early completion (or Substantial Completion) and the contract completion date.
 4. Project float is for the benefit of the project and for the mutual use of the Owner and the Contractor.
 5. Contractor's non-work weather days bank of time activity shall not be defined as "Float or Slack" for this project. It is Contractor time identified in item 1.9.G which follows.
- H. Negative float will not be a basis for requesting time extensions. Any extension of time will be addressed in accordance with item 1.9 Time Extensions. Scheduled

SECTION 01310A – PROGRESS SCHEDULES

completion dates(s) that extend beyond the contract (or phase) completion date(s) (evidenced by negative float) may be used in computation for assessment of payment withholdings. The use of this computation is not to be construed as a means of acceleration.

1.8 TIME EXTENSIONS

- A. Extensions of time to the Contract may be granted only for delays to activities on the critical path that actually delay the project completion beyond the date of Substantial Completion or for delays to activities that transform that activity onto the critical path, and, as a result, delay completion beyond the contract Substantial Completion date.
- B. Seasonal weather conditions and resulting impacts shall be included in the planning and scheduling of all work influenced by wind, cold or warm weather, smoke, snow, and/or precipitation to ensure completion of all work within the Contract time.

If all the work, or the portion(s) of the work which are the currently controlling operation(s), are suspended for weather so as not to prosecute the work, a time extension at the Owners discretion, **may be awarded if the following conditions are satisfied**

- a. The weather shall actually be the delay to the Substantial Completion Date of the project and the delay must be beyond the control and without the fault or negligence of Contractor; weather will be evaluated based on the original baseline schedule without revision if revision is the result of contractor performance; **and**
- b. The weather recorded by NOAA / NWS (WS Form: F6) website: (www.weather.gov/climate/index), Reno location or owner approved location of work during the Contract period shall be found to occur more frequently than the weather normally recorded by NOAA / NWS to be anticipated is documented more frequently occurring than 5 Year NOAA / NWS (WS Form: F6) Averages for all project locations; or
- c. Owner/Architect orders the stoppage or suspension of the work in the interest of public safety or health or due to specification requirements.

Weather is defined for the purposes of this Contract to be compared to current recorded National Oceanic and Atmospheric Administration (NOAA) / National Weather Service Preliminary Local Climatological Data (WS FORM: F-6) for Station: Reno, Nevada, or for owner approved alternate project location, as follows:

- **PRECIPITATION** water equivalent of greater than or equal to 0.1 inch

SECTION 01310A – PROGRESS SCHEDULES

- recorded for the 24-hour period, of the date, and /or
- **AVERAGE** wind speed of greater than or equal to 20 miles per hour recorded for the 24-hour period for the date of occurrence. **NOT** 2 Minute Sustained or Gusts as recorded in (WS FORM:F6).

The schedule of anticipated weather delays is based on current National Oceanic and Atmospheric Administration (NOAA) / National Weather Service (NWS) records kept as Preliminary Local Climatological Data (WS FORM: F-6) for Station: Reno, Nevada, (e.g. 5 Year NOAA / NWS (WS Form: F6) Averages) for all project locations **and will constitute the baseline for the total Contract Time weather delay evaluations.** Contractor's CPM schedule shall be understood to include as a minimum, the amount of weather delay days lost in all Contractors' weather dependent activities occurring during the activity.

1.9 THREE (3) WEEK PROJECTION SCHEDULE

- A. As deemed necessary by the Owner or Architect, the Contractor shall provide a three (3) week detailed short interval schedule for each building story, and area of the work, at regularly scheduled progress meetings. The format shall be satisfactory to the Owner and Architect. Short interval schedules shall be based upon the most current precedence Network Diagram and will indicate the actual progress achieved the previous week as well as the detailed activities scheduled for the next two (2) weeks and will show anticipated durations, start and completion dates for activities, and how the schedule tracks to the baseline schedule. All projection schedules shall be derived from the baseline schedule.

PART 2 – PRODUCTS (NOT USED)

PART 3 – EXECUTION (NOT USED)

END OF SECTION 01310A

SECTION 01400 – QUALITY CONTROL

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all contract documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for quality control services.
- B. Quality control services include inspections, tests and related actions, including reports performed by the Contractor, by independent agencies and by governing authorities. They do not include contract enforcement activities performed by the Architect.
- C. Inspection and testing services are required to verify compliance with requirements specified or indicated. These services do not relieve the Contractor of responsibility for compliance with contract document requirements.
- D. Requirements of this section relate to customized fabrication and installation procedures, not production of standard products.
 - 1. Specific quality control requirements for individual construction activities are specified in the sections that specify those activities. Requirements in those sections may also cover production of standard products.
 - 2. Specified inspections, tests and related actions do not limit the Contractor's quality control procedures that facilitate compliance with contract document requirements.
 - 3. Requirements for the Contractor to provide quality control services required by the Architect, Owner or Authorities Having Jurisdiction (AHJ) are not limited by provisions of this section.
- E. Related Sections: The following sections contain requirements that relate to this section:
 - 1. Division 1 SECTION 01045 – CUTTING AND PATCHING specifies requirements for repair and restoration of construction disturbed by inspection and testing activities.
 - 2. Division 1 SECTION 01300 – SUBMITTALS specifies requirements for development of a schedule of required tests and inspections.

SECTION 01400 – QUALITY CONTROL

1.3 RESPONSIBILITIES

- A. Owners Responsibilities: Unless otherwise indicated as the responsibility of another identified entity, the Owner or Owners representatives/agents, project managers, QA/QC inspectors, coordinators etc. shall provide inspections, tests and other quality control services specified elsewhere in the contract documents and required by AHJ.
 - 1. Where individual sections specifically indicate that certain inspections, tests and other quality control services are the Contractor's responsibility, the Contractor shall employ and pay a qualified independent testing agency to perform quality control services. Costs for these services are included in the contract sum.
 - 2. Where individual sections specifically indicate that certain inspections, tests and other quality control services are the Owner's responsibility, the Owner will employ and pay a qualified independent testing agency to perform those services.
 - a. Where the Owner has engaged a testing agency for testing and inspecting part of the work and the Contractor is also required to engage an entity for the same or related element, the Contractor shall not employ the entity engaged by the Owner, unless agreed to in writing by the Owner.
- B. Retesting: The Contractor is responsible for retesting where results of inspections, tests or other quality control services prove unsatisfactory and indicate non-compliance with contract document requirements, regardless of whether the original test was the Contractor's responsibility.
 - 1. The cost of retesting construction, revised or replaced by the Contractor, is the Contractor's responsibility where required tests performed on original construction indicated non-compliance with contract document requirements.
- C. Associated Services: Cooperate with agencies performing required inspections, tests and similar services and provide reasonable auxiliary services as requested. Notify the agency sufficiently in advance of operations to permit assignment of personnel. Auxiliary services required include, but are not limited to, the following:
 - 1. Provide access to the work.
 - 2. Furnish incidental labor and facilities necessary to facilitate inspections and tests.

SECTION 01400 – QUALITY CONTROL

3. Take adequate quantities of representative samples of materials that require testing or assist the agency in taking samples.
 4. Provide facilities for storage and curing of test samples.
 5. Deliver samples to testing laboratories.
 6. Provide the agency with a preliminary design mix proposed for use for materials mixes that require control by the testing agency.
 7. Provide security and protection of samples and test equipment at the project site.
- D. Duties of the Testing Agency: The independent agency engaged to perform inspections, sampling and testing of materials and construction specified in individual sections shall cooperate with the Architect and the Contractor in performance of the agency's duties. The testing agency shall provide qualified personnel to perform required inspections and tests.
1. The agency shall notify the Architect and the Contractor promptly of irregularities or deficiencies observed in the work during performance of its services.
 2. The agency is not authorized to release, revoke, alter or enlarge requirements of the contract documents or approve or accept any portion of the work.
 3. The agency shall not perform any duties of the Contractor.
- E. Coordination: Coordinate the sequence of activities to accommodate required services with a minimum of delay. Coordinate activities to avoid the necessity of removing and replacing construction to accommodate inspections and tests.
1. The Contractor is responsible for scheduling times for inspections, tests, taking samples and similar activities. The Contractor will also be responsible for standby charges from the Owner's laboratory if they are due to a scheduling error by the Contractor.

1.4 SUBMITTALS

- A. Unless the Contractor is responsible for this service, the independent testing agency shall submit a certified written report, in duplicate, of each inspection, test or similar service to the Architect. If the Contractor is responsible for the service, submit a certified written report, in duplicate, of each inspection, test or similar service through the Contractor.

SECTION 01400 – QUALITY CONTROL

1. Submit additional copies of each written report directly to the governing authority, when the authority so directs.
2. Report Data: Written reports of each inspection, test, or similar service include, but are not limited to, the following:
 - a. Date of issue
 - b. Project title and number
 - c. Name, address and telephone number of testing agency
 - d. Dates and locations of samples and tests or inspections
 - e. Names of individuals making the inspection or test
 - f. Designation of the work and test method
 - g. Identification of product and specification section
 - h. Complete inspection or test data
 - i. Test results and an interpretation of test results
 - j. Ambient conditions at the time of sample taking and testing
 - k. Comments or professional opinion on whether inspected or tested work complies with the contract document requirements
 - l. Name and signature of laboratory inspector
 - m. Recommendations on retesting

1.5 QUALITY ASSURANCE

- A. Qualifications for Service Agencies: Engage inspection and testing service agencies, including independent testing laboratories, that are prequalified as complying with the American Council of Independent Laboratories' *Recommended Requirements for Independent Laboratory Qualification* and that specialize in the types of inspections and tests to be performed.
 1. Each independent inspection and testing agency engaged on the project shall be authorized by AHJ to operate in the State of Nevada.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 REPAIR AND PROTECTION

- A. General: Upon completion of inspection, testing, sample taking and similar services, repair damaged construction and restore substrates and finishes. Comply with the contract document requirements for Division 1 SECTION 01045 – CUTTING AND PATCHING
- B. Protect construction exposed by or for quality control service activities and protect repaired construction.

SECTION 01400 – QUALITY CONTROL

- C. Repair and protection is the Contractor's responsibility, regardless of the assignment of responsibility for inspection, testing or similar services.

END OF SECTION 01400

SECTION 01420 – REFERENCES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section includes abbreviations and acronyms, additional definitions, and reference standards used in the contract documents.
- B. Refer to Drawings and general provisions of the Contract, including all contract documents and addendums associated with this project for further information.

1.2 ABBREVIATIONS AND ACRONYMS

- A. The following abbreviations and acronyms may be used in the contract documents. Refer uncertainties to the Architect for a decision before proceeding.

AA	Aluminium Association
AAADM	American Association of Automatic Door Manufacturers
AAMA	Architectural Aluminum Manufacturers' Association
AASHTO	American Association of State Highway and Transportation Officials
AATCC	American Association of Textile Chemists and Colorists
ACI	American Concrete Institute
ADA	Americans with Disabilities Act
AFPA	American Forest and Paper Association
AIA	American Institute of Architects
AIMA	Acoustical and Insulation Materials Association
AISC	American Institute of Steel Construction
AMCA	American Movement and Control Association
ANSI	American National Standards Institute
APA	The Engineered Wood Association (formerly the American Plywood Association)
ARI	Air Conditioning and Refrigeration Institute
ASA	American Standards Association
ASHRAE	American Society of Heating, Refrigerating, and Air-Conditioning Engineers
ASME	American Society of Mechanical Engineers
ASTM	American Society for Testing and Materials
AWI	Architectural Woodwork Institute
AWPA	American Wood Preservers' Association
AWWA	American Water Works Association
AWS	American Welding Society
BHMA	Builders Hardware Manufacturers' Association
BIA	Brick Institute of America
CAL/OSHA	State of California Construction Safety Orders
CALTRANS	State of California, Business and Transportation Agency,

SECTION 01420 – REFERENCES

	Department of Transportation, <i>Standard Specifications</i>
CCR	California Code of Regulations
CDA	Copper Development Association
CISCA	Ceilings and Interior Systems Construction Association
CFFA	Chemical Fabrics and Film Association, Inc.
CFMG	Cabinet and Fixture Manufacturers Guild
CLFMI	Chain Link Fence Manufacturers' Institute
CPA	Composite Panel Association (formerly the National Particleboard Association)
CRI	Carpet and Rug Institute
CRSI	Concrete Reinforcing Steel Institute
CPSC	United States Consumer Products Safety Commission
CS	Commercial Standard, United States Department of Commerce
CSA	Canadian Standards Association
DASMA	Door and Access Systems Manufacturers Association International
EIMA	EIFS Industry Members Association
EPA	Environmental Protection Agency
ESO	Electrical Safety Orders
FAA	Federal Aviation Administration, United States Department of Transportation
FCC	Federal Communications Commission
FGMA	Flat Glass Marketing Association (now the GANA)
FM	Factory Mutual System, Factory Mutual Engineering Corporation
FS	Federal Specification Unit
GA	Gypsum Association
GANA	Glass Association of North America (formerly the Flat Glass Marketing Association and Glass Tempering Association)
GRI	Geosynthetic Research Institute
GTA	Glass Tempering Association (now the GANA)
HMA	Hardwood Manufacturers Association
HPMA	Hardwood Plywood Manufacturers Association
HPVA	Hardwood Plywood and Veneer Association
HUD	United States Department of Housing and Urban Development
IEEE	Institute of Electrical and Electronic Engineers
IGCC	Insulating Glass Certification Council
ITS-WH	Intertek Testing Service - Warnock Hersey
LSGA`	Laminator's Safety Glass Association
MIA	Marble Institute of America or the Masonry Institute of America

SECTION 01420 – REFERENCES

MIL	Military Standardization Document, United States Department of Defense
MIW	Masonry Institute of Washington
ML/SFA	Metal Lath/Steel Framing Association
MM	“Materials Manual”, State of California, Business and Transportation Agency, Department of Transportation
NAAMM	National Association of Architectural Metal Manufacturers
NBGQA	National Building Granite Quarries Association, Inc.
NBS	National Bureau of Standards (now the NIST)
NCMA	National Concrete Masonry Association
NEC	National Electrical Code
NEMA	National Electric Manufacturers' Association
NFPA	National Fire Protection Association
NFPA	National Forest Products Association (now the AFPA)
NFRC	National Fenestration Rating Council
NHLA	National Hardwood Lumber Association
NIST	National Institute of Standards and Technology, United States Department of Commerce (formerly the National Bureau of Standards)
NOFMA	National Oak Flooring Manufacturers Association
NPDES	National Pollutant Discharge Elimination System
NRCA	National Roofing Contractors Association
NSF	NSF International (formerly National Sanitary Foundation)
NTMA	National Terrazzo and Mosaic Association
NWWDA	National Wood Window and Door Association (now WDMA)
OSA	Office of the State Architect, State of California
OSHPD	Office of Statewide Health Planning and Development, State of California
PCI	Precast / Prestressed Concrete Institute
PS	Product Standard, United States Department of Commerce
RCW	Revised Code of Washington, State of Washington
RIS	Redwood Inspection Service
SDI	Steel Deck Institute or the Steel Door Institute
SFM	Office of State Fire Marshal, State of California
SIGMA	Sealed Insulated Glass Manufacturer's Association
SMACNA	Sheet Metal and Air Conditioning Contractors National Association
SSPC	Society for Protective Coatings (formerly the Steel Structures Painting Council)
SWI	Steel Window Institute
TCA	Tile Council of America

SECTION 01420 – REFERENCES

UBC	Uniform Building Code
UFC	Uniform Fire Code
UL	Underwriters Laboratories, Inc.
UMC	Uniform Mechanical Code
UPC	Uniform Plumbing Code
USPS	United States Postal Service
USS	United States Standard
WAC	Washington Administrative Code, State of Washington
WCLIB	West Coast Lumber Inspection Bureau
WDMA	Window and Door Manufacturers Association (formerly the National Wood Window and Door Association)
WIC	Woodwork Institute of California
WLPDIA	Western Lath Plaster /Drywall Industries Association (now the WWCCA)
WSDOT	Washington State Department of Transportation
WWCCA	Western Wall & Ceiling Contractors Association
WWPA	Woven Wire Products Association or Western Wood Products Association

- B. Additional abbreviations, used only on the drawings, are listed and defined thereon.

USE SECTION 1.03 ONLY IF THESE DEFINITIONS ARE NOT INCLUDED IN THE GENERAL CONDITIONS FOR THE SPECIFIC CONTRACT.

1.03 ADDITIONAL DEFINITIONS

- A. In addition to the terms defined in the General Conditions, the following terms are used in the contract documents and are defined as follows:

Accepted Equal	As accepted by the Architect as being of equivalent quality, utility and appearance.
Addenda	Written or graphic instruments issued by the Owner/Architect prior to the execution of the Contract which modify or interpret the bidding documents by additions, deletions, clarifications or corrections.
By Owner	Work on this project that will be performed by the Owner or its agents, at the Owner's cost.
By Others	Work on this project that is outside the Scope of Work to be performed by the Contractor under this Contract, but that will be performed by the Owner, other contractors or other means.
Consultant Directed	A consultant to the Architect Directed by the Architect

SECTION 01420 – REFERENCES

Furnish	Supply only; do not install
Indicated	As shown and/or noted on the drawings
Install	Install or apply only; do not furnish
Owner-Furnished,	The Owner will furnish at their cost and the Contractor
Contractor-Installed	shall install under their contract for this work.
Project Manual	The Project Manual consists of two volumes: Volume 1 includes the bidding and contract requirements and Specifications; and Volume 2 includes the details and schedules. One volume which includes the bidding and contract requirements and specifications and the details and schedules.
Provide	Furnish and install
Site	Geographical location of the project
Specified	As written in the specifications

1.4 REFERENCE STANDARDS

- A. Specified standards of the construction industry shall have the same force and effect on the performance of the work as if bound or copied directly into the contract documents. Such standards are made a part of the contract documents by reference.
- B. Each entity or person engaged in the work shall be familiar with the industry standards applicable to its construction activity.
- C. Where compliance with two (2) or more standards is specified and the standards establish different or conflicting requirements for minimum qualities or quality levels, comply with the most stringent requirement. Refer uncertainties and requirements that are different, but apparently equal, to the Architect for a decision before proceeding.
- D. Copies of applicable standards are not bound with the contract documents. Where copies are required for proper performance of the work, obtain and pay for authorized copies directly from publication source and maintain at the site during submittals, planning and performance of work until final acceptance by the Owner. Make such copies of standards available to the Owner and Architect for review upon request.
- E. For products or quality of installation specified by association, trade, military, federal or other reference standards, comply with requirements of the standard, except when more rigid requirements are specified in the contract documents or are required by applicable codes and/or public Authorities Having Jurisdiction (AHJ).
 - 1. Except as otherwise indicated or specified, where compliance with a reference standard is required, comply with the standard in effect as of the

SECTION 01420 – REFERENCES

date established for the receipt of bids. Where a reference standard has been revised and reissued after the date established for the receipt of bids and before performance of the work affected, notify the Architect in writing and request a decision on how to proceed. The Architect may issue a contract modification or an Architect's Supplemental Instruction (ASI) for proceeding in accordance with the updated standard.

2. The contractual relationship of the parties to the Contract shall not be altered from the contract documents by mention or inference otherwise in a reference standard. The provisions of the bidding requirements; contract documents including, but not limited to all issued addendums; and the Contract shall void the general, but not technical, provisions of a reference standard in conflict therewith.

PART 2 – PRODUCTS (Not Used)

PART 3 – EXECUTION (Not Used)

END OF SECTION 01420

SECTION 01600 – MATERIALS AND EQUIPMENT

PART 1 – GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all contract documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements governing the Contractor's selection of products for use in the project.
- B. Related Sections: The following sections contain requirements that relate to this Section:
 - 1. Division 1 SECTION 01420 - REFERENCES specifies the applicability of industry standards to products specified.
 - 2. Division 1 SECTION 01300 – SUBMITTALS specifies requirements for submittal of the Contractor's construction schedule and the submittal schedule.
 - 3. Division 1 SECTION 01631 – SUBSTITUTIONS specifies administrative procedures for handling requests for substitutions made after award of the contract.

1.3 DEFINITIONS

- A. Definitions used in this section are not intended to change the meaning of other terms used in the contract documents such as *Specialties*, *Systems*, *Structure*, *Finishes*, *Accessories* and similar terms. Such terms are self-explanatory and have well recognized meanings in the construction industry.
 - 1. *Products* are items purchased for incorporation in the work, whether purchased for the project or taken from previously purchased stock. The term *Product* includes the terms *Material*, *Equipment*, *System* and terms of similar intent.
 - a. *Named Products* are items identified by the Manufacturer's product name, including make and model number or other designation, shown or listed in the Manufacturer's published product literature that is current as of the date of the contract documents.
 - b. *Foreign Products* as distinguished from domestic products are items substantially manufactured fifty percent [(50%) or more of value] outside the United States and its possessions. Products produced or supplied by entities substantially owned [more than fifty percent (50%)] by persons who are not citizens of, nor living within, the United States and its possessions.

SECTION 01600 – MATERIALS AND EQUIPMENT

2. *Materials* are products substantially shaped, cut worked, mixed, finished, refined or otherwise fabricated, processed or installed to form a part of the work.
3. *Equipment* is a product with operational parts, whether motorized or manually operated, that requires service connections, such as wiring or piping.

1.4 SUBMITTALS

- A. Product List: A list of products required is included at the end of this section. Prepare a schedule in tabular form showing each product listed. Include the Manufacturer's name and proprietary product names for each item listed.
 1. Coordinate product list with the Contractor's construction schedule and the schedule of submittals.
 2. Form: Prepare product list with information on each item tabulated under the following column headings:
 - a. Related Specification Section Number
 - b. Generic name used in the contract documents
 - c. Proprietary Name, Model Number and similar designations
 - d. Manufacturer's Name and Address
 - e. Supplier's Name and Address
 - f. Installer's Name and Address
 - g. Projected Delivery Date or time span of delivery period
 3. Initial Submittal: Within thirty (30) days after date of commencement of the work, submit three (3) copies of an initial product list. Provide a written explanation for omissions of data and for known variations from the contract requirements.
 - a. At the Contractor's option, the initial submittal may be limited to product selections and designations that must be established early in the contract period.
 4. Completed List: Within sixty (60) days after date of commencement of work, submit three (3) copies of the completed product list. Provide a written explanation for omissions of data and for known variations from the contract requirements.
 5. Architect's Action: The Architect will respond in writing to Contractor within two (2) weeks of receipt of the completed product list. No response within this period constitutes no objection to listed manufacturers or products but does not constitute a waiver of the requirement that products comply with the contract documents. The Architect's response will include a list of unacceptable product selections containing a brief explanation of reasons for this action.

SECTION 01600 – MATERIALS AND EQUIPMENT

1.5 QUALITY ASSURANCE

- A. Source Limitations: To the fullest extent possible, provide products of the same kind from a single source.
 - 1. When specified products are available only from sources that do not, or cannot, produce a quantity adequate to complete project requirements in a timely manner, consult with the Architect to determine the most important product qualities before proceeding. Qualities may include attributes, such as visual appearance, strength, durability or compatibility. When a determination has been made select products from sources producing products that possess these qualities to the fullest extent possible.
- B. Compatibility of Options: When the Contractor is given the option of selecting between two (2) or more products for use on the project, the product selected shall be compatible with products previously selected, even if previously selected products were also options.
 - 1. Each Prime Contractor is responsible for providing products and construction methods that are compatible with products and construction methods of other prime or separate contractors.
 - 2. If a dispute arises between Prime Contractors over concurrently selectable, but incompatible products, the Architect will determine which products shall be retained and which are incompatible and must be replaced.
- C. Foreign Product Limitations: Except under one or more of the following conditions, provide domestic products, not foreign products, for inclusion in the work:
 - 1. No available domestic product complies with the contract documents.
 - 2. Domestic products that comply with the contract documents are available only at prices or terms substantially higher than foreign products that comply with the contract documents.
- D. Nameplates: Except for required labels and operating data, do not attach or imprint manufacturers or producer's nameplate or trademarks on exposed surfaces of products that will be exposed to view in occupied spaces or on the exterior.
 - 1. Labels: Locate required product labels and stamps on concealed surfaces, or where required for observation after installation, on accessible surfaces that are not conspicuous.
 - 2. Equipment Nameplates: Provide a permanent nameplate on each item of service connected or power operated equipment. Locate on an easily accessible

SECTION 01600 – MATERIALS AND EQUIPMENT

surface that is inconspicuous in occupied spaces. The nameplate shall contain the following information and other essential operating data:

- a. Name of Product and Manufacturer
- b. Model and Serial Number
- c. Capacity
- d. Speed
- e. Ratings

1.6 PRODUCT DELIVERY, STORAGE AND HANDLING

A. Deliver, store and handle products according to the Manufacturer's recommendations, using means and methods that will prevent damage, deterioration and loss, including theft.

1. Schedule delivery to minimize long term storage at the site and to prevent overcrowding of construction spaces.
2. Coordinate delivery with installation time to assure minimum holding time for items that are flammable, hazardous, easily damaged or sensitive to deterioration, theft and other losses.
3. Deliver products to the site in an undamaged condition in the manufacturer's original sealed container or other packaging system, complete with labels and instructions for handling, storing, unpacking, protecting and installing.
4. Inspect products upon delivery to ensure compliance with the contract documents and to ensure that products are undamaged and properly protected.
5. Store products at the site in a manner that will facilitate inspection and measurement of quantity or counting of units.
6. Store heavy materials away from the project structure in a manner that will not endanger the supporting construction.
7. Store products subject to damage by the elements above ground, under cover in a weather tight enclosure, with ventilation adequate to prevent condensation. Maintain temperature and humidity within range required by manufacturer's instructions.

PART 2 – PRODUCTS

2.1 PRODUCT SELECTION

SECTION 01600 – MATERIALS AND EQUIPMENT

- A. General Product Requirements: Provide products that comply with the contract documents that are undamaged and, unless otherwise indicated, new at the time of installation.
1. Provide products complete with accessories, trim, finish, safety guards, and other devices and details needed for a complete installation and the intended use and effect.
 2. Standard Products: Where available, provide standard products of types that have been produced and used successfully in similar situations on other projects.
- B. Product Selection Procedures: The contract documents and governing regulations govern product selection. Procedures governing product selection include the following:
1. Proprietary Specification Requirements: Where specifications name only a single product or manufacturer, provide the product indicated. No substitutions will be permitted.
 2. Semi Proprietary Specification Requirements: Where specifications name two (2) or more products or manufacturers, provide one (1) of the products indicated. No substitutions will be permitted.
 - a. Where specifications specify products or manufactures by name, accompanied by the term “or equal” or “or approved equal.” Comply with the contract document provisions concerning *Substitutions* to obtain approval for use of an unnamed product.
 3. Non-Proprietary Specifications: When specifications list products or manufacturers that are available and may be incorporated in the work, but do not restrict the Contractor to use of these products only, the Contractor may propose any available product that complies with contract requirements. Comply with contract document provisions concerning *Substitutions* to obtain approval for use of an unnamed product.
 4. Descriptive Specification Requirements: Where specifications describe a product or assembly, listing exact characteristics required, with or without use of a brand or trade name, provide a product or assembly that provides the characteristics and otherwise complies with contract requirements.
 5. Performance Specification Requirements: Where specifications require compliance with performance requirements, provide products that comply with these requirements and are recommended by the manufacturer for the application indicated.

SECTION 01600 – MATERIALS AND EQUIPMENT

- a. Manufacturer's recommendations may be contained in published product literature or by the Manufacturer's Certification of Performance.
6. Compliance with Standards, Codes, and Regulations: Where specifications only require compliance with an imposed code, standard or regulation, select a product that complies with the standards, codes or regulations specified.
7. Visual Matching: Where specifications require matching an established sample, the Architect's decision will be final on whether a proposed product matches satisfactorily.
 - a. Where no product available within the specified category matches satisfactorily and complies with other specified requirements, comply with provisions of the contract documents concerning *Substitutions* for selection of a matching product in another product category.
8. Visual Selection: Where specified product requirements include the phrase "...as selected from Manufacturer's standard colors, patterns, textures..." or a similar phrase, select a product and Manufacturer that comply with other specified requirements. The Architect will select the color, pattern and texture from the product line selected.
9. Allowances: Refer to individual specification sections and *Allowance* provisions in Division 1 for allowances that control product selection and for procedures required for processing such selections.

PART 3 – EXECUTION

3.1 INSTALLATION OF PRODUCTS

- A. Comply with Manufacturer's instructions and recommendations for installation of products in the applications indicated. Anchor each product securely in place, accurately located and aligned with other work.
 1. Clean exposed surfaces and protect as necessary to ensure freedom from damage and deterioration at time of Substantial Completion.

END OF SECTION 01600

SECTION 01631 - SUBSTITUTIONS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for handling requests for substitutions made after award of the Contract.
- B. Related Sections: The following sections contain requirements that relate to this Section:
 - 1. Division 1 SECTION 01420 - REFERENCES specifies the applicability of industry standards to products specified.
 - 2. Division 1 SECTION 01300 - SUBMITTALS specifies requirements for submitting the Contractor's Construction Schedule and the Submittal Schedule.

1.3 DEFINITIONS

- A. Definitions in this article do not change or modify the meaning of other terms used in the contract documents.
- B. Substitutions: Changes in products, materials, equipment, and methods of construction required by the contract documents proposed by the Contractor after award of the Contract are considered to be requests for substitutions. The following are not considered to be requests for substitutions:
 - 1. Substitutions requested during the bidding period, and accepted by addendum prior to award of the Contract, are included in the contract documents and are not subject to requirements specified in this section for substitutions.
 - 2. Revisions to the Contract Documents requested by the Owner or Architect.
 - 3. Specified options of products and construction methods included in the contract documents.
 - 4. The Contractor's determination of and compliance with governing regulations and orders issued by governing authorities.

1.4 SUBMITTALS

SECTION 01631 - SUBSTITUTIONS

- A. Substitution Request Submittal: The Architect will consider requests for substitution if received within sixty (60) days after commencement of the work. Requests received more than sixty (60) days after commencement of the work may be considered or rejected at the discretion of the Architect.
1. Submit three (3) copies of each request for substitution for consideration. Submit requests in the form and according to procedures required for change-order proposals and include the Product Evaluation Questionnaire (CP-F116) found within these bid documents.
 2. Identify the product or the fabrication or installation method to be replaced in each request. Include related specification section and drawing numbers.
 3. Provide complete documentation showing compliance with the requirements for substitutions, and the following information, as appropriate:
 - a. Coordination information, including a list of changes or modifications needed to other parts of the work and to construction performed by the Owner and separate contractors, that will be necessary to accommodate the proposed substitution.
 - b. A detailed comparison of significant qualities of the proposed substitution with those of the work specified. Significant qualities may include elements, such as performance, weight, size, durability, and visual effect.
 - c. Product Data, including drawings and descriptions of products and fabrication and installation procedures.
 - d. Samples, where applicable or requested.
 - e. A statement indicating the substitution's effect on the Contractor's Construction Schedule compared to the schedule without approval of the substitution. Indicate the effect of the proposed substitution on overall Contract Time.
 - f. Cost information, including a proposal of the net change, if any in the Contract Sum.
 - g. The Contractor's certification that the proposed substitution conforms to requirements in the Contract Documents in every respect and is appropriate for the applications indicated.
 - h. The Contractor's waiver of rights to additional payment or time that may subsequently become necessary because of the failure of the substitution to perform adequately.

SECTION 01631 - SUBSTITUTIONS

4. Architect's Action: If necessary, the Architect will request additional information or documentation for evaluation within one (1) week of receipt of a request for substitution. The Architect will notify the Contractor of acceptance or rejection of the substitution within three (3) weeks of receipt of the request, or two (2) weeks of receipt of additional information or documentation, whichever is later. Acceptance will be in the form of a change order.
 - a. Use the product specified if the Architect cannot make a decision on the use of a proposed substitute within the time allocated.

PART 2 - PRODUCTS

2.1 SUBSTITUTIONS

- A. Conditions: The Architect will receive and consider the Contractor's request for substitution when one or more of the following conditions are satisfied, as determined by the Architect. If the following conditions are not satisfied, the Architect will return the requests without action except to record noncompliance with these requirements.
 1. Extensive revisions to the contract documents are not required.
 2. Proposed changes are in keeping with the general intent of the contract documents.
 3. The request is timely, fully documented, and properly submitted.
 4. The specified product or method of construction cannot be provided within the Contract Time. The Architect will not consider the request if the product or method cannot be provided as a result of failure to pursue the work promptly or coordinate activities properly.
 5. The request is directly related to an "or-equal" clause or similar language in the contract documents.
 6. The requested substitution offers the Owner a substantial advantage, in cost, time, energy conservation, or other considerations, after deducting additional responsibilities the Owner must assume. The Owner's additional responsibilities may include compensation to the Architect for redesign and evaluation services, increased cost of other construction by the Owner, and similar considerations.
 7. The specified product or method of construction cannot receive necessary approval by a governing authority, and the requested substitution can be approved.

SECTION 01631 - SUBSTITUTIONS

8. The specified product or method of construction cannot be provided in a manner that is compatible with other materials and where the Contractor certifies that the substitution will overcome the incompatibility.
 9. The specified product or method of construction cannot be coordinated with other materials and where the Contractor certifies that the proposed substitution can be coordinated.
 10. The specified product or method of construction cannot provide a warranty required by the contract documents and where the Contractor certifies that the proposed substitution provides the required warranty.
- B. The Contractor's submittal and the Architect's acceptance of shop drawings, product data, or samples for construction activities not complying with the contract documents do not constitute an acceptable or valid request for substitution, nor do they constitute approval.

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 01631

SECTION 01631 - SUBSTITUTIONS

PRODUCT EVALUATION QUESTIONNAIRE

When proposing to substitute products for those specified or proposing a product to meet a specified performance standard, please furnish the following information to assist the Owner and Architect in evaluating the proposed product.

Bid/Quote #: _____

Project: _____

Specification Section: _____

Division: _____

Article #: _____

Name of Product: _____

Manufacturer's Name and Address: _____

1. Attach manufacturer's complete technical data and all information relating to limitations of the product information requiring further testing be deemed necessary by the Architect, the cost of the prescribed test shall be borne by the Contractor. Contractor shall send product samples upon request.
2. Attach a list of projects where comparable use has been made of this product. List the name and location of the project, name of Owner or Architect, Engineer, General Contractor, and Subcontractor (if applicable), and the year installed.
3. List any problems encountered with this product on projects where it has been used. What corrective measures were required?
4. Provide a detailed comparison of the proposed substitute product with that of the specified product. Differences are to be highlighted and called out.
5. Submit a detailed specification, conforming to the format of the technical specifications herein contained, tailored to this project for installation of this product.
6. Will the services of an expert field representative be furnished to supervise the installation of this product?

SECTION 01631 - SUBSTITUTIONS

7. Describe maintenance requirements for this product and availability of expert repair service, if needed.
8. Will the proposed substitution result in a change in Contract price or time of completion? If so, submit itemization of price change and explain effect on time of completion.
9. Will the use of the proposed product necessitate a change in the contract drawings or specifications?
10. Will the use of this product necessitate the payment of any license fees or royalties?
11. Furnish information establishing financial responsibility of the manufacturer. (Number of years in business, volume of business, Dunn & Bradstreet rating, etc.)
12. The Contractor certifies that he or she understands the conditions of use to which this product will be put and he/she warrants this product as stipulated in the General Conditions.

Name of Contractor

Signature of Officer, Owner or Partner

Date

SECTION 01700 - CONTRACT CLOSEOUT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all bid documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for Contract closeout including, but not limited to, the following:

1. Inspection Procedures
2. Submittal of Project Record Document
3. Submittal of Operation and Maintenance Manual
4. Submittal of Warranties
5. Final Cleaning
6. Submittal of Regulated Systems [ACBM (Asbestos Containing Building Materials) & Lead] Closeout Documents
7. Submittal of any Final Prevailing Wage Reports

- B. Closeout requirements for specific construction activities are included in the appropriate sections in Divisions 2 through 16.

1.3 SUBSTANTIAL COMPLETION

- A. Preliminary Procedures: Before requesting inspection for certification of Substantial Completion, complete the following. List exceptions in the request.

1. In the Application for Payment that coincides with, or first follows, the date Substantial Completion is claimed, show one hundred percent (100%) completion for the portion of the work claimed as substantially complete.
 - a. Include supporting documentation for completion as indicated in these Contract Documents and a statement showing an accounting of changes to the contract sum.
 - b. If one hundred percent (100%) completion cannot be shown, include a list of incomplete items, the value of incomplete construction, and reasons the work is not complete.

SECTION 01700 - CONTRACT CLOSEOUT

- c. Provide a list of all warranties, provide warranty duration, complete contract information of firm, and name of individual who will be performing work – post one (1) year. extended warranties will be submitted on a separate spread sheet within the closeout documents in the following format. Specification #, Company responsible for performing the warranty work, Local contact for responsible individual, phone number and email address, warranty description, warranty period, warranty start and end dates.
2. Advise the Owner of pending insurance changeover requirements.
3. Submit specific warranties, workmanship bonds, maintenance agreements, final certifications, and similar documents.
4. Obtain and submit releases enabling the Owner unrestricted use of the work and access to services and utilities.
5. Include occupancy permits, operating certificates, and similar releases.
6. Submit record drawings, maintenance manuals, final project photographs, damage or settlement surveys, property surveys, and similar final record information.
7. Submit all required training meeting minutes and video recordings of all training courses.
8. Deliver tools, spare parts, extra stock, and similar items.
9. Make final changeover of permanent locks and transmit keys to the Owner. Advise the Owner's personnel of changeover in security provisions.
10. Complete startup testing of systems and videoed training instruction of/for the Owner's Operation and Maintenance personnel.
11. Discontinue and remove temporary facilities from the site, along with mockups, construction tools, and similar elements.
12. Complete final clean-up requirements, including touch up painting.
13. Touch-up and otherwise repair and restore marred, exposed finishes.
14. Provide Contractor furnished fixtures, furnishings, and equipment individually valued over \$5,000 including description, manufacturer model and serial number, location at site, and specific value for equipment.

SECTION 01700 - CONTRACT CLOSEOUT

- B. Inspection Procedures: On receipt of a request for inspection, the Architect will either proceed with inspection or advise the Contractor of unfilled requirements. The Architect will prepare the Certificate of Substantial Completion following inspection or advise the Contractor of construction that must be completed or corrected before the certificate will be issued.
1. The Architect will repeat inspection when requested and assured that the work is substantially complete.
 2. Results of the completed inspection will form the basis of requirements for final acceptance.
 3. The cost for any Architectural services for reinspection is the Contractor's sole responsibility.

1.4 FINAL ACCEPTANCE

- A. Preliminary Procedures: Before requesting final inspection for certification of final acceptance and final payment, complete the following. List exceptions in the request.
1. Submit the final payment request with releases and supporting documentation not previously submitted and accepted. Include insurance certificates for products and completed operations where required.
 2. Submit an updated final statement, accounting for final additional changes to the Contract Sum.
 3. Submit a certified copy of the WCSD's, Architect's & Engineer's final inspection lists of items to be completed or corrected, endorsed, and dated by the Architect. The certified copy of the list shall state that each item has been completed or otherwise resolved for acceptance and shall be endorsed and dated by the Architect.
 4. Submit consent of surety to final payment.
 5. Submit a final liquidated damages settlement statement.
 6. Submit evidence of final, continuing insurance coverage complying with insurance requirements.
 7. Submit final meter readings for utilities, a measured record of stored fuel, and similar data as of the date of Substantial Completion or when the Owner took possession of and assumed responsibility for corresponding elements of the work.

SECTION 01700 - CONTRACT CLOSEOUT

- B. Reinspection Procedure: The Architect will reinspect the work upon receipt of notice that the work, including inspection list items from earlier inspections, has been completed, except for items whose completion is delayed under circumstances acceptable to the Architect.
 - 1. Upon completion of reinspection, the Architect will prepare a Certificate of Final Acceptance. If the work is incomplete, the Architect will advise the Contractor of work that is incomplete or of obligations that have not been fulfilled but are required for final acceptance.
 - 2. If necessary, reinspection will be repeated.

1.5 RECORD DOCUMENT SUBMITTALS

- A. General: Do not use record documents for construction purposes. Protect record documents from deterioration and loss in a secure, fire-resistant location. Provide access to record documents for the Architect's reference during normal working hours.
- B. Record Drawings: Maintain a clean, undamaged set black line white prints of Contract Drawings and Shop Drawings or continuous live electronic as built drawings with appropriate mark ups. Mark the set to show the actual installation where the installation varies from the work as originally shown. Mark which drawing is most capable of showing conditions fully and accurately. Where Shop Drawings are used, record a cross reference at the corresponding location on the Contract Drawings. Give particular attention to concealed elements that would be difficult to measure and record at a later date. At the conclusion of the project, this record set of prints shall be submitted to the Architect for his/her review and comment. If the record set of prints is found to be complete and accurate, the prints shall be returned to the Contractor for submittal to the Owner with other closeout documents.

Record drawings must be reviewed and approved prior to each pay request by the Owner's representative. The drawings should reflect the work that has been accomplished during the time period of the pay request. Lack of record drawings approval at the time of submittal of a pay request will result in a potential delay in the processing of the pay request.

- 1. Mark record sets with red erasable pencil or electronic. Use other colors to distinguish between variations in separate categories of work.
- 2. Mark new information that is important to the Owner but was not shown on Contract Drawings or Shop Drawings.
- 3. Note related change order numbers where applicable.
- 4. Organize record drawing sheets into manageable sets.

SECTION 01700 - CONTRACT CLOSEOUT

5. Provide one Bound set of record drawings with durable paper cover sheets; print suitable titles, dates and other identification on the cover of each set.
 6. .Provide record drawings using electronic media, including one PDF and one Auto Cad compatible. Original media will be provided for Contractor to make required record drawing notations.
- C. Record Specifications: Maintain one complete copy of the Project Manual, including addenda. Include with the Project Manual, one copy of other written construction documents, such as Change Orders and modifications issued in printed form during construction.

Record specifications must be reviewed and approved prior to each pay request by the Owner's representative. The specifications should reflect the work that has been accomplished during the time period of the pay request. Lack of record specification approval at the time of submittal of a pay request will result in a potential delay in the processing of the pay request.

1. Mark these documents to show substantial variations in actual work performed in comparison with the text of the specifications and modifications.
 2. Give particular attention to substitutions and selection of options and information on concealed construction that cannot otherwise be readily discerned later by direct observation.
 3. Note related record drawing information and product data.
 4. Upon completion of the work, submit an electronic record specifications to the Architect for the Owner's records.
- D. Record Product Data: Maintain one (1) copy of each Product Data submittal. Note related Change Orders and markup of record drawings and specifications.
1. Mark these documents to show significant variations in actual work performed in comparison with information submitted. Include variations in products delivered to the site and from the manufacturer's installation instructions and recommendations.
 2. Give particular attention to concealed products and portions of the work that cannot otherwise be readily discerned later by direct observation.
 3. Upon completion of markup, submit complete set of record Product Data to the Architect for the Owner's records.

SECTION 01700 - CONTRACT CLOSEOUT

- E. Record Sample Submitted: Immediately prior to Substantial Completion, the Contractor shall meet with the Architect and the Owner's personnel at the project site to determine which samples are to be transmitted to the Owner for record purposes. Comply with the Owner's instructions regarding delivery to the Owner's sample storage area.
- F. Miscellaneous Record Submittals: Refer to other specification sections for requirements of miscellaneous record keeping and submittals in connection with actual performance of the work. Immediately prior to the date or dates of Substantial Completion, complete miscellaneous records and place in good order. Identify miscellaneous records properly and bind or electronic file, ready for continued use and reference. Submit to the Architect for the Owner's records.
- G. Maintenance Manuals: Organize operation and maintenance data into suitable sets of manageable size. Bind 2 copies (1 hard copy / 1 electronic) properly indexed data in individual, heavy duty, 2-inch, 3-ring, vinyl covered binders, with pocket folders for folded sheet information. Mark appropriate identification on front and spine of each binder. Include the following types of information:
 - 1. Emergency instructions
 - 2. Spare parts list
 - 3. Copies of warranties
 - 4. Wiring diagrams
 - 5. Recommended turn around cycles
 - 6. Inspection procedures
 - 7. Shop Drawings and Product Data
 - 8. Fixture lamping schedule
 - 9. Any other applicable information
- H. Warranty Manuals: organize warranty data into suitable set of manageable size, Bind 1 copy and 1 electronic properly indexed in individual, heavy duty 3 ring binder. Mark appropriate identification on front and spine. Include the following types of information:
 - 1. All products with extended warranties beyond 1 year, including duration (start and end date, similar to what is described in 1.3, A, 1,c)
 - 2. Manufacturer

SECTION 01700 - CONTRACT CLOSEOUT

3. Model / Serial where applicable
4. Manufacturer contact information
- I. Provide one complete download of all Procore Files properly organized and linked in PDF versions. Contractor to ensure original Procore file and documentation remains in place on Procore for use by owner. Owner shall instruct the contractor of the proper file structure

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 CLOSEOUT PROCEDURES

- A. Operation and Maintenance Instructions: Arrange for each installer of equipment that requires regular maintenance to meet with the Owner's personnel to provide instruction in proper operation and maintenance. Film Document each training and demonstration. Provide instruction by manufacturer's representatives if installers are not experienced in operation and maintenance procedures. Include a detailed review of the following items:
 1. Maintenance manuals
 2. Record documents
 3. Spare parts and materials
 4. Tools
 5. Lubricants
 6. Fuels
 7. Identification systems
 8. Control sequences
 9. Hazards
 10. Cleaning
 11. Warranties and bonds
 12. Maintenance agreements and similar continuing commitments

SECTION 01700 - CONTRACT CLOSEOUT

B. As part of instruction for operating equipment, demonstrate the following procedures:

1. Start-up
2. Shut down
3. Emergency operations
4. Noise and vibration adjustments
5. Safety procedures
6. Economy and efficiency adjustments
7. Effective energy utilization

END OF SECTION 01700

SECTION 01710 - FINAL CLEANING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including all contract documents and addendums associated with this project shall apply to this section.

1.2 SUMMARY

- A. This section includes administrative and procedural requirements for final cleaning at Substantial Completion.
- B. Related Sections: The following sections contain requirements that relate to this Section:
 - 1. Division 1 SECTION 01500 – CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS specifies general cleanup and waste removal requirements.
 - 2. Division 1 SECTION 1700 – CONTRACT CLOSEOUT specifies general contract closeout requirements.
 - 3. Special cleaning requirements for specific construction elements are included in appropriate sections of Divisions 2 through 16.
- C. Multiple Prime Contracts: Each Prime Contractor is responsible for final cleaning their own work. The Contractor for General Construction is responsible for coordinating final cleaning of an area or piece of equipment where more than one (1) Prime Contractor is involved.
- D. Environmental Requirements: Conduct cleaning and waste disposal operations in compliance with local laws and ordinances. Comply fully with federal and local environmental and antipollution regulations.
 - 1. Do not dispose of volatile wastes, such as mineral spirits, oil, or paint thinner, in storm or sanitary drains.
 - 2. Burning or burying of debris, rubbish, or other waste material on the premises is not permitted.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cleaning Agents: Use cleaning materials and agents recommended by the manufacturer or fabricator of the surface to be cleaned. Do not use cleaning agents

SECTION 01710 - FINAL CLEANING

that are potentially hazardous to health or property or that might damage finished surfaces.

PART 3 - EXECUTION

3.1 FINAL CLEANING

- A. General: Provide final-cleaning operations to all work spaces and any adjacent spaces affected by the work performed. Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit of Work to the condition expected from a commercial building cleaning and maintenance program. Comply with manufacturer's instructions.
- B. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for the entire Project or a portion of the Project.
 - 1. Clean the Project Site, yard and grounds, in areas disturbed by construction activities, including landscape development areas, of rubbish, waste material, litter, and foreign substances.
 - 2. Sweep paved areas broom clean. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
 - 3. Remove petrochemical spills, stains, and other foreign deposits.
 - 4. Remove tools, construction equipment, machinery, and surplus material from the site.
 - 5. Remove snow and ice to provide safe access to the building.
 - 6. Clean exposed exterior and interior hard surfaced finishes to a dirt free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition. Wax any required flooring to the District standard.
 - 7. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
 - 8. Broom clean concrete floors in unoccupied spaces.
 - 9. Vacuum clean carpet and similar soft surfaces, removing debris and excess nap. Shampoo, if required.

SECTION 01710 - FINAL CLEANING

10. Clean transparent materials, including mirrors and glass in doors and windows. Remove glazing compounds and other substances that are noticeable vision-obscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.
 11. Remove labels that are not permanent labels.
 12. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
 - a. Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
 13. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
 14. Clean plumbing fixtures to a sanitary condition, free of stains, including stains resulting from water exposure.
 15. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
 16. Clean ducts, blowers, and coils if units were operated without filters during construction.
 17. Clean food-service equipment to a sanitary condition, ready and acceptable for its intended use.
 18. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs and defective and noisy starters in fluorescent and mercury vapor fixtures.
 19. Leave the Project clean and ready for occupancy.
- C. Pest Control: Engage an experienced, licensed exterminator to make a final inspection and rid the Project of rodents, insects, and other pests. Comply with regulations of local authorities. This section is only applicable for a new facility or an addition to an existing facility.
- D. Removal of Protection: Remove temporary protection and facilities installed during construction to protect previously completed installations during the remainder of the construction period.

SECTION 01710 - FINAL CLEANING

- E. Compliances: Comply with regulations of Authorities Having Jurisdiction and safety standards for cleaning. Do not burn waste materials. Do not bury debris or excess materials on the Owner's property. Do not discharge volatile, harmful, or dangerous materials into drainage systems. Remove waste materials from the site and dispose of lawfully.
- 1. Where extra materials of value remain after completion of associated Work, they become the Owner's property. Dispose of these materials as directed by the Owner.

END OF SECTION 01710

ROOF AND PAVEMENT CONSULTANTS

PROJECT MANUAL

INCLUDING SPECIFICATIONS

BID SET

WASHOE COUNTY SCHOOL DISTRICT
130 ROY GOMM ELEMENTARY SCHOOL
2025 ROOF REPLACEMENT PROJECT
SECTIONS A, A1, B, AND B1
4000 MAYBERRY DRIVE
RENO, NEVADA 89509
FCIS NOS. 130-RO-0012/0013/0018
PROJECT NO. 25-505-130-08
JL NO. 69505
BENCHMARK PROJECT NO. 24WAS0130R330B

CONSULTANT:

BENCHMARK, INC.
DOUG HENKEL
6065 HUNTINGTON COURT NE
CEDAR RAPIDS, IOWA 52402
319.393.9100


PROJECT MANUAL DATE
12/13/2024



These Bidding Documents, and the ideas, drawings and specifications incorporated herein, as an instrument of professional service, is the property of Benchmark, Inc., and is not to be used, in whole or in part, for any other project without the written authorization of Benchmark, Inc.

These Bidding Documents were prepared for Washoe County School District by:

BENCHMARK, INC.



Doug Henkel
Senior Consultant

and reviewed by:

BENCHMARK, INC.



Jennifer Stephan, RRC, CDT
Senior Consultant

DIVISION 00 – PROCUREMENT AND CONTRACTING REQUIREMENTS

00 01 01	COVER
00 01 02	OWNERSHIP OF DOCUMENTS
00 01 10	TABLE OF CONTENTS
00 01 16	PROJECT DIRECTORY

DIVISION 01 – GENERAL REQUIREMENTS

01 22 00	UNIT PRICES
	PRECONSTRUCTION DAMAGE REPORT
01 33 24	SCHEDULE OF PRE-JOB SUBMITTALS
01 35 13	SPECIAL PROJECT PROCEDURES
01 35 24	CONSTRUCTION PROJECT SAFETY
01 78 00	SCHEDULE OF CLOSEOUT SUBMITTALS
01 78 36	WARRANTIES

DIVISION 02 – EXISTING CONDITIONS

02 41 20	ROOF DEMOLITION AND CLEANUP
----------	-----------------------------

DIVISION 05 – METALS

05 01 30.61	STEEL DECKING REPAIR/REPLACEMENT
-------------	----------------------------------

DIVISION 06 – WOOD, PLASTICS, AND COMPOSITES

06 10 53	MISCELLANEOUS ROUGH CARPENTRY
----------	-------------------------------

DIVISION 07 – THERMAL AND MOISTURE PROTECTION

07 22 16	ROOF BOARD INSULATION
07 26 04	SELF-ADHERING VAPOR RETARDER
07 54 19.02	ADHERED PVC THERMOPLASTIC MEMBRANE ROOFING
07 62 00.02	SHEET METAL FLASHING AND TRIM
07 72 13	MANUFACTURED CURBS
07 72 65	SUPPORT SYSTEMS

PROJECT TITLE: Washoe County School District
130 Roy Gomm Elementary School
2025 Roof Replacement Project
Sections A, A1, B, and B1
4000 Mayberry Drive
Reno, Nevada 89509
FCIS Nos. 130-RO-0012/0013/0018
Project No. 25-505-130-08
JL No. 69505
Benchmark Project No. 24WAS0130R330B

OWNER: Washoe County School District
Capital Projects and Planning
14101 Old Virginia Road
Reno, Nevada 89511

Brian Soulier
Telephone No. 775.409.8965
E-mail: bsoulier@washoeschools.net

ROOFING CONSULTANT: Benchmark, Inc.
6065 Huntington Court NE
Cedar Rapids, Iowa 52402

Doug Henkel
Telephone No. 319.393.9100
E-mail: dhenkel@benchmark-inc.com

- End of Section -

PART ONE - GENERAL**1.01 Description**

- A. Work to be performed and reimbursed on a unit price basis, and quantity allowances associated with specific unit prices are described on the drawings and in pertinent sections of the Bidding Documents.

1.02 Related Documents

- A. Refer to the Contract Agreement, Instructions to Bidders, Bid Form, specifications, and drawings for information related to unit prices and performance of the associated work.

1.03 Definitions

- A. Unit price is a price per unit of measurement for a specific part of the work, added to or deducted from the contract sum by appropriate modification, if the expended quantities of work are more than or less than the quantities required by the Bidding Documents for that specific type of work.
 - 1. Unit prices shall include associated materials, installation, labor, equipment, delivery, taxes, insurance, services, overhead, and profit.
 - 2. The unit of measurement for each unit price shall be as specified.
 - 3. A single price is established for each unit price bid item, which shall apply for either more than or less than the quantity of work required by the Bidding Documents.
- B. Quantity allowance is a stipulated quantity of a specific part of the work, which is to be accounted for on a unit price basis during the performance of the work. Quantity allowances may be stipulated for some, or all of the unit prices defined by the Bidding Documents and shall be distributed within the Base Bid or Alternate Bid items as described.
 - 1. Where bids are to include stipulated quantity allowances for specific unit prices, this information is provided in Summary of Work notes on the drawings.

1.04 Procedures

- A. Each quantity allowance and the associated value shall be separately listed on the Contractor's schedule of values, to be tracked individually when processing applications for payment. Allowances shall be distributed by roof section to match the specified quantities.
- B. The total value of each quantity allowance line item shall be calculated by multiplying the corresponding unit price from the Contract Agreement times the stipulated quantity allowance.
- C. Progress payment applications shall only include expended, documented, and approved draws against the total of each applicable line item.
- D. Methods of measurement, reporting and approval processes, and reimbursement for unit price-based work shall be as specified elsewhere in the Bidding Documents.
- E. Performance of any unit price-based work that could increase the contract sum, whether or not there is an associated quantity allowance, shall be authorized by the Owner prior to proceeding. Failure to obtain the Owner's approval may result in rejection of any associated requests for reimbursement.

- F. Contract change orders shall be issued to increase or decrease the contract sum and/or contract schedule, based on the actual approved unit price work performed compared to quantities defined by the Bidding Documents. When the unit price-based parts of the project scope of work have been completed, the Owner will deduct unexpended quantity allowances from the contract sum via change order.
- G. If the Contractor fails to facilitate the specified reporting, tracking, and/or Owner approval of unit price-based work, the Owner shall then have the right to reject the Contractor's request for reimbursement of additional work; or may execute a unilateral change order to deduct the value of any quantity allowance work that is unsubstantiated.

PART TWO – PRODUCTS

2.01 No products are required in this section.

PART THREE – EXECUTION

3.01 Schedule of Unit Prices and Units of Measurement

<u>Unit Price</u>	<u>Description and Unit of Measure</u>
No. 1	Description: Add or delete wood lumber/nailer to/from the scope of work. Refer to the drawings and Section 06 10 53 - Miscellaneous Rough Carpentry. Unit of Measure: Per board foot
No. 2	Description: Add or delete plywood to/from the scope of work. Refer to the drawings and Section 06 10 53 - Miscellaneous Rough Carpentry. Unit of Measure: Per square foot
No. 3	Description: Install roof system walkway as specified. Refer to the drawings and Division 07 specifications. Unit of Measure: Per linear foot
No. 4	Description: Infill opening in the steel deck as specified. Refer to the drawings and Section 05 01 30.61 - Steel Roof Decking Repair/Replacement. Unit of Measure: Per square foot
No. 5	Description: Inspect the existing decking. Where the existing surface is corroded but deck replacement is unnecessary, wire brush, clean, and paint top surface of decking as specified. Refer to the drawings and Section 05 01 30.61 - Steel Roof Decking Repair/Replacement. Unit of Measure: Per square foot

- End of Section -

PRECONSTRUCTION DAMAGE REPORT

Project: WCDSD 130 Roy Gomm Elementary School
2025 Roof Replacement Project
Sections A, A1, B, and B1

Contractor:

Project No.: 25WAS0130R330C

Date: _____

Owner: Washoe County School District
130 Roy Gomm Elementary School
4000 Mayberry Drive
Reno, Nevada 89509

Anticipated
Start Date: _____

Upon inspection of the above-mentioned premises, we are in agreement that existing visible damage to the facility consists of the following: (Itemize damages, listing item descriptions, quantities, locations, and extent of damages. Provide photo or video documentation where appropriate and authorized by the Owner).

INTERIOR:

EXTERIOR:

The above-mentioned items should be excluded from any future claims for damages related to the construction project.

OWNER:

CONTRACTOR:

Date: _____

Date: _____

Photo or video documentation provided ☐ Yes ☐ No

PROJECT NO.: 25WAS0130R330C

PROJECT: Washoe County School District - 130 Roy Gomm Elementary School
 2025 Roof Replacement Project - Sections A, A1, B, and B1
 4000 Mayberry Drive
 Reno, Nevada 89509

CONTRACTOR: _____

SUBMITTED BY: _____

DATE: _____

SUBMITTAL NO: _____

This review is only for general conformance with the design concepts and information given in the Contract Documents, and does not relieve the Contractor of responsibility for conformance with the Contract Documents and applicable Codes; all of which have priority over the submittals. Contractor shall be responsible for accuracy and completeness of submitted information. Corrections or comments made on the submittals by the reviewer do not relieve the Contractor from being responsible for compliance with the Contract Documents. Review of a specific item does not constitute review of an assembly of which the item is a component. The Contractor is responsible for dimensions to be confirmed and correlated at the job site; for information that pertains solely to the fabrication process or to means, methods, techniques, sequences, and procedures of construction; for coordination of the work of all trades; and performing all work in a safe and satisfactory manner.

REVIEWED BY: _____

DATE: _____

NOTES:

1. Contractor shall submit transmittal letter and all items listed in the schedule in accordance with Section 01 30 01 - Project Administration, allowing 14 days for review by the Owner's Representative.
2. Contractor shall clearly indicate which information on each submittal is pertinent to the project.
3. Contractor shall submit all SDS combined into one bookmarked PDF file, separate from the balance of the submittals.
4. Do not resubmit items marked "No Exceptions or "Make Corrections Noted". Items marked "Revise and Resubmit" or "Rejected" require resubmittal.
5. Contractor shall refer to Section 01 30 01 - Project Administration and submittal requirements in each specification section for additional information.

General Information		Transmittal No.					Action			
Specification Section	Submittal	"X" If Included					No Exceptions	Make Corrections Noted	Revise and Resubmit	Rejected
		1	2	3	4	5				

DIVISION 01 - GENERAL REQUIREMENTS

01 35 13

Special Project Procedures

Notice of Award or Guarantee Application to Roof Manuf.										
Roof Manufacturer's Approval of NOA or Guarantee App.										
Preconstruction Damage Documentation										

01 35 24

Construction Project Safety

Pre-Job Site Safety Plan/Assessment										
Safety Data Sheets (Combined Separate PDF - See Notes)										

DIVISION 05 - METALS

05 01 30.61

Steel Roof Decking Repair/Replacement

List of Materials										
-------------------	--	--	--	--	--	--	--	--	--	--

General Information		Transmittal No.					Action			
Specification Section	Submittal	"X" If Included					No Exceptions	Make Corrections Noted	Revise and Resubmit	Rejected
		1	2	3	4	5				

DIVISION 06 - WOOD, PLASTICS AND COMPOSITES**06 10 53 Miscellaneous Rough Carpentry**

List of Materials										
-------------------	--	--	--	--	--	--	--	--	--	--

DIVISION 07 - THERMAL AND MOISTURE PROTECTION**07 22 16 Roof Board Insulation**

Manufacturer's Literature										
List of Materials										

07 26 04 Self-Adhering Vapor Retarder

Manufacturer's Literature										
List of Materials										
Shop Drawing For Proposed Temporary Water Cutoff										

07 54 19.02 Adhered PVC Thermoplastic Membrane Roofing

Manufacturer's Literature										
List of Materials										
Shop Drawing For Proposed Temporary Water Cutoff										

07 62 00.02 Sheet Metal Flashing and Trim

Product Information or Material List for All Accessories										
Color Chart or Samples For Metal Color Selection										
Color Chart or Samples For Sealant Color Selection										

07 72 13 Manufactured Curbs

Manufacturer's Literature										
List of Materials										

07 72 65 Support Systems

List of Materials										
-------------------	--	--	--	--	--	--	--	--	--	--

PART ONE – GENERAL**1.01 Description**

- A. This section is intended to assure adequate planning and execution of the project, to maintain proper facility security and to assist the Owner with eliminating workplace hazards, production disruptions, product damage, and inconvenience.
- B. The Contractor shall advise all administrative and field personnel, Subcontractors, and material suppliers of the requirements of this section.
- C. Any delays experienced due to the Contractor's negligence in providing proper notifications and coordination shall be at the Contractor's expense.
- D. If any conflict should arise over a specific provision of this section, the Owner's decision shall be final.
- E. Coordinate the requirements of this section with related requirements specified elsewhere in the Contract Documents. Immediately inform the Owner's Representative of any conflicts.
- F. Refer to related information on the drawings.

1.02 Qualifications of Project Supervisors

- A. Individuals supervising the work included in this specification section shall be competent and qualified persons.
- B. Contractor shall have a foreman or superintendent present on the project site throughout the entire construction project, who is fluent in the English language (both written and verbal) and is capable of clear communications with all crew members, tenants, and Owner's Representative. Foreman/Superintendent must be on site supervising the roofers during the entire time they are working.

PART TWO – PRODUCTS**2.01 Not Used****PART THREE – EXECUTION****3.01 Notice of Award/Guarantee Application**

- A. Submit copy of notice of award or guarantee application to the roof system Manufacturer.
- B. Submit Manufacturer's written approval of notice of award or guarantee application.

3.02 Preconstruction Damage Report

- A. Prior to beginning the contract work, the Contractor shall inspect the site with the Owner and document any pre-existing damage to the interior and exterior. Report shall be generated using the form provided.

3.03 Coordination with Facility Operations

- A. The Contractor shall note that the building will be occupied and in use at all times during this work. The Contractor shall provide and maintain all OSHA or Owner required danger signs, guards, and/or obstructions necessary to protect the public and workers from dangers associated with the work.
- B. Coordinate all work throughout the duration of the project as to minimize disruption of facility operations.
- C. Schedule and coordinate all aspects of the work to maintain the building in a totally watertight condition, no exceptions.
- D. Contractor shall provide a minimum of 72 hours' notice for all activities requiring coordination or action on the part of the Owner or Owner's Representative.
- E. Coordinate roofing work around school events, as directed by the Owner.

3.04 Temporary Facilities and Utilities

- A. Temporary facilities provided by the Contractor shall include, but are not limited to:
 - 1. Utilities such as heat, water, electricity, and telephone as required.
 - 2. Contractor's facilities.
 - 3. Temporary sanitary facilities.
- B. Project Requirements
 - 1. Contractor shall furnish all required electricity.
 - 2. The on-site project supervisor shall carry a reliable cellular phone on the project site at all times.
 - 3. Contractor shall provide temporary sanitary facilities in the quantity required for use of all personnel. Maintain in a sanitary condition at all times.
- C. Maintain all temporary facilities and controls as long as needed for the safe and proper completion of the work.

3.05 Staging Areas

- A. Contractor shall perform all material storage and staging activities within those locations approved by the Owner's Representative.
- B. Staging area(s) will be determined at the preconstruction meeting.
- C. Contractor shall barricade all adjacent roof areas. Contractor shall prohibit traffic on all adjacent roof areas. At the Owner's discretion, any damage to adjacent roof areas caused by the Contractor shall be repaired by an approved applicator at no additional cost to the Owner.
- D. All roads and doorways shall remain open, unless approved otherwise by the Owner's Representative.

- E. Contractor shall not block access to dumpsters, and shall maintain safe clearance from all equipment, tanks, and valves.
- F. Contractor shall implement measures to protect the staging areas from damage. At the Owner's discretion, any damage to staging areas caused by the Contractor shall be repaired to match the pre-existing conditions at no additional cost to the Owner.
- G. Furnish and install adequate barricade around all ground level staging areas, equipment, and materials to keep areas safe and secure at all times.
- H. When approved by the Owner's Representative, building entrances shall be blocked off when pedestrians could be endangered by the overhead construction activities or adjacent ground level staging operations. Where blocking of entrances is not approved, provide alternative pedestrian protection as approved in advance by the Owner's Representative.

3.06 Roof Damage Control

- A. Contractor shall be responsible for protection of new and existing roof surfaces from construction traffic damage.
- B. Contractor shall inspect all areas on a daily basis and repair any areas of damage before leaving the job site that day.

3.07 Access and Logistical Requirements

- A. Protect the building from staining or damage where ladders, and scaffolding are set up against the building.
- B. Ladders must be removed and secured on a daily basis.
- C. Protect the building from staining and damage where hoisting operations occur.
- D. Roof access for Contractor's personnel shall be via the building exterior.
- E. If a crane is used, blocking of the street may be required. Bidders shall research associated permit requirements, barricade/traffic control procedures, pedestrian protection, and time restrictions. All applicable costs shall be included in the Contractor's bid.
- F. Contractor employees shall be required to wear clean footwear whenever inside the building.
- G. The use of Owner's facilities, such as the cafeteria, washrooms, etc. will not be allowed.
- H. Roofing personnel shall not enter the building, except to perform their contractual duties, or where approved by the Owner to access the roof.
- I. Roof access shall be as approved by the Owner.
- J. Contractor shall protect and properly barricade all access and staging areas.
- K. Contractor shall only park in the Owner-approved areas.

3.08 Interior Activities

- A. Contractor shall provide and maintain Owner-approved interior activities during all work that could potentially result in debris or construction materials entering the building, or whenever building occupants could be in danger.

- B. Contractor shall coordinate all work with the Owner's Representative to allow coordination and adequate notification to building occupants.
- C. Contractor's competent person shall be capable of fluent conversation with facility employees, the Contractor's employees, and any Subcontractor's employees.
- D. Contractor shall provide interior personnel and the rooftop supervisor with two-way communication. Interior personnel and the rooftop supervisor shall maintain full contact at all times that the Contractor is inside the building.
- E. Contractor shall follow these additional requirements at a minimum:
 - 1. Areas of Deck Replacement, Roof Openings, and Areas Where the Deck is Exposed
 - a. At any time that the deck requires removal or an opening will be created, and in all locations where the deck is exposed, the Contractor shall first cover all furnishings below with polyethylene sheeting, provide a competent person to barricade off the interior floor a safe distance out from the roof work area(s), provide warning signage, monitor the interior activities, notify employees of overhead hazards, restrict/coordinate access within the barricaded area, and manage housekeeping.
 - b. Work may only occur when the barricaded area is clear of building occupants.
 - c. Immediately upon replacement of the decking, closing the opening, or finishing laying up the roof, the Contractor shall remove the sheeting containing as much of the debris within the sheeting, sweep down all floor areas, clean off all elevated areas and equipment, properly dispose of the debris, and remove all barricades. Contractor shall immediately notify the Owner's Representative when complete.
 - 2. Areas Without Deck Replacement or Roof Openings
 - a. Whenever debris or construction materials could enter the building, or whenever building occupants could be in danger, the Contractor shall first cover all furnishings below with polyethylene sheeting, provide a competent person to barricade off the interior floor a safe distance out from the roof work area(s), provide warning signage, monitor the interior activities, notify employees of overhead hazards, restrict/coordinate access within the barricaded area, and manage housekeeping.
 - b. Immediately upon closing the opening or finishing laying up the roof, the Contractor shall remove the sheeting containing as much of the debris within the sheeting, sweep down all floor areas, clean off all elevated areas and equipment, properly dispose of the debris, and remove all barricades. Contractor shall immediately notify the Owner's Representative when complete.

3.09 Temporary Supports

- A. The Contractor shall completely and adequately support all conduits and piping prior to removal of the existing supports. Supports shall consist of steel frames and steel supporting members under the items being supported. Chains or cable supports will not be allowed.

3.10 Rain Day Activities

- A. The Contractor shall visit the project site on all rain days and make all necessary corrections to ensure watertightness of the building and roof system and proper protection of all materials.
- B. The Contractor's Representative shall contact the Owner's Representative prior to leaving the project site on such days.

3.11 Labor Forces and Completion of Work

- A. The project shall be fully staffed with qualified and trained personnel at all times.
- B. Once established, the crew size shall not be reduced by more than 20 percent without prior approval of the Owner.

3.12 Employee Conduct

- A. All Contractor employees shall conduct themselves in a professional manner at all times.
- B. Tobacco use, including smoking, e-cigarettes, and chewing tobacco, shall not occur on the roof, in the facility, or on the school property. Comply with Owner's requirements with respect to tobacco use in all other areas of the Owner's property.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. This section is provided to identify and emphasize the importance of safe working conditions, and to help assure a safe work site environment for the employees of all Contractors, Subcontractors, Consultants, Manufacturer's Representatives, Owner's Representatives and Employees, Owner's Vendors, and all other site occupants. If any conflict arises over a specific provision or requirement, the laws and rules governing the specific project location shall be followed.
- B. The Contractor shall have sole responsibility for construction project safety.

1.02 Related Work

- A. Additional safety-related items may be found elsewhere in the contract documents.

1.03 Standards

- A. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
 - 1. Occupational Safety and Health Act of 1970.
 - 2. State, County, and City regulations, as applicable to the project location.

1.04 Quality Assurance

- A. Per OSHA 29 CFR 1926.20(b), it is the Contractor's responsibility to prevent accidents on the project. Activities related to accident prevention include, but are not limited to the following:
 - 1. Initiate and maintain a safety program.
 - 2. Designate a competent person to make frequent and regular inspections of the job site, materials and/or equipment.
 - 3. Identify unsafe tools, materials, and/or equipment, and remove from the job site. Unsafe items which cannot be removed from the job site shall be tagged and/or locked out rendering them inoperable.
 - 4. The contractor shall permit only employees qualified by training or experience to operate equipment or machinery.
- B. At a minimum, the Contractor's first inspection shall be performed no later than the first week of the project. After the first inspection, subsequent inspections shall be performed a minimum of every 30 days, or as required by the referenced standards.
- C. A competent person designated by the Contractor shall perform all inspections and shall have authorization to take prompt corrective measures. The competent person may be an employee of the Contractor or a Subcontractor. Proof of the qualified person's education, training, and qualifications must be provided for verification, upon the request of the Owner or Owner's Representative.

- D. The Contractor's competent person making safety inspections shall prepare a report for each job site safety inspection. The Contractor shall submit each report to the Owner's Representative within five calendar days of the inspection.
- E. Contractor shall have sole responsibility for maintaining the job site in compliance with all applicable regulations, Owner requirements, and the Contractor's pre-job site safety plan/assessment. This responsibility shall apply whether or not the Owner or Consultant is present on the job site.
- F. Contractor shall also appoint a competent person to be present at all times on the project site. The Contractor's competent person shall have authority to make decisions regarding safety and health issues on the Contractor's behalf. The competent person shall speak fluent English and must be capable of oral and written communication with all project participants.
- G. The Contractor's employees, Subcontractor's employees, Owner, or Owner's Representative shall all have the authority to stop any witnessed unsafe work practices.
- H. At a minimum, Contractor shall maintain Safety Data Sheets (SDS) at the job site in accordance with OSHA and Owner requirements.
- I. One full and current set of SDS shall be located on the roof, in addition to other sets that the Contractor maintains on site.

1.05 Submittals

- A. Contractor shall submit a pre-job site safety plan/assessment, which is prepared by the Contractor's safety professional. This plan/assessment shall outline specific safety considerations for each individual section or level of roof included in the project. Examples of items that shall be included in the safety plan/assessment include:
 - 1. Laydown/staging areas
 - 2. Crane/hoist
 - 3. Setup, material storage and material handling
 - 4. Fall protection
 - 5. Skylights and roof openings
 - 6. Hot work/fire protection
 - 7. Pedestrian/vehicular safety
 - 8. Interior safety
 - 9. Personal protective equipment (PPE)
 - 10. Emergency Action Plan per OSHA 29 CFR 1926.35
 - 11. Any other pertinent, site-specific issue(s) listed

- B. Contractor shall submit SDS for all construction materials and other substances to be used on the project.
 - 1. Review of the Contractor's SDS submittal by the Owner or Owner's Representative is for general conformance only. Contractor shall be responsible to ensure that the set of SDS is complete, up to date, and accurate.
 - 2. After completion of the pre-job submittal process, Contractor shall accurately maintain all sets of SDS on the project site, with modifications being made when either of the following occur:
 - a. When revised SDS are issued by material and/or substance Manufacturers.
 - b. When materials and/or substances are brought to the project site that were not anticipated when the existing set was assembled.
 - 3. SDS shall be combined into a single PDF document with title page and table of contents. The PDF file shall be bookmarked by specification division and section, with SDS documents grouped by applicable section.

PART TWO – PRODUCTS

2.01 Materials and Equipment

- A. General: Contractor shall supply all necessary materials and equipment required to complete the work in a manner consistent with a safe work site and as required by regulatory agencies.
- B. All equipment used on the project shall be maintained in a safe operating condition for the project's duration. Equipment that is unsafe or in disrepair shall be tagged and removed from service immediately and returned to service only after being properly repaired and made safe. Any tagged equipment that will not be repaired by the Contractor shall be removed from the job site immediately. Refer to OSHA 29 CFR 1926.20(b)(3).
- C. Dispose of any solvents, containers, and other regulated materials in strict accordance with all applicable laws and regulations.

PART THREE – EXECUTION

3.01 General

- A. The safety requirements specified in this section are broad in nature by design. The Contractor shall augment the information contained in this section as necessary, with more specific information from OSHA, Owner's safety requirements, material and equipment Manufacturers' safety recommendations, and roofing industry requirements and standards.
- B. Where parts of OSHA 1926 standards are listed in this section, the intent is only to provide general references, and not to, in any way, limit the applicability of the OSHA standard with respect to execution of this project. The Contractor shall be responsible to comply with all aspects of OSHA 1926 standard that apply to the performance of this project.

3.02 Contractor Employee Training

- A. Per OSHA 29 CFR 1926.20(f)(2) Contractor and Subcontractors shall provide adequate training for employees to ensure their safety and the safety of others on the project site.

- B. Contractor and Subcontractors shall provide instruction in the proper operation of power tools, hoisting equipment, scaffolding, ladders, powered carts, and all other pieces of equipment employees will be required to use in completion of the work.
- C. Contractor and Subcontractors shall ensure each worker is aware of job and site-specific hazards and of the safety precautions appropriate for each.
- D. Contractor and Subcontractors shall present a safety and loss prevention orientation program to each new employee before that employee starts work.
- E. Contractor and Subcontractors shall inform their employees of all health and safety rules pertaining to their particular job.
- F. Contractor and Subcontractors shall inform their employees of location and use of safety devices such as first aid kits, phones, and fire extinguishers.
- G. Contractor shall implement a regular system of work inspection to detect and correct hazardous conditions, safety rule violations, and unsafe working practices.
- H. Contractor shall ensure that their workers and any Subcontractor's workers participate in any safety orientations or training programs required by the Owner.
- I. Employees shall be trained regarding any job site alarms, code signals, evacuation warnings, appropriate responses, and requirements for any actions that will need to be taken.

3.03 Accident Investigation and Reporting

- A. Contractor and Subcontractors shall immediately investigate any and all accidents on the job site and shall follow all applicable reporting requirements. An accident investigation and report shall be immediately made by the Contractor's designated competent person on site. Contractor shall provide to the Owner a copy of the completed Accident Report, Employer's First Report of Injury or Illness, and other such reports required by federal, state, county, and municipal safety regulations. At a minimum, all reporting and record keeping requirements shall be in accordance with OSHA regulations.
- B. In addition to investigation and reporting required under 3.03, A, perform investigation and reporting of accidents as required by the Owner's safety requirements and policies, where applicable.

3.04 First Aid

- A. Per OSHA 29 CFR 1926.50 Contractor and Subcontractors shall be responsible for providing first aid and medical treatment for their employees. The names, addresses, and telephone numbers of nearby urgent care, hospital, and ambulance services shall be conspicuously posted, as required by law.
- B. ANSI-approved first aid kit(s) shall be located at all times on the roof and shall be conspicuously located and readily accessible at all times. The first aid kit(s) shall be of appropriate size(s), location(s), and composition(s) given the number of workers, work locations, and types of work being performed.

3.05 Individual Conduct and Safety

- A. Contractor's and Subcontractors' employees shall be made aware of and comply with the following rules:
 - 1. Alcohol and/or illegal drugs shall not be permitted. Employees under the influence of these substances shall not be permitted on the job site.
 - 2. Prescription drugs with side effects that impair an employee's ability to perform their work duties in a safe manner, shall not be permitted. Employees under the influence of these substances shall not be permitted on the job site.
 - 3. Employees entering job site found to be under the influence of alcohol and/or drugs will be subject to removal from the job site.
 - 4. The carrying of firearms and all other weapons is prohibited on the job site.
 - 5. Fighting, gambling, stealing, soliciting, and inappropriate behavior is prohibited on the job site.
 - 6. Abusive language, harassment, bullying, or other disrespectful behavior will not be tolerated and may be considered grounds for removal of an employee from the job site.

3.06 Personal Protective Equipment (PPE) and Clothing

- A. Per OSHA 29 CFR 1926.95, Contractor and Subcontractors shall furnish and require the use and wearing of PPE and protective clothing by their employees.
- B. Per OSHA 29 CFR 1926.102, Contractor and Subcontractors shall require their employees to wear approved eye and face protection when warranted by exposure to hazards, and/or where mandated by facility safety requirements. Safety glasses with side shields are required in all circumstances where there is an exposure to flying particles. Plastic face shields are required to be worn for guarding against flying particles and spraying liquids and/or corrosives.
- C. Contractor and Subcontractors shall require their employees to wear appropriate clothing at all times on the job site.
- D. Per OSHA 29 CFR 1926.100, Contractor and Subcontractors shall require their employees to wear hard hats at all times there is a possibility of head injury from impact, flying or falling objects, and/or where mandated by facility safety requirements.
- E. Per OSHA 29 CFR 1926.101, Contractor and Subcontractors shall require their employees to wear hearing protection where mandated by OSHA regulations and/or facility safety requirements.
- F. Contractor and Subcontractors shall require their employees to wear protective footwear where mandated by OSHA regulations and/or facility safety requirements. Safety toe footwear shall comply with OSHA 29 CFR 1926.96.
- G. Per OSHA 29 CFR 1926.28(a), Contractor and Subcontractors shall require their employees to wear hand protection to protect employees' hands from potential injury due to exposure to sharp materials, chemicals, hot or cold surfaces, electrical dangers, welding burns, and skin absorption of harmful substances.

3.07 Housekeeping

- A. Per OSHA 29 CFR 1926.25, Contractor and Subcontractors shall maintain good housekeeping standards at all times as an integral part of the work. Contractor and Subcontractors shall perform daily cleanup of work areas, material and equipment storage areas, laydown areas, and personnel areas.
- B. Materials shall be stored such that safe clearances are maintained and tipping or wind movement of stacked material does not occur. Loose materials on the roof must be secured so that they cannot become wind-blown or be bumped off.
- C. All roofs shall be kept free of any loose material, packaging, aluminum cans, bottles, clothing, or similar debris that could restrict drainage devices and potentially cause retention of water on the roof surface.
- D. Accumulation of material that may create a fire hazard is not permitted.
- E. When using the roof for storage, Contractor shall prevent placement of excessive quantities of materials in a single area and shall be responsible for ensuring that overloading of the roof structure does not occur during material handling/storage.
- F. Contractor shall be responsible for making all roof areas watertight at the end of each work shift. Contractor's or Subcontractors' failure to make the roof watertight at the end of the workday may be considered grounds for dismissal.

3.08 Signs and Barricades

- A. Per OSHA 29 CFR 1926 Subpart G, Contractor and Subcontractors shall erect barriers and/or barricades when overhead work is occurring, when equipment or cranes are being used or moved, or any other time personnel could be at risk during hazardous operations. Barriers and barricades shall be erected before starting the work requiring isolation/protection. If the barricades are in a roadway or walkway, blinking lights shall be used after dark. When the work is completed and hazards are no longer present, the barricades shall be promptly removed from the job site.
- B. Contractor or Subcontractors are forbidden to remove posted signs, unless otherwise approved in writing by the Owner and/or authorities having jurisdiction.
- C. Traffic control signage shall be constructed of metal and conform to the latest edition of *Manual of Uniform Traffic Control Devices (MUTCD)*.

3.09 Fall Protection

- A. Per OSHA 29 CFR 1926 Subpart M, Contractor and Subcontractors shall implement fall protection when dictated by criteria contained in the referenced standard. One of the following methods of fall protection shall be implemented, as determined by the Contractor to ensure worker safety and conformance with OSHA regulations at a minimum.
 - 1. Fall restraint (motion stopping) system.
 - 2. Personal fall arrest system with warning lines.
 - 3. Safety monitor system with warning lines.

- B. The three fall protection methods are listed in order of Benchmark, Inc. preference, with a fall restraint (motion stopping) system being the most preferred and the safety monitor system being the least preferred.
- C. All open mechanical curbs, openings in the roof deck, and similar openings or holes which could be potential fall hazards shall be guarded at all times to prevent accidental falls. Guarding shall meet OSHA standards at a minimum.

3.10 Ladders and Scaffolding Towers

- A. Comply with OSHA CFR 1926 Subparts L and X.
- B. Contractor and Subcontractor provided ladders shall be free of defects. Ladders with split or cracked side rails, damaged rungs, missing feet, or other defects shall not be brought to the project site. Ladders set up near doorways, walkways, or other congested areas shall be barricaded or guarded.
- C. Ladders shall be of adequate length to safely access adjacent surfaces and must extend at least 3' or 4 rungs above the upper landing.
- D. Place straight ladders on solid, level footings with the foot of the ladder a minimum distance from the wall equal to 1/4 the length of the ladder from the resting point.
- E. Straight ladders shall have non-skid feet and be securely tied off.
- F. Limit use of step ladders to applications allowed by OSHA and approved by the Owner. Step ladder usage shall be in strict accordance with OSHA standards.
- G. When climbing a ladder, users shall face the ladder and use both hands going up or down so as to maintain three points of contact.
- H. Users shall not climb or descend ladders with tools, equipment, or material in their hands.
- I. Metal ladders shall not be used.
- J. Roofs not able to be accessed using a 30 foot or shorter ladder must be accessed by alternative means. If access cannot be achieved from other roofs or through the building interior, then an OSHA approved scaffolding tower with access ladder shall be erected and maintained by the Contractor or a qualified scaffolding Subcontractor.

3.11 Fire Protection

- A. Comply with OSHA CFR 1926.24 and CFR 1926 Subpart F.
- B. At a minimum, Contractor and Subcontractors shall provide and maintain fully charged, inspected, and tagged fire extinguishers at all times on occupied roof sections and staging areas. All fire extinguishers shall be minimum 20 lb., type ABC. At a minimum, one fire extinguisher shall be provided for each 3,000 square feet of roof area under construction. Travel distance from any point of the protected area to the nearest fire extinguisher shall not exceed 50 feet.
- C. The Contractor shall ensure that all required fire extinguishers are maintained in a fully charged and operable condition, including testing, inspections and tagging. Fire extinguishers with out-of-date inspection tags shall be removed and replaced immediately.

- D. Smoking may be prohibited on the job site for various reasons. Employees will be expected to obey all No Smoking signs. If project areas are not marked with No Smoking signs, it shall be assumed that smoking is prohibited unless otherwise approved by the Owner. Strictly comply with Owner's site-specific requirements. Violation of smoking policies may be grounds for employee or company dismissal, depending on Owner's requirements.
- E. Store all flammable liquids in approved safe containers. Contents shall be described and marked flammable.
- F. Flammable liquids in excess of ten gallons shall not be stored on the roof overnight unless specific written authorization is provided in advance by the Owner.
- G. When using flammable liquids for cleaning, dispose of the rags in approved containers or remove them from the roof daily to prevent possible spontaneous combustion.
- H. Never store bulk flammable material or liquids closer than 25' from open flames or other source of ignition.
- I. All hot work must be done in accordance with permit procedures in use at the facility. Obtain all necessary approvals prior to proceeding with any work that could result in a flame or spark.

3.12 Electrical Safety

- A. Comply with OSHA CFR 1926 Subparts I and K.
- B. All electrical circuits shall utilize ground-fault circuit interrupters (GFCI) to protect workers from injury.
- C. Regularly inspect all power cords. Any defective power cords shall be taken out of service and removed from the job site immediately.
- D. Only double insulated power tools shall be used.
- E. Regularly inspect all power tools. Any defective tools, including tools with damaged or repaired power cords, shall be taken out of service, and removed from the job site immediately.
- F. When working on powered equipment, and power must be disconnected to perform the required work, the Contractor shall implement lock-out and tag-out procedures to protect workers from injury.
- G. Per OSHA CFR 1926.1408(h), Contractor and Subcontractors shall maintain the following clearances from overhead powerlines, depending on the voltage, to prevent arcing and electrocution.

TABLE A – MINIMUM CLEARANCE DISTANCES

Voltage (nominal, kV, alternating current)	Minimum clearance distance (feet)
up to 50	10
over 50 to 200	15
over 200 to 350	20
over 350 to 500	25
over 500 to 750	35
over 750 to 1,000	45
over 1,000	(as established by the utility owner/operator or registered professional engineer who is a qualified person with respect to electrical power transmission and distribution)

Note: The value that follows "to" is up to and includes that value. For example, over 50 to 200 means up to and including 200kV.

3.13 Crane and Hoist

- A. Per OSHA CFR 1926 Subpart CC, for all crane and rigging operations on site a Certified Crane Operator and qualified rigger(s) shall be used.
- B. Contractor shall comply with the Manufacturer's specifications and limitations. Rated load capacities, recommended operating speeds, and special hazard warnings or instructions shall be conspicuously posted on all equipment. Instructions or warnings shall be visible from the operator's station.
- C. Accessible areas within the swing radius of the rear of the rotating superstructure shall be properly barricaded to prevent the public or employees from being struck or crushed by the crane.
- D. All crawler or truck cranes in use shall meet the requirements as prescribed in the ANSI B30-5-1968 Safety Code for Crawler and Truck Cranes.
- E. Inspect all rigging equipment prior to use (chains, ropes, slings, shackles, etc.). Remove any defective equipment from the job site.

3.14 Public Liability

- A. Unauthorized persons are not allowed access to the roof at any time. Contractor shall control access to the roof.
- B. Barricades and signs shall be posted on the ground around the work area to warn the public.
- C. Locate air intake ducts, air conditioners, and/or air pumps. Notify Owner's Representative when dust or fumes may be drawn into the facility so that the unit may be shut down and/or covered.
- D. At the end of each work shift, lock trucks, deactivate hoisting equipment, and take down and secure all ladders.
- E. Park vehicles so that they do not pose a hazard to other traffic moving around the job site. Trucks and equipment should not block sidewalks or other pedestrian travel ways without providing a clear, well-marked, alternate route of travel.

- End of Section -

PROJECT NO.: 25WAS0130R330C

DATE: _____

PROJECT: Washoe County School District - 130 Roy Gomm Elementary School
 2025 Roof Replacement Project - Sections A, A1, B, and B1
 4000 Mayberry Drive
 Reno, Nevada 89509

SUBMITTAL NO: _____

REVIEWED BY: _____

DATE: _____

NOTES:

1. Submit transmittal letter and all listed items in accordance with related requirements in Specification Division 01 - General Requirements.
2. Refer to submittal requirements within each referenced specification section for additional information not specified in Division 01 - General Requirements.

General Information		Transmittal No.					Action	
Specification Section	Submittal	"X" If Included					Accepted	Revise and Resubmit
		1	2	3	4	5		

DIVISION 01 - GENERAL REQUIREMENTS

Signed Completion Punch List								
Building Permit Closeout Documentations								
Final adjustment of accounts, as specified.								

01 78 36**Warranties**

Manufacturer's Final Inspection Report/Punch List								
Contractor's Certification of Punch List Completion								
Manufacturer's Report if Reinspection of Punch List is Required								
Roofing Manufacturer's Warranties								
Sheet Metal Finish Warranties								
Accessory Warranties as Specified								
Contractor's Warranty								
Roofing Manufacturer's Maintenance Directives								

PART ONE – GENERAL**1.01 General Requirements**

- A. Upon completion of work and prior to final payment, Contractor shall pay all required fees, secure all required inspections, and complete any other actions necessary to secure and deliver the specified warranties and related documents to the Owner.
- B. The warranty start date shall be no earlier than the date the Contractor certifies completion of all Manufacturer final inspection punch list(s). In instances where the Manufacturer requires reinspection of the final inspection punch list, the warranty start date shall be no earlier than the date the Manufacturer certifies that the Contractor completed all punch list items to the Manufacturer's satisfaction.
- C. Manufacturers' warranties shall cover defects in materials and workmanship, shall not include any buy-out clauses, and shall not be prorated.
- D. All warranties shall contain written provisions stating that they will be fully transferable at any time during the specified warranty period.
- E. Warranties issued prior to the Manufacturer's final inspection, such as offered under the Manufacturer's pre-issue or early bird warranty programs, are not approved.

1.02 Manufacturer's Warranties

- A. The Contractor shall make all necessary notices for warranty purposes to the Manufacturer(s), as required to secure timely inspections and issuance of the specified warranties.
- B. After Manufacturers' final inspections, submit Manufacturers' final inspection reports and/or punch lists, and Contractor's certification that all identified corrective work has been corrected as required by the Manufacturers. If a Manufacturer requires reinspection of an issued punch list, submit certification from the Manufacturer that punch list items have been completed to the Manufacturer's satisfaction.
- C. The following roofing Manufacturer's warranty shall be provided:
 - 1. Primary roofing Manufacturer's 20-year, no dollar limit (NDL) labor and material warranty.
- D. Provide the following accessory warranties, each signed by the respective Manufacturer(s) and referencing the Owner and project area(s) under contract:
 - 1. Shop-fabricated Prefinished Sheet Metal Components: 25-year minimum warranty for Kynar 500/Hylar 5000 metal finish integrity and color retention. The paint film shall be guaranteed against cracking, peeling, and chalking in excess of ASTM D659 number 8 rating or fade in excess of 5 units per ASTM D2244, under normal weather and atmospheric conditions.

1.03 Contractor Warranty

- A. The Contractor shall guarantee all materials and workmanship for a period of two years from the date of acceptance of the completed work by the Owner. The Contractor shall make good any defects in materials or workmanship that may develop during the two-year period by repairing or replacing such defects at without cost to the Owner.

- B. Contractor's warranty shall be prepared and submitted using the form provided in this section.

PART TWO – MATERIALS**2.01 Not Used****PART THREE – EXECUTION****3.01 Not Used**

CONTRACTOR'S WARRANTY

Trade: All Contract Work

Manufacturer and Roof System Installed:

Contractor:

Contractor Address:

Contractor Phone:

Contractor E-mail:

Contract Number and Date:

Project and Location

WCSD 130 Roy Gomm Elementary School

2025 Roof Replacement Project

4000 Mayberry Drive

Reno, Nevada 89509

Area of Roof Installation:

Sections A, A1, B, and B1

Date of Acceptance
(Effective Warranty Date):

1. Contractor guarantees to Owner that the work identified above has been installed in accordance with the Contract Documents for the above referenced project, and meets the minimum requirements of the Manufacturers of all materials used in performance of the work.
2. Contractor guarantees to Owner that Contractor for a period of two years commencing with the date of Owner's acceptance of the installation, will make good any deficiencies that develop as a direct result of workmanship defects, by repairing or replacing such defects. All corrective work shall utilize materials and installation procedures in strict accordance with the Contract Documents.
3. Contractor guarantees to Owner that Contractor for a period of two years commencing with the date of Owner's acceptance of the installation, will maintain all sheet metal flashing in a watertight condition without cost to the Owner.
4. Contractor's liability hereunder shall be limited to the repair or necessary replacement of any defective component of the work without cost to Owner and shall not include incidental or consequential damages.

* By: _____

Title: _____

Company: _____

Date Executed: _____

** Warranty must be signed by a Company Officer*

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Provide all labor, materials, equipment, and tools to prepare the existing roofing system for the specified work, as designated in the specifications or on the drawings.
- B. Provide for the proper disposal of all existing materials to be removed, as designated in the specifications or on the drawings.
- C. Provide for the cleanup of excess materials, equipment, tools, and construction debris, as required to maintain the project site in a neat and orderly condition.

1.02 Standards

- A. Resource Conservation and Recovery Act of 1976.
- B. State, County, and City requirements, as applicable.

1.03 Scheduling and Coordination

- A. Schedule and coordinate the roof demolition and/or preparation work with the new work in such a manner as to keep the new insulation and roofing materials, building, and building interior absolutely dry and watertight.
- B. Coordinate all work with related trades and the Owner, to minimize any disruptions of the Owner's operations.
- C. Refer to related requirements specified elsewhere in the Contract Documents.

1.04 Disposal

- A. All debris shall be stored in containers approved by the Owner's Representative, and removed from the roof on a daily basis.
- B. Keep Owner's property clean of any construction debris.
- C. Contractor shall dispose of construction debris in accordance with the referenced standards.

PART TWO – PRODUCTS**2.01 Cleaners**

- A. Cleaners used in conjunction with surface preparation work shall meet local code requirements for runoff water quality.
- B. Cleaners and/or solvents shall not have a detrimental effect on the new or existing roof systems or the roof and building drainage system.

PART THREE – EXECUTION**3.01 Protection of Surfaces**

- A. Contractor shall take all precautions during demolition and preparation necessary to protect the building and adjacent surfaces from being soiled or damaged.
- B. Contractor shall restore to original condition any damage caused during work performed under this section.
- C. Keep roof surface clean of any debris that might prevent proper drainage.
- D. Prior to demolition work, verify that all soil pipes, flues, steel members, and other similar penetrations are secured to the building structure. Coordinate removal or securement of all unsecured penetrations prior to the start of demolition work.

3.02 Debris Handling

- A. No material shall be dropped to any point lying outside the exterior walls of the structure, unless otherwise approved in writing by the Owner's Representative.

3.03 Disposal

- A. Properly dispose of all construction debris on a daily basis.
- B. Do not store debris on roof unless otherwise directed by the Owner. Contractor shall not overstress the roof decking.

3.04 Preparation of Surfaces

- A. The extent of preparation of surfaces is listed in each section of the specifications and notes on the drawings.
- B. All debris shall be removed from the roof decking. The decking shall be broom clean at a minimum, and additionally prepared as noted on the drawings, as specified elsewhere, and as required by the Manufacturer of materials to be applied over the decking.
- C. All debris shall be removed from the rib openings of metal decking, where metal decking is present, prior to the start of new roof system installation.

3.05 Cleanup

- A. Throughout the duration of the project, retain all stored materials and equipment in an orderly arrangement allowing maximum access, not impeding drainage or traffic and providing the required protection of materials.
- B. Weekly, and more often if necessitated by job conditions, Contractor shall inspect all arrangements of materials stored on site and restack, tidy and resecure as required.
- C. Contractor shall clear the construction areas and shall provide for the removal of all construction debris from the site. Contractor shall not allow the accumulation of scrap, debris, waste material, and other items not required for construction of this work. Contractor shall provide storage of all items awaiting removal from the project site, observing all requirements for fire protection, and protection of the surrounding site.

- D. Daily and more often if necessitated by job conditions, Contractor shall inspect the site and pickup all scrap, debris, and waste material. Contractor shall remove such items promptly, leaving the construction area and site clean daily.
- E. Contractor shall be responsible to assure that their subcontractors have properly removed and disposed of all debris relating to their contract.
- F. At least twice each month and more often if directed by the Owner, Contractor shall completely remove all scrap, debris, and waste material from the project site. Contractor shall maintain the site in a neat and orderly condition at all times.
- G. At the completion of the contract, Contractor shall remove from the project site all equipment, tools, excess materials, and construction debris related to their contract. Contractor shall be responsible to assure that their subcontractors have properly removed from the project site all equipment, tools, excess materials, and construction debris related to their contract.
- H. Contractor shall be responsible for returning all areas set aside for staging and storage to their original condition.
- I. Contractor shall repair damage and remove stains caused by work related to their contract.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Work includes, but is not necessarily limited to:
 - 1. Covering openings in the deck using 16 gauge flat stock and secure as detailed.
 - 2. Wire brush and prime paint surface rusted steel decking, where the level of corrosion does not necessitate deck replacement.

1.02 Quality Assurance

- A. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
 - 1. *Steel Deck Institute Design Manual*, Steel Deck Institute
 - 2. *Steel Deck Construction Handbook*, Steel Deck Institute
 - 3. Manufacturer's published specifications, product data sheets, application instructions, and technical bulletins.
 - 4. *Annual Book of ASTM Standards*, ASTM International
 - 5. *ASCE/SEI 7 - Minimum Design Loads for Buildings and Other Structures*, American Society of Civil Engineers
 - 6. *Surface Preparation Standards*, Society for Protective Coatings (SSPC) and the National Association of Corrosion Engineers International (NACE)
- B. Qualifications of Installers: Use adequate number of skilled workers who are thoroughly trained and experienced in the necessary crafts, and who are completely familiar with the specified requirements and methods needed for proper performance of the work in this section. In acceptance or rejection of the work, the Owner will make no allowance for lack of skill on the part of the workers.

1.03 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Complete material list of all items proposed to be furnished and installed under this section.

1.04 Delivery, Storage, and Handling

- A. Deliver materials to the job site in original, unopened bundles. Materials are to be stored off the ground with one end elevated to provide drainage and are to be protected from the elements with weatherproof tarps ventilated to avoid condensation.

- B. Keep all materials clearly identified with all identifying marks legible. Keep all damaged material clearly identified as damaged and stored separately to prevent its inadvertent use.
- C. Do not allow installation of damaged or otherwise non-complying material.
- D. Use all necessary means to protect the materials in this section before, during, and after installation, and to protect the work and materials of all other trades.
- E. In the event of damage, immediately make all necessary repairs and replacements subject to the approval of, and at no additional cost to the Owner.
- F. Roof surfaces shall be protected from damage at all times.

1.05 Warranty

- A. See Section 01 78 36 - Warranties.

PART TWO – PRODUCTS

2.01 Steel Decking

- A. Flat stock decking repair material, if necessary, shall be 16-gauge, G90 galvanized or Galvalume coated steel.

2.02 Fasteners

- A. Fasteners for securement of steel decking to structural supports or for steel decking and steel flat stock side laps shall be self-drilling, screw type fasteners. Powder-activated or compressed air-actuated fasteners will not be accepted or used.
- B. Fasteners shall be listed in RoofNav as FM Global approved products.
- C. Approved Products
 - 1. Teks 5 HWH 12-24 x 1.5" by ITW Buildex – For fastening of steel decking to structural members.
 - 2. Teks 1 HWH 10-16 x 3/4" by ITW Buildex – For fastening of steel decking side laps and flat stock repair materials.
 - 3. Approved equal

2.03 Primers and Paints – Galvanized Steel Decking

- A. Steel Decking Primer – Approved Products
 - 1. Pro Industrial Pro-Cryl Universal Acrylic Primer by Sherwin-Williams
 - 2. Approved equal
- B. Steel Decking Paint – Approved Products
 - 1. Pro Industrial DTM Acrylic Coating by Sherwin-Williams
 - 2. Approved equal

PART THREE – EXECUTION**3.01 Installation - Deck Replacement**

- A. For openings, install, G90 galvanized sheet metal overlapping the adjacent decking 18" on all sides. Sheet metal repair shall be fastened to existing decking at 6" o.c.

3.02 Surface Rust Repair - General

- A. Perform all preparation and cleaning procedures in strict accordance with the paint Manufacturer's recommendations.
- B. Surface rust areas shall be wire brushed to remove any loose or foreign materials that would adversely affect adhesion or function of applied coating. Surface preparation shall meet or exceed SSPC-SP2.
- C. Stir all materials before application to produce a mixture of uniform density and as required during the application of materials. Do not stir into the material any film that may form on the surface.
- D. Coverage of all coating applications shall be complete and of uniform thickness.
- E. Allow paint to dry prior to installing subsequent roof system components.

3.03 Priming and Painting - Galvanized Steel Decking

- A. Over the prepared and cleaned surfaces, apply one coat of rust-inhibitive primer. Application rate shall provide for 5.0 to 10.0 wet mils and 1.8 to 3.6 dry mils.
- B. After primer has dried, apply one coat of paint. Coverage shall be complete and of uniform thickness. Application rate shall provide for 6.0 to 9.5 wet mils and 2.5 to 4.0 dry mils.

3.04 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed.
- B. Contractor shall correct any deficient work prior to installing subsequent work or notification of completion.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Work includes, but is not necessarily limited to:
 - 1. Installation of nailers, lumber and/or plywood per the drawings and specifications.

1.02 Quality Assurance

- A. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
 - 1. Manufacturer's published specifications, product data sheets, application instructions, and technical bulletins.
- B. Qualifications of Installers: Use adequate numbers of skilled workers who are thoroughly trained and experienced in the necessary crafts, and who are completely familiar with the specified requirements and the methods needed for proper performance of the work in this section.
- C. In acceptance or rejection of the work of this section, the Owner will make no allowance for lack of skill on the part of the workers.

1.03 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Complete material list of all items proposed to be furnished and installed under this section.

1.04 Delivery, Storage, and Handling

- A. Store all materials up, off of the roof or ground, and covered with weatherproof tarps anchored sufficiently, so as to resist wind blow-off. Roof surfaces shall be protected from damage at all times.
- B. Keep all materials clearly identified with all grade marks legible. Keep all damaged material clearly identified as damaged and stored separately to prevent its inadvertent use.
- C. Do not allow installation of damaged or otherwise non-complying material.
- D. In the event of damage, immediately make all necessary repairs and replacements to the approval of and at no additional cost to the Owner.

1.05 Warranty

- A. See Section 01 78 36 - Warranties.

PART TWO – PRODUCTS**2.01 Wood Nailers and Dimension Lumber**

- A. Lumber shall have Gradestamp indicating #2 or better, construction grade, S4S, produced in North America. Lumber Gradestamp indicating lumber importation from outside of North America is unacceptable.
- B. Size shall be as indicated on the drawings or meet performance criteria noted on the drawings.
- C. Minimum nailer size shall be 2" x 6" (nominal).
- D. Minimum top nailer thickness shall be 1.5" (nominal).
- E. Nailers shall extend 1/2" minimum beyond metal flanges.

2.02 Plywood

- A. All plywood shall be minimum 1/2", APA Rated Exterior, Structural 1. Only waterproof glue is acceptable. Plywood shall have PS-1 Gradestamp. PRP-108 Gradestamp without PS-1 is unacceptable.
- B. Plywood thickness shall be as indicated on the drawings. Provide 3/4" minimum material if no thickness is indicated.

2.03 Carbon Steel Fasteners

- A. All fasteners shall be carbon steel with corrosion-resistant coating.
- B. Fasteners shall be FM Global approved and meet FM 4470.
- C. Contractor shall field verify existing and new substrates and select appropriate fasteners from the specified options to meet the intent of the drawings, specifications, and specified standards. Contractor shall coordinate all fastener types, dimensions, head styles, drill points and threads per inch. If a required fastener is not included in the specifications or noted on the drawings, Contractor shall submit a request for clarification to the Owner's Representative before proceeding.
- D. Masonry and Concrete Fasteners
 - 1. Corrosion-resistant, threaded fastener, #14 minimum.
 - 2. Fasteners shall be of length to provide 1.5" minimum embedment into concrete and masonry substrates.
 - 3. Approved Products
 - a. #15 Dekfast by SFS Group USA, Inc. with E-coat
 - b. #14 Heavy Duty Roofing Fastener by OMG, with CR-10 coating
 - c. HeadLok SP Fastener by OMG, with CR-10 coating
 - d. Trufast #14 HD by Altenloh, Brinck & Co. U.S., Inc., with E-coat

- e. Specified roof system Manufacturer equivalent
- E. Steel Decking and Wood Fasteners
 - 1. Corrosion-resistant, self-tapping, self-drilling screw, #14 minimum.
 - 2. Fasteners shall be of length to provide 1.5" penetration into substrates.
 - 3. Approved Products
 - a. #15 Dekfast by SFS Group USA, Inc. with E-coat
 - b. #14 Heavy Duty Roofing Fastener by OMG, with CR-10 Coating
 - c. HeadLok SP Fastener (steel deck) or HeadLok GP Fastener (wood) by OMG, with CR-10 coating
 - d. Trufast #15 EHD by Altenloh, Brinck & Co. U.S., Inc., with E-coat
 - e. Trufast SIP LD by Altenloh, Brinck & Co. U.S., Inc., with E-coat
 - f. Specified roof system Manufacturer equivalent

PART THREE – EXECUTION

3.01 General

- A. Protect adjacent surfaces as required to prevent damage when storing, cutting, handling and installing the work described by this section.
- B. Contain and immediately remove sawdust, to prevent contamination of substrates to receive subsequent construction. Replace any damaged components or construction at no cost to the Owner.
- C. Where predrilling of concrete and/or masonry is required for fastener installation, utilize bit type and size, and hole depth recommended by the fastener Manufacturer. Remove drilling dust from fastener holes prior to installing fasteners.

3.02 Lumber and Nailers

- A. Lumber and nailers shall be installed per detail drawings. Screws shall be used for all carpentry work.
- B. Discard units of material with defects that might impair quality of work and units that are too small to use in fabricating work with minimum joints or optimum joint arrangement.
- C. Set lumber and nailers to required levels and lines with members plumb and true.
- D. All perimeter nailers shall be of uniform height within a given roof section.
- E. Lumber shall be installed with 1/4" gap between ends of adjoining pieces.
- F. Where two or more pieces of lumber are stacked, offset butt joints a minimum of 12" between adjacent layers.

- G. Perimeter nailer installation shall be in accordance with the following:
1. Fasteners in 6" or wider (nominal) lumber shall be installed in two rows, staggered one-third of nailer width. Fastener spacings scheduled on drawings indicate distance between fasteners within each row.
 2. Nailer fastener spacing shall be decreased within Zone 3, as noted on the drawings.
 3. Two fasteners shall be installed 4" to 6" from the end of each piece of lumber, as shown on the drawings.
 4. Where two or more nailers are stacked, fasten each piece of lumber independently unless otherwise shown on the drawings.
 5. Lay out and route each fastener location in bottom nailer using 3/4" Forstner bit. Recess shall be no deeper than required for fastener heads to be flush with wood surface. Attach bottom nailer using specified hex washer head fasteners with 5/8" diameter washers. Fasten subsequent lumber with the specified screws without washers at the specified spacings.
 - a. Recess fastener heads to be flush with wood surface in all layers attached using hex washer head fasteners.
 - b. Where roofing materials will be applied onto carpentry work, outer/upper lumber shall be fastened using Phillips flat head or Phillips truss head fasteners, with heads installed flush with wood surface.
 - c. Do not point load underside of roofing or flashing membrane.
 6. Maximum fastener spacing shall be as specified on the drawings.

3.03 Plywood

- A. Plywood shall be installed per detail drawings. Screws shall be used for all plywood attachment.
- B. Plywood joints shall be true and well fitting, allowing for expansion and contraction. Allow 1/8" at end and edge joints.
- C. Plywood fasteners shall be installed in a uniform grid pattern, with a maximum spacing of 18" o.c. between adjacent fasteners.
- D. Where fastening to steel stud framing, fasten to each framing member at 6" o.c.
- E. If plywood facing is installed over a curb, offset plywood joints a minimum of 24" from underlying butt joints in the curb.
- F. Individual pieces of plywood shall be a minimum of 24" wide with a minimum of two vertical fastener rows applied.
- G. Bevel cut edges of plywood at 45-degrees, if shown on the detail drawings.

3.04 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed.

- B. Contractor shall correct any deficient work prior to installing subsequent work or notification of completion.

3.05 Cleaning

- A. Debris from carpentry work shall be frequently and thoroughly removed from construction areas as it accumulates.
- B. Clean debris and properly dispose of all construction debris such as wood trimmings, sawdust, and fasteners, prior to proceeding with subsequent parts of the work.
- C. Refer to Section 02 41 20 – Roof Demolition and Cleanup for additional requirements.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Provide and install roof board insulation and means of securement complete, in-place, per the drawings and specifications.

1.02 Quality Assurance

- A. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
 - 1. *The NRCA Roofing and Waterproofing Manual*, National Roofing Contractors Association
 - 2. Manufacturer's published specifications, product data sheets, application instructions, and technical bulletins.
 - 3. *Annual Book of ASTM Standards*, ASTM International
- B. Qualifications of Installers: Use adequate number of skilled workers who are thoroughly trained and experienced in the necessary crafts, and who are completely familiar with the specified requirements and methods needed for proper performance of the work in this section. In acceptance or rejection of the work, the Owner will make no allowance for lack of skill on the part of the workers.
- C. Roofing Inspections: Make all required notifications and secure all required inspections by the Manufacturer of the approved materials to facilitate issuance of the specified roof warranty.
- D. U.L. Listing: Provide materials bearing Underwriters Laboratories (U.L.) marking on bundle, package, or container indicating that materials have been produced under U.L.'s classification and follow-up service.

1.03 References

- A. References: Materials used in this section shall be listed in the reference(s) below. The reference(s) used shall be the latest published edition available on the date the Contractor submits its price proposal to the Owner.
 - 1. *UL Product iQ* <https://productiq.ulprospector.com> UL Solutions

1.04 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Most recent copy of Manufacturer's literature applicable to products and specifications to be used.
 - 2. Complete material list of all items proposed to be furnished and installed under this section.

1.05 Delivery, Storage, and Handling

- A. Deliver materials to job site in their original unopened containers, no sooner than 14 days prior to start of project. Package labels shall indicate material name, production date, and/or product code. Slit Manufacturer-supplied plastic covering and cover with weatherproof tarps that are securely anchored to prevent blow-off.
- B. Store materials in dry, raised, protected areas in an upright position. Control temperature of storage areas in accordance with Manufacturer's instructions. Protect materials from exposure to the elements. When storing materials on the roof, do not over stress the deck.
- C. Use all necessary means to protect the materials in this section before, during, and after installation, and to protect the work and materials of all other trades.
- D. In the event of damage, immediately make all necessary repairs and replacements subject to the approval of and at no additional cost to the Owner.
- E. Follow the Manufacturer's recommendations for storage of temperature-sensitive materials.

1.06 Scheduling

- A. Work shall be performed on a daily basis with each section completed before progressing to the next day's work, unless specifically directed otherwise by the Owner's Representative.
- B. Completion of work will be defined as the installation of all specified roof preparation, insulation, field membrane, flashings, counterflashings, sheet metal, fasteners, and caulking.

1.07 Warranty

- A. See Section 01 78 36 - Warranties.

PART TWO – PRODUCTS**2.01 General**

- A. All materials used on this project shall be compatible with the existing conditions and with each other.
- B. No product shall contain any asbestos or asbestos-related products.
- C. Insulation, fasteners, and/or adhesives used on this project shall be approved by the roofing membrane Manufacturer, shall be compatible with the roof system specified, and shall qualify for the specified roofing membrane Manufacturer's warranty.

2.02 Insulation Materials

- A. Polyisocyanurate Foam Roof Insulation - Coated Glass Facer (CGF)
 - 1. Insulation shall be a closed-cell, polyisocyanurate foam core with polymer-bonded, fiberglass facers conforming to ASTM specification C 1289, Type II, Class 2. Foam core shall have a rated flame spread of 75 or less in accordance with ASTM E 84. Insulation shall have minimum compressive strength of 20 psi (Grade 2) in accordance with ASTM C 1289.

2. Approved Products
 - a. Sarnatherm CG by Sika Sarnafil Inc.
 - b. SecurShield Polyiso by Carlisle SynTec Systems
 - c. ENRGY 3 CGF by Johns Manville Roofing Systems Group
 3. Flat Stock Insulation Requirements
 - a. Insulation shall be supplied in 4' x 8' boards. Insulation shall be flat stock 3.0" thick.
 4. Tapered Insulation Requirements
 - a. Insulation shall be supplied in 4' x 4' boards. Insulation slope(s) and minimum thickness(es) shall be as noted on the drawings.
- B. Gypsum Board (Thermal Barrier)
1. Non-structural, moisture resistant gypsum panel. Gypsum board shall conform to ASTM C 1177 or ASTM C 1278. Gypsum board product shall be specifically recommended for the type of membrane application required by the Contract Documents, as applicable.
 2. Approved Products
 - a. DensDeck Prime by Georgia-Pacific Gypsum Corp.
 - b. SECUROCK Glass-Mat Roof Board by United States Gypsum Company
 3. Insulation Requirements
 - a. Gypsum board shall be supplied in 4' x 4' or 4' x 8' sheets. Gypsum board shall be flat stock 1/2" thick.
- C. High-Density Polyisocyanurate Cover Board
1. Insulation shall be a closed-cell, polyisocyanurate foam core with polymer-bonded glass fiber facers conforming to ASTM specification C 1289, Type II, Class 4. Foam core shall have a rated flame spread of 75 or less in accordance with ASTM E 84. Insulation shall have minimum compressive strength of 109 psi (Grade 2) in accordance with ASTM C 1289.
 2. Approved Products
 - a. Sarnatherm Roof Board H by Sika Sarnafil Inc.
 - b. SecurShield HD or SecurShield HD Plus by Carlisle SynTec Systems
 - c. ProtectoR HD by Johns Manville Roofing Systems Group
 3. Insulation Requirements
 - a. Insulation shall be supplied in 4' x 8' boards. Insulation shall be flat stock 0.5" thick.

- D. Polyisocyanurate/High-Density Polyisocyanurate Composite Board Roof Insulation
1. Insulation shall be polyisocyanurate foam core bonded to a glass fiber facer on one side and a 1/2" high-density polyisocyanurate cover board on the other. Insulation foam core shall have minimum compressive strength of 20 psi (Type II, Class 2, Grade 2) and HD cover board shall have a minimum compressive strength of 80 psi (Type II, Class 4, Grade 2) in accordance with ASTM C 1289. Foam core shall have a rated flame spread of 75 or less in accordance with ASTM E 84.
 2. Approved Products
 - a. H-Shield HD Composite CG by Hunter Panels, LLC
 - b. SecurShield HD Composite Polyiso by Carlisle SynTec Systems
 - c. ProtectorR Foam by Johns Manville Roofing Systems Group
 - d. Specified roof membrane Manufacturer-approved equal
 3. Insulation Requirements
 - a. Insulation shall be supplied in 4' x 8' boards. Total composite board thicknesses shall be flat stock 2.5" thick.
- E. Tapered Polyisocyanurate Edge Strip (for use upslope of curbs 18" or wider)
1. Polyisocyanurate insulation boards factory-produced to provide zero-edge transition. Insulation shall conform to C 1289, Type II, Class 1.
 2. Approved Products
 - a. SureSlope TES Tapered Edge Strip with AC Foam II Facer Technology by Atlas Roofing Corporation
 3. Insulation Requirements
 - a. Insulation shall be supplied 0" - 1.5" x 12".

2.03 Insulation Fasteners

- A. Steel Decking
1. Corrosion-resistant, self-tapping, self-drilling #12 threaded fastener with #3 Phillips head. Fasteners with hex washer heads (HWH) shall not be used. Fastener shall be carbon steel with corrosion-resistant coating.
 2. Corrosion-resistant 3" Galvalume-coated steel plate, supplied by fastener Manufacturer.
 3. Fastener and plate shall be tested and approved by FM Global to ensure compliance with the requirements of FM Approval Standard 4470.
 4. Approved Products
 - a. Sarnafastener - #12 and Sarnaplate by Sika Sarnafil Inc.

- b. InsulFast or HP Fastener and Insulation Fastening plate by Carlisle SynTec Systems
 - c. UltraFast Fastener and Insulation Plate by Johns Manville Roofing Systems Group
 - d. Manufacturer-approved equal
5. Steel Deck: Fasteners shall be the shortest length to penetrate the top flange of the deck by 3/4".
6. Fasteners shall not protrude below the bottom rib of steel deck.

PART THREE – EXECUTION

3.01 Description

- A. The latest Manufacturer specifications and installation instructions shall be followed along with the following requirements. These specific minimum requirements must be included in the bid and shall not be altered.
- B. Inspection
 - 1. Examine the areas and conditions under which work in this section will be installed. Correct conditions detrimental to the proper and timely completion of the work. Do not proceed until such conditions have been corrected.
- C. Preparation and Surface Conditions
 - 1. Before insulation application is started, remove trash, debris, grease, oil, water, moisture, and contaminants from substrate to receive insulation.
 - 2. Prepare all surfaces in accordance with applicable specification sections.
 - 3. Protect adjacent areas from damage.
 - 4. Surfaces scheduled to receive insulation shall be free of any standing water, frost, snow, or loose debris.
 - 5. Substrate shall be smooth, free of sharp projections, and free of obvious depressions.
 - 6. All nailers shall be installed prior to installing insulation.
- D. Installation – General
 - 1. Perform all related work specified elsewhere necessary for the installation of the specified roof insulation.
 - 2. Ensure that fasteners do not penetrate conduit or other miscellaneous items located on the underside of the roof deck, or spall the underside of the deck.
 - 3. Install plates and fasteners tight and flat to substrate with no dimpling of the substrate surface. Prevent deformation of plates due to overdriving fasteners. Do not underdrive fasteners so that the plate is able to spin freely.

4. Do not apply insulation materials when water in any form (i.e., rain, dew, ice, frost, snow, etc.) is present.
5. Install tapered insulation cricket at the upslope side of each curb that is 18" or wider. Cricket shall extend out half the width of the curb and the cricket's slope shall be twice the opposing field slope.
6. Attachment zone dimensions shall be calculated based upon the code-mandated version of ASCE-7.
7. Refer to the material Manufacturer's published product data sheets and installation instructions for information regarding acceptable temperature ranges and other weather-related criteria that might affect the installation schedule.
 - a. Do not install materials if substrate temperature falls outside the acceptable ranges defined in the material Manufacturer's published information.
 - b. Commence with application of systems and materials only when ambient temperatures and other weather-related criteria are forecast to satisfy the Manufacturer's requirements for all components to be installed.
 - c. To the extent defined by the Manufacturer's published information, consideration shall be made for cure times after installation. Do not proceed with material or system application if Manufacturer's requirements are not able to be met during the full recommended curing period.
 - d. Any exceptions shall require the Contractor to provide a project-specific letter from the material Manufacturer's technical services department approving a deviation to install or cure a given material outside the published parameters. Where a deviation letter is provided, Manufacturer shall clearly state the revised acceptable limitations to be followed by the Contractor.
 - e. Refer to Manufacturer's published installation instructions and applicable technical bulletins for specialized cold or hot weather application techniques. When weather conditions on the project site meet the specified criteria, proceed in accordance with the Manufacturer-recommended techniques.

3.02 Mechanically Fastened Construction

- A. Single Layer (Thermal Barrier)
 1. Insulation shall be installed with all joints tightly butted and end joints staggered 12" minimum. Insulation shall fit tightly against all adjacent substrate surfaces and penetrations.
 2. Areas of damage or broken corners shall be cut out and replaced with pieces 12" x 12" minimum, fastened into place.
 3. Fastener spacings shall be as defined on the drawings, but no less than two fasteners per each piece of insulation.
 4. Fasten insulation with screw and plate type fasteners.

B. Multiple Layers

1. Bottom layer of insulation shall be installed with all joints tightly butted and end joints staggered 12" minimum. Insulation shall fit tightly against all adjacent substrate surfaces and penetrations.
2. Areas of damage or broken corners shall be cut out and replaced with pieces 12" x 12" minimum.
3. Additional layer(s) of insulation shall be installed over preceding layer(s) with all joints tightly butted and end joints staggered 12" minimum. Insulation shall fit tightly against all adjacent substrate surfaces and penetrations.
4. Insulation joints in each layer shall be offset a minimum of 12" from insulation joints in the preceding layer, including all daily tie-off locations.
5. Areas of damage or broken corners shall be cut out and replaced with pieces 12" x 12" minimum, fastened into place.
6. Fastener spacings shall be as defined on the drawings, but no less than two fasteners per each piece of insulation.
7. Fasten the top layer of insulation boards with screw and plate type fasteners.
8. Fastening patterns and attachment zones shall be installed per the drawings and specifications.
9. Any whole or partial insulation board that falls within a given attachment zone shall have the increased fastening applied over the entire board.

3.03 Tapered Insulation

- A. Install tapered crickets on the upslope sides of all rectangular penetrations with a dimension greater than 18" perpendicular to slope.
- B. Utilize tapered edge strip at transitions in construction of more than 1/4", and in other specified locations, to provide a smooth transition and proper support for the membrane system or subsequent insulation layer. Field cut and shape edge strip as required. Direct slope of edge strip to provide for proper drainage.

3.04 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed. Verify that insulation boards are positively secured.
- B. Contractor shall correct any deficient work prior to installing subsequent work.

3.05 Cleaning

- A. Contractor shall follow the requirements of Section 02 41 20 - Roof Demolition and Cleanup.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Furnish and install a self-adhering vapor retarder system, complete, in-place, per the drawings and specifications.
- B. Vapor retarder and flashings shall function as a temporary roof system and shall be protected and maintained watertight during construction.

1.02 Quality Assurance

- A. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
 - 1. *The NRCA Roofing and Waterproofing Manual*, National Roofing Contractors Association
 - 2. Manufacturer's published specifications, product data sheets, application instructions, and technical bulletins.
- B. Qualifications of Installers: Use adequate numbers of skilled workers who are thoroughly trained and experienced in the necessary crafts, and who are completely familiar with the specified requirements and the methods needed for proper performance of the work in this section.
- C. In acceptance or rejection of the work of this section, the Owner will make no allowance for lack of skill on the part of the workers.
- D. Roofing Inspections: Make all required notifications and secure all required inspections by the Manufacturer of the approved materials to facilitate issuance of the specified roof warranty.
- E. The Contractor shall not subcontract the installation of the material covered under this section to an individual or firm that is not a full-time employee of the Contractor's company.

1.03 References

- A. References: Materials used in this section shall be listed in the reference(s) below. The reference(s) used shall be the latest published edition available on the date the Contractor submits its price proposal to the Owner.
 - 1. *UL Product iQ* <https://productiq.ulprospector.com> UL Solutions

1.04 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Complete material list of all items proposed to be furnished and installed under this section.
 - 2. Most recent copy of Manufacturer's literature applicable to products and specifications to be used.

3. Submit Contractor's proposed detail for temporary water cutoff installation.

1.05 Delivery, Storage, and Handling

- A. Protection: Use all means to protect the materials of this section before, during, and after installation and to protect the work and materials of all other trades.
- B. Delivery and Storage: Deliver materials to the job site in original, unopened containers no sooner than 14 days prior to start of job. Package labels shall indicate material name, production date, lot number, and/or product code. Materials shall be stored up off the roof or ground, and covered completely with weatherproof tarps that are securely anchored, so as to resist wind blow-off. When storing materials on the roof, do not overstress the deck.
- C. Replacements: In the event of damage, immediately make all repairs and replacements to the approval of the Owner and at no additional cost to the Owner.
- D. Follow the Manufacturer's recommendations for storage of temperature sensitive materials.

1.06 Scheduling

- A. Work is to be performed on a daily basis with each section completed before progressing to the next day's work, unless specifically directed otherwise by the Owner's Representative.
- B. Completion of work will be defined as the installation of all specified substrate preparation, primer, vapor retarder, vapor retarder flashings, and temporary tie-ins.
- C. Comply with maximum length of time the vapor retarder Manufacturer allows the completed work to be exposed to the elements prior to installation of the subsequent roof board insulation system.

1.07 Warranty

- A. See Section 01 78 36 - Warranties.

PART TWO – PRODUCTS

2.01 General

- A. All materials used on this project shall be compatible with the existing conditions and with each other.
- B. No product shall contain any asbestos or asbestos-related products.
- C. No product shall contain lead or lead-related products.
- D. Vapor retarder primer, vapor retarder, and vapor retarder flashings used on this project shall be approved by the roofing membrane Manufacturer, shall be compatible with the roof system specified, and shall qualify for the specified Membrane Manufacturers' warranties.

2.02 Vapor Retarder Primer

- A. Solvent based primer composed of resins and synthetic rubber.

- B. Approved Products
 - 1. Vapor Retarder Primer SB by Sika Sarnafil, Inc.
 - 2. CAV-Grip III by Carlisle SynTec Systems
 - 3. SAR Primer by Johns Manville Roofing Systems Group
 - 4. Membrane Manufacturer-approved equal

2.03 Vapor Retarder

- A. Vapor retarder for field of roof, perimeter flashings, and curb flashings shall be a self-adhering membrane composed of SBS modified bitumen adhesive on the bottom surface and a tri-laminated woven polyethylene on the top surface. A silicone release film covers the self-adhesive under surface.
- B. Approved Products
 - 1. Vapor Retarder SA 31 by Sika Sarnafil, Inc.
 - 2. VapAir Seal725TR by Carlisle SynTec Systems
 - 3. JM Vapor Barrier SAR by Johns Manville Roofing Systems Group
 - 4. Membrane manufacturer approved equal

2.04 Vapor Retarder Flashings (Sika Sarnafil System Only)

- A. Sika Sarnafil supplied mastic for sealing around pipe penetrations, T-joints, 90° angle transition and other openings.
- B. Membrane manufacturer approved equal.

2.05 Vapor Retarder Flashings (Johns Manville Roofing Systems Group System Only)

- A. JM Single Ply LVOC Caulk for sealing around pipe penetrations, T-joints, 90° angle transition and other openings.
- B. Membrane Manufacturer-approved equal.

2.06 Vapor Retarder Flashings (Carlisle SynTec Systems Only)

- A. CAV-Grip III and Carlisle Water Cutoff Mastic for sealing around pipe penetrations, T-joints, 90° angle transition and other openings.
- B. Membrane Manufacturer-approved equal.

2.07 Vapor Retarder Seam Protection (Sika Sarnafil System Only)

- A. Aluminum foil duct tape.
- B. Membrane Manufacturer-approved equal.

2.08 Vapor Retarder Seam Protection (Johns Manville Roofing Systems Group Only)

- A. SAR Primer and JM LVOC Caulk by Johns Manville Roofing Systems Group.
- B. Membrane Manufacturer-approved equal.

2.09 Vapor Retarder Seam Protection (Carlisle SynTec System Only)

- A. CAV-Grip III and Carlisle Water Cutoff Mastic by Carlisle SynTec Incorporated.
- B. Membrane Manufacturer-approved equal.

2.10 Other Materials

- A. All other materials not specifically described but required for a complete and proper installation of the work in this section shall be as proposed by the Contractor, approved by the Manufacturer, and subject to the approval of the Owner's Representative.

PART THREE – EXECUTION**3.01 Description**

- A. The latest Manufacturer specifications and installation techniques shall be followed with the following requirements. These specific minimum requirements shall be included in the bid and are not to be altered.

3.02 Inspection

- A. Examine the areas and conditions under which work in this section will be installed. Correct conditions detrimental to the proper and timely completion of the work. Do not proceed until such conditions have been corrected.

3.03 Preparation and Surface Conditions

- A. Before vapor retarder installation is started, remove trash, debris, grease, oil, water, moisture, and contaminants from substrates to receive vapor retarder.
- B. Prepare all surfaces according to applicable specification sections.
- C. Protect adjacent areas from damage.
- D. Surfaces scheduled to receive vapor retarder shall be dry and free of frost, snow, or loose debris.
- E. Substrate shall be smooth, free of sharp projections and free of obvious depressions.
- F. All carpentry, metal fabrications, or other required preliminary work shall be installed prior to installing vapor retarder membrane, where applicable. Refer to Drawings for components to be installed prior to the vapor retarder.
- G. Vapor retarder membrane shall be inspected and repaired by the Contractor prior to installing roof insulation.

3.04 Installation – General

- A. Perform all related work specified elsewhere necessary for the installation of the specified vapor retarder system
- B. Do not apply roofing materials when water in any form (i.e., rain, dew, ice, frost, snow, etc.) is present.
- C. Specified side lap and end lap dimensions are minimums. If vapor retarder Manufacturer's requirements exceed those stated, then the Manufacturer's requirements shall be followed.
- D. Temperature of substrate, vapor retarder system materials, and ambient conditions shall be within the Manufacturer's recommended ranges during application of materials.

3.05 Installation – Primer, Vapor Retarder, and Vapor Retarder Flashings

- A. Priming
 - 1. Prime all substrates to receive vapor retarder membrane and associated flashings at the Manufacturer's recommended application rates. Rates vary depending on type and porosity of the substrate materials; but shall not be less than 1/2 gallon per 100 square feet. The primer shall be allowed to dry prior to application of vapor retarder materials.
 - 2. Primer application shall achieve full and uniform coverage, using application procedures recommended by the Manufacturer.
- B. Vapor Retarder
 - 1. After primer has flashed-off as recommended by the Manufacturer, vapor retarder membrane shall be unrolled and placed.
 - 2. Beginning at low point of roof slope, apply 1 layer of vapor retarder membrane maintaining minimum 3" side laps and 6" end laps. End laps shall be offset 3' minimum.
 - 3. Roll all sheets in a straight line so that no kinks or fish mouths result, and sheets are laid completely flat. Once sheet direction is determined, do not change direction over the entire roof area.
 - 4. Once the membrane is in place, while holding the membrane tight, peel off the silicone release film by pulling diagonally. Membrane shall be immediately rolled with a steel roller or roller wrapped in resilient material, weighing a minimum of 100 pounds.
 - 5. All side and end laps in the vapor retarder membrane shall be immediately rolled with a 2" silicon roller. Full adhesion shall be achieved, and all edges and T-laps shall be well sealed. At all T-laps, apply Manufacturer-supplied mastic or sealant, as recommended by the Manufacturer.
 - 6. Any wrinkles or fish mouths shall be cut out and repaired with new material overlapping 12" minimum onto adjacent material to remain.
 - 7. Any vapor retarder punctures or other damage shall be patched with a new material overlapping 12" minimum onto adjacent material on all sides.

C. Vapor Retarder Flashings

1. Vapor retarder shall be flashed watertight and vapor-tight at all roof perimeters and penetrations.
2. Vapor retarder shall be continuous with adjacent building envelope materials, where shown on the Drawings, as required to provide a continuous seal.
3. Install one-ply self-adhered modified bitumen vapor retarder material at base, edges, and curb flashings. Flashings shall be applied according to the Manufacturer's current published application instructions, unless superseded by the requirements of this section. All laps in the flashing materials shall be hand-rolled to ensure complete adhesion. Prevent contamination of laps. All corners and angle changes shall be additionally sealed with mastic or sealant.
4. All flashings shall be thoroughly rubbed in. Loose or poorly bonded flashings will not be accepted.
5. Laps at corners shall be thoroughly sealed with a heavy tooled bead of Manufacturer-supplied mastic or polyurethane sealant immediately after installation.
6. For flashing of vent pipes, gas piping, conduits, and other similar penetrations, Manufacturer-supplied trowel-applied mastic (Sika Sarnafil) or sealant (Johns Manville Roofing Systems Group and Carlisle SynTec Incorporated). All edges shall receive sealant.
7. At all locations where roofing membrane will be installed in direct contact with the vapor retarder surface, all vapor retarder lap seam edges shall be encapsulated with a tooled bead of sealant.

3.06 Temporary Water Cutoffs

- A. Temporary water cutoffs shall be constructed at the end of each working day to protect the vapor retarder substrate materials, roofing, building, and building interior from damage due to wind, snow, and rain.
- B. Contractor shall provide methods and materials compatible with the membrane, to provide a positively adhered weather and watertight seal, capable of withstanding inclement weather and ponded water.
- C. Construction of temporary water cutoffs is to be detailed by the Contractor and approved by the Manufacturer and the Owner's Representative.
- D. Temporary water cutoffs and contaminated membrane shall be neatly trimmed and removed at the start of the next workday.
- E. If any water is allowed to enter the vapor retarder system, the entire affected area, including substrate materials, shall be removed and replaced at no additional cost to the Owner.

3.07 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed.
- B. Contractor shall correct any deficient work prior to installing subsequent work.

- C. Inspect all vapor retarder and flashing seams prior to proceeding with subsequent construction. All loose or separated seams shall be repaired prior to proceeding.
- D. Inspect the vapor retarder system for punctures or other damage prior to proceeding with subsequent construction. Repair any such damage as specified prior to proceeding.

3.08 Repairs and Corrective Work

- A. Any areas of the vapor retarder system that incurs damaged due to staging of construction work, construction traffic, or other causes shall be repaired to satisfaction of the Owner and Manufacturer.
- B. Repairs shall be performed during the same workday that damaged is identified.
- C. Repairs shall be performed by removal of any materials that are not fully adhered, where the vapor retarder or flashings have been punctured/damaged, or where moisture has passed through the membrane and damaged the substrate materials. Following replacement of the substrate materials, the membrane shall then be replaced. Any areas of damage shall be overlaid with vapor retarder membrane material installed as specified, and extending a minimum of 12" past the damage on all sides.

3.09 Cleaning

- A. Contractor shall follow the requirements to Section 02 41 20 – Roof Demolition and Cleanup.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Furnish and install a weather and watertight adhered PVC roof complete, in-place, per the drawings and specifications.

1.02 Quality Assurance

- A. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
1. *The NRCA Roofing and Waterproofing Manual*, National Roofing Contractors Association
 2. Manufacturer's published specifications, product data sheets, application instructions, and technical bulletins.
 3. *Annual Book of ASTM Standards*, ASTM International
- B. Qualifications of Installers: Use adequate number of skilled workers who are thoroughly trained and experienced in the necessary crafts, and who are completely familiar with the specified requirements and methods needed for proper performance of the work in this section. In acceptance or rejection of the work, the Owner will make no allowance for lack of skill on the part of the workers.
- C. Roofing Inspections: Make all required notifications and secure all required inspections by the Manufacturer of the approved materials to facilitate issuance of the specified roof warranty.
- D. U.L. Listing: Provide materials bearing Underwriters Laboratories (U.L.) marking on bundle, package, or container, indicating that materials have been produced under U.L.'s classification and follow-up service.
- E. The Contractor shall not subcontract the installation of the roof system covered under this specification to an individual or a firm that is not a full-time employee of the Contractor's company. Included shall be the following components:
1. Insulation
 2. Roof Membrane
 3. Flashings
 4. Walkways

1.03 References

- A. References: Materials used in this section shall be listed in the reference(s) below. The reference(s) used shall be the latest published edition available on the date the Contractor submits its price proposal to the Owner.
1. *UL Product iQ* <https://productiq.ulprospector.com> UL Solutions

1.04 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Most recent copy of Manufacturer's literature applicable to products and specifications to be used.
 - 2. Complete material list of all items proposed to be furnished and installed under this section.
 - 3. Contractor's proposed detail for temporary water cutoff installation.

1.05 Delivery, Storage, and Handling

- A. Protection: Use all means to protect the materials of this section before, during, and after installation and to protect the work and materials of all other trades.
- B. Delivery and Storage: Deliver materials to the job site in original, unopened containers no sooner than 14 days prior to start of job. Package labels shall indicate material name, production date, lot number, and/or product code. Materials shall be stored up, off of the roof deck or ground and covered completely with weatherproof tarps that are securely anchored, so as to resist wind blow-off. When storing materials on the roof, do not over stress the deck.
- C. Replacements: In the event of damage, immediately make all repairs and replacements to the approval of the Owner and at no additional cost to the Owner.
- D. Follow the Manufacturer's recommendations for storage of temperature sensitive materials.

1.06 Scheduling

- A. Work is to be performed on a daily basis with everything completed before progressing to the next day's work, unless specifically directed otherwise by the Owner's Representative.
- B. Completion of work will be defined as the installation of all specified roof preparation, insulation, field membrane, flashings, termination bars and caulking. Roof-related sheet metal can be installed later in the project.

1.07 Warranty

- A. See Section 01 78 36 - Warranties.

PART TWO – PRODUCTS**2.01 General**

- A. Minimum product requirements have been listed. All of these components must be used and bid. Products not supplied by the membrane Manufacturer are to be purchased from a Manufacturer-approved source.
- B. Manufacturer supplied V.O.C. compliant products shall be bid and used if V.O.C. regulations are in effect at the project location at the time of bidding.

- C. No product shall contain any asbestos or asbestos-related products.
- D. No product shall contain lead or lead-related products.
- E. **Approved equal products must be proposed prior to the bid due date, and approval shall be granted by the Owner prior to award of the contract. Otherwise, substitutions shall not occur.**

2.02 Products Supplied by Manufacturer**A. Roof Membrane**

- 1. Roof membrane shall be 60-mil minimum, polyester reinforced, polyvinyl chloride (PVC) sheet membrane and shall comply with ASTM D 4434, Type III. Sheet widths of 6' (2 meters) or 10' (3 meters) are acceptable for use. Membrane color shall be white.
- 2. Approved Products
 - a. S327 Membrane by Sika Sarnafil, Inc.
 - b. Sure-Flex PVC Membrane by Carlisle SynTec Systems
 - c. JM PVC SD Plus Membrane by Johns Manville Roofing Systems Group

B. Flashing Membrane

- 1. Flashing membrane shall be nominal 60-mil minimum, fiberglass or polyester reinforced polyvinyl chloride (PVC) sheet membrane flashing color shall be white.

C. Membrane Adhesive

- 1. Solvent based contact adhesive for bonding the membrane to suitable horizontal and vertical substrates.
- 2. Approved Products
 - a. Sarnacol 2170 by Sika Sarnafil, Inc.
 - b. Sure-Flex PVC Bonding Adhesive by Carlisle SynTec Systems
 - c. JM PVC Membrane Adhesive Low VOC by Johns Manville Roofing Systems Group

-OR-

- 1. Water based membrane adhesive suitable for horizontal substrates.
- 2. Approved Products
 - a. Sarnacol 2121 Water Based Membrane Adhesive by Sika Sarnafil Inc.
 - b. Sure-Flex PVC Hydrobond Water Based Membrane Adhesive by Carlisle SynTec Systems

-
- c. JM PVC Water Based Membrane Adhesive by Johns Manville Roofing Systems Group
 - D. Membrane Coated Sheet Metal
 - 1. PVC film laminated to 24 or 25-gauge, galvanized sheet metal. Membrane coated metal color shall be white.
 - 2. Approved Products
 - a. Sarnaclad by Sika Sarnafil, Inc.
 - b. Sure-Flex Coated Metal by Carlisle SynTec Systems
 - c. JM PVC Coated Metal by Johns Manville Roofing Systems Group
 - E. System Fasteners – Wood
 - 1. Corrosion-resistant, Climeaseal coated, self-tapping, self-drilling screw with low profile head.
 - 2. Approved Products
 - a. Sarnafastener by Sika Sarnafil, Inc.
 - b. Carlisle HP-X Fastener by Carlisle SynTec Systems
 - c. High Load Fastener by Johns Manville Roofing Systems Group
 - F. System Fasteners – Concrete/Masonry
 - 1. Corrosion-resistant, threaded, or friction fit fastener with low profile head.
 - 2. Approved Products
 - a. Sarnafastener by Sika Sarnafil, Inc.
 - b. Carlisle HD-10 Concrete Fastener by Carlisle SynTec Systems
 - c. JM All Purpose Fasteners by Johns Manville Roofing Systems Group
 - G. Batten Strip
 - 1. 1" wide extruded aluminum or Galvalume metal bar, pre-punched at 6" o.c.
 - 2. Approved Products
 - a. Sarnastop by Sika Sarnafil, Inc.
 - b. Metal Fastening Bar by Carlisle SynTec Systems
 - H. Membrane Cleaners
 - 1. High quality, clear solvent cleaner for removing dirt and other contaminants from PVC membranes.

-
- 2. Approved Products
 - a. Sarna Seam Cleaner by Sika Sarnafil, Inc.
 - b. Carlisle PVC Membrane Cleaner by Carlisle SynTec Systems
 - c. JM Single-ply Membrane Cleaner Low VOC by Johns Manville Roofing Systems Group
 - I. Termination Bar
 - 1. Extruded aluminum counterflashing/bar with predrilled holes every 6" to 8" o.c.
 - 2. Approved Products
 - a. Sarnareglet by Sika Sarnafil, Inc.
 - b. Carlisle Termination Bar by Carlisle SynTec Systems
 - c. JM Termination Bar by Johns Manville Roofing Systems Group
 - J. Lap Seam Sealant
 - 1. Liquid thermoplastic sealant compound for sealing membrane edges where the reinforcement is exposed (if required by the selected membrane Manufacturer).
 - K. Water Cutoff Sealant
 - 1. Single-components, gun grade, polyurethane, or butyl-blend sealant used as water cutoffs behind flashings.
 - 2. Approved Products
 - a. Sikaflex 1a by Sika Sarnafil, Inc.
 - b. Carlisle Water Cutoff Mastic by Carlisle SynTec Systems
 - c. JM PVC Polyurethane Caulk by Johns Manville Roofing Systems Group
 - L. Prefabricated Flashings
 - 1. Pre-molded PVC flashings used for sealing all inside and outside flashing corners as supplied by the selected membrane Manufacturer.
 - 2. Pre-molded PVC pipe boot flashings for sealing stacks and vent pipe penetrations as supplied by the selected membrane Manufacturer.
 - M. Walkway
 - 1. Reinforced PVC protection mat
 - 2. Approved Products
 - a. Sarnatred V by Sika Sarnafil, Inc.

- b. Sure-Flex PVC Walkway by Carlisle SynTec Systems
 - c. JM PVC Walkpad by Johns Manville Roofing Systems Group
- N. Membrane Protection Mat
 - 1. Reinforced PVC protection mat for use under premanufactured pipe support bases.
 - 2. Approved Products
 - a. Sarnatred V by Sika Sarnafil, Inc.
 - b. Sure-Flex PVC Walkway by Carlisle SynTec Systems
 - c. JM PVC Walkpad by Johns Manville Roofing Systems Group

2.03 Other Materials

- A. All other materials not specifically described but required for a complete and proper installation of the work in this section shall be as selected by the Contractor, approved by the Manufacturer, and subject to the approval of the Owner.

PART THREE – EXECUTION**3.01 Description**

- A. The latest Manufacturer specifications and installation techniques are to be followed along with the following requirements. These specific minimum requirements must be included in bid and are not to be altered.

3.02 Inspection

- A. Examine the areas and conditions under which work in this section will be installed. Correct conditions detrimental to the proper and timely completion of the work. Do not proceed until such conditions have been corrected.

3.03 Surface Conditions

- A. Surfaces scheduled to receive roofing are to be free of any standing water, frost, snow, or loose debris.
- B. Substrate is to be smooth, free of sharp projections, and free of obvious depressions.
- C. All metal fittings specified or shown on drawings are to be in-place before roofing.
- D. All nailers shall be securely installed prior to roofing.
- E. All surfaces scheduled to receive PVC membrane must be free of physical contact with any bituminous materials, clean, and smooth.

3.04 Installation – General

- A. Perform all related work specified elsewhere necessary for the installation of the specified membrane system.

- B. Ensure that fasteners do not penetrate conduit, post tension cables, or other miscellaneous items located within or on the underside of the roof deck.
- C. Owner's Representative may take a seam sample of approximately 8" x 8" twice daily. Contractor shall be responsible for making watertight each sample area immediately after sample is cut.

3.05 Installation of Roofing Membrane

- A. Laps in the membrane sheets shall be oriented as to not oppose the direction of drainage. Sheets shall overlap a minimum of 3" at all side and end laps. When placing the membrane, ensure seam locations are held back a minimum of 24" from edges of drainage devices.

- B. Solvent Based Adhesive

Apply contact adhesive in a uniform fashion over a properly installed substrate using an approved 1/2" to 3/4" nap solvent resistant paint roller. The adhesive shall be applied in an even coat without holidays, puddles, or other irregularities, only over an area that can be covered by the day's operations. Coverage rate shall be 3/4 to 1.75 gallons per 100 square feet, depending upon substrate finish. The adhesive shall be allowed to dry completely before installing the membrane. Unroll and position roofing membrane, without stretching, over the approved substrate, allowing sheets to overlap a minimum of 3".

Once in place, one-half of the sheet's length shall be turned back and the underside shall be coated with adhesive at a rate of 1/2 to 1.25 gallons per 100 square feet. When the membrane adhesive has dried slightly to produce strings when touched with a dry finger, the coated membrane shall be rolled onto the previously coated substrate being careful to avoid wrinkles or air pockets. **Do not allow adhesive on the underside of the membrane to dry completely.** The amount of membrane that can be coated with adhesive before rolling into substrate will be determined by ambient temperature, humidity and crew. The bonded sheet shall be pressed firmly in-place with a water-filled, foam-covered lawn roller by frequent rolling in two directions. The remaining un-bonded half of the sheet shall be folded back and the procedure repeated.

-OR-

- B. Water Based Adhesive

Apply adhesive in a uniform fashion over a properly installed and prepared substrate by pouring the adhesive out of the pail and spread using a medium nap roller. Alternatively, the adhesive may be spread using an airless sprayer only if care is taken to keep adhesive completely out of the seam and the adhesive is back rolled with a medium nap roller to obtain uniform coverage. No adhesive shall be placed on the back of the membrane. The membrane shall be carefully unrolled into the wet adhesive, allowing sheets to overlap a minimum of 3". The formation of a film on the surface of the adhesive shall not be allowed to occur. After the membrane is unrolled, immediately broom into place with a medium bristle push broom to work out any air bubbles. Push the broom down the center of the sheet followed by brooming out from the center on both sides. Immediately after brooming, roll the membrane in two directions with a minimum 100 lb. steel, membrane roller.

- C. Laps in the membrane sheets shall be installed in a shingled manner in the direction of drainage as not to restrict the flow of water.
- D. Seaming area is to be clean and free of dust, dirt, and debris. When cleaning is required, follow the Manufacturer's procedures for cleaning.

- E. Laps are to be hot air welded using a Manufacturer-approved automatic welder. Laps shall be welded daily.
- F. All seams are to be fully welded a minimum of 1" to 1.5" from the edge of the lap.
- G. All T-laps and transitions where the automatic welder and hand welder meet (start/stops) shall be patched using hot air welded 60-mil flashing membrane.
- H. Allow laps to cool and then check for fishmouths and other voids. Repairs are to be made daily by hot air welding.
- I. Seam sealant shall be applied to the membrane edges where the reinforcement is cut and exposed, if required by the Manufacturer. Seam sealant shall be applied daily after the seams have been checked and any necessary repairs completed.
- J. After installation of the field membrane and before installation of flashings, the field membrane shall be secured using one of the following methods:
 - 1. A nosing or gravel stop detail fastened 12" o.c. on the vertical face of the nailer and 3" o.c. on the horizontal face.
 - 2. Fastening the deck flange of a membrane-clad metal flashing through the membrane and into a secure nailer at 3" o.c.

3.06 Flashings

- A. Flashings shall be constructed and terminated as per the detail drawings. The specified water cutoff sealant or sealant tape shall be applied behind the top edges of the flashings. The top edges of flashings shall be fastened per the Manufacturer's requirements at a minimum, unless superseded by the detail drawings.
- B. Apply contact adhesive over the clean, dry, compatible substrate, using an approved solvent resistant roller. Apply in a uniform coat at the Manufacturer-approved rate depending upon substrate finish. Allow adhesive to dry completely before installing flashing membrane.
- C. All flashings shall be totally bonded to the previously coated substrate at the Manufacturer-approved rate. Do not allow adhesive to dry completely on the underside of the membrane. The bonded sheet shall be pressed firmly into place using a hand roller.
- D. Flashings shall extend a minimum of 6" onto the roof membrane and 8" up the vertical.
- E. All vertical laps at the horizontal to vertical transition shall be patched using heat-welded 60-mil flashing membrane.

3.07 Membrane-Clad Metal Flashings

- A. Where indicated on the detail drawings, install membrane-clad metal flashings.
- B. Form and install flashings in the shapes and profiles indicated on the detail drawings.
- C. Metal flashings shall be fastened according to the detail drawings. If the Manufacturer's fastening requirements exceed those shown on the drawings, then Manufacturer's requirements are to be followed.

- D. All flashings shall be installed concurrently with the roof membrane as the job progresses. No temporary flashings are allowed without prior written approval from the Owner's Representative and membrane Manufacturer.

3.08 Membrane Patching

- A. Where adjacent patches are within 12" of each other, one long patch shall be used to incorporate both locations to be patched, as opposed to using two smaller separate patches.
- B. Patches shall not overlap onto one another. Any locations where patches overlap shall be covered with one large patch that completely covers all edges of underlying patches. Edges of this large patch shall be welded onto the primary field or flashing membrane material, and not onto the underlying patching materials. Where installation of this large patch results in the formation of three-way overlaps, subsequently patch these T-joints as specified.
- C. Provide corrective patching of all membrane cuts, punctures, and defective seams unable to be properly repaired by hot air welding.
- D. The Owner may require removal and replacement of the roof system at any area containing more than six patches in a 10' x 10' area, when the repairs are required due to poor workmanship or roof membrane damage.

3.09 Roof Walkways

- A. Walkways shall be installed in a neat, orderly fashion and where indicated on roof plans or in specifications.
- B. Chalk line walkway locations on roof membrane and position walkway in-place, using chalk line as a guide.
- C. Install walkway continuous and centered with previous walkway material. Apply a continuous coat of contact adhesive to the field sheet and back of walkway in accordance with Manufacturer's requirements.
- D. Walkways shall be secured to the roof membrane by heat welding. All edges shall be continuously hot air welded watertight.

3.10 Membrane Protection Mat

- A. Membrane protection mat shall be installed in a neat and orderly fashion under the premanufactured electrical conduit support bases. Membrane protection mat shall be centered under the support base and shall extend 3" minimum beyond the base in all directions.
- B. Membrane protection mat shall be secured to the roof membrane by heat welding. All edges shall be continuously hot air welded watertight.

3.11 Temporary Water Cutoffs

- A. Temporary water cutoffs shall be constructed at the end of each working day to protect the insulation, roofing, building, and building interior from damage due to wind, snow, and rain.
- B. Contractor shall provide methods and materials compatible with the membrane, to provide a positively adhered weather and watertight seal, capable of withstanding inclement weather and ponded water.

- C. Construction of temporary water cutoffs is to be detailed by the Contractor and approved by the Manufacturer and the Owner's Representative.
- D. Temporary water cutoffs and contaminated membrane shall be neatly trimmed and removed at the start of the next workday.

3.12 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed.
- B. Contractor shall correct any deficient work prior to installing subsequent work or notification of completion.

3.13 Cleanup

- A. Contractor shall follow the requirements of Section 02 41 20 - Roof Demolition and Cleanup.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Furnish and install roof-related sheet metal work per the drawings and specifications, including all joining, clips, fasteners, sealants, and related accessories to make weathertight and watertight.

1.02 Quality Assurance

- A. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
 - 1. *ANSI/SPRI/FM 4435/ES-1 Test Standard for Edge Systems Used with Low Slope Roofing Systems*, Single Ply Roofing Industry (SPRI)
 - 2. *Architectural Sheet Metal Manual*, Sheet Metal and Air Conditioning Contractors National Association (SMACNA)
 - 3. *The NRCA Roofing and Waterproofing Manual* National Roofing Contractors Association
 - 4. Manufacturer's published specifications, product data sheets, application instructions, and technical bulletins
 - 5. *Annual Book of ASTM Standards*, ASTM International
 - 6. Sealant, Waterproofing & Restoration Institute (SWR Institute) written recommendations and technical bulletins
- B. Qualifications of Installers: Use adequate number of skilled workers who are thoroughly trained and experienced in the necessary crafts, and who are completely familiar with the specified requirements and methods needed for proper performance of the work in this section.
- C. In acceptance or rejection of the work of this section, the Owner will make no allowance for lack of skill on the part of the workers.

1.03 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Product information or material list noting fasteners, sealants, sealant primers, sealant tapes, and other required accessories.
 - 2. Color chart or physical samples for selection of prefinished metal color by the Owner.
 - 3. Color chart or physical samples for selection of sealant color by the Owner.

1.04 Delivery, Storage, and Handling

- A. Use all means to protect the materials of this section before, during, and after installation and to protect the work and materials of all other trades. Roof surfaces shall be protected from damage at all times.
- B. Deliver only new materials to the job site. Materials to be stored in such a manner as to be protected from wind displacement, rain, snow, or inclement weather. Do not overstress the deck, when storing materials on the roof.
- C. In the event of damage, immediately make all repairs and replacements to the approval of the Owner and at no additional cost to the Owner.
- D. Follow the Manufacturer's recommendations for storage of temperature sensitive materials.

1.05 Scheduling

- A. All new sheet metal work shall be closely coordinated with the installation of the new roofing system.
- B. Sheet metal shall be installed directly after roofing work such that roofing terminations are not left unprotected by metal. Where specified, fully-detailed flashing termination bars are allowable to function as weathertight temporary coverings.

1.06 Warranty

- A. See Section 01 78 36 - Warranties.

PART TWO – PRODUCTS**2.01 General**

- A. Manufacturer-supplied V.O.C. compliant products shall be bid and used if V.O.C. regulations are in effect at the project location at the time of bidding.
- B. No product shall contain any asbestos or asbestos-related products.
- C. Approved equal products must be proposed prior to the bid due date, and approval shall be granted by the Owner prior to award of contract. Otherwise, substitutions shall not occur.

2.02 Materials

- A. Sheet metal components, metal types, finishes, gauges/thicknesses, and joint types and ANSI/SPRI ES-1 compliance data are specified in the detail drawings.
- B. Contractor shall use gauges or thicknesses listed in the drawings or as prescribed in the referenced standards for specific girths, whichever is greater.
- C. Where sheet metal material or gauge is not indicated on the drawings, provide the highest quality and gauge commensurate with the referenced standards.
- D. Approved equal products must be proposed prior to the bid due date, and approval shall be granted by the Owner prior to award of contract.

2.03 Material Specifications**A. Galvanized Steel**

1. Steel shall be supplied with G90 galvanized finish.
2. Steel to be field painted shall be supplied with galvanized finish, as indicated.
3. Specifications References
 - a. ASTM A 653/A 653M – Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvanized) by the Hot Dip Process
4. Continuous clips, where specified for use, shall be G90 galvanized steel, one gauge thicker than the primary component being secured.

B. Kynar Prefinished Steel

1. G90 galvanized steel with a polyester wash coat on the concealed side, and Kynar 500/Hylar 5000 coating on the exposed side.
2. Approved Products
 - a. PAC-CLAD by Peterson Aluminum Corporation
 - b. ColorKlad by Ryerson Inc.
 - c. Lead-free approved equal
3. Color shall be selected by the Owner from the Manufacturer's standard colors.
4. Continuous clips, where specified for use, shall be galvanized steel, one gauge thicker than the primary component being secured.

2.04 Coated Carbon Steel Fasteners

- A. All fasteners shall be carbon steel with corrosion-resistant coating, unless otherwise noted. Fasteners shall show no more than 15 percent red rust corrosion after 30 cycles of Kesternich testing.
- B. Masonry/Concrete Fasteners
 1. Fasteners shall be threaded or expansion type as shown on the drawings.
 2. Threaded fasteners shall be 1/4" minimum with hex washer head.
 3. Expansion fasteners shall be 1/4" zinc-alloy jacketed with stainless steel or zinc-alloy drive pin and 1/2" minimum mushroom head (nylon or plastic anchors are not approved).
 4. Fasteners exposed to weather shall be supplied with aluminum or corrosion-resistant steel washer with watertight bonded EPDM gasket.
 5. Approved Products
 - a. Tapcon HWH with Climaseal Coating by ITW RED HEAD

- b. UltraCon+ HWH with Stalgard Coating by DeWALT
 - c. ZAC Anchor Termination Fastener ZA-#14 with epoxy e-coat by SFS Group USA, Inc.
 - d. Powers Zamac Hammer-Screw with Zinc-Plated Carbon Steel Drive Screw by DeWALT
 - e. Metal Hit Anchor by Hilti
 - f. Masonry Anchor by OMG
 - g. Zinc Nailin Termination Fastener by SFS Group USA, Inc.
 - h. Approved equal
6. Fasteners shall be of sufficient length to penetrate the substrate a minimum of 1-1/2" deep.
- C. Steel/Wood Fasteners
- 1. Corrosion-resistant threaded fasteners of the types and minimum sizes specified for each application.
 - 2. Fasteners exposed to weather shall be supplied with aluminum or corrosion-resistant steel washer with watertight bonded EPDM gasket.
 - 3. Approved Products: Sheet Metal-to-Sheet Metal Stitch Fasteners Exposed to Weather
 - a. TEKS 1 ABOT MAXISEAL 1/4-14 x 7/8" with Climaseal Coating by ITW Buildex
 - b. 1/4-14 x 7/8" ZAC Impax Lap (5/16) Panel to Panel Fastener by SFS Group USA, Inc.
 - c. 1/4-14 x 7/8" Drilit #1DP HWH with Stalgard Coating by Elco Construction Products/DeWALT
 - d. Approved equal
 - 4. Approved Products: Sheet Metal-to-Metal Framing Fasteners Exposed to Weather
 - a. TEKS 5 HWH/BD 12-24 with Climaseal Coating by ITW Buildex
 - b. #12-24 ZAC Impax SD5 Metal to Metal Fastener SFS Group USA, Inc.
 - c. #12-24 Drilit #5DP HWH with Stalgard Coating by Elco Construction Products/DeWALT
 - d. Approved equal
 - 5. Approved Products: Sheet Metal-to-Wood Fasteners Exposed to Weather
 - a. TruGrip SHARP HWH/BD 9-15 with Climaseal Coating by ITW Buildex

- b. ZAC Anchor Termination Fastener ZA-#14 with epoxy e-coat by SFS Group USA, Inc.
 - c. 1/4-14 ZAC Type AB Self-Tapping Metal to Wood or Metal Fastener by SFS Group USA, Inc.
 - d. TapFast with Stalgard Coating by Elco Construction Products/DeWALT
 - e. Approved equal
 - 6. Approved Products: Concealed Sheet Metal-to-Steel Framing Fasteners
 - a. Corrosion-resistant, #2 Phillips or square drive #8-18 screw with #2 self-tapping drill point and 0.42" minimum modified truss head or pancake head design.
 - 7. Approved Products: Concealed Sheet Metal-to-Sheet Metal Stitch Fasteners
 - a. Corrosion-resistant, #2 Phillips or square drive #8-18 screw with #2 self-tapping drill point and 0.42" minimum modified truss head or pancake head design.
 - 8. Fasteners to be of sufficient length to penetrate through steel 1" minimum and into wood 1.5" minimum.
- D. Closed End Self Sealing Pop Rivets
- 1. Watertight closed-end pop rivets with stainless steel mandrel; dome head; aluminum, steel, or copper body to match sheet metal material; 3/16" rivet body diameter; with grip ranges as required to execute concepts required by the drawings.
 - 2. Rivets shall be color matched where used with prefinished sheet metal.
 - 3. Approved Products
 - a. Stanley Engineered Fastening
 - b. aDP Rivet
 - c. Approved equal
- E. Sheet Metal Nails
- 1. 1-1/4" minimum x 11-gauge, 3/8" head, hot dip galvanized, ring shank roofing nails shall be used where specified on the drawings for concealed fastening into wood.
 - 2. Approved Products
 - a. STORMGUARD by Maze Nails
 - b. Approved equal

2.05 Other Materials**A. Flashing Membrane**

1. Flashing and detailing of flanged sheet metal components shall be achieved with flashing membrane supplied by the roof membrane Manufacturer. Refer to the associated Division 07 roof membrane specification section for approved products.

B. Aluminum Foil Tape

1. Where required on the drawings for butt joint detailing of membrane-clad metal, 2" wide, high-temperature, self-adhering 2-mil soft aluminum foil tape with butyl rubber-based adhesive shall be used.
2. Refer to associated Division 07 roof membrane specification section for specific products approved for use with each roof system option.

a. Approved Products

- 1) Aluminum Tape by Sika Sarnafil Inc.
- 2) Foil-Grip 1403-181BFX by HARDCAST, a Carlisle Company
- 3) 3M Venture Tape Aluminum Foil Tape 1580 by 3M Company
- 4) Nashua 360-17 FoilMastic Butyl Rubber Tape by Berry Global Inc.
- 5) Approved equal

C. Sealants and Related Accessories

1. General: Unless specifically directed otherwise by the Owner's Representative, use only the type of sealants described in this section. Color of sealant shall be determined in the pre-job submittal process.

a. Approved Products: Polyether (Hybrid) Sealant

- 1) MasterSeal NP 150 by Sika Corporation
- 2) SikaHyflex-150 LM by Sika Corporation
- 3) DuraLink 50 by CHEM LINK
- 4) Approved equal

2. Cleaner

- a. Industrial solvent recommended by the sealant Manufacturer, such as Isopropyl Alcohol, Naphtha, Mineral Spirits, Xylol, Toluene, MEK, or Manufacturer-supplied cleaner.

3. Primer

- a. General: Furnish primer recommended by the sealant Manufacturer for use with the selected sealant on the substrate type to receive the sealant.

- b. Approved Products: Primer for Polyether (Hybrid) Sealant
 - 1) MasterSeal P 173 by Sika Corporation
 - 2) Sikaflex Primer 429 by Sika Corporation; porous surfaces only.
 - 3) As recommended by CHEM LINK for DuraLink 50
- 4. Backer Rod
 - a. General: Use only those backup materials that are specifically recommended for this installation by the sealant Manufacturer and that are closed-cell, non-absorbent, non-staining, and non-gassing when punctured. Backup materials shall be 1.5 times the width of the joint.
 - b. Approved Products
 - 1) MasterSeal 921 by Sika Corporation
 - 2) Sika Backer Rod by Sika Corporation
 - 3) HBR-Rod by CHEM LINK
 - 4) KOOL-ROD by W.R. Meadows, Inc.
 - 5) Approved equal
- 5. High Temperature Resistant Sealant
 - a. Approved Products
 - 1) DOWSIL 736 Heat Resistant Sealant by Dow Corning Corporation
 - 2) Approved equal
- D. Sealant Tape
 - 1. Permanently elastic isobutylene tripolymer tape or isobutylene isoprene copolymer tape that will bond to Galvalume, galvanized steel; aluminum; siliconized polyester, and polyvinyl fluoride painted metals; as well as wood, concrete, etc., 1/8" x 1" minimum nominal cross section, available in multiple sizes, meeting Federal Specification TT-C 1796A, Type II, Class B, with minimum 20 psi adhesive tensile strength according to ASTM C 907, with a service temperature range of -60°F to 212°F.
 - a. Approved Products
 - 1) SikaLastomer-90 or -95 Gray by Sika Corporation
 - 2) SikaLastomer-93 Black by Sika Corporation
 - 3) SikaLastomer-65 White by Sika Corporation
 - 4) Approved equal

E. Butyl Tape

1. Formulation of 100% solids, permanently elastic butyl sealant tape extruded on silicone coated paper for ease of application. 1" 1-1/2" 2" 2-1/2" 3" x 3/32" 1/8" 3/16" 1/4" 5/32" 7/32" cross section size. Silicone release liners to be removed during application.
 - a. Approved Products
 - 1) MB-10A Sealant Tape by GSSI Sealants
 - 2) Approved equal

F. Gutter Brackets, Gutter Straps and Downspout Straps

1. Where referenced on the drawings, 1/8" x 1" gutter brackets and downspout straps shall be provided using specified type and finish. Where painting is required, predrill steel before applying finish.
 - a. Prefinished Steel Gutters and Downspouts: Shop primed and painted Galvannealed steel gutter brackets and downspout straps, color to match gutter and downspout finishes.
2. Gutter straps shall be fabricated from same sheet metal material as gutter, 1-1/2" wide with 1/2" hem on each side.

PART THREE – EXECUTION**3.01 Inspection**

- A. Examine the areas and conditions under which work of this section will be installed. Correct conditions detrimental to the proper and timely completion of the work. Do not proceed until unsatisfactory conditions have been corrected.
- B. Verify that the work by all other trades has been completed prior to installing roof-related sheet metal work.

3.02 General

- A. Install all materials and components in accordance with Manufacturer's instructions, to ensure finished system meets the intent of the drawings, specifications and specified standards.
- B. Where prefinished sheet metal is used, remove protective vinyl film immediately before installation.
- C. Refer to the material Manufacturer's published product data sheets and installation instructions for information regarding acceptable temperature ranges and other weather-related criteria that might affect the installation schedule.
 1. Do not install materials if substrate temperature falls outside the acceptable ranges defined in the material Manufacturer's published information.
 2. Commence with application of systems and materials only when ambient temperatures and other weather-related criteria are forecast to satisfy the Manufacturer's requirements for all components to be installed.

3. To the extent defined by the Manufacturer's published information, consideration shall be made for cure times after installation. Do not proceed with material or system application if Manufacturer's requirements are not able to be met during the full recommended curing period.
4. Any exceptions shall require the Contractor to provide a project-specific letter from the material Manufacturer's technical services department approving a deviation to install or cure a given material outside the published parameters. Where a deviation letter is provided, Manufacturer shall clearly state the revised acceptable limitations to be followed by the Contractor.
5. Refer to Manufacturer's published installation instructions and applicable technical bulletins for specialized cold or hot weather application techniques. When weather conditions on the project site meet the specified criteria, proceed in accordance with the Manufacturer-recommended techniques.

3.03 Fabrication

- A. Sheet metal shall be formed accurately to sheet shapes as indicated on the drawings and in conformance with details on the processed shop drawings. Conform to dimensions provided on the drawings. Contractor shall be responsible for coordination of all dimensions. Review of shop drawings by the Consultant shall not be construed as approving unspecified dimensions.
- B. Counterflashings shall overlap base flashings a minimum of 3".
- C. Where the drawings indicate counterflashings being installed tight to roof membrane flashings, over-break as required to provide spring tension against roof flashing surface.
- D. Fabricate sheet metal using full length sections not less than 8' in length, unless otherwise approved prior to fabrication.
 1. Any partial pieces required within each run of exterior facing sheet metal, such as copings, edge metal, fascia extensions, and gutters, shall be planned and installed for minimum impact on aesthetics.
 2. Approved configurations include adding one partial piece centered within the run, or two partial pieces of equal length placed symmetrically within the run.
- E. Where loose lock lap joints are specified on the drawings, adjacent sections of metal shall overlap a minimum of 3".
- F. Where underplates are specified on the drawings, Contractor shall size smaller than the primary component to ensure a proper fit.
- G. Miter all inside and outside corner joints in edge metal, fascia counterflashing receivers, and gutters. Joints adjacent to inside and outside corners shall be placed exactly 24" each direction from the corner, with full length sheets starting on both sides.
- H. Break sheet metal components where they cross building expansion joints, if applicable.
- I. Horizontal flanges of edge metal and all set-on sheet metal accessories shall be 4" minimum with rounded corners.

- J. All exposed edges of cut sheet metal shall be folded back on concealed surfaces, with 1/2" hem created. Where sheet metal contacts roof system flashings, break hems such that unfolded edges do not contact the roofing material.
- K. Form, fabricate, and install all sheet metal with allowances made for expansion and contraction in the finished work.
- L. Continuous clips shall be fabricated using metal material of greater thickness than the components being secured.
 - 1. Refer to Article 2.03 of this section for minimum requirements.
- M. At multi-piece sheet metal expansion joint covers, form all pieces, including continuous sliding clips, use the specified gauge or thickness of material for all pieces.
- N. Crimped joints shall be continuously formed, full length.
- O. Where a continuous clip is specified on the drawings, the primary component shall be continuously crimped along the bottom edge of the clip.

3.04 Dissimilar Metals

- A. Dissimilar materials in contact, which are subject to electrolysis and galvanic corrosion, shall be protected against such action prior to installation. Protective materials shall not be visible after installation. Protect metals using coatings recommended by Manufacturer, or separate using felt, sealant tape or EPDM membrane.

3.05 Weatherproofing

- A. Finish all sheet metal watertight and weathertight where so required.
- B. Make all lap seams in the direction of the water flow.
- C. Weatherproof laps between adjacent sheet metal components using continuous application of specified sealant.
- D. Prior to installing sheet metal, all substrates shall first be protected from water intrusion by use of the specified flashing detail where shown,.

3.06 Joints

- A. Join parts with closed-end rivets or sheet metal screws where necessary for strength or stiffness.
- B. Provide suitable watertight expansion joints for all sheet metal as required for proper installation in accordance with the schedule of roof-related sheet metal and detail drawings.
- C. Sealant application shall be neatly and thoroughly performed by qualified personnel, for a continuous watertight seal. Sealant shall be continuously installed behind and above sheet metal terminations, within all loose lock joints, between joint underplates and primary components pieces, and in other locations indicated on the drawings.
- D. All exposed sealant joints shall be dry tooled to the profile indicated on the detail drawings. If required, Contractor shall build custom tools on job site, if necessary, to provide the specified profiles.

- E. Concave sealant joint profiles that could potentially hold water will be considered defective and require removal and replacement.
- F. At underplates, sealant shall be neatly applied so sealant remains concealed following completion of detail work.
- G. All surfaces to receive sealant shall be thoroughly cleaned as recommended by the sealant Manufacturer. All bitumen coating materials, roof cement, adhesive residue, rust, old caulking and/or other contaminants shall be removed down to the substrate to which sealant bonding is intended.
- H. All surfaces to receive sealant shall be primed initially with the sealant Manufacturer's recommended primer. Strictly adhere to Manufacturer's instructions regarding substrate preparation, primer application and wait time, and maximum exposure time before sealant application.
- I. Prepare surfaces to receive sealant tape as recommended by the sealant Manufacturer. Thoroughly remove all release paper during application. Prevent contamination of surfaces that could impede adhesion to substrate or adhesion of overlying material to tape. Lap sealant tape 1/4" minimum at joints.
- J. At membrane-clad edge metal install butt joints as indicated on the drawings and in accordance with membrane Manufacturer's installation instructions. Nail along butt joint and apply 2" aluminum foil tape, full girth, centered over butt joint.

3.07 Fastening

- A. Secure sheet metal components as indicated on the drawings. Do not install exposed fasteners on a horizontal plane, unless specifically shown on the drawings or otherwise authorized by the Owner's Representative.
- B. All fasteners exposed to the weather shall have washers with bonded watertight EPDM gaskets. Ensure that fasteners are not overdriven such that EPDM gasket damage results. Remove and replace all such damaged fasteners, using oversized fasteners.
- C. Where predrilling of metal is required, remove any pigtails prior to installing fasteners.
- D. Where predrilling of concrete and/or masonry is required for fastener installation, utilize bit type and size, and hole depth recommended by the fastener Manufacturer. Remove drilling dust from fastener holes prior to installing fasteners.
- E. All clips and cleats are to be fastened 6" o.c., unless otherwise noted on the drawings.
- F. Do not fasten adjacent pieces of sheet metal together at laps or at joint covers, so sheet metal components are able to expand and contract.
 - 1. If an underplate is specified, install underplate first, then gap adjacent pieces with butt joint centered over plate. Fasten at least 1/2" beyond edges of underlying joint cover.
 - 2. If a lap joint is specified, fasten each adjacent piece 1/2" beyond the overlapping metal.
- G. For concealed fastening into wood, use specified ring shank roofing nails or screws with modified truss head or pancake head, as indicated on drawings.

- H. Embedded metal flanges shall be fastened 3" o.c. staggered, unless otherwise noted.
- I. For fastening into concrete and masonry use specified threaded or friction-fit fastener as indicated on the drawings. Plastic or nylon anchors shall not be used.
- J. For exposed fastening into wood, use specified screws.

3.08 Flashing of Embedded Metal Flanges

- A. Flash embedded sheet metal flanges per drawings and specifications, meeting membrane Manufacturer's requirements at a minimum. Membrane flashings shall be installed by trained and qualified roofing personnel. Refer to the associated Division 07 roof membrane specification section for related requirements.

3.09 Protection

- A. Roof surfaces and flashing shall be adequately protected to prevent damage during the installation of metal work or during storage of the required materials. The Contractor shall replace any damaged construction, at no cost to the Owner.
- B. Protect installed work to ensure no damage occurs prior to project completion.

3.10 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed.
- B. Contractor shall correct any deficient work prior to installing subsequent work or notification of completion.

3.11 Adjusting

- A. Repair minor damages to finish in accordance with Manufacturer's instructions and as approved by the Owner's Representative.
- B. Remove and replace any damaged components that cannot be successfully repaired, using new material to the approval of the Owner's Representative.

3.12 Cleaning

- A. Debris from sheet metal work shall be frequently removed from building site as it accumulates.
- B. Leave job site clean at completion of work, and properly dispose of all construction debris such as metal trimmings, fasteners, rivet nails, sealant tube ends and similar scrap.
- C. Clean materials promptly after installation in accordance with Manufacturer's instructions. Limit cleaners to those recommended by the Manufacturer so as to avoid staining or damaging finishes.
- D. Refer to Section 02 41 20 – Roof Demolition and Cleanup for additional requirements.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Furnish and install manufactured metal roof curbs complete, in-place per the drawings and specifications.

1.02 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Most recent copy of Manufacturer's literature applicable to products and specifications to be used.
 - 2. Complete material list of all items proposed to be furnished and installed under this section.

PART TWO – PRODUCTS**2.01 Materials**

- A. Curbs shall be constructed using minimum 18-gauge, G90 galvanized steel fully-enclosed design.
- B. Curbs shall have fully mitered and welded corners, non-canted base and integral base plates,
- C. Curbs with any side longer than 36" shall be internally reinforced with 1" x 1" x 1/8" steel angle.
- D. Curbs shall be factory insulated packing full with 3 lb. density fiberglass insulation.
- E. Curbs shall have factory-installed, pressure-treated wood nailers, unless otherwise shown on the drawings.
- F. Curb locations shall be as noted on drawings.
- G. Minimum height of curb shall be 8" above finished roof elevation.
- H. Curbs shall be constructed to match slope of roof and provide a level top surface for mounting of mechanical equipment.
- I. Approved Manufacturers
 - 1. Roof Products, Inc.
 - 2. ThyCurb by Thybar Corporation
 - 3. The Pate Company
 - 4. Roof Products and Systems Corp.
 - 5. KCC International Inc.

PART THREE – EXECUTION**3.01 Installation**

- A. Installation shall be in accordance with the latest Manufacturer's specifications and installation techniques.
- B. Mount curbs so that top is level and slope of curb matches slope in roof deck.
- C. Fasten curb 12" o.c. at perimeter flange with low profile head, corrosion resistant threaded fastener.

3.02 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed.
- B. Contractor shall correct any deficient work prior to installing subsequent work or notification of completion.

3.03 Cleaning

- A. Contractor shall follow the requirements of Section 02 41 20 – Roof Demolition and Cleanup.

- End of Section -

PART ONE – GENERAL**1.01 Description**

- A. Work includes furnishing and installing rooftop equipment support systems.

1.02 Quality Assurance

- A. Manufacturer: Company specializing in pipe support systems engineering, design, and manufacturing, with a minimum of five continuous years of documented experience.
- B. Standards: Comply with all pertinent standards specified in the contract documents, including those listed below. If the building code references a specific edition or revision of an individual standard, then comply with that edition or revision. Otherwise, comply with the latest published edition or revision available on the date the Contractor submits its price proposal to the Owner.
 - 1. Manufacturer's published specifications, product data sheets, application instructions, and technical bulletins.
 - 2. ANSI/MSS SP-69
 - 3. MSS SP-58
 - 4. *Annual Book of ASTM Standards*, ASTM International
- C. Qualifications of Installers: Use adequate number of skilled workers who are thoroughly trained and experienced in the necessary crafts, and who are completely familiar with the specified requirements and methods needed for proper performance of the work in this section. In acceptance or rejection of the work, the Owner will make no allowance for lack of skill on the part of the workers.
- D. In acceptance or rejection of the work of this section, the Owner will make no allowance for lack of skill on the part of the workers.

1.03 Submittals

- A. General: Comply with submittal requirements specified in Division 01.
- B. Provide the following submittals:
 - 1. Complete material list of all items proposed to be furnished and installed under this section.

1.04 Product Handling

- A. Deliver materials to job site in their original, unopened containers. Package labels shall indicate product model names, catalog numbers, identification numbers, production date, and/or product code. Cover with weatherproof tarps.
- B. Protect roof surfaces in material storage and support erection locations.
- C. Use all necessary means to protect the materials in this section before, during, and after installation and to protect the work and materials of all other trades.

- D. In the event of damage, immediately make all necessary repairs and replacements subject to the approval of and at no additional cost to the Owner.

1.05 Scheduling

- A. Coordinate support installation with installation of roof system.

1.06 Warranty

- A. See Section 01 78 36 - Warranties.

PART TWO – PRODUCTS

2.01 Acceptable Manufacturers

- A. Portable Pipe Hangers, Inc.
- B. Miro Industries, Inc.

2.02 Components

- A. Bases:
 - 1. Rubber, polycarbonate, stainless steel, or galvanized steel, as supplied standard by the support Manufacturer.
 - 2. Base shall be Manufacturer's standard size, and as designed for weight of equipment to be supported, fabricated in the shop with inserts for support members as required.
- B. Framing
 - 1. Hot dipped galvanized framing as supplied standard by the support Manufacturer.
- C. Pipe Supports and Hangers
 - 1. Metal supports and hangers shall be fabricated of carbon steel where framing is carbon steel, and of stainless steel where framing is stainless steel. Polycarbonate supports shall be used where recommended and supplied by the Manufacturer.
 - 2. Rollers, clevis hangers, or band hangers shall be used as recommended by the Manufacturer for the size of pipe being supported, allowing for expansion and contraction without movement of the bases.

2.03 Accessories

- A. Provide all clamps, hangers, bolts, nuts, washers, and other devices as required for a complete system. Provide galvanized accessories where framing is galvanized and stainless steel accessories where framing is stainless steel.

2.04 Finishes

- A. Galvanized surfaces: Hot dip galvanize metal framing, supports, and hangers, after fabrication is completed, and produce coatings free of roughness, whiskers, unsightly spangle, icicles, runs, barbs, sags, droplets, and other surface blemishes. Galvanizing shall conform to ASTM A 123 for tubing and ASTM A 153 for hardware and accessories.
- B. Bases: Black color for rubber/plastic or polycarbonate bases.

2.05 Approved Products

- A. Refer to the detail drawings for type of the type of support needed.

PART THREE – EXECUTION**3.01 Description**

- A. The latest Manufacturer specifications and installation instructions shall be followed along with the following requirements. These specific minimum requirements must be included in the bid and shall not be altered.

3.02 Inspection

- A. Examine the areas and conditions under which work in this section will be installed. Correct conditions detrimental to the proper and timely completion of the work. Do not proceed until such conditions have been corrected.
- B. Verify that roofing system is complete and that roof surfaces are smooth and flat and are ready to receive work.

3.03 Preparation and Surface Conditions

- A. Prepare all surfaces according to applicable specification sections.
- B. Protect adjacent areas from damage with tarps or other durable materials.
- C. Use care in installation of portable pipe support systems not to damage roofing, flashing, equipment, or related materials.
- D. Substrate shall be smooth, free of sharp projections, and free of obvious depressions.
- E. Clean surfaces of roof to receive portable support bases. Remove dirt, dust, oils, and other foreign materials.

3.04 Installation

- A. Perform all related work specified elsewhere necessary for the installation of the specified support system.
- B. Bases and support framing shall be located as indicated on drawings and as specified herein. The support of all equipment and piping shall be complete and adequate, whether or not all required devices, equipment, and piping are shown.
- C. The use of wood or wire for supporting equipment and piping will not be permitted.

- D. Deflection of equipment and piping shall not exceed 1/240th of the span.
- E. Install bases on a piece of system membrane walkway material extending 3" beyond the base on all sides, hot air welding all edges watertight.
- F. Accurately locate and align bases.
- G. Use galvanized hardware for all connections.
- H. Trim all the thread support rods to be 1/2" maximum above nuts. Protect roof surface from damage and immediately dispose of related debris.

3.05 Verification

- A. Contractor shall inspect the work described by this section of the specification and shall verify that all components are complete and properly installed.
- B. Contractor shall correct any deficient work prior to installing subsequent work or notification of completion.

3.06 Cleaning

- A. Remove all packaging, unused fasteners, adhesive, and other installation materials from site.
- B. Remove adhesive from exposed surfaces of supports, pipes, and bases, and leave work in clean condition.
- C. Contractor shall comply with the requirements of Section 02 41 20 – Roof Demolition and Cleanup.

- End of Section -